

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1215143

Luminaire Tested: 22-ID2-60-DBD-L940-U

Issue Date: 12/4/2025

Test Information

Test Method: LM-79-2019
Report Number: P1215143
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2506-458-17)
Test Lab: INNOVATION CENTER
Issue Date: 12/4/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: 22-ID2-60-DBD-L940-U
Description: 2X2 IN DEPTH TROFFER WITH 2INCH DOUBLE BARREL DROP
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5814.9 lumens
Efficiency: N/A
Efficacy: 110.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.31
Luminous Opening: Rectangular w/ Sides (W: 2' x L: 2' x H: 0.15')
CIE Type: Direct

Input Watts (W): 52.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P1215143
CATALOG NUMBER: 22-ID2-60-DBD-L940-U

Luminous Intensity Polar Plot

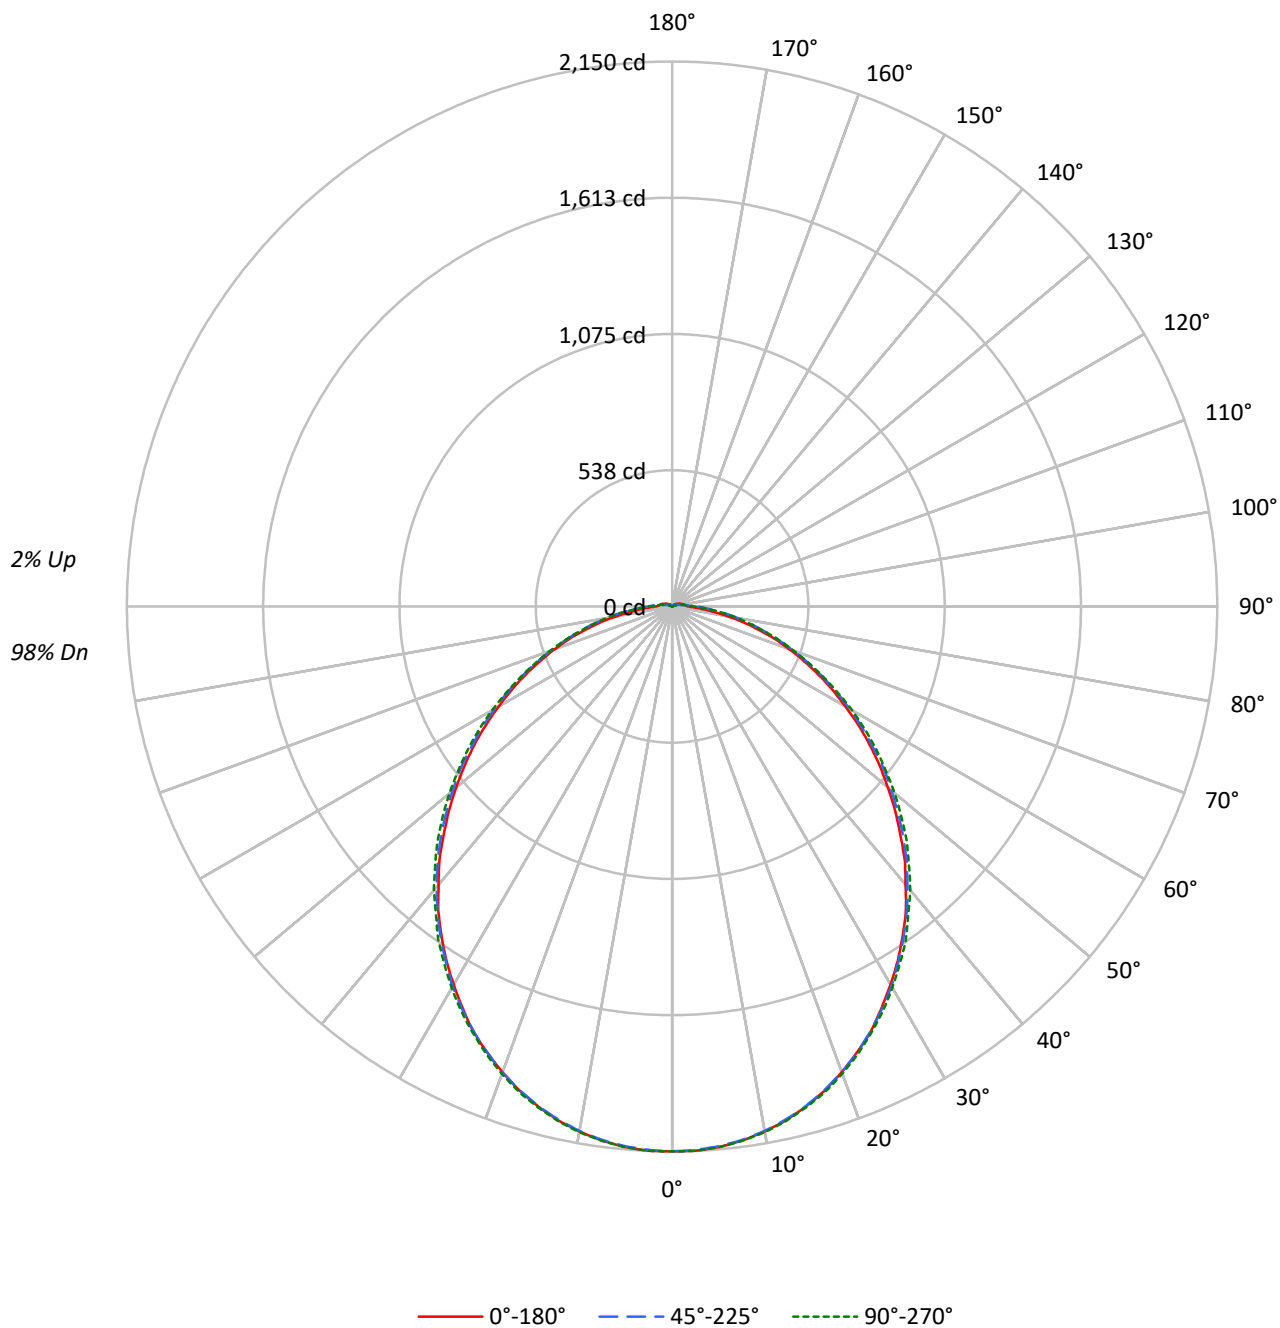

TEST NUMBER: P1215143

CATALOG NUMBER: 22-ID2-60-DBD-L940-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10		50	30	10			50	30	10			0
RCR																				
0	119	119	119	119	116	116	116	116		110	110	110			105	105	105			98
1	108	103	99	95	105	101	97	93		96	93	90			92	89	87			81
2	98	90	83	77	95	88	82	76		84	79	74			80	76	72			68
3	90	79	71	64	87	77	70	64		74	68	62			71	66	61			57
4	82	70	62	55	80	69	61	54		66	59	53			63	57	52			49
5	76	63	54	47	73	62	53	47		59	52	46			57	51	46			43
6	70	57	48	41	68	56	47	41		54	46	41			52	45	40			38
7	65	52	43	37	63	51	42	37		49	42	36			47	41	36			33
8	61	47	39	33	59	46	38	33		45	38	32			43	37	32			30
9	57	43	35	30	55	43	35	29		41	34	29			40	34	29			27
10	53	40	32	27	52	39	32	27		38	31	27			37	31	26			24

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5785	5785	5785
5°	5744	5721	5746
10°	5672	5637	5680
15°	5577	5526	5585
20°	5453	5392	5469
25°	5316	5234	5328
30°	5130	5066	5175
35°	4949	4866	5016
40°	4733	4659	4830
45°	4506	4436	4630
50°	4269	4195	4404
55°	4029	3935	4163
60°	3761	3668	3907
65°	3497	3393	3611
70°	3200	3089	3326
75°	2837	2798	3041
80°	2409	2519	2822
85°	1992	2262	2670

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 45°

Luminance: 4630 cd/sqm

TEST NUMBER: P1215143
 CATALOG NUMBER: 22-ID2-60-DBD-L940-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.0	3.5
10°-20°	575.4	9.9
20°-30°	852.6	14.7
30°-40°	996.1	17.1
40°-50°	995.0	17.1
50°-60°	865.5	14.9
60°-70°	646.0	11.1
70°-80°	394.2	6.8
80°-90°	173.8	3.0
90°-100°	63.7	1.1
100°-110°	26.5	0.5
110°-120°	12.6	0.2
120°-130°	6.5	0.1
130°-140°	2.8	0.0
140°-150°	0.9	0.0
150°-160°	0.3	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1631.0	28.0
0°-40°	2627.1	45.2
0°-60°	4487.6	77.2
0°-90°	5701.7	98.1
90°-120°	102.7	1.8
90°-150°	112.9	1.9
90°-180°	113.0	1.9
0°-180°	5814.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2150	2150	2150	2150	2150	
5°	2140	2138	2138	2139	2141	203
15°	2042	2040	2040	2042	2045	575
25°	1853	1849	1850	1854	1857	851
35°	1586	1587	1591	1600	1607	991
45°	1273	1280	1289	1299	1308	983
55°	951	956	966	979	982	850
65°	638	644	654	660	658	632
75°	349	362	376	379	374	373
85°	120	146	162	166	161	120
90°	62	82	93	95	88	36
95°	52	53	59	60	56	41
105°	39	34	22	14	13	41
115°	25	22	13	2	0	25
125°	15	13	7	1	0	14
135°	8	6	2	1	0	7
145°	3	2	1	1	1	2
155°	1	1	1	1	1	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	

TEST NUMBER: P1215143

CATALOG NUMBER: 22-ID2-60-DBD-L940-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2149.8	2149.8	2149.8	2149.8	2149.8
2.5°	2149.8	2147.6	2146.2	2147.6	2149.1
5°	2140.5	2138.3	2137.6	2139.0	2141.2
7.5°	2125.4	2124.0	2122.5	2124.7	2126.1
10°	2103.2	2101.0	2101.7	2103.9	2106.1
12.5°	2076.7	2074.5	2073.1	2075.2	2079.5
15°	2042.2	2040.1	2040.1	2042.2	2045.1
17.5°	2002.1	2002.1	1999.9	2004.2	2007.8
20°	1956.2	1955.5	1955.5	1958.3	1961.9
22.5°	1904.6	1904.6	1905.3	1909.6	1912.4
25°	1852.9	1849.3	1850.1	1853.6	1857.2
27.5°	1787.7	1788.4	1791.3	1794.8	1800.6
30°	1722.4	1724.6	1730.3	1733.2	1737.5
32.5°	1656.4	1657.9	1660.7	1668.6	1671.5
35°	1585.5	1586.9	1591.2	1600.5	1607.0
37.5°	1514.5	1513.0	1519.5	1528.8	1529.5
40°	1432.0	1437.7	1444.2	1452.8	1461.4
42.5°	1358.1	1361.0	1368.9	1376.8	1382.5
45°	1272.8	1280.0	1289.3	1298.6	1307.9
47.5°	1193.2	1201.8	1209.0	1220.5	1225.5
50°	1110.8	1120.1	1128.7	1140.2	1145.9
52.5°	1031.2	1037.6	1051.9	1060.6	1062.0
55°	950.8	955.9	965.9	978.8	982.4
57.5°	870.5	877.0	887.7	899.2	900.6
60°	789.5	797.4	806.7	816.0	820.3
62.5°	712.8	719.9	729.3	737.2	736.4
65°	637.5	643.9	654.0	660.4	658.3
67.5°	562.9	570.1	579.4	584.4	583.0
70°	490.5	496.2	507.0	512.0	509.8
72.5°	423.1	431.0	439.6	445.3	442.4
75°	349.2	362.1	375.7	379.3	374.3
77.5°	285.4	299.7	316.2	320.5	315.5
80°	221.6	243.8	260.3	265.3	259.6
82.5°	167.1	191.5	210.1	214.4	207.2
85°	119.8	146.3	162.1	165.6	160.6
87.5°	84.6	109.0	122.6	124.8	117.6
90°	61.7	82.5	93.2	94.7	87.5
92.5°	56.6	65.3	73.9	76.0	71.7
95°	52.3	53.1	58.8	59.5	55.9
97.5°	48.8	45.2	45.9	45.2	42.3
100°	45.2	40.9	35.1	33.0	30.8
102.5°	42.3	37.3	27.2	22.9	20.8
105°	38.7	33.7	21.5	14.3	12.9
107.5°	35.1	30.8	18.6	8.6	6.5
110°	31.6	27.2	16.5	4.3	2.2

TEST NUMBER: P1215143

CATALOG NUMBER: 22-ID2-60-DBD-L940-U

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	28.7	24.4	15.1	3.6	0.0
115°	25.1	22.2	12.9	2.2	0.0
117.5°	22.2	19.4	11.5	1.4	0.0
120°	20.1	17.2	10.0	0.7	0.0
122.5°	17.9	15.1	8.6	0.7	0.0
125°	15.1	12.9	7.2	0.7	0.0
127.5°	13.6	11.5	5.7	0.0	0.0
130°	11.5	9.3	5.0	0.0	0.0
132.5°	10.0	7.9	3.6	0.7	0.0
135°	7.9	6.5	2.2	0.7	0.0
137.5°	7.2	5.7	1.4	0.7	0.0
140°	5.7	4.3	1.4	0.7	0.0
142.5°	4.3	3.6	0.7	0.7	0.7
145°	2.9	2.2	0.7	0.7	0.7
147.5°	2.2	1.4	0.7	0.7	0.7
150°	1.4	1.4	0.7	0.7	0.7
152.5°	0.7	0.7	0.7	0.7	0.7
155°	0.7	0.7	0.7	0.7	0.7
157.5°	0.7	0.7	0.7	0.7	0.7
160°	0.7	0.7	0.7	0.7	0.7
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1215143

CATALOG NUMBER: 22-ID2-60-DBD-L940-U

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.44	18.02	16.84	18.38	18.74	16.63	18.21	17.02	18.56	18.93
	3H	18.11	19.55	18.52	19.91	20.32	18.31	19.75	18.72	20.11	20.52
	4H	18.74	20.09	19.17	20.48	20.90	18.97	20.32	19.40	20.71	21.14
	6H	19.21	20.46	19.65	20.87	21.31	19.52	20.77	19.96	21.18	21.62
	8H	19.37	20.56	19.82	20.99	21.44	19.73	20.93	20.19	21.36	21.81
	12H	19.49	20.63	19.95	21.05	21.53	19.92	21.07	20.38	21.49	21.96
4H	2H	17.03	18.38	17.46	18.77	19.19	17.18	18.53	17.61	18.91	19.34
	3H	18.92	20.06	19.36	20.49	20.94	19.09	20.23	19.53	20.66	21.11
	4H	19.68	20.71	20.14	21.16	21.64	19.89	20.92	20.35	21.37	21.85
	6H	20.28	21.19	20.77	21.66	22.16	20.58	21.49	21.07	21.96	22.46
	8H	20.50	21.34	20.99	21.82	22.33	20.86	21.71	21.35	22.19	22.70
	12H	20.67	21.43	21.18	21.94	22.46	21.11	21.87	21.62	22.38	22.90
8H	4H	20.00	20.84	20.49	21.32	21.83	20.18	21.03	20.67	21.51	22.02
	6H	20.74	21.45	21.26	21.97	22.49	21.02	21.73	21.54	22.25	22.77
	8H	21.04	21.68	21.58	22.22	22.75	21.39	22.03	21.93	22.57	23.10
	12H	21.31	21.88	21.85	22.40	23.00	21.75	22.32	22.29	22.85	23.45
12H	4H	20.04	20.80	20.55	21.31	21.83	20.21	20.98	20.73	21.49	22.00
	6H	20.82	21.46	21.36	22.00	22.53	21.08	21.72	21.62	22.26	22.79
	8H	21.19	21.76	21.73	22.28	22.88	21.53	22.09	22.06	22.62	23.22

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Corelite

Report Number: SP1-2506-458-11

Test Date: 08/26/2025

Luminaire Tested: 22ID2-55-CFR1-L940-U

Data in this report applies to families of products including 22ID2-55-CFR1-L940-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-458-11
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/27/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Corelite
 Catalog Number: **22ID2-55-CFR1-L940-U**
 Description: 2X2 CGTX WITH INDEPTH FRAME AND CFR1 LENS - 5500 LUMEN 4000K 90CRI

Spectral Parameters

CCT (K): 3910
 CIE u' : 0.2263
 CIE v' : 0.5043
 Duv: 0.0008
 CIE x: 0.3851
 CIE y: 0.3813
 CIE z: 0.2336
 Peak Wavelength (nm): 451
 Dominant Wavelength (nm): 578
 Purity: 30.01895
 R_f: 90.8
 R_g: 98.8

CRI (Ra): 92.4
 R1: 92.5
 R2: 94.9
 R3: 95.8
 R4: 92.7
 R5: 91.7
 R6: 92.1
 R7: 94.3
 R8: 85.2
 R9: 62.0
 R10: 87.0
 R11: 92.8
 R12: 71.7
 R13: 93.2
 R14: 97.3
 R15: 89.6

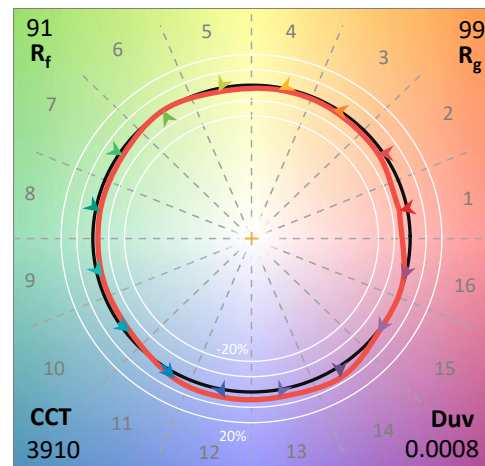

Test Conditions


Stabilization Time: 31M
 Operation Time: 1H 31M
 Sphere Temperature (°C): 25.2.

REPORT NUMBER: SP1-2506-458-11


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-458-11

CIE 1931 Chromaticity Diagram

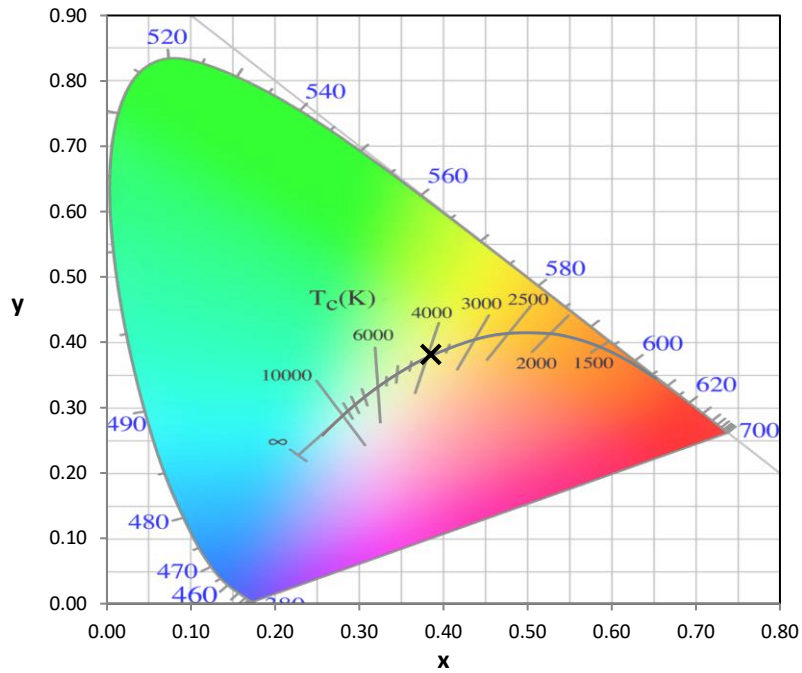


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

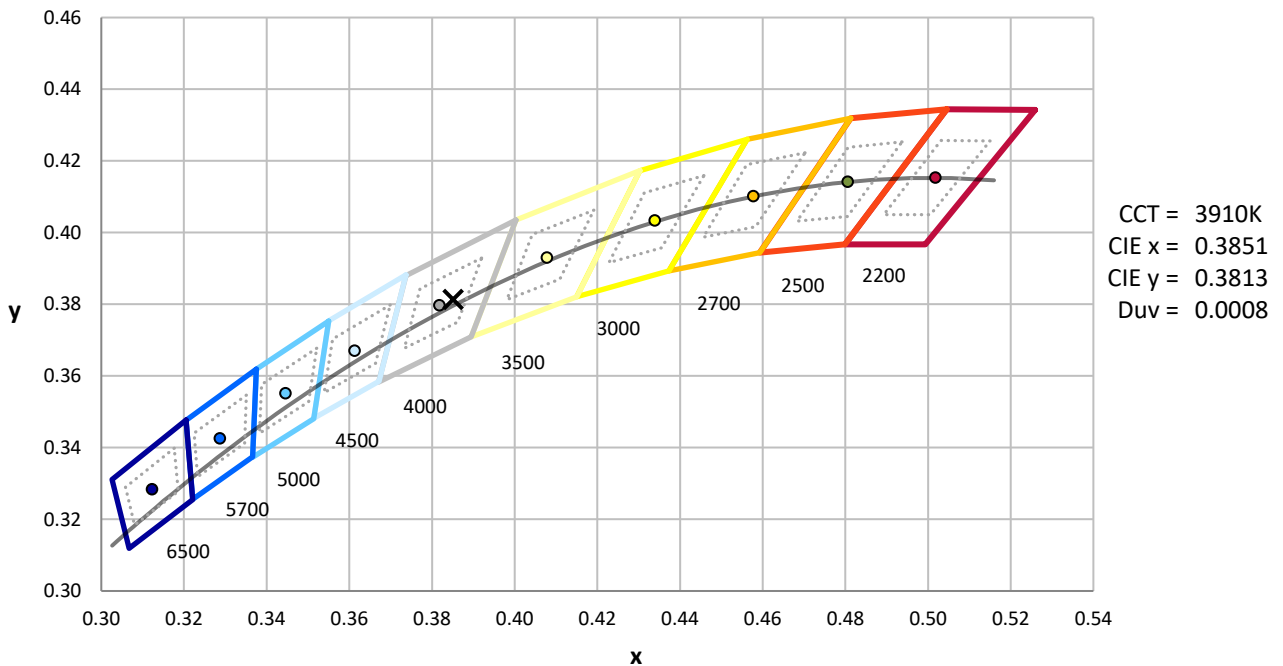

Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2506-458-11

Photopic Flux vs. Wavelength

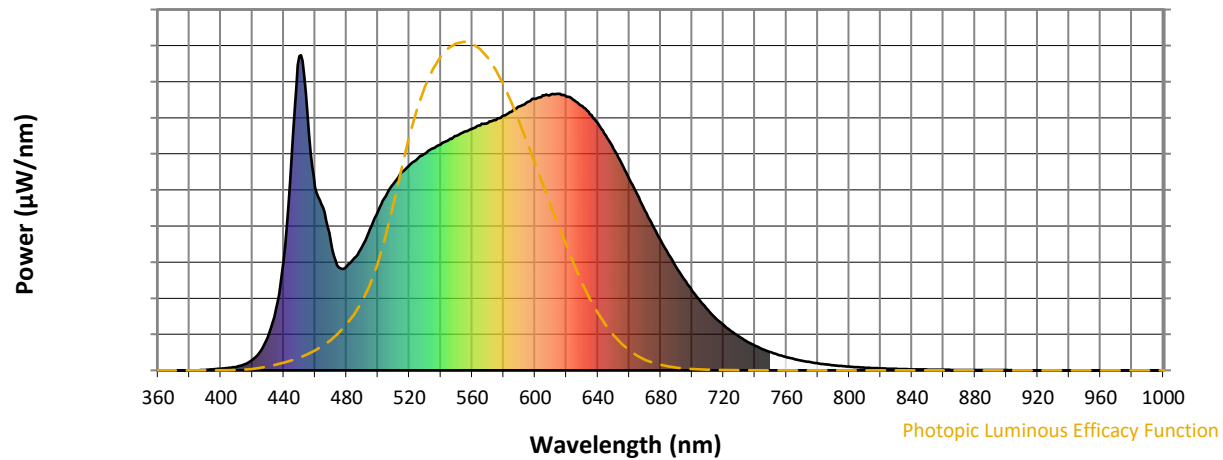


Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	394	NR	620	868	NR	750	58	NR	880	1	NR
365	0	NR	495	449	NR	625	858	NR	755	49	NR	885	1	NR
370	0	NR	500	505	NR	630	839	NR	760	42	NR	890	1	NR
375	0	NR	505	553	NR	635	813	NR	765	36	NR	895	1	NR
380	0	NR	510	593	NR	640	783	NR	770	31	NR	900	1	NR
385	0	NR	515	628	NR	645	746	NR	775	26	NR	905	1	NR
390	1	NR	520	651	NR	650	702	NR	780	22	NR	910	0	NR
395	4	NR	525	670	NR	655	657	NR	785	19	NR	915	0	NR
400	5	NR	530	687	NR	660	607	NR	790	16	NR	920	0	NR
405	8	NR	535	705	NR	665	559	NR	795	14	NR	925	0	NR
410	12	NR	540	717	NR	670	507	NR	800	12	NR	930	0	NR
415	19	NR	545	731	NR	675	458	NR	805	10	NR	935	0	NR
420	34	NR	550	745	NR	680	413	NR	810	9	NR	940	0	NR
425	60	NR	555	757	NR	685	367	NR	815	7	NR	945	0	NR
430	107	NR	560	767	NR	690	328	NR	820	6	NR	950	0	NR
435	194	NR	565	777	NR	695	289	NR	825	5	NR	955	0	NR
440	349	NR	570	785	NR	700	253	NR	830	5	NR	960	0	NR
445	678	NR	575	794	NR	705	221	NR	835	4	NR	965	0	NR
450	997	NR	580	809	NR	710	192	NR	840	3	NR	970	0	NR
455	819	NR	585	820	NR	715	165	NR	845	3	NR	975	0	NR
460	581	NR	590	838	NR	720	144	NR	850	2	NR	980	0	NR
465	517	NR	595	851	NR	725	124	NR	855	2	NR	985	0	NR
470	406	NR	600	861	NR	730	107	NR	860	2	NR	990	0	NR
475	327	NR	605	873	NR	735	91	NR	865	2	NR	995	0	NR
480	330	NR	610	875	NR	740	78	NR	870	1	NR	1000	0	NR
485	356	NR	615	877	NR	745	67	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-11

Scotopic Flux vs. Wavelength

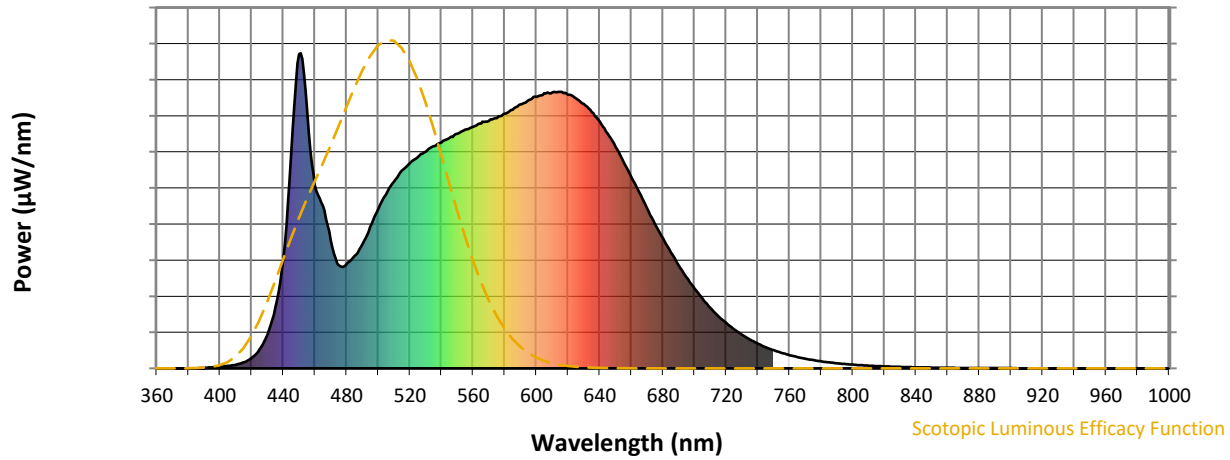


Scotopic Lumens: NR

S/P: 1.75

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	394	NR	620	868	NR	750	58	NR	880	1	NR
365	0	NR	495	449	NR	625	858	NR	755	49	NR	885	1	NR
370	0	NR	500	505	NR	630	839	NR	760	42	NR	890	1	NR
375	0	NR	505	553	NR	635	813	NR	765	36	NR	895	1	NR
380	0	NR	510	593	NR	640	783	NR	770	31	NR	900	1	NR
385	0	NR	515	628	NR	645	746	NR	775	26	NR	905	1	NR
390	1	NR	520	651	NR	650	702	NR	780	22	NR	910	0	NR
395	4	NR	525	670	NR	655	657	NR	785	19	NR	915	0	NR
400	5	NR	530	687	NR	660	607	NR	790	16	NR	920	0	NR
405	8	NR	535	705	NR	665	559	NR	795	14	NR	925	0	NR
410	12	NR	540	717	NR	670	507	NR	800	12	NR	930	0	NR
415	19	NR	545	731	NR	675	458	NR	805	10	NR	935	0	NR
420	34	NR	550	745	NR	680	413	NR	810	9	NR	940	0	NR
425	60	NR	555	757	NR	685	367	NR	815	7	NR	945	0	NR
430	107	NR	560	767	NR	690	328	NR	820	6	NR	950	0	NR
435	194	NR	565	777	NR	695	289	NR	825	5	NR	955	0	NR
440	349	NR	570	785	NR	700	253	NR	830	5	NR	960	0	NR
445	678	NR	575	794	NR	705	221	NR	835	4	NR	965	0	NR
450	997	NR	580	809	NR	710	192	NR	840	3	NR	970	0	NR
455	819	NR	585	820	NR	715	165	NR	845	3	NR	975	0	NR
460	581	NR	590	838	NR	720	144	NR	850	2	NR	980	0	NR
465	517	NR	595	851	NR	725	124	NR	855	2	NR	985	0	NR
470	406	NR	600	861	NR	730	107	NR	860	2	NR	990	0	NR
475	327	NR	605	873	NR	735	91	NR	865	2	NR	995	0	NR
480	330	NR	610	875	NR	740	78	NR	870	1	NR	1000	0	NR
485	356	NR	615	877	NR	745	67	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-11

Melanopic Flux vs. Wavelength

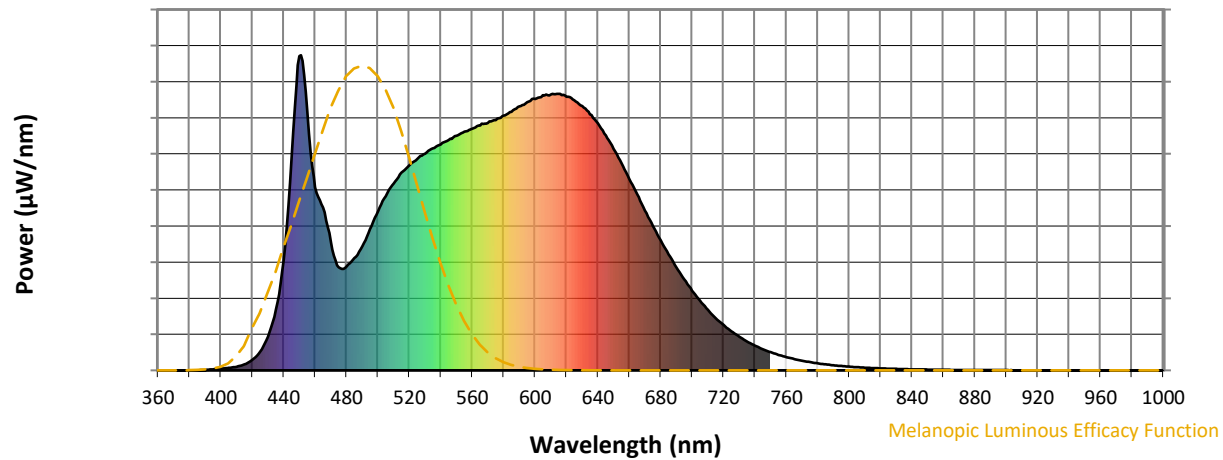

Melanopic Lumens: NR

M/P: 3.61


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	394	NR	620	868	NR	750	58	NR	880	1	NR
365	0	NR	495	449	NR	625	858	NR	755	49	NR	885	1	NR
370	0	NR	500	505	NR	630	839	NR	760	42	NR	890	1	NR
375	0	NR	505	553	NR	635	813	NR	765	36	NR	895	1	NR
380	0	NR	510	593	NR	640	783	NR	770	31	NR	900	1	NR
385	0	NR	515	628	NR	645	746	NR	775	26	NR	905	1	NR
390	1	NR	520	651	NR	650	702	NR	780	22	NR	910	0	NR
395	4	NR	525	670	NR	655	657	NR	785	19	NR	915	0	NR
400	5	NR	530	687	NR	660	607	NR	790	16	NR	920	0	NR
405	8	NR	535	705	NR	665	559	NR	795	14	NR	925	0	NR
410	12	NR	540	717	NR	670	507	NR	800	12	NR	930	0	NR
415	19	NR	545	731	NR	675	458	NR	805	10	NR	935	0	NR
420	34	NR	550	745	NR	680	413	NR	810	9	NR	940	0	NR
425	60	NR	555	757	NR	685	367	NR	815	7	NR	945	0	NR
430	107	NR	560	767	NR	690	328	NR	820	6	NR	950	0	NR
435	194	NR	565	777	NR	695	289	NR	825	5	NR	955	0	NR
440	349	NR	570	785	NR	700	253	NR	830	5	NR	960	0	NR
445	678	NR	575	794	NR	705	221	NR	835	4	NR	965	0	NR
450	997	NR	580	809	NR	710	192	NR	840	3	NR	970	0	NR
455	819	NR	585	820	NR	715	165	NR	845	3	NR	975	0	NR
460	581	NR	590	838	NR	720	144	NR	850	2	NR	980	0	NR
465	517	NR	595	851	NR	725	124	NR	855	2	NR	985	0	NR
470	406	NR	600	861	NR	730	107	NR	860	2	NR	990	0	NR
475	327	NR	605	873	NR	735	91	NR	865	2	NR	995	0	NR
480	330	NR	610	875	NR	740	78	NR	870	1	NR	1000	0	NR
485	356	NR	615	877	NR	745	67	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-11





TM-30-18

Summary

$R_f = 90.8$
 $R_g = 98.8$
 $CIE R_a = 92.4$
 $R_9 = 62.0$

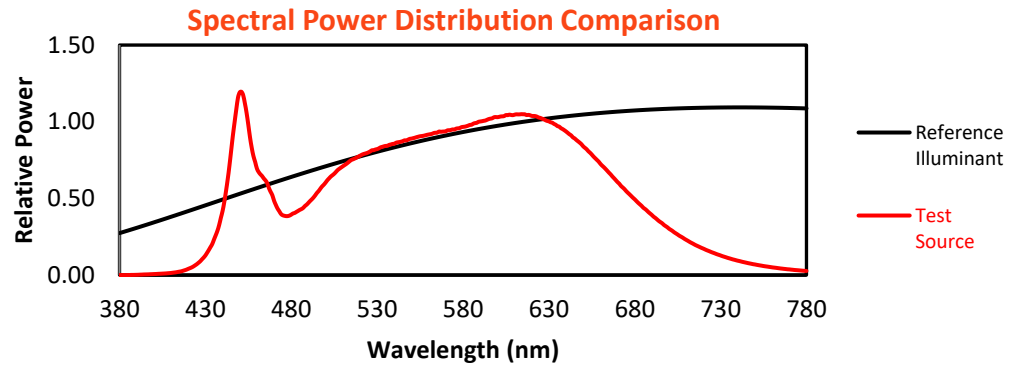


Color Vector Graphics

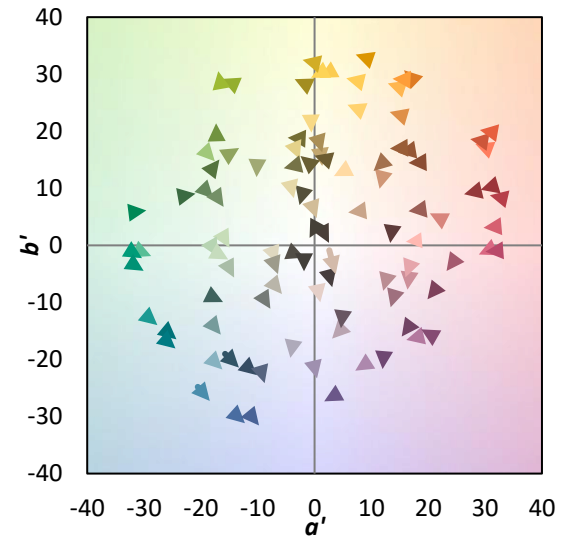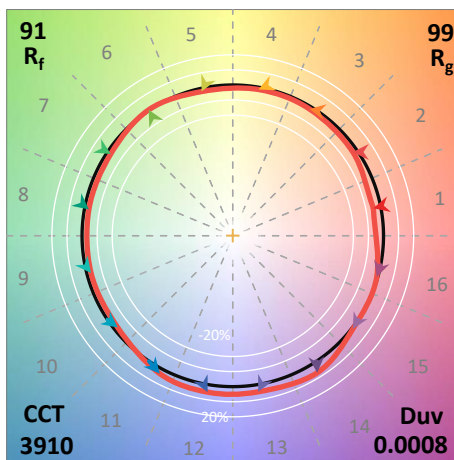
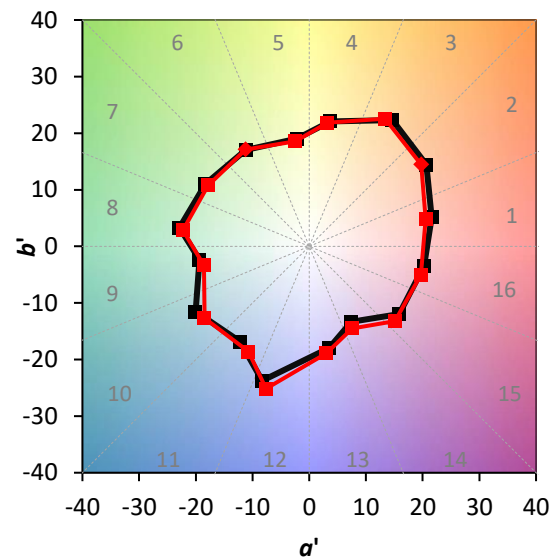
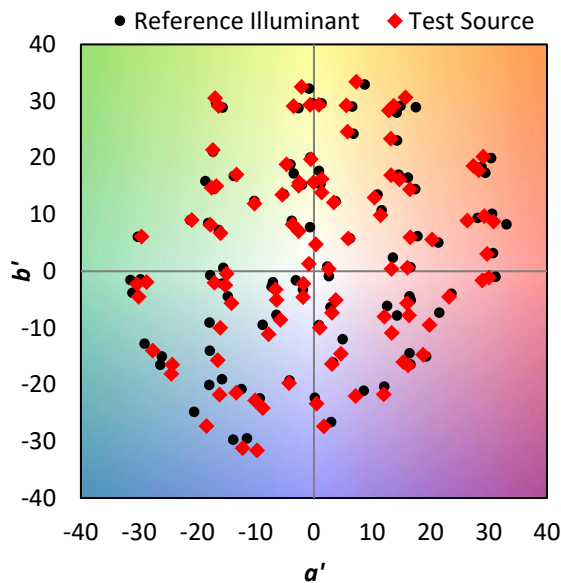


Individual Sample Fidelity Index ($R_{f,i}$)



CES01 = 86	CES26 = 93	CES51 = 96	CES76 = 85
CES02 = 62	CES27 = 90	CES52 = 98	CES77 = 88
CES03 = 31	CES28 = 96	CES53 = 96	CES78 = 82
CES04 = 69	CES29 = 96	CES54 = 92	CES79 = 96
CES05 = 49	CES30 = 90	CES55 = 90	CES80 = 93
CES06 = 50	CES31 = 97	CES56 = 93	CES81 = 89
CES07 = 42	CES32 = 91	CES57 = 91	CES82 = 97
CES08 = 41	CES33 = 98	CES58 = 92	CES83 = 98
CES09 = 29	CES34 = 93	CES59 = 96	CES84 = 93
CES10 = 74	CES35 = 96	CES60 = 91	CES85 = 83
CES11 = 57	CES36 = 79	CES61 = 91	CES86 = 88
CES12 = 63	CES37 = 95	CES62 = 84	CES87 = 91
CES13 = 43	CES38 = 85	CES63 = 91	CES88 = 96
CES14 = 74	CES39 = 99	CES64 = 87	CES89 = 87
CES15 = 71	CES40 = 98	CES65 = 87	CES90 = 96
CES16 = 47	CES41 = 96	CES66 = 84	CES91 = 71
CES17 = 49	CES42 = 95	CES67 = 83	CES92 = 79
CES18 = 56	CES43 = 95	CES68 = 86	CES93 = 87
CES19 = 71	CES44 = 99	CES69 = 87	CES94 = 81
CES20 = 66	CES45 = 98	CES70 = 84	CES95 = 82
CES21 = 85	CES46 = 97	CES71 = 77	CES96 = 91
CES22 = 78	CES47 = 97	CES72 = 93	CES97 = 96
CES23 = 91	CES48 = 90	CES73 = 78	CES98 = 94
CES24 = 90	CES49 = 96	CES74 = 91	CES99 = 91
CES25 = 71	CES50 = 97	CES75 = 80	

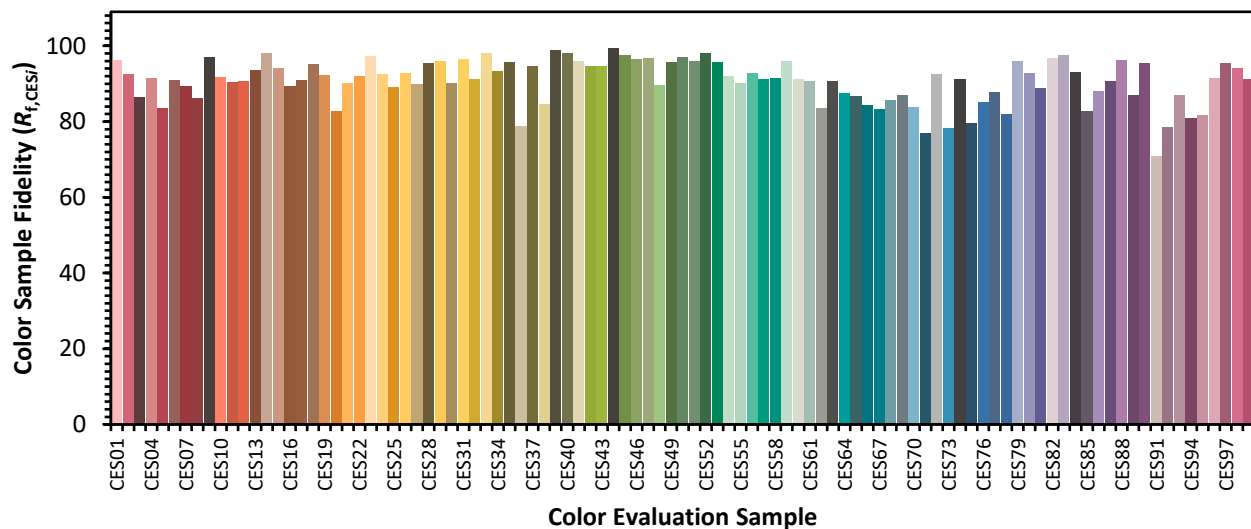

Color Rendition by Hue-Angle Bin

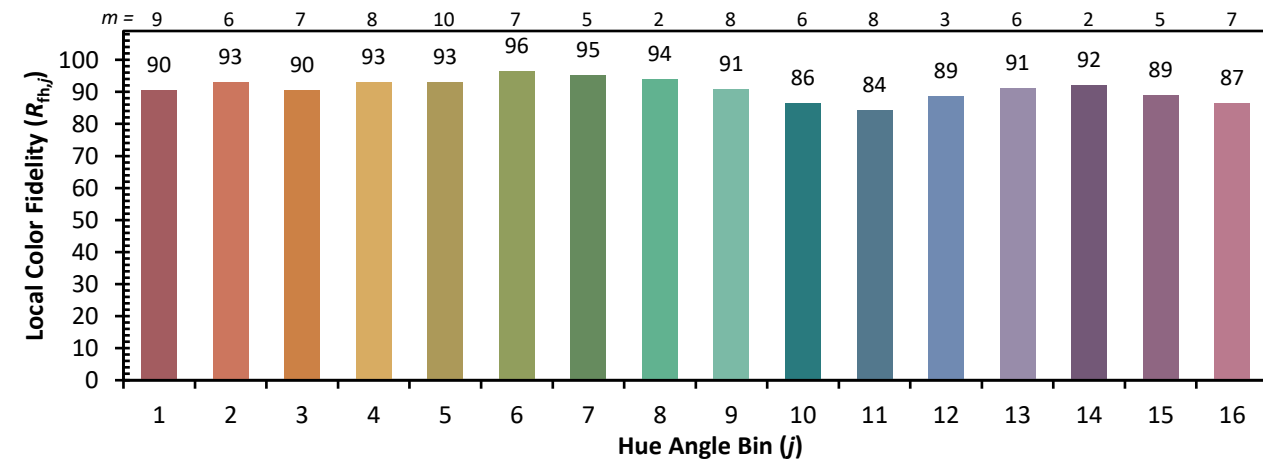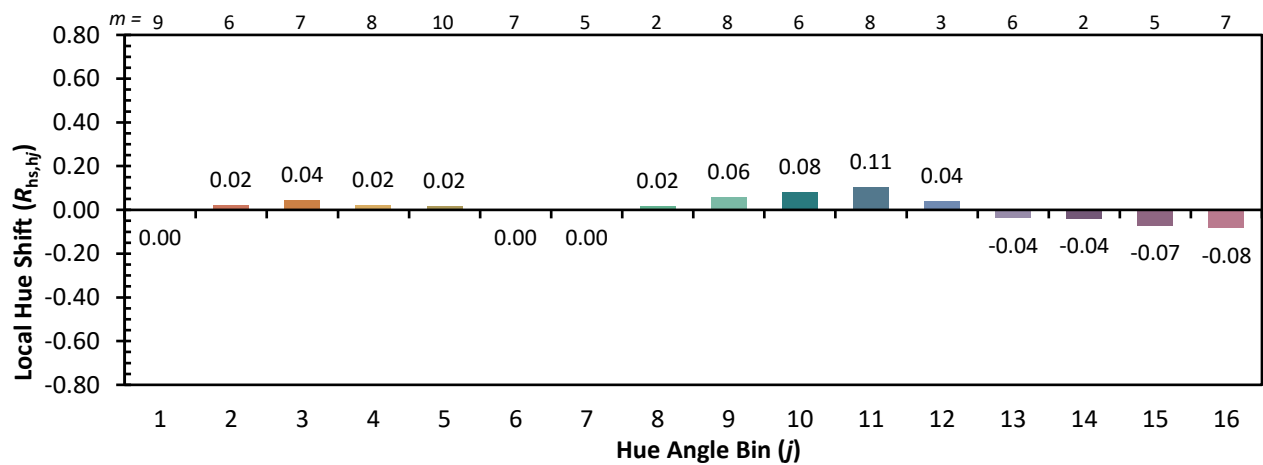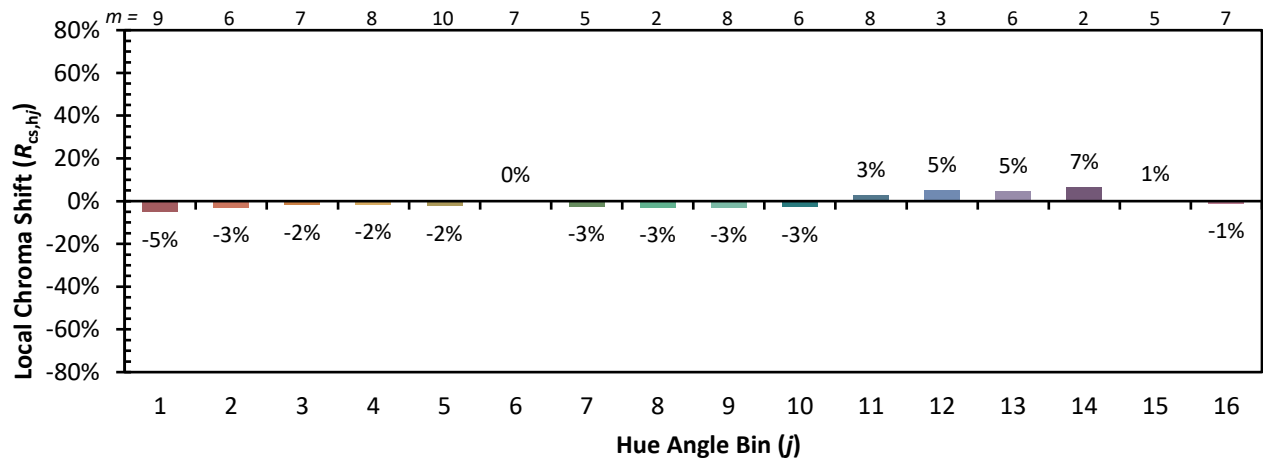

Measure Comparisons

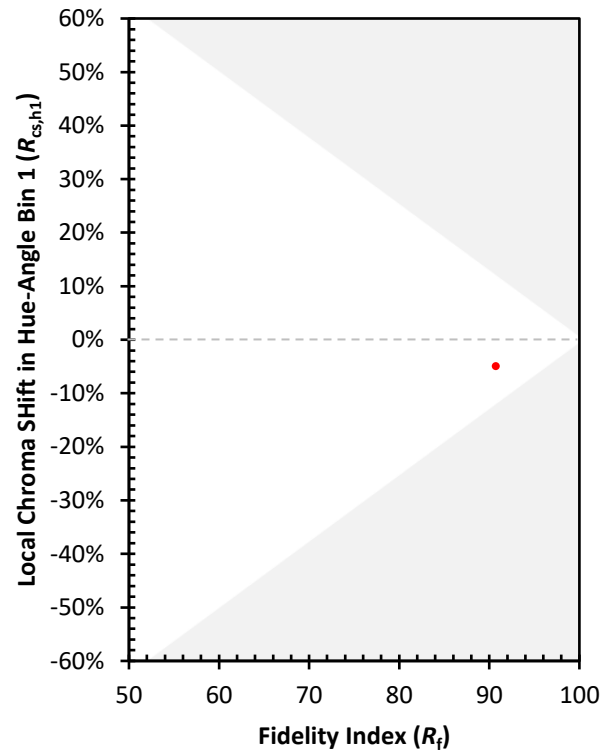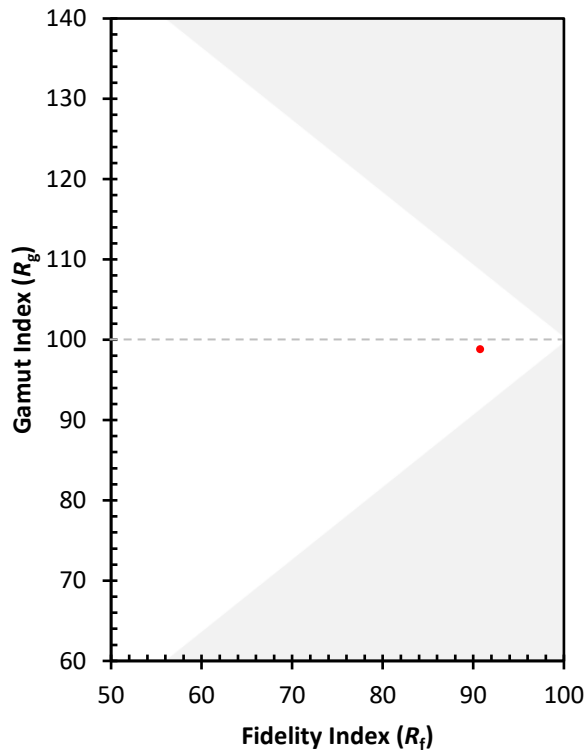

(END OF REPORT)