

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1215514

Luminaire Tested: 24-ID2-100-CFR1-L835-U

Issue Date: 12/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1215514
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2508-510-6)
Test Lab: INNOVATION CENTER
Issue Date: 12/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: 24-ID2-100-CFR1-L835-U
Description: 2X4 IN DEPTH TROFFER WITH 1INCH CUBE REGRESS LENS
Light Source: 3500K CCT, 80 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10216.9 lumens
Efficiency: N/A
Efficacy: 117.7 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.19 / 1.3
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 86.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P1215514
CATALOG NUMBER: 24-ID2-100-CFR1-L835-U

Luminous Intensity Polar Plot

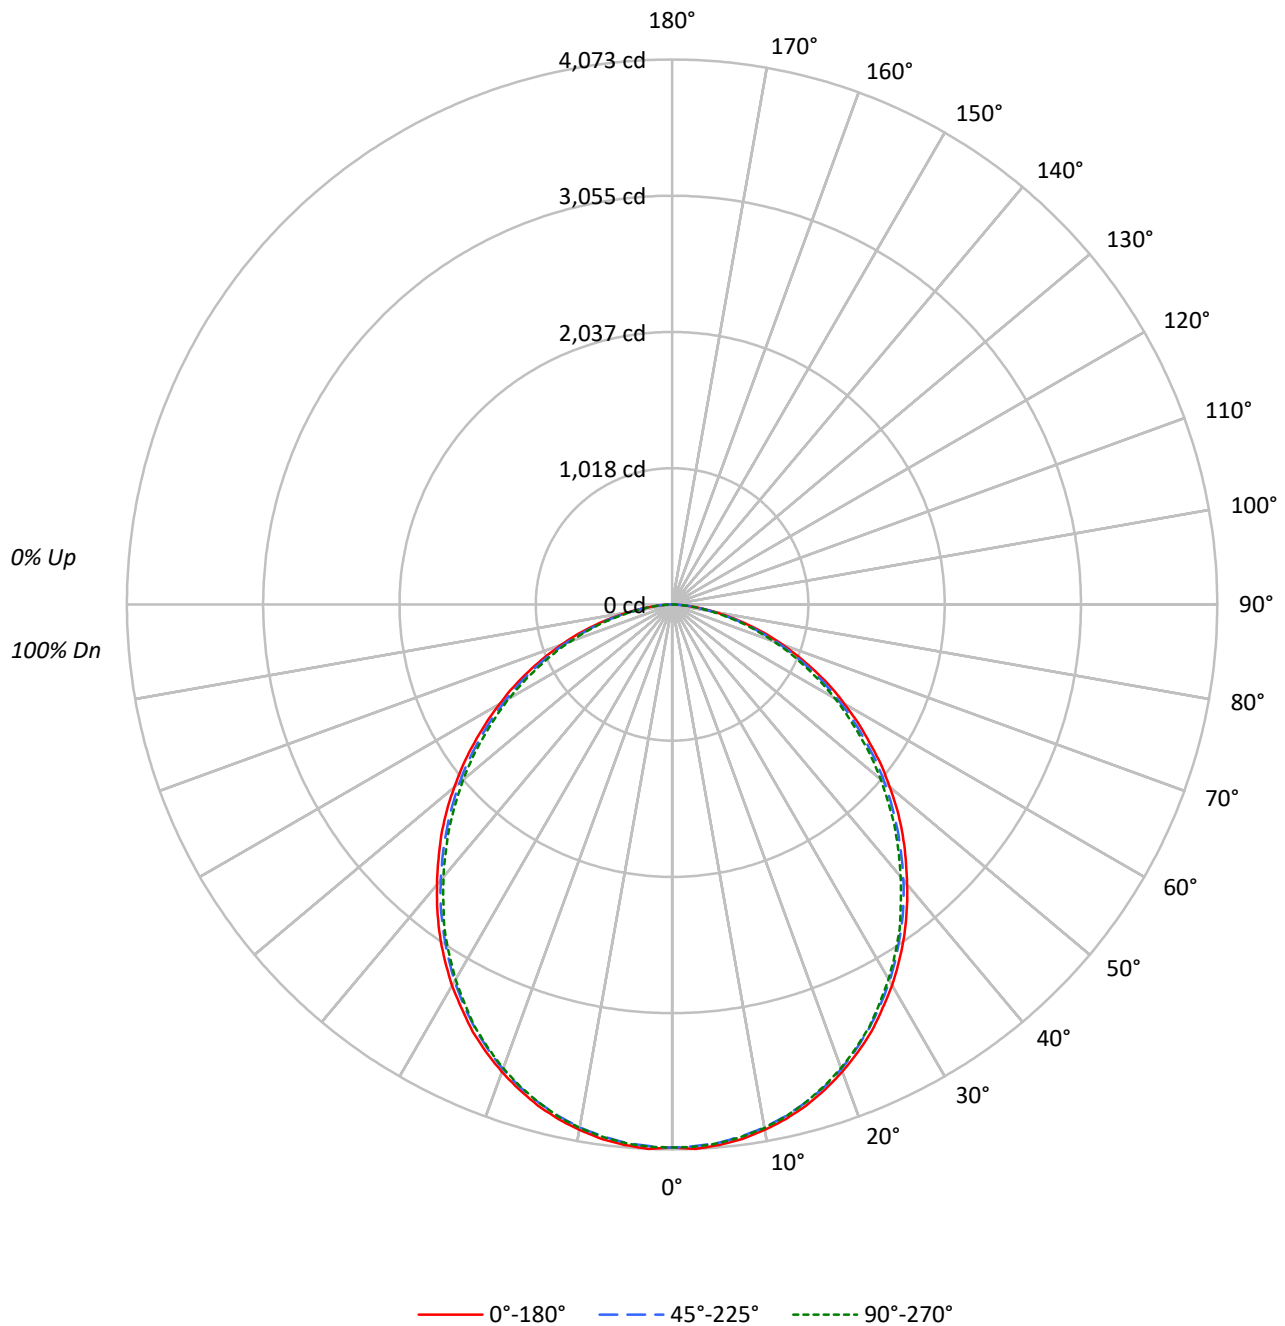

TEST NUMBER: P1215514

CATALOG NUMBER: 24-ID2-100-CFR1-L835-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	109	105	101	97	107	103	99	95	98	95	92		94	92	90		85
2	100	92	85	80	97	90	84	79	86	81	77		83	79	75		71
3	91	81	73	67	89	79	72	66	77	70	65		74	68	64		61
4	84	72	64	57	81	71	63	57	68	61	56		66	60	55		52
5	77	65	56	49	75	64	55	49	61	54	49		59	53	48		45
6	71	58	50	43	70	57	49	43	56	48	43		54	47	42		40
7	66	53	44	38	65	52	44	38	51	43	38		49	43	38		36
8	62	49	40	34	60	48	40	34	47	39	34		45	39	34		32
9	58	45	37	31	56	44	36	31	43	36	31		42	35	31		29
10	54	41	33	28	53	41	33	28	40	33	28		39	32	28		26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5462	5462	5462
5°	5477	5452	5458
10°	5449	5422	5428
15°	5400	5369	5367
20°	5323	5291	5281
25°	5231	5181	5173
30°	5107	5049	5025
35°	4966	4893	4868
40°	4798	4722	4666
45°	4638	4531	4476
50°	4441	4336	4263
55°	4227	4110	4018
60°	4000	3873	3779
65°	3760	3604	3484
70°	3460	3300	3168
75°	3084	2903	2801
80°	2520	2380	2260
85°	1768	1724	1595

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4638 cd/sqm

TEST NUMBER: P1215514
 CATALOG NUMBER: 24-ID2-100-CFR1-L835-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	383.4	3.8
10°-20°	1087.0	10.6
20°-30°	1607.8	15.7
30°-40°	1865.6	18.3
40°-50°	1841.3	18.0
50°-60°	1571.3	15.4
60°-70°	1126.4	11.0
70°-80°	596.9	5.8
80°-90°	137.1	1.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3078.2	30.1
0°-40°	4943.8	48.4
0°-60°	8356.4	81.8
0°-90°	10216.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10216.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4059	4059	4059	4059	4059	
5°	4055	4042	4037	4031	4041	385
15°	3876	3861	3854	3847	3853	1092
25°	3523	3506	3490	3479	3484	1620
35°	3024	3005	2979	2964	2964	1889
45°	2437	2414	2381	2359	2352	1878
55°	1802	1783	1752	1727	1713	1614
65°	1181	1164	1132	1111	1094	1169
75°	593	578	558	544	539	629
85°	114	117	112	106	103	144
90°	0	0	0	0	0	

TEST NUMBER: P1215514

CATALOG NUMBER: 24-ID2-100-CFR1-L835-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4059.3	4059.3	4059.3	4059.3	4059.3
2.5°	4073.2	4057.9	4052.3	4048.1	4056.5
5°	4055.1	4042.5	4036.9	4031.4	4041.1
7.5°	4028.6	4014.6	4007.6	4003.4	4011.8
10°	3988.1	3975.5	3968.6	3964.4	3972.7
12.5°	3937.8	3925.3	3916.9	3912.7	3921.1
15°	3876.4	3861.1	3854.1	3847.1	3852.7
17.5°	3801.0	3789.9	3781.5	3770.3	3775.9
20°	3717.3	3703.3	3695.0	3685.2	3688.0
22.5°	3623.8	3612.6	3597.2	3588.9	3588.9
25°	3523.3	3506.5	3489.8	3478.6	3484.2
27.5°	3404.6	3390.6	3372.5	3357.1	3358.5
30°	3287.4	3269.2	3249.7	3235.7	3234.3
32.5°	3157.5	3145.0	3117.1	3103.1	3098.9
35°	3023.5	3005.4	2978.9	2963.5	2963.5
37.5°	2881.1	2865.8	2839.3	2816.9	2807.2
40°	2731.8	2716.4	2688.5	2664.8	2656.4
42.5°	2583.8	2575.4	2535.0	2515.4	2502.9
45°	2437.2	2413.5	2381.4	2359.1	2352.1
47.5°	2283.7	2262.8	2226.5	2201.3	2190.2
50°	2121.8	2107.8	2071.5	2040.8	2036.6
52.5°	1968.2	1944.5	1916.6	1883.1	1877.5
55°	1802.1	1782.6	1751.9	1726.7	1712.8
57.5°	1645.8	1630.4	1599.7	1566.2	1559.2
60°	1486.6	1471.3	1439.2	1414.0	1404.3
62.5°	1337.3	1314.9	1289.8	1257.7	1247.9
65°	1180.9	1164.2	1132.1	1111.1	1094.4
67.5°	1024.6	1012.0	985.5	966.0	954.8
70°	879.4	864.1	838.9	815.2	805.4
72.5°	737.0	717.5	693.8	677.0	672.8
75°	593.3	577.9	558.4	544.4	538.8
77.5°	452.3	446.7	429.9	414.6	409.0
80°	325.2	321.1	307.1	297.3	291.7
82.5°	210.8	208.0	202.4	194.0	192.6
85°	114.5	117.3	111.7	106.1	103.3
87.5°	40.5	39.1	37.7	36.3	33.5
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1215514

CATALOG NUMBER: 24-ID2-100-CFR1-L835-U

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.00	18.59	17.37	18.91	19.22	16.70	18.30	17.07	18.61	18.92
	3H	18.65	20.08	19.02	20.41	20.77	18.29	19.73	18.67	20.05	20.41
	4H	19.23	20.58	19.63	20.93	21.31	18.84	20.19	19.24	20.54	20.92
	6H	19.61	20.86	20.03	21.23	21.62	19.19	20.44	19.60	20.80	21.20
	8H	19.71	20.90	20.14	21.29	21.69	19.28	20.47	19.71	20.86	21.26
	12H	19.76	20.90	20.19	21.29	21.71	19.33	20.47	19.76	20.85	21.28
4H	2H	17.54	18.89	17.94	19.24	19.62	17.30	18.65	17.70	19.00	19.38
	3H	19.40	20.53	19.81	20.93	21.33	19.10	20.23	19.51	20.62	21.02
	4H	20.10	21.12	20.53	21.53	21.97	19.76	20.78	20.19	21.19	21.63
	6H	20.60	21.48	21.05	21.93	22.38	20.22	21.10	20.67	21.54	22.00
	8H	20.73	21.56	21.19	22.00	22.47	20.34	21.17	20.80	21.61	22.08
	12H	20.81	21.56	21.30	22.03	22.50	20.41	21.15	20.89	21.63	22.10
8H	4H	20.34	21.16	20.80	21.61	22.07	20.03	20.86	20.49	21.30	21.77
	6H	20.93	21.61	21.42	22.10	22.58	20.58	21.26	21.07	21.75	22.23
	8H	21.11	21.73	21.63	22.24	22.72	20.75	21.37	21.26	21.87	22.36
	12H	21.25	21.79	21.75	22.28	22.84	20.87	21.41	21.38	21.91	22.47
12H	4H	20.35	21.09	20.83	21.57	22.04	20.05	20.79	20.53	21.27	21.74
	6H	20.95	21.57	21.46	22.07	22.56	20.61	21.23	21.12	21.73	22.22
	8H	21.18	21.73	21.69	22.22	22.78	20.83	21.38	21.34	21.87	22.43

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Corelite

Report Number: SP1-2506-458-1

Test Date: 07/23/2025

Luminaire Tested: 22ID2-55-CFR1-L835-U

Data in this report applies to families of products including 22ID2-55-CFR1-L835-U

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-458-1
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/27/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Corelite
 Catalog Number: **22ID2-55-CFR1-L835-U**
 Description: 2X2 CGTX WITH INDEPTH FRAME AND CFR1 LENS - 5500 LUMEN 3500K 80CRI

Spectral Parameters

CCT (K): 3440
 CIE u' : 0.2370
 CIE v' : 0.5132
 Duv: 0.0005
 CIE x: 0.4093
 CIE y: 0.3940
 CIE z: 0.1967
 Peak Wavelength (nm): 599
 Dominant Wavelength (nm): 580
 Purity: 41.09375
 R_f: 84.9
 R_g: 94.6

CRI (Ra): 84.2
 R1: 82.8
 R2: 91.7
 R3: 96.7
 R4: 81.9
 R5: 82.6
 R6: 88.8
 R7: 85.0
 R8: 63.7
 R9: 13.6
 R10: 80.1
 R11: 81.1
 R12: 65.8
 R13: 85.2
 R14: 98.7
 R15: 76.2



Test Conditions

Stabilization Time: 36M
 Operation Time: 1H 36M
 Sphere Temperature (°C): 24.0

REPORT NUMBER: SP1-2506-458-1

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-458-1

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2506-458-1

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	295	NR	620	910	NR	750	30	NR	880	1	NR
365	0	NR	495	335	NR	625	862	NR	755	25	NR	885	1	NR
370	0	NR	500	390	NR	630	809	NR	760	21	NR	890	1	NR
375	0	NR	505	445	NR	635	752	NR	765	18	NR	895	0	NR
380	0	NR	510	490	NR	640	694	NR	770	16	NR	900	0	NR
385	0	NR	515	532	NR	645	630	NR	775	13	NR	905	0	NR
390	0	NR	520	563	NR	650	571	NR	780	12	NR	910	0	NR
395	2	NR	525	588	NR	655	512	NR	785	10	NR	915	0	NR
400	3	NR	530	609	NR	660	453	NR	790	8	NR	920	0	NR
405	5	NR	535	631	NR	665	401	NR	795	7	NR	925	0	NR
410	8	NR	540	654	NR	670	351	NR	800	6	NR	930	0	NR
415	13	NR	545	677	NR	675	306	NR	805	5	NR	935	0	NR
420	23	NR	550	702	NR	680	267	NR	810	5	NR	940	0	NR
425	40	NR	555	734	NR	685	230	NR	815	4	NR	945	0	NR
430	70	NR	560	767	NR	690	199	NR	820	4	NR	950	0	NR
435	126	NR	565	802	NR	695	171	NR	825	3	NR	955	0	NR
440	221	NR	570	838	NR	700	146	NR	830	3	NR	960	0	NR
445	418	NR	575	875	NR	705	125	NR	835	2	NR	965	0	NR
450	729	NR	580	913	NR	710	107	NR	840	2	NR	970	0	NR
455	816	NR	585	946	NR	715	90	NR	845	2	NR	975	0	NR
460	578	NR	590	976	NR	720	77	NR	850	1	NR	980	0	NR
465	458	NR	595	992	NR	725	66	NR	855	1	NR	985	0	NR
470	390	NR	600	999	NR	730	56	NR	860	1	NR	990	0	NR
475	299	NR	605	995	NR	735	47	NR	865	1	NR	995	0	NR
480	260	NR	610	975	NR	740	40	NR	870	1	NR	1000	0	NR
485	271	NR	615	948	NR	745	34	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-1

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.53

λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)
360	0	NR	490	295	NR	620	910	NR	750	30	NR	880	1	NR
365	0	NR	495	335	NR	625	862	NR	755	25	NR	885	1	NR
370	0	NR	500	390	NR	630	809	NR	760	21	NR	890	1	NR
375	0	NR	505	445	NR	635	752	NR	765	18	NR	895	0	NR
380	0	NR	510	490	NR	640	694	NR	770	16	NR	900	0	NR
385	0	NR	515	532	NR	645	630	NR	775	13	NR	905	0	NR
390	0	NR	520	563	NR	650	571	NR	780	12	NR	910	0	NR
395	2	NR	525	588	NR	655	512	NR	785	10	NR	915	0	NR
400	3	NR	530	609	NR	660	453	NR	790	8	NR	920	0	NR
405	5	NR	535	631	NR	665	401	NR	795	7	NR	925	0	NR
410	8	NR	540	654	NR	670	351	NR	800	6	NR	930	0	NR
415	13	NR	545	677	NR	675	306	NR	805	5	NR	935	0	NR
420	23	NR	550	702	NR	680	267	NR	810	5	NR	940	0	NR
425	40	NR	555	734	NR	685	230	NR	815	4	NR	945	0	NR
430	70	NR	560	767	NR	690	199	NR	820	4	NR	950	0	NR
435	126	NR	565	802	NR	695	171	NR	825	3	NR	955	0	NR
440	221	NR	570	838	NR	700	146	NR	830	3	NR	960	0	NR
445	418	NR	575	875	NR	705	125	NR	835	2	NR	965	0	NR
450	729	NR	580	913	NR	710	107	NR	840	2	NR	970	0	NR
455	816	NR	585	946	NR	715	90	NR	845	2	NR	975	0	NR
460	578	NR	590	976	NR	720	77	NR	850	1	NR	980	0	NR
465	458	NR	595	992	NR	725	66	NR	855	1	NR	985	0	NR
470	390	NR	600	999	NR	730	56	NR	860	1	NR	990	0	NR
475	299	NR	605	995	NR	735	47	NR	865	1	NR	995	0	NR
480	260	NR	610	975	NR	740	40	NR	870	1	NR	1000	0	NR
485	271	NR	615	948	NR	745	34	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-1

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.07

λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	295	NR	620	910	NR	750	30	NR	880	1	NR
365	0	NR	495	335	NR	625	862	NR	755	25	NR	885	1	NR
370	0	NR	500	390	NR	630	809	NR	760	21	NR	890	1	NR
375	0	NR	505	445	NR	635	752	NR	765	18	NR	895	0	NR
380	0	NR	510	490	NR	640	694	NR	770	16	NR	900	0	NR
385	0	NR	515	532	NR	645	630	NR	775	13	NR	905	0	NR
390	0	NR	520	563	NR	650	571	NR	780	12	NR	910	0	NR
395	2	NR	525	588	NR	655	512	NR	785	10	NR	915	0	NR
400	3	NR	530	609	NR	660	453	NR	790	8	NR	920	0	NR
405	5	NR	535	631	NR	665	401	NR	795	7	NR	925	0	NR
410	8	NR	540	654	NR	670	351	NR	800	6	NR	930	0	NR
415	13	NR	545	677	NR	675	306	NR	805	5	NR	935	0	NR
420	23	NR	550	702	NR	680	267	NR	810	5	NR	940	0	NR
425	40	NR	555	734	NR	685	230	NR	815	4	NR	945	0	NR
430	70	NR	560	767	NR	690	199	NR	820	4	NR	950	0	NR
435	126	NR	565	802	NR	695	171	NR	825	3	NR	955	0	NR
440	221	NR	570	838	NR	700	146	NR	830	3	NR	960	0	NR
445	418	NR	575	875	NR	705	125	NR	835	2	NR	965	0	NR
450	729	NR	580	913	NR	710	107	NR	840	2	NR	970	0	NR
455	816	NR	585	946	NR	715	90	NR	845	2	NR	975	0	NR
460	578	NR	590	976	NR	720	77	NR	850	1	NR	980	0	NR
465	458	NR	595	992	NR	725	66	NR	855	1	NR	985	0	NR
470	390	NR	600	999	NR	730	56	NR	860	1	NR	990	0	NR
475	299	NR	605	995	NR	735	47	NR	865	1	NR	995	0	NR
480	260	NR	610	975	NR	740	40	NR	870	1	NR	1000	0	NR
485	271	NR	615	948	NR	745	34	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-1


TM-30-18

Summary

$R_f = 84.9$
 $R_g = 94.6$
 $\text{CIE } R_a = 84.2$
 $R_9 = 13.6$



Color Vector Graphics

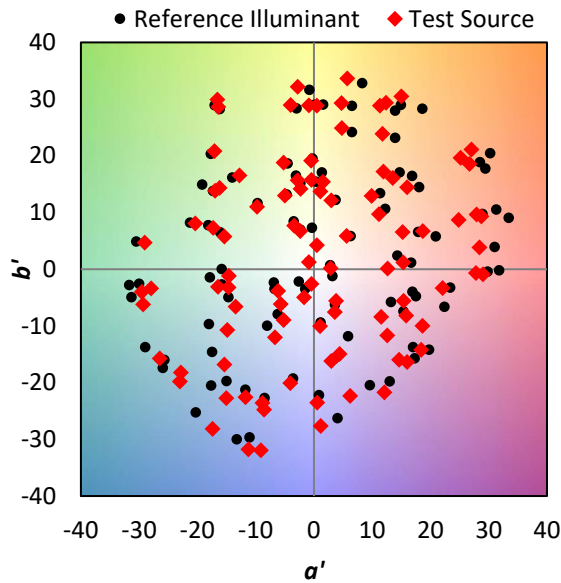

Individual Sample Fidelity Index (R_{fi})

CES01 = 86	CES26 = 87	CES51 = 92	CES76 = 81
CES02 = 62	CES27 = 91	CES52 = 93	CES77 = 85
CES03 = 31	CES28 = 94	CES53 = 90	CES78 = 80
CES04 = 70	CES29 = 92	CES54 = 89	CES79 = 92
CES05 = 49	CES30 = 89	CES55 = 86	CES80 = 90
CES06 = 51	CES31 = 94	CES56 = 85	CES81 = 77
CES07 = 41	CES32 = 86	CES57 = 83	CES82 = 96
CES08 = 40	CES33 = 97	CES58 = 84	CES83 = 96
CES09 = 29	CES34 = 91	CES59 = 91	CES84 = 91
CES10 = 75	CES35 = 95	CES60 = 89	CES85 = 76
CES11 = 58	CES36 = 79	CES61 = 87	CES86 = 73
CES12 = 64	CES37 = 95	CES62 = 81	CES87 = 85
CES13 = 43	CES38 = 84	CES63 = 85	CES88 = 89
CES14 = 74	CES39 = 98	CES64 = 78	CES89 = 78
CES15 = 71	CES40 = 97	CES65 = 78	CES90 = 90
CES16 = 47	CES41 = 95	CES66 = 75	CES91 = 71
CES17 = 50	CES42 = 96	CES67 = 74	CES92 = 65
CES18 = 56	CES43 = 92	CES68 = 79	CES93 = 79
CES19 = 72	CES44 = 99	CES69 = 83	CES94 = 64
CES20 = 66	CES45 = 95	CES70 = 77	CES95 = 74
CES21 = 86	CES46 = 91	CES71 = 71	CES96 = 85
CES22 = 78	CES47 = 94	CES72 = 90	CES97 = 90
CES23 = 92	CES48 = 83	CES73 = 72	CES98 = 86
CES24 = 90	CES49 = 92	CES74 = 90	CES99 = 79
CES25 = 72	CES50 = 93	CES75 = 75	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)