

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1216359

Luminaire Tested: 24-ID2-100-DBR-L940-U

Issue Date: 12/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1216359
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2508-510-10)
Test Lab: INNOVATION CENTER
Issue Date: 12/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: 24-ID2-100-DBR-L940-U
Description: 2X4 IN DEPTH TROFFER WITH 2INCH DOUBLE BARREL REGRESSED
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 9083.0 lumens
Efficiency: N/A
Efficacy: 104.6 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.3
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 86.8
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P1216359
CATALOG NUMBER: 24-ID2-100-DBR-L940-U

Luminous Intensity Polar Plot

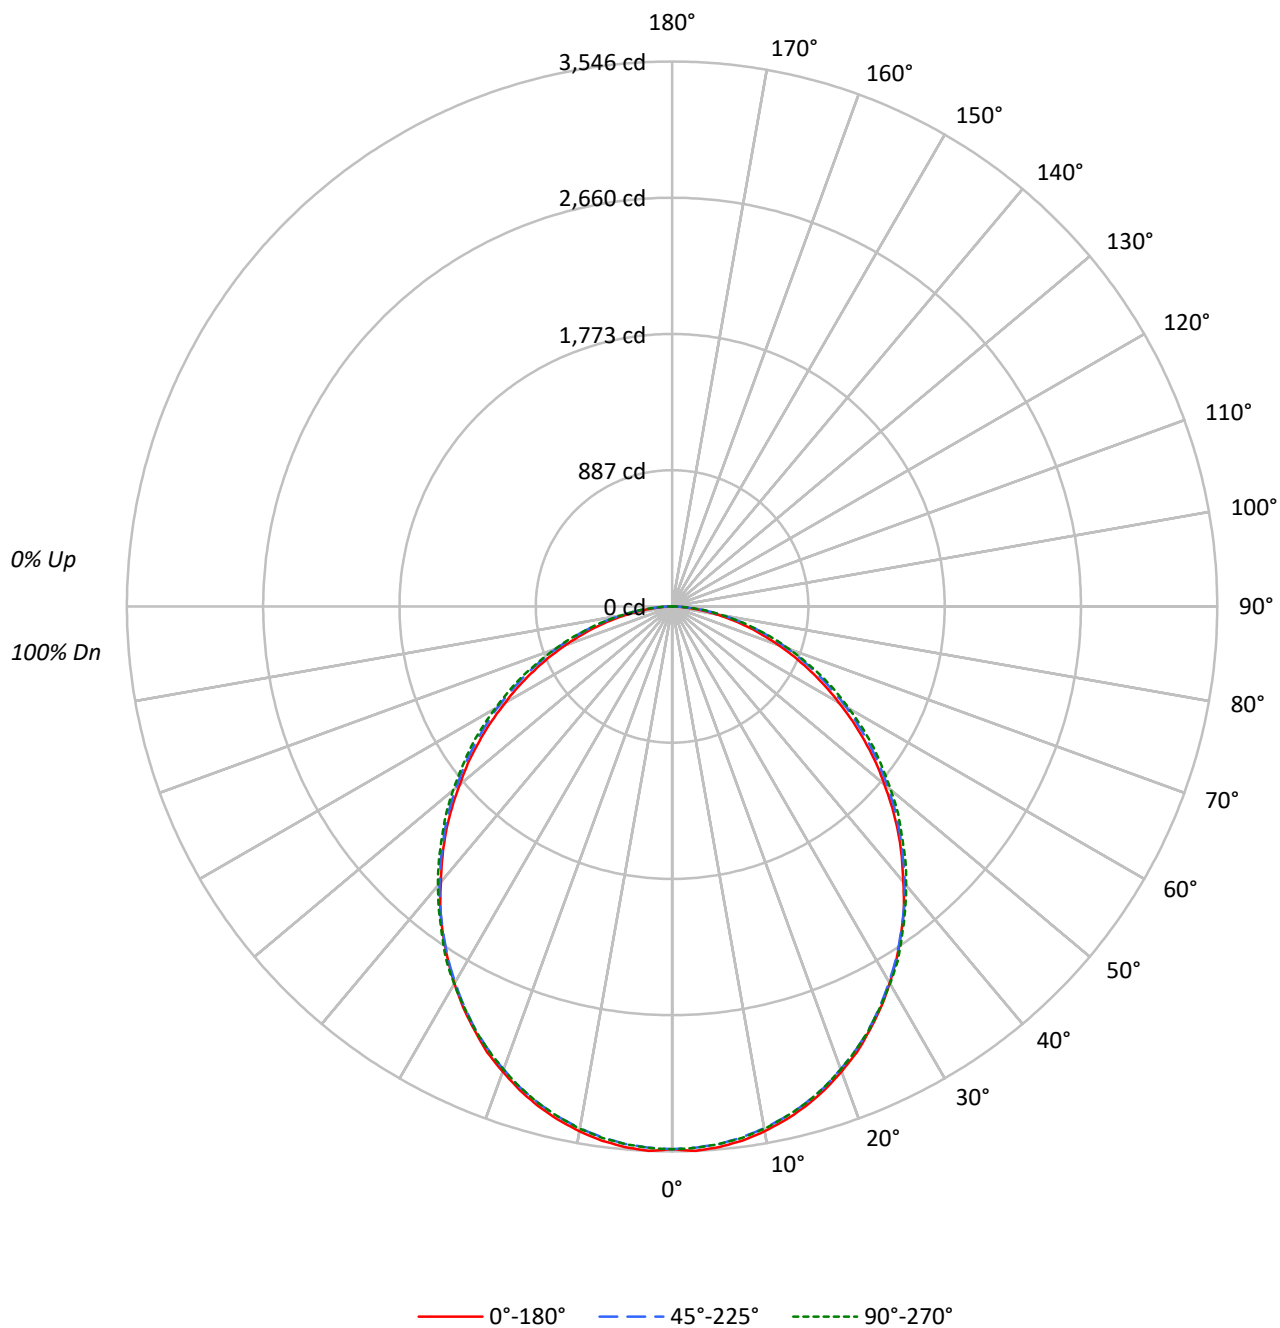

TEST NUMBER: P1216359
 CATALOG NUMBER: 24-ID2-100-DBR-L940-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	102	102	100
1	109	104	100	96	106	102	98	95	98	95	92	94	91	89	90	88	86	86	86	84
2	99	91	85	79	97	89	83	78	86	81	76	83	78	74	80	76	73	73	73	71
3	91	80	72	66	88	79	71	65	76	70	64	73	68	63	71	66	62	62	62	60
4	83	71	63	56	81	70	62	56	68	61	55	65	59	54	63	58	54	54	54	51
5	77	64	55	49	75	63	55	48	61	53	48	59	52	47	57	51	47	47	47	45
6	71	58	49	43	69	57	48	42	55	48	42	53	47	42	52	46	41	41	41	39
7	66	52	44	38	64	52	43	38	50	43	37	49	42	37	47	41	37	37	37	35
8	61	48	40	34	60	47	39	34	46	39	33	45	38	33	44	38	33	33	33	31
9	57	44	36	31	56	44	36	30	42	35	30	41	35	30	40	34	30	30	30	28
10	54	41	33	28	53	40	33	28	39	32	28	38	32	27	37	32	27	27	27	26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4752	4752	4752
5°	4769	4742	4743
10°	4738	4711	4716
15°	4688	4663	4665
20°	4612	4589	4591
25°	4516	4501	4505
30°	4399	4385	4405
35°	4268	4262	4285
40°	4108	4133	4161
45°	3960	3988	4022
50°	3774	3834	3889
55°	3591	3677	3750
60°	3372	3517	3574
65°	3155	3319	3415
70°	2903	3135	3189
75°	2619	2918	2944
80°	2223	2602	2631
85°	1703	2147	2205

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 67.5°
 Vertical Angle: 45°
 Luminance: 4022 cd/sqm

TEST NUMBER: P1216359
 CATALOG NUMBER: 24-ID2-100-DBR-L940-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	333.4	3.7
10°-20°	944.0	10.4
20°-30°	1396.2	15.4
30°-40°	1625.2	17.9
40°-50°	1617.0	17.8
50°-60°	1399.3	15.4
60°-70°	1029.0	11.3
70°-80°	581.2	6.4
80°-90°	157.7	1.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2673.6	29.4
0°-40°	4298.8	47.3
0°-60°	7315.1	80.5
0°-90°	9083.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9083.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3532	3532	3532	3532	3532	
5°	3531	3518	3511	3506	3512	335
15°	3365	3355	3348	3341	3349	948
25°	3042	3033	3032	3028	3034	1401
35°	2598	2594	2595	2606	2608	1624
45°	2081	2081	2096	2114	2114	1603
55°	1531	1538	1567	1589	1599	1369
65°	991	1011	1042	1062	1072	984
75°	504	531	561	565	566	534
85°	110	130	139	142	143	132
90°	0	0	0	0	0	

TEST NUMBER: P1216359

CATALOG NUMBER: 24-ID2-100-DBR-L940-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3531.9	3531.9	3531.9	3531.9	3531.9
2.5°	3545.7	3531.9	3524.4	3520.6	3525.6
5°	3530.6	3518.1	3510.6	3505.6	3511.8
7.5°	3505.6	3491.8	3484.3	3479.3	3488.0
10°	3468.0	3454.2	3447.9	3444.2	3451.7
12.5°	3421.6	3410.3	3402.8	3397.8	3402.8
15°	3365.2	3355.2	3347.7	3341.4	3349.0
17.5°	3298.8	3286.3	3283.8	3276.3	3282.5
20°	3221.2	3211.1	3204.9	3201.1	3206.1
22.5°	3141.0	3127.2	3123.4	3119.7	3124.7
25°	3042.0	3033.2	3032.0	3028.2	3034.5
27.5°	2941.8	2936.8	2930.5	2933.0	2934.2
30°	2831.5	2825.2	2822.7	2827.8	2835.3
32.5°	2717.5	2712.5	2713.7	2718.8	2732.5
35°	2598.5	2593.5	2594.7	2606.0	2608.5
37.5°	2476.9	2468.2	2476.9	2484.5	2490.7
40°	2339.1	2340.4	2352.9	2362.9	2369.2
42.5°	2211.3	2211.3	2223.9	2238.9	2246.4
45°	2081.0	2081.0	2096.1	2113.6	2113.6
47.5°	1943.2	1940.7	1968.3	1987.1	1993.3
50°	1802.9	1807.9	1831.7	1850.5	1858.0
52.5°	1671.3	1673.8	1700.2	1720.2	1724.0
55°	1531.0	1538.5	1567.4	1588.7	1598.7
57.5°	1393.2	1405.7	1434.5	1460.9	1463.4
60°	1252.9	1272.9	1306.8	1320.5	1328.1
62.5°	1125.1	1145.1	1172.7	1195.2	1200.3
65°	991.0	1011.1	1042.4	1062.4	1072.5
67.5°	865.7	889.5	920.9	935.9	935.9
70°	737.9	764.3	796.8	809.4	810.6
72.5°	617.7	647.7	676.6	686.6	689.1
75°	503.7	531.2	561.3	565.0	566.3
77.5°	392.2	421.0	443.5	451.0	447.3
80°	286.9	315.7	335.8	340.8	339.5
82.5°	195.4	219.3	238.0	238.0	238.0
85°	110.3	130.3	139.1	141.6	142.8
87.5°	36.3	51.4	58.9	58.9	58.9
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1216359

CATALOG NUMBER: 24-ID2-100-DBR-L940-U

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.34	17.94	16.70	18.26	18.57	16.62	18.23	16.98	18.54	18.85
	3H	17.99	19.44	18.37	19.77	20.13	18.35	19.80	18.73	20.13	20.49
	4H	18.59	19.95	18.99	20.30	20.68	19.00	20.37	19.40	20.72	21.09
	6H	19.00	20.27	19.41	20.63	21.02	19.48	20.74	19.89	21.11	21.50
	8H	19.12	20.33	19.54	20.72	21.12	19.63	20.84	20.05	21.23	21.62
	12H	19.19	20.35	19.62	20.73	21.16	19.73	20.88	20.16	21.27	21.69
4H	2H	16.97	18.34	17.37	18.69	19.06	17.20	18.56	17.59	18.91	19.29
	3H	18.86	20.00	19.26	20.40	20.80	19.16	20.30	19.57	20.70	21.10
	4H	19.58	20.62	20.01	21.03	21.47	19.94	20.97	20.37	21.39	21.82
	6H	20.12	21.02	20.57	21.46	21.92	20.55	21.45	21.00	21.89	22.35
	8H	20.28	21.13	20.74	21.57	22.04	20.75	21.59	21.21	22.03	22.50
	12H	20.39	21.15	20.87	21.62	22.09	20.89	21.65	21.37	22.12	22.59
8H	4H	19.91	20.76	20.37	21.20	21.66	20.23	21.07	20.69	21.52	21.98
	6H	20.57	21.28	21.07	21.77	22.24	20.96	21.66	21.45	22.15	22.62
	8H	20.81	21.44	21.32	21.95	22.43	21.23	21.86	21.74	22.37	22.85
	12H	20.98	21.54	21.49	22.03	22.59	21.44	22.00	21.95	22.49	23.05
12H	4H	19.95	20.71	20.43	21.18	21.65	20.26	21.01	20.74	21.49	21.96
	6H	20.64	21.27	21.15	21.78	22.26	21.01	21.64	21.52	22.14	22.63
	8H	20.93	21.49	21.44	21.98	22.54	21.34	21.89	21.84	22.38	22.95

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Corelite

Report Number: SP1-2506-458-11

Test Date: 08/26/2025

Luminaire Tested: 22ID2-55-CFR1-L940-U

Data in this report applies to families of products including 22ID2-55-CFR1-L940-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-458-11
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/27/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Corelite
 Catalog Number: **22ID2-55-CFR1-L940-U**
 Description: 2X2 CGTX WITH INDEPTH FRAME AND CFR1 LENS - 5500 LUMEN 4000K 90CRI

Spectral Parameters

CCT (K): 3910
 CIE u' : 0.2263
 CIE v' : 0.5043
 Duv: 0.0008
 CIE x: 0.3851
 CIE y: 0.3813
 CIE z: 0.2336
 Peak Wavelength (nm): 451
 Dominant Wavelength (nm): 578
 Purity: 30.01895
 R_f: 90.8
 R_g: 98.8

CRI (Ra): 92.4
 R1: 92.5
 R2: 94.9
 R3: 95.8
 R4: 92.7
 R5: 91.7
 R6: 92.1
 R7: 94.3
 R8: 85.2
 R9: 62.0
 R10: 87.0
 R11: 92.8
 R12: 71.7
 R13: 93.2
 R14: 97.3
 R15: 89.6

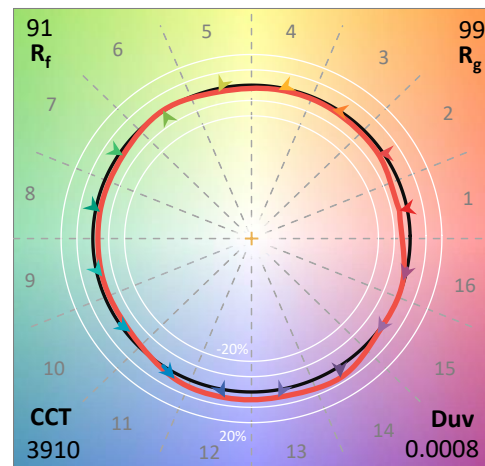

Test Conditions


Stabilization Time: 31M
 Operation Time: 1H 31M
 Sphere Temperature (°C): 25.2.

REPORT NUMBER: SP1-2506-458-11


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-458-11

CIE 1931 Chromaticity Diagram

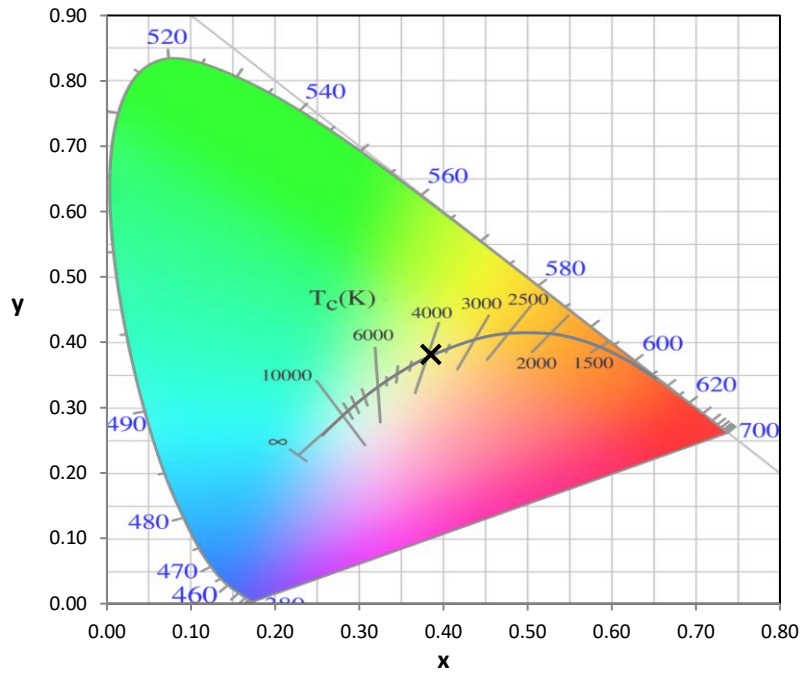


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

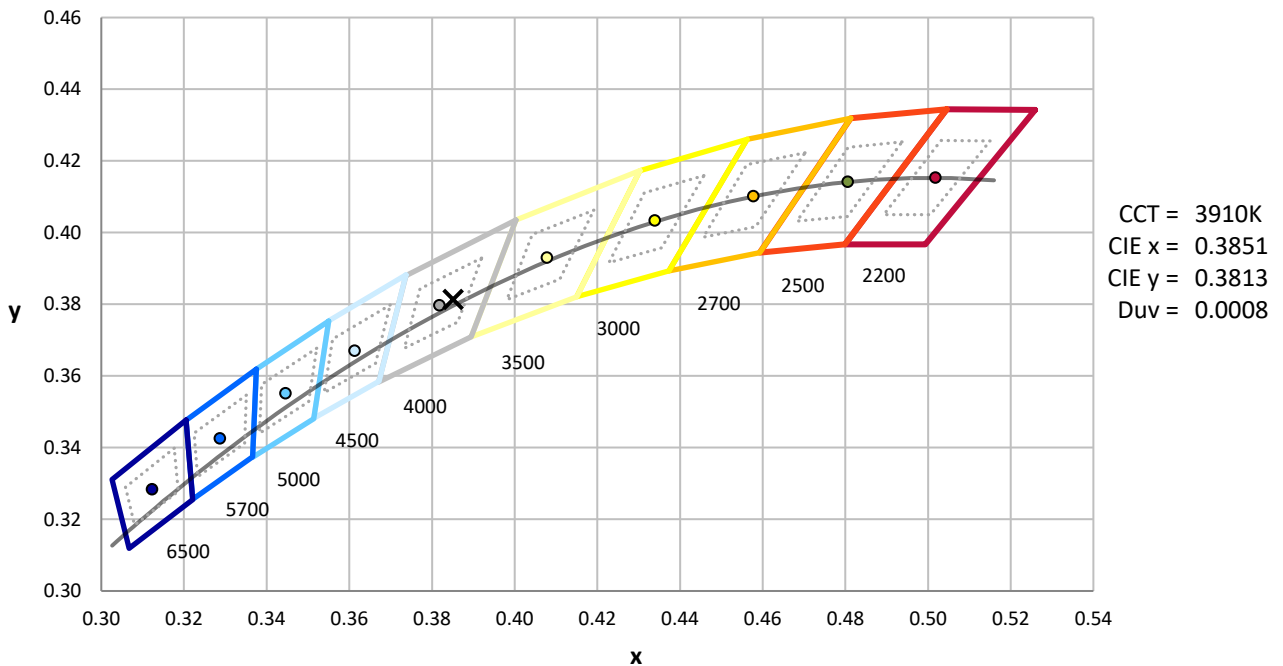

Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2506-458-11

Photopic Flux vs. Wavelength

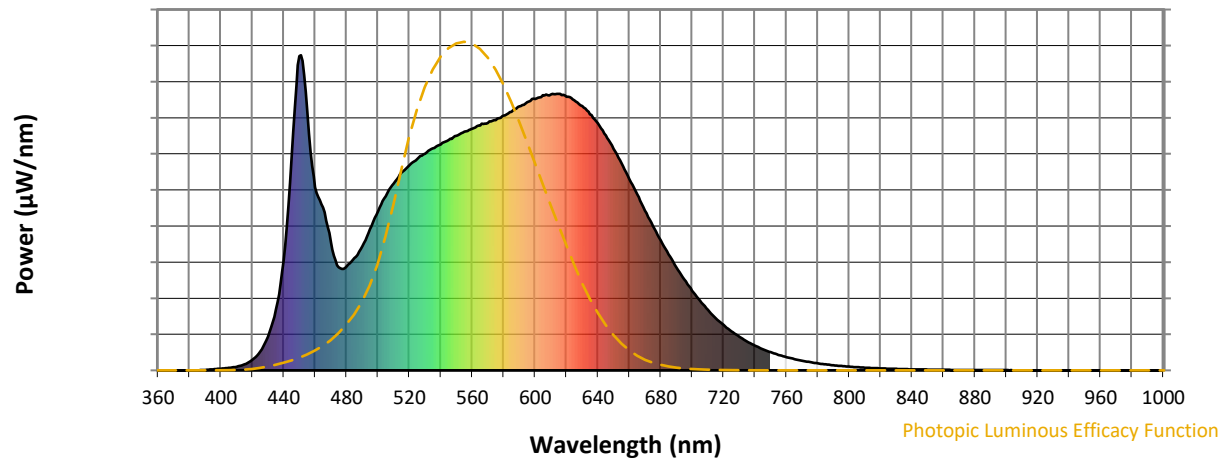


Photopic Lumens: NR

λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (φ/nm)
360	0	NR	490	394	NR	620	868	NR	750	58	NR	880	1	NR
365	0	NR	495	449	NR	625	858	NR	755	49	NR	885	1	NR
370	0	NR	500	505	NR	630	839	NR	760	42	NR	890	1	NR
375	0	NR	505	553	NR	635	813	NR	765	36	NR	895	1	NR
380	0	NR	510	593	NR	640	783	NR	770	31	NR	900	1	NR
385	0	NR	515	628	NR	645	746	NR	775	26	NR	905	1	NR
390	1	NR	520	651	NR	650	702	NR	780	22	NR	910	0	NR
395	4	NR	525	670	NR	655	657	NR	785	19	NR	915	0	NR
400	5	NR	530	687	NR	660	607	NR	790	16	NR	920	0	NR
405	8	NR	535	705	NR	665	559	NR	795	14	NR	925	0	NR
410	12	NR	540	717	NR	670	507	NR	800	12	NR	930	0	NR
415	19	NR	545	731	NR	675	458	NR	805	10	NR	935	0	NR
420	34	NR	550	745	NR	680	413	NR	810	9	NR	940	0	NR
425	60	NR	555	757	NR	685	367	NR	815	7	NR	945	0	NR
430	107	NR	560	767	NR	690	328	NR	820	6	NR	950	0	NR
435	194	NR	565	777	NR	695	289	NR	825	5	NR	955	0	NR
440	349	NR	570	785	NR	700	253	NR	830	5	NR	960	0	NR
445	678	NR	575	794	NR	705	221	NR	835	4	NR	965	0	NR
450	997	NR	580	809	NR	710	192	NR	840	3	NR	970	0	NR
455	819	NR	585	820	NR	715	165	NR	845	3	NR	975	0	NR
460	581	NR	590	838	NR	720	144	NR	850	2	NR	980	0	NR
465	517	NR	595	851	NR	725	124	NR	855	2	NR	985	0	NR
470	406	NR	600	861	NR	730	107	NR	860	2	NR	990	0	NR
475	327	NR	605	873	NR	735	91	NR	865	2	NR	995	0	NR
480	330	NR	610	875	NR	740	78	NR	870	1	NR	1000	0	NR
485	356	NR	615	877	NR	745	67	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-11

Scotopic Flux vs. Wavelength

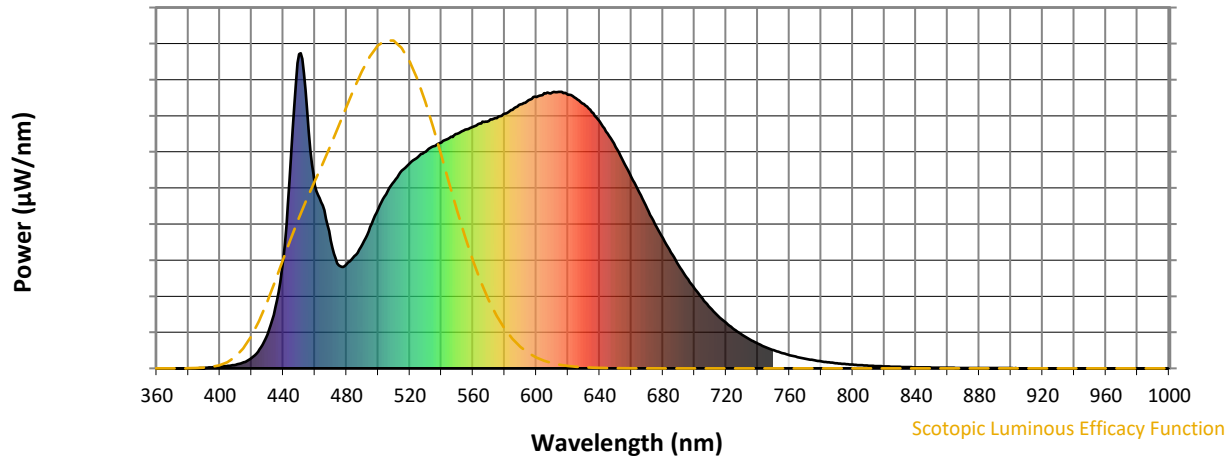


Scotopic Lumens: NR

S/P: 1.75

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	394	NR	620	868	NR	750	58	NR	880	1	NR
365	0	NR	495	449	NR	625	858	NR	755	49	NR	885	1	NR
370	0	NR	500	505	NR	630	839	NR	760	42	NR	890	1	NR
375	0	NR	505	553	NR	635	813	NR	765	36	NR	895	1	NR
380	0	NR	510	593	NR	640	783	NR	770	31	NR	900	1	NR
385	0	NR	515	628	NR	645	746	NR	775	26	NR	905	1	NR
390	1	NR	520	651	NR	650	702	NR	780	22	NR	910	0	NR
395	4	NR	525	670	NR	655	657	NR	785	19	NR	915	0	NR
400	5	NR	530	687	NR	660	607	NR	790	16	NR	920	0	NR
405	8	NR	535	705	NR	665	559	NR	795	14	NR	925	0	NR
410	12	NR	540	717	NR	670	507	NR	800	12	NR	930	0	NR
415	19	NR	545	731	NR	675	458	NR	805	10	NR	935	0	NR
420	34	NR	550	745	NR	680	413	NR	810	9	NR	940	0	NR
425	60	NR	555	757	NR	685	367	NR	815	7	NR	945	0	NR
430	107	NR	560	767	NR	690	328	NR	820	6	NR	950	0	NR
435	194	NR	565	777	NR	695	289	NR	825	5	NR	955	0	NR
440	349	NR	570	785	NR	700	253	NR	830	5	NR	960	0	NR
445	678	NR	575	794	NR	705	221	NR	835	4	NR	965	0	NR
450	997	NR	580	809	NR	710	192	NR	840	3	NR	970	0	NR
455	819	NR	585	820	NR	715	165	NR	845	3	NR	975	0	NR
460	581	NR	590	838	NR	720	144	NR	850	2	NR	980	0	NR
465	517	NR	595	851	NR	725	124	NR	855	2	NR	985	0	NR
470	406	NR	600	861	NR	730	107	NR	860	2	NR	990	0	NR
475	327	NR	605	873	NR	735	91	NR	865	2	NR	995	0	NR
480	330	NR	610	875	NR	740	78	NR	870	1	NR	1000	0	NR
485	356	NR	615	877	NR	745	67	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-11

Melanopic Flux vs. Wavelength

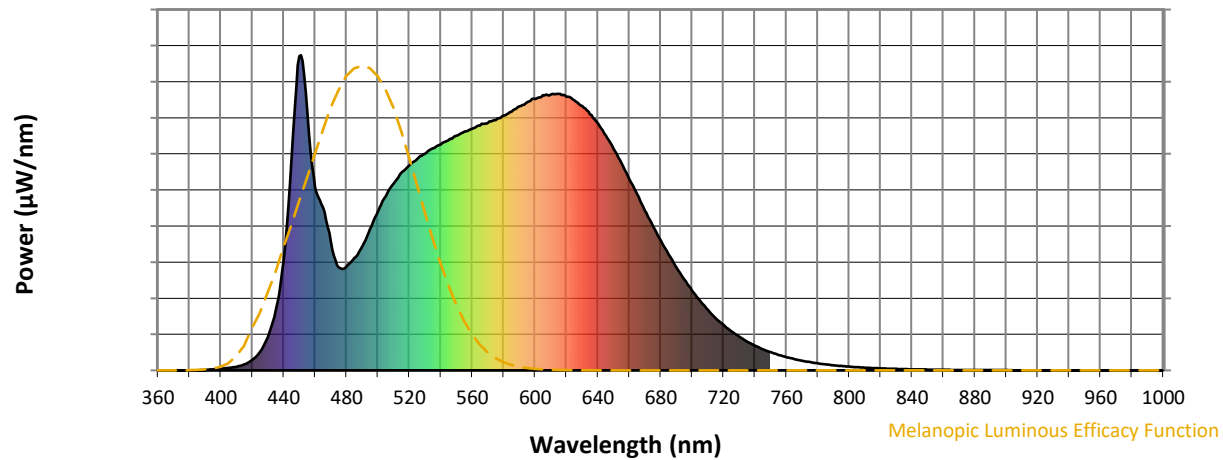

Melanopic Lumens: NR

M/P: 3.61


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	394	NR	620	868	NR	750	58	NR	880	1	NR
365	0	NR	495	449	NR	625	858	NR	755	49	NR	885	1	NR
370	0	NR	500	505	NR	630	839	NR	760	42	NR	890	1	NR
375	0	NR	505	553	NR	635	813	NR	765	36	NR	895	1	NR
380	0	NR	510	593	NR	640	783	NR	770	31	NR	900	1	NR
385	0	NR	515	628	NR	645	746	NR	775	26	NR	905	1	NR
390	1	NR	520	651	NR	650	702	NR	780	22	NR	910	0	NR
395	4	NR	525	670	NR	655	657	NR	785	19	NR	915	0	NR
400	5	NR	530	687	NR	660	607	NR	790	16	NR	920	0	NR
405	8	NR	535	705	NR	665	559	NR	795	14	NR	925	0	NR
410	12	NR	540	717	NR	670	507	NR	800	12	NR	930	0	NR
415	19	NR	545	731	NR	675	458	NR	805	10	NR	935	0	NR
420	34	NR	550	745	NR	680	413	NR	810	9	NR	940	0	NR
425	60	NR	555	757	NR	685	367	NR	815	7	NR	945	0	NR
430	107	NR	560	767	NR	690	328	NR	820	6	NR	950	0	NR
435	194	NR	565	777	NR	695	289	NR	825	5	NR	955	0	NR
440	349	NR	570	785	NR	700	253	NR	830	5	NR	960	0	NR
445	678	NR	575	794	NR	705	221	NR	835	4	NR	965	0	NR
450	997	NR	580	809	NR	710	192	NR	840	3	NR	970	0	NR
455	819	NR	585	820	NR	715	165	NR	845	3	NR	975	0	NR
460	581	NR	590	838	NR	720	144	NR	850	2	NR	980	0	NR
465	517	NR	595	851	NR	725	124	NR	855	2	NR	985	0	NR
470	406	NR	600	861	NR	730	107	NR	860	2	NR	990	0	NR
475	327	NR	605	873	NR	735	91	NR	865	2	NR	995	0	NR
480	330	NR	610	875	NR	740	78	NR	870	1	NR	1000	0	NR
485	356	NR	615	877	NR	745	67	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-11





TM-30-18

Summary

$R_f = 90.8$
 $R_g = 98.8$
 $CIE R_a = 92.4$
 $R_9 = 62.0$

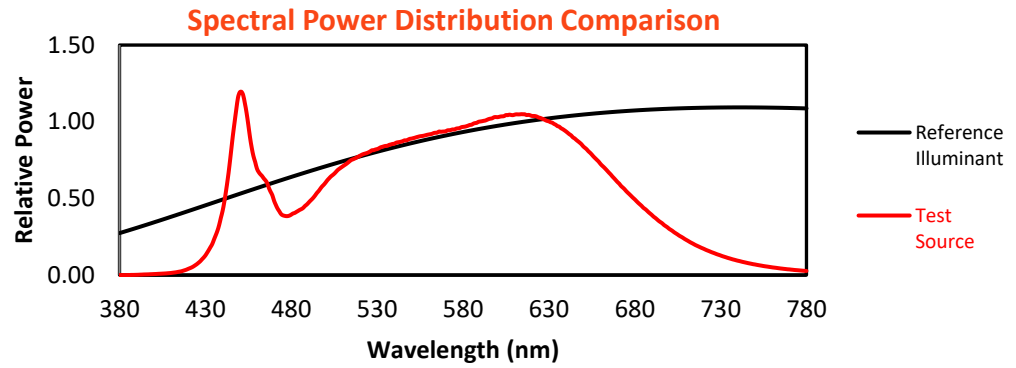


Color Vector Graphics

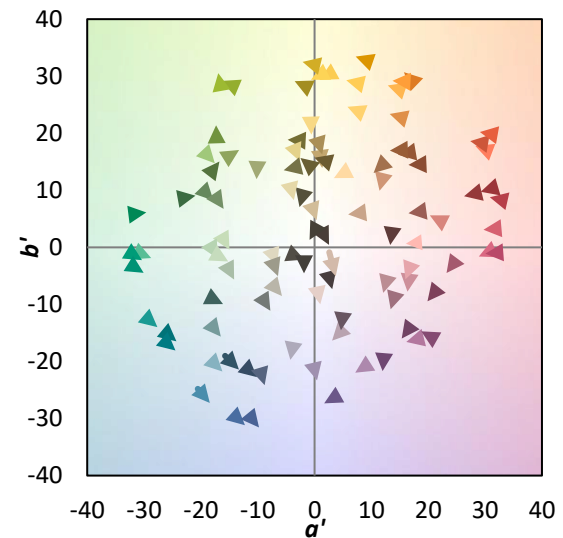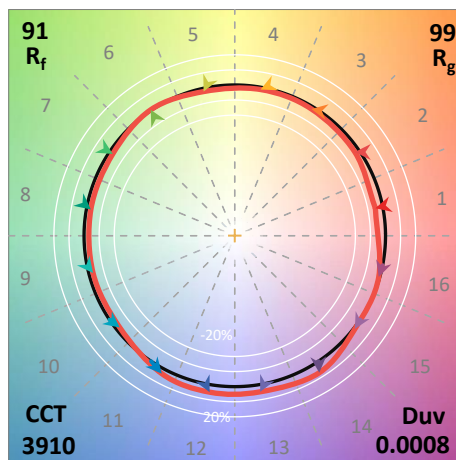
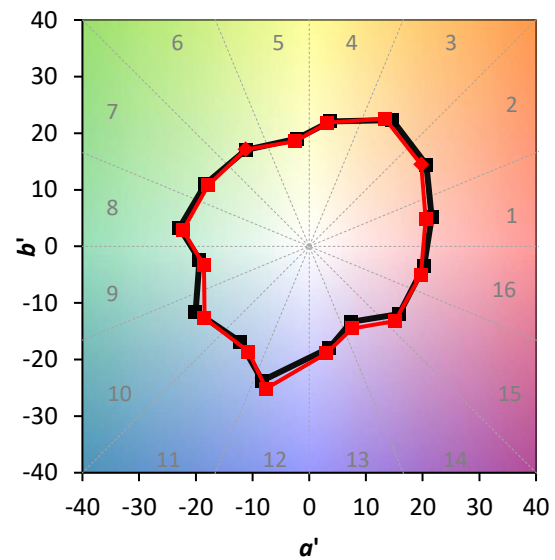
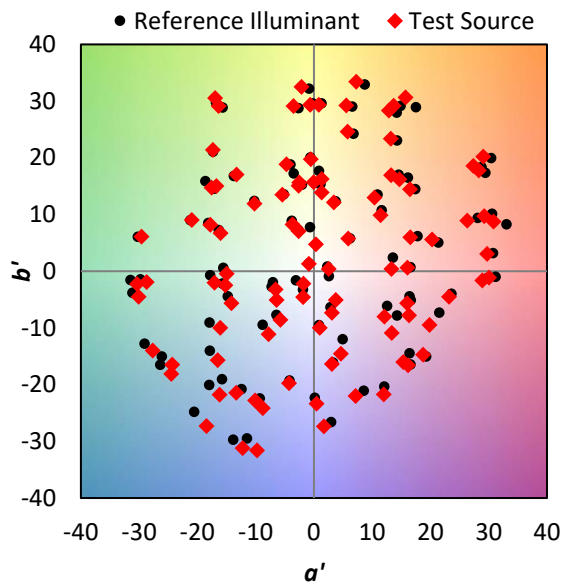


Individual Sample Fidelity Index ($R_{f,i}$)



CES01 = 86	CES26 = 93	CES51 = 96	CES76 = 85
CES02 = 62	CES27 = 90	CES52 = 98	CES77 = 88
CES03 = 31	CES28 = 96	CES53 = 96	CES78 = 82
CES04 = 69	CES29 = 96	CES54 = 92	CES79 = 96
CES05 = 49	CES30 = 90	CES55 = 90	CES80 = 93
CES06 = 50	CES31 = 97	CES56 = 93	CES81 = 89
CES07 = 42	CES32 = 91	CES57 = 91	CES82 = 97
CES08 = 41	CES33 = 98	CES58 = 92	CES83 = 98
CES09 = 29	CES34 = 93	CES59 = 96	CES84 = 93
CES10 = 74	CES35 = 96	CES60 = 91	CES85 = 83
CES11 = 57	CES36 = 79	CES61 = 91	CES86 = 88
CES12 = 63	CES37 = 95	CES62 = 84	CES87 = 91
CES13 = 43	CES38 = 85	CES63 = 91	CES88 = 96
CES14 = 74	CES39 = 99	CES64 = 87	CES89 = 87
CES15 = 71	CES40 = 98	CES65 = 87	CES90 = 96
CES16 = 47	CES41 = 96	CES66 = 84	CES91 = 71
CES17 = 49	CES42 = 95	CES67 = 83	CES92 = 79
CES18 = 56	CES43 = 95	CES68 = 86	CES93 = 87
CES19 = 71	CES44 = 99	CES69 = 87	CES94 = 81
CES20 = 66	CES45 = 98	CES70 = 84	CES95 = 82
CES21 = 85	CES46 = 97	CES71 = 77	CES96 = 91
CES22 = 78	CES47 = 97	CES72 = 93	CES97 = 96
CES23 = 91	CES48 = 90	CES73 = 78	CES98 = 94
CES24 = 90	CES49 = 96	CES74 = 91	CES99 = 91
CES25 = 71	CES50 = 97	CES75 = 80	

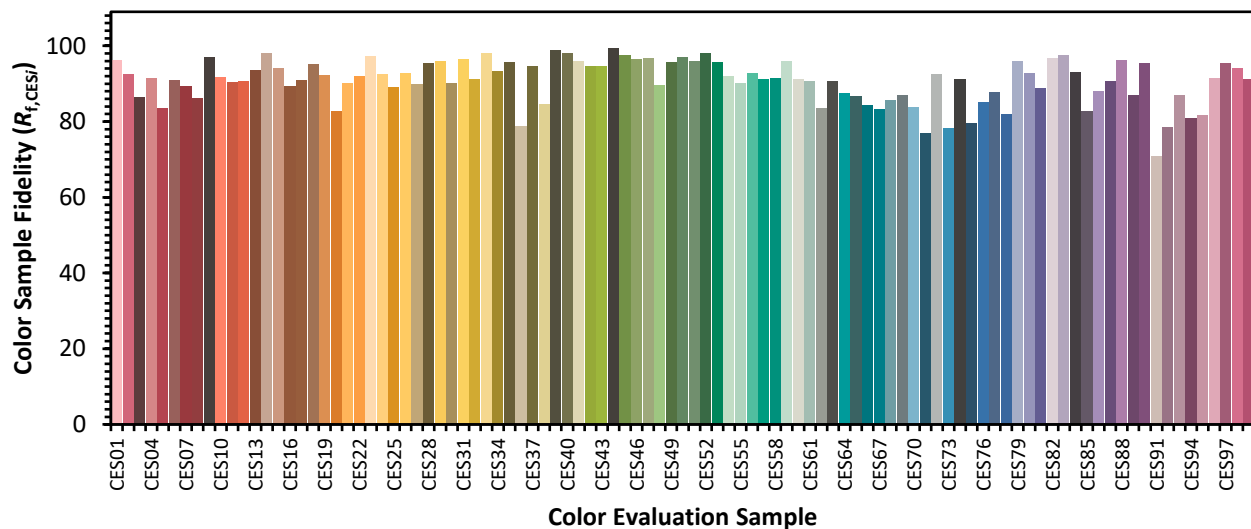

Color Rendition by Hue-Angle Bin

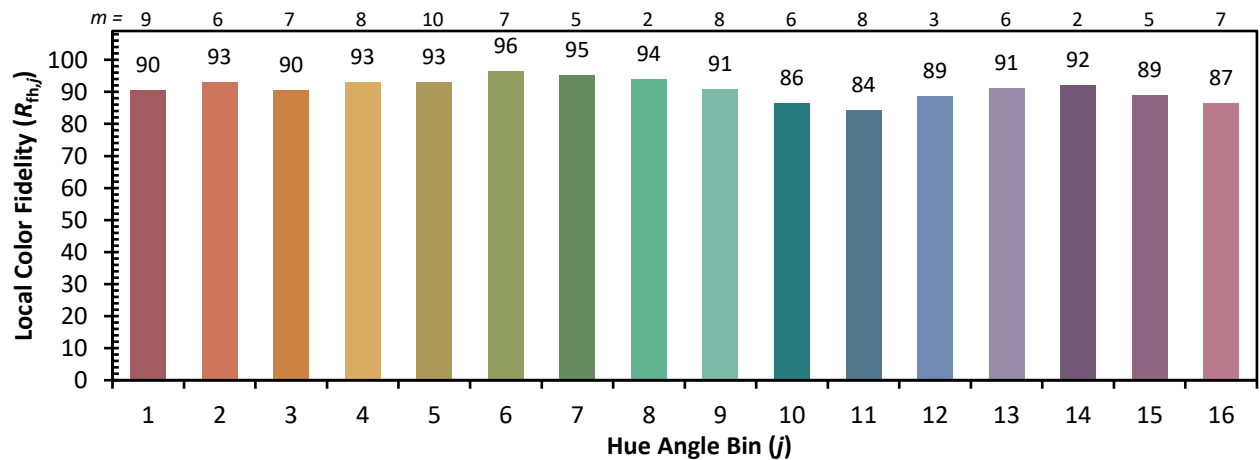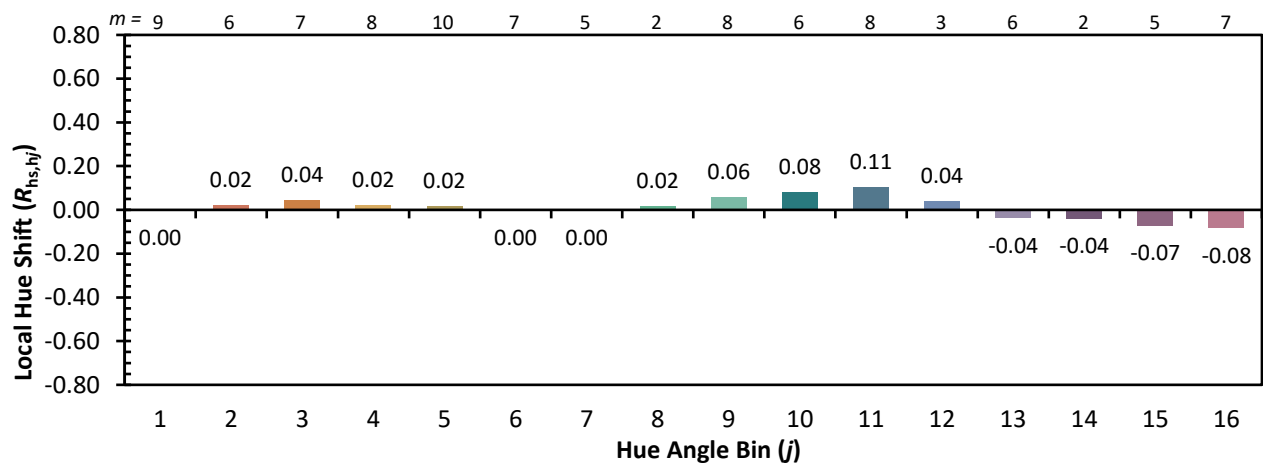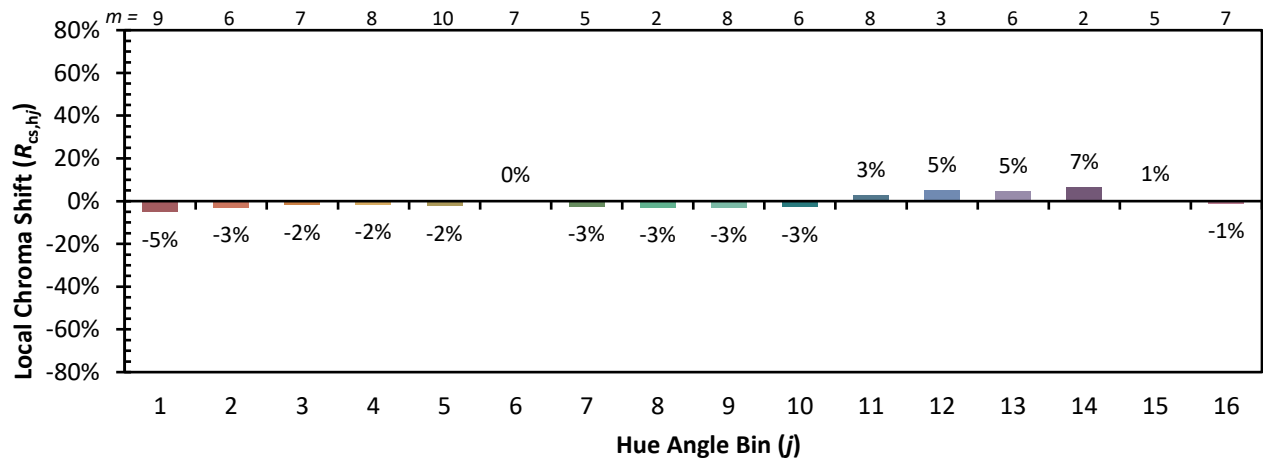

Measure Comparisons

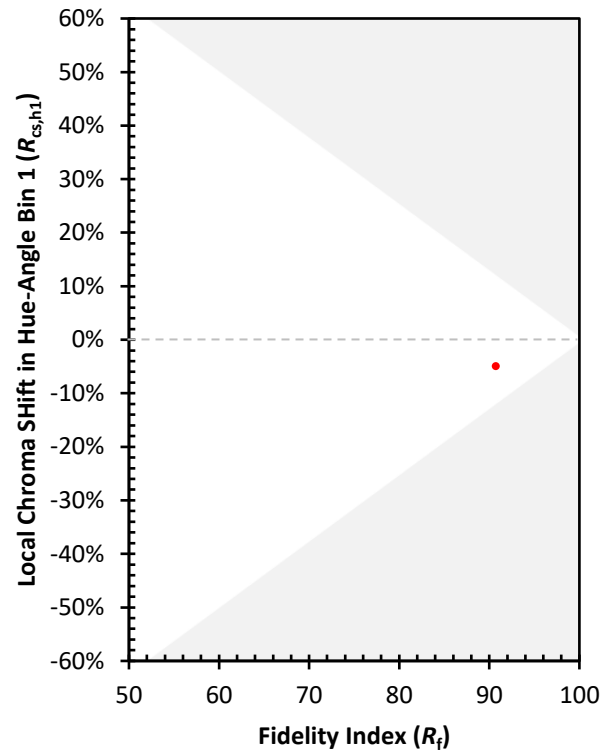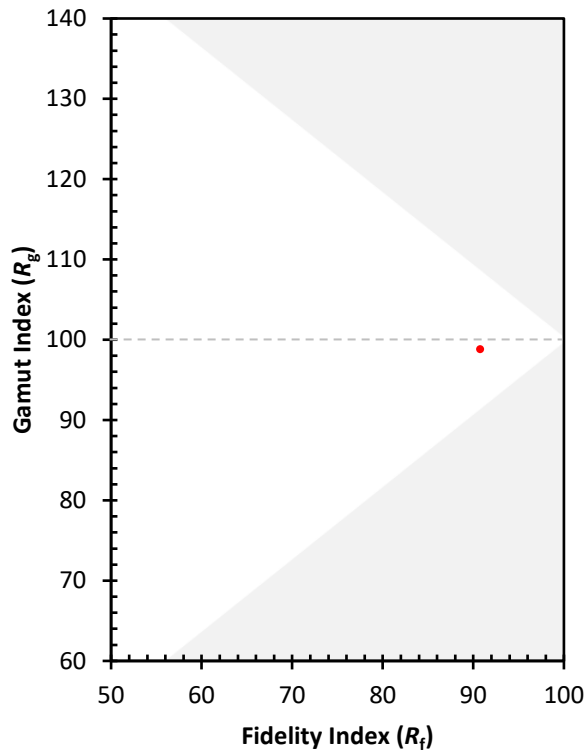

(END OF REPORT)