

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1215572

Luminaire Tested: 24-ID2-50-CFR1-L850-U

Issue Date: 12/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1215572
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2508-510-6)
Test Lab: INNOVATION CENTER
Issue Date: 12/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: 24-ID2-50-CFR1-L850-U
Description: 2X4 IN DEPTH TROFFER WITH 1INCH CUBE REGRESS LENS
Light Source: 5000K CCT, 80 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5436.6 lumens
Efficiency: N/A
Efficacy: 125.8 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.19 / 1.3
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 43.2
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P1215572
CATALOG NUMBER: 24-ID2-50-CFR1-L850-U

Luminous Intensity Polar Plot

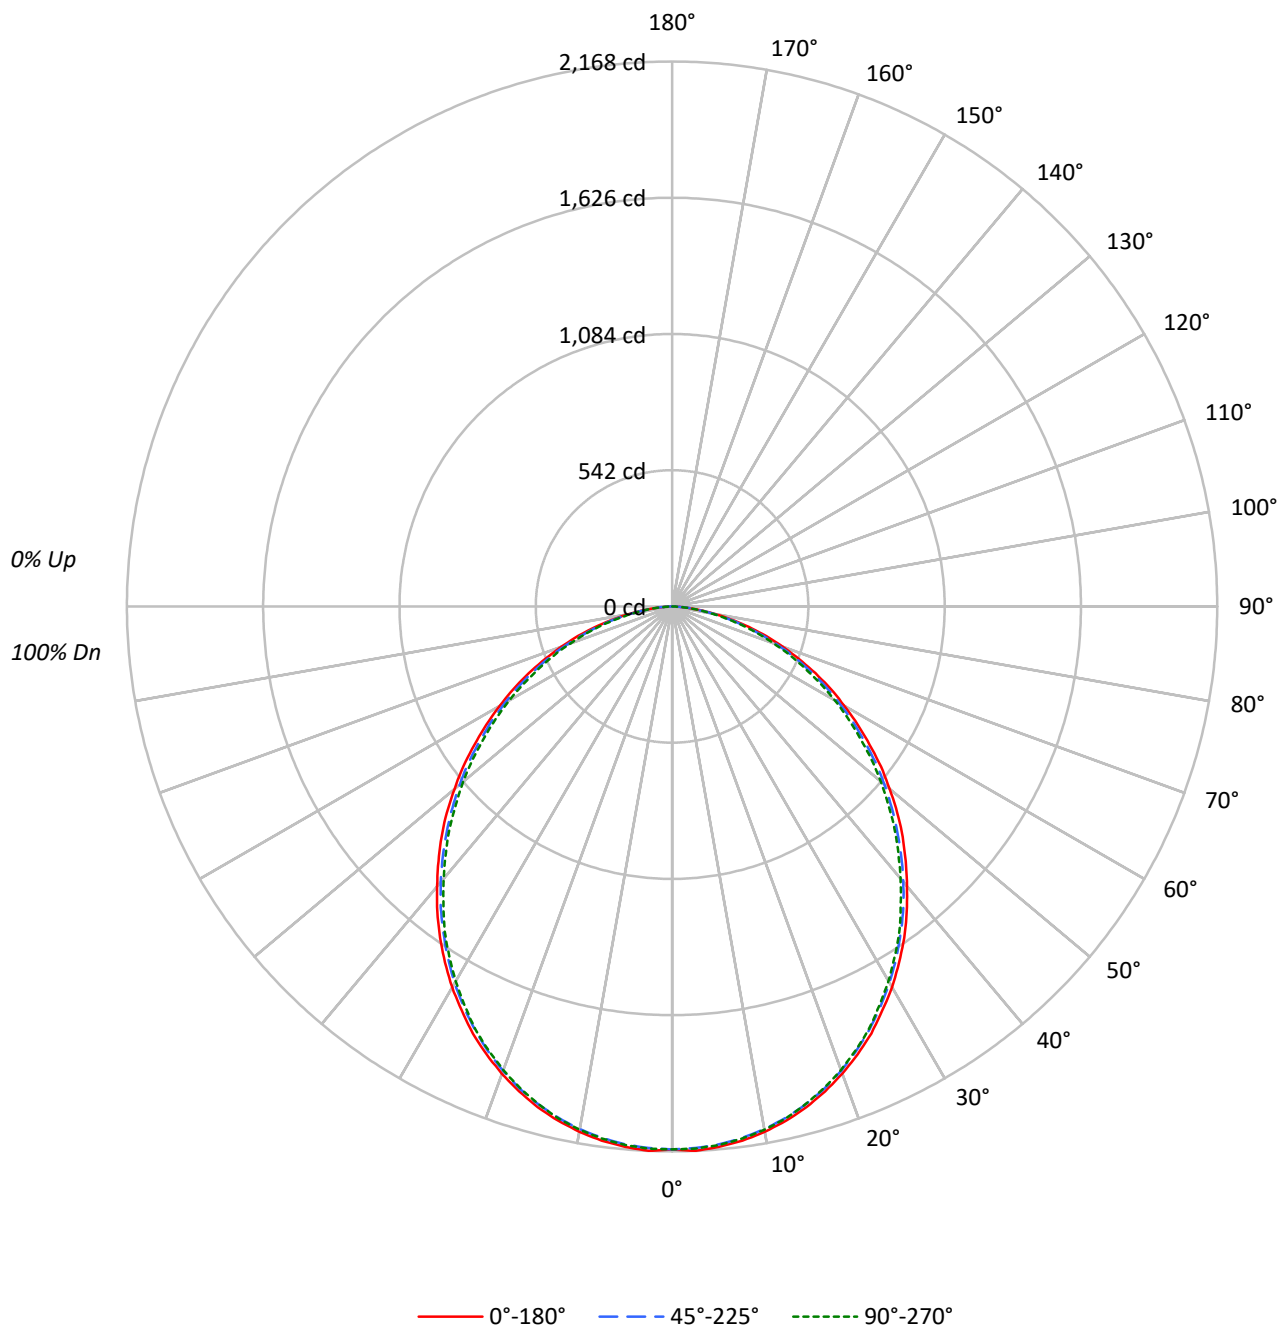

TEST NUMBER: P1215572

CATALOG NUMBER: 24-ID2-50-CFR1-L850-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	109	105	101	97	107	103	99	95	98	95	92		94	92	90		85
2	100	92	85	80	97	90	84	79	86	81	77		83	79	75		71
3	91	81	73	67	89	79	72	66	77	70	65		74	68	64		61
4	84	72	64	57	81	71	63	57	68	61	56		66	60	55		52
5	77	65	56	49	75	64	55	49	61	54	49		59	53	48		45
6	71	58	50	43	70	57	49	43	56	48	43		54	47	42		40
7	66	53	44	38	65	52	44	38	51	43	38		49	43	38		36
8	62	49	40	34	60	48	40	34	47	39	34		45	39	34		32
9	58	45	37	31	56	44	36	31	43	36	31		42	35	31		29
10	54	41	33	28	53	41	33	28	40	33	28		39	32	28		26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2906	2906	2906
5°	2914	2901	2904
10°	2899	2885	2888
15°	2873	2857	2856
20°	2832	2815	2810
25°	2783	2757	2752
30°	2718	2687	2674
35°	2643	2604	2590
40°	2553	2513	2483
45°	2468	2411	2382
50°	2363	2307	2268
55°	2249	2187	2138
60°	2129	2061	2011
65°	2001	1918	1854
70°	1841	1756	1686
75°	1641	1544	1490
80°	1341	1266	1203
85°	940	917	849

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2468 cd/sqm

TEST NUMBER: P1215572
 CATALOG NUMBER: 24-ID2-50-CFR1-L850-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	204.0	3.8
10°-20°	578.4	10.6
20°-30°	855.5	15.7
30°-40°	992.7	18.3
40°-50°	979.8	18.0
50°-60°	836.1	15.4
60°-70°	599.4	11.0
70°-80°	317.6	5.8
80°-90°	73.0	1.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1638.0	30.1
0°-40°	2630.7	48.4
0°-60°	4446.6	81.8
0°-90°	5436.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5436.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2160	2160	2160	2160	2160	
5°	2158	2151	2148	2145	2150	205
15°	2063	2055	2051	2047	2050	581
25°	1875	1866	1857	1851	1854	862
35°	1609	1599	1585	1577	1577	1005
45°	1297	1284	1267	1255	1252	999
55°	959	948	932	919	911	859
65°	628	620	602	591	582	622
75°	316	308	297	290	287	335
85°	61	62	59	56	55	76
90°	0	0	0	0	0	

TEST NUMBER: P1215572

CATALOG NUMBER: 24-ID2-50-CFR1-L850-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2160.0	2160.0	2160.0	2160.0	2160.0
2.5°	2167.5	2159.3	2156.3	2154.1	2158.6
5°	2157.8	2151.1	2148.2	2145.2	2150.4
7.5°	2143.7	2136.3	2132.6	2130.3	2134.8
10°	2122.2	2115.5	2111.8	2109.5	2114.0
12.5°	2095.4	2088.7	2084.3	2082.0	2086.5
15°	2062.7	2054.6	2050.8	2047.1	2050.1
17.5°	2022.6	2016.7	2012.2	2006.3	2009.3
20°	1978.1	1970.6	1966.2	1961.0	1962.5
22.5°	1928.3	1922.3	1914.2	1909.7	1909.7
25°	1874.8	1865.9	1857.0	1851.0	1854.0
27.5°	1811.7	1804.2	1794.6	1786.4	1787.2
30°	1749.3	1739.6	1729.2	1721.8	1721.0
32.5°	1680.2	1673.5	1658.7	1651.2	1649.0
35°	1608.9	1599.2	1585.1	1576.9	1576.9
37.5°	1533.1	1525.0	1510.8	1499.0	1493.8
40°	1453.6	1445.5	1430.6	1418.0	1413.5
42.5°	1374.9	1370.4	1348.9	1338.5	1331.8
45°	1296.9	1284.3	1267.2	1255.3	1251.6
47.5°	1215.2	1204.1	1184.8	1171.4	1165.4
50°	1129.0	1121.6	1102.3	1086.0	1083.7
52.5°	1047.3	1034.7	1019.9	1002.0	999.1
55°	958.9	948.5	932.2	918.8	911.4
57.5°	875.8	867.6	851.2	833.4	829.7
60°	791.1	782.9	765.8	752.4	747.2
62.5°	711.6	699.7	686.3	669.3	664.1
65°	628.4	619.5	602.4	591.3	582.3
67.5°	545.2	538.5	524.4	514.0	508.1
70°	468.0	459.8	446.4	433.8	428.6
72.5°	392.2	381.8	369.2	360.3	358.0
75°	315.7	307.5	297.1	289.7	286.7
77.5°	240.7	237.7	228.8	220.6	217.6
80°	173.1	170.8	163.4	158.2	155.2
82.5°	112.2	110.7	107.7	103.2	102.5
85°	60.9	62.4	59.4	56.5	55.0
87.5°	21.5	20.8	20.1	19.3	17.8
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1215572

CATALOG NUMBER: 24-ID2-50-CFR1-L850-U

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.81	16.40	15.17	16.72	17.03	14.51	16.10	14.88	16.42	16.73
	3H	16.46	17.89	16.83	18.22	18.58	16.10	17.54	16.48	17.86	18.22
	4H	17.04	18.39	17.44	18.74	19.11	16.65	18.00	17.05	18.35	18.72
	6H	17.42	18.67	17.83	19.04	19.43	17.00	18.25	17.41	18.61	19.00
	8H	17.52	18.71	17.95	19.10	19.50	17.09	18.28	17.52	18.67	19.07
	12H	17.57	18.71	18.00	19.09	19.52	17.14	18.28	17.57	18.66	19.09
4H	2H	15.35	16.70	15.75	17.05	17.42	15.11	16.46	15.51	16.81	17.19
	3H	17.21	18.34	17.62	18.73	19.13	16.91	18.03	17.32	18.43	18.83
	4H	17.91	18.93	18.34	19.34	19.78	17.57	18.58	18.00	19.00	19.44
	6H	18.41	19.29	18.86	19.73	20.19	18.02	18.91	18.48	19.35	19.81
	8H	18.54	19.37	19.00	19.81	20.28	18.15	18.98	18.61	19.42	19.88
	12H	18.62	19.36	19.10	19.84	20.31	18.22	18.96	18.70	19.44	19.91
8H	4H	18.14	18.97	18.61	19.41	19.88	17.84	18.66	18.30	19.11	19.57
	6H	18.73	19.42	19.23	19.91	20.38	18.38	19.07	18.88	19.56	20.04
	8H	18.92	19.54	19.43	20.04	20.53	18.56	19.17	19.07	19.68	20.17
	12H	19.05	19.60	19.56	20.09	20.65	18.68	19.22	19.19	19.71	20.28
12H	4H	18.16	18.90	18.64	19.38	19.85	17.86	18.60	18.34	19.08	19.55
	6H	18.76	19.37	19.27	19.88	20.37	18.42	19.03	18.93	19.54	20.03
	8H	18.99	19.53	19.50	20.03	20.59	18.64	19.18	19.15	19.67	20.24

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Corelite

Report Number: SP1-2506-458-7

Test Date: 08/26/2025

Luminaire Tested: 22ID2-55-CFR1-L850-U

Data in this report applies to families of products including 22ID2-55-CFR1-L850-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-458-7
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/27/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Corelite
 Catalog Number: **22ID2-55-CFR1-L850-U**
 Description: 2X2 CGTX WITH INDEPTH FRAME AND CFR1 LENS - 5500 LUMEN 5000K 80CRI

Spectral Parameters

CCT (K): 4966
 CIE u' : 0.2093
 CIE v' : 0.4890
 Duv: 0.0036
 CIE x: 0.3468
 CIE y: 0.3601
 CIE z: 0.2931
 Peak Wavelength (nm): 450
 Dominant Wavelength (nm): 570
 Purity: 12.1135
 R_f: 84
 R_g: 96.2

CRI (Ra): 83.1
 R1: 81.0
 R2: 87.8
 R3: 92.7
 R4: 82.4
 R5: 81.0
 R6: 82.6
 R7: 88.5
 R8: 68.6
 R9: 10.3
 R10: 70.9
 R11: 81.3
 R12: 55.9
 R13: 82.8
 R14: 96.1
 R15: 75.1

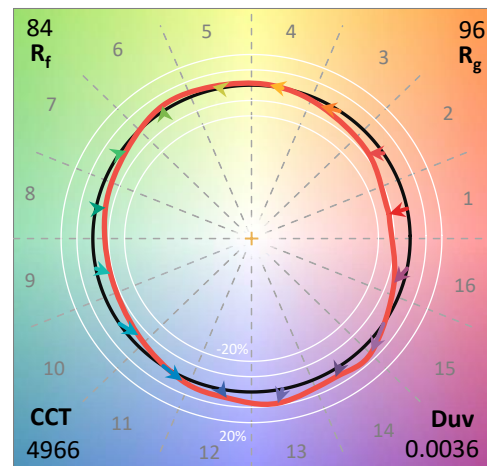

Test Conditions


Stabilization Time: 37M
 Operation Time: 1H 37M
 Sphere Temperature (°C): 25.2

REPORT NUMBER: SP1-2506-458-7


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-458-7

CIE 1931 Chromaticity Diagram

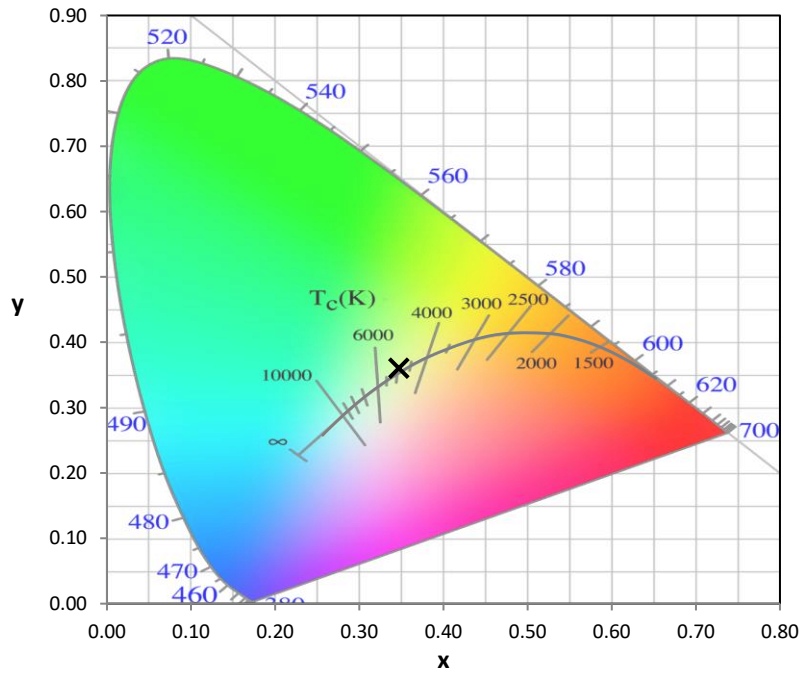


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

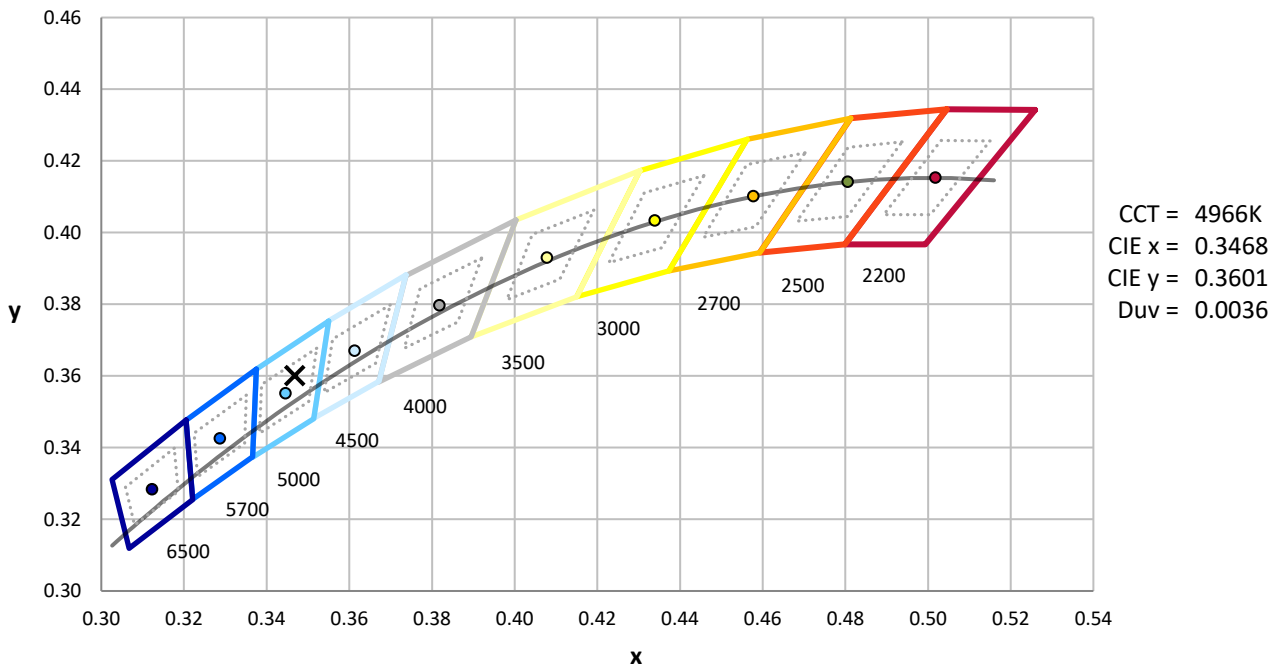

Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-458-7

Photopic Flux vs. Wavelength

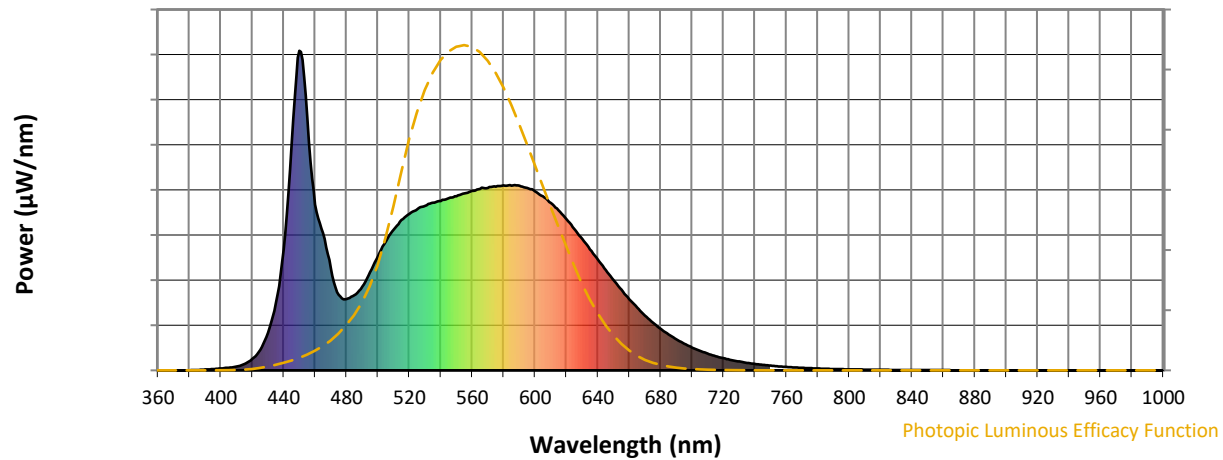


Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	262	NR	620	472	NR	750	15	NR	880	0	NR
365	0	NR	495	307	NR	625	443	NR	755	13	NR	885	0	NR
370	0	NR	500	358	NR	630	412	NR	760	11	NR	890	0	NR
375	0	NR	505	403	NR	635	379	NR	765	9	NR	895	0	NR
380	0	NR	510	440	NR	640	346	NR	770	8	NR	900	0	NR
385	1	NR	515	471	NR	645	313	NR	775	7	NR	905	0	NR
390	3	NR	520	490	NR	650	282	NR	780	6	NR	910	0	NR
395	4	NR	525	504	NR	655	252	NR	785	5	NR	915	0	NR
400	6	NR	530	515	NR	660	223	NR	790	4	NR	920	0	NR
405	9	NR	535	524	NR	665	197	NR	795	4	NR	925	0	NR
410	12	NR	540	530	NR	670	171	NR	800	3	NR	930	0	NR
415	20	NR	545	539	NR	675	149	NR	805	3	NR	935	0	NR
420	36	NR	550	545	NR	680	130	NR	810	2	NR	940	0	NR
425	64	NR	555	554	NR	685	112	NR	815	2	NR	945	0	NR
430	117	NR	560	562	NR	690	97	NR	820	2	NR	950	0	NR
435	212	NR	565	567	NR	695	83	NR	825	2	NR	955	0	NR
440	378	NR	570	571	NR	700	71	NR	830	1	NR	960	0	NR
445	709	NR	575	574	NR	705	61	NR	835	1	NR	965	0	NR
450	1000	NR	580	579	NR	710	52	NR	840	1	NR	970	0	NR
455	789	NR	585	578	NR	715	44	NR	845	1	NR	975	0	NR
460	519	NR	590	578	NR	720	38	NR	850	1	NR	980	0	NR
465	429	NR	595	571	NR	725	32	NR	855	1	NR	985	0	NR
470	316	NR	600	560	NR	730	28	NR	860	1	NR	990	0	NR
475	236	NR	605	545	NR	735	24	NR	865	1	NR	995	0	NR
480	224	NR	610	524	NR	740	20	NR	870	0	NR	1000	0	NR
485	235	NR	615	501	NR	745	17	NR	875	0	NR			

REPORT NUMBER: SP1-2506-458-7

Scotopic Flux vs. Wavelength

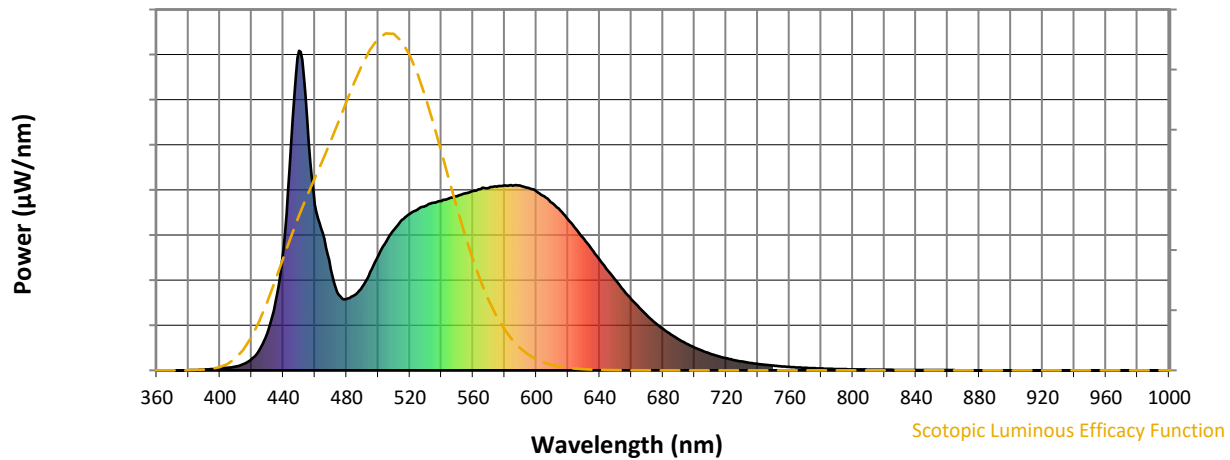


Scotopic Lumens: NR

S/P: 1.94

λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)
360	0	NR	490	262	NR	620	472	NR	750	15	NR	880	0	NR
365	0	NR	495	307	NR	625	443	NR	755	13	NR	885	0	NR
370	0	NR	500	358	NR	630	412	NR	760	11	NR	890	0	NR
375	0	NR	505	403	NR	635	379	NR	765	9	NR	895	0	NR
380	0	NR	510	440	NR	640	346	NR	770	8	NR	900	0	NR
385	1	NR	515	471	NR	645	313	NR	775	7	NR	905	0	NR
390	3	NR	520	490	NR	650	282	NR	780	6	NR	910	0	NR
395	4	NR	525	504	NR	655	252	NR	785	5	NR	915	0	NR
400	6	NR	530	515	NR	660	223	NR	790	4	NR	920	0	NR
405	9	NR	535	524	NR	665	197	NR	795	4	NR	925	0	NR
410	12	NR	540	530	NR	670	171	NR	800	3	NR	930	0	NR
415	20	NR	545	539	NR	675	149	NR	805	3	NR	935	0	NR
420	36	NR	550	545	NR	680	130	NR	810	2	NR	940	0	NR
425	64	NR	555	554	NR	685	112	NR	815	2	NR	945	0	NR
430	117	NR	560	562	NR	690	97	NR	820	2	NR	950	0	NR
435	212	NR	565	567	NR	695	83	NR	825	2	NR	955	0	NR
440	378	NR	570	571	NR	700	71	NR	830	1	NR	960	0	NR
445	709	NR	575	574	NR	705	61	NR	835	1	NR	965	0	NR
450	1000	NR	580	579	NR	710	52	NR	840	1	NR	970	0	NR
455	789	NR	585	578	NR	715	44	NR	845	1	NR	975	0	NR
460	519	NR	590	578	NR	720	38	NR	850	1	NR	980	0	NR
465	429	NR	595	571	NR	725	32	NR	855	1	NR	985	0	NR
470	316	NR	600	560	NR	730	28	NR	860	1	NR	990	0	NR
475	236	NR	605	545	NR	735	24	NR	865	1	NR	995	0	NR
480	224	NR	610	524	NR	740	20	NR	870	0	NR	1000	0	NR
485	235	NR	615	501	NR	745	17	NR	875	0	NR			

REPORT NUMBER: SP1-2506-458-7

Melanopic Flux vs. Wavelength

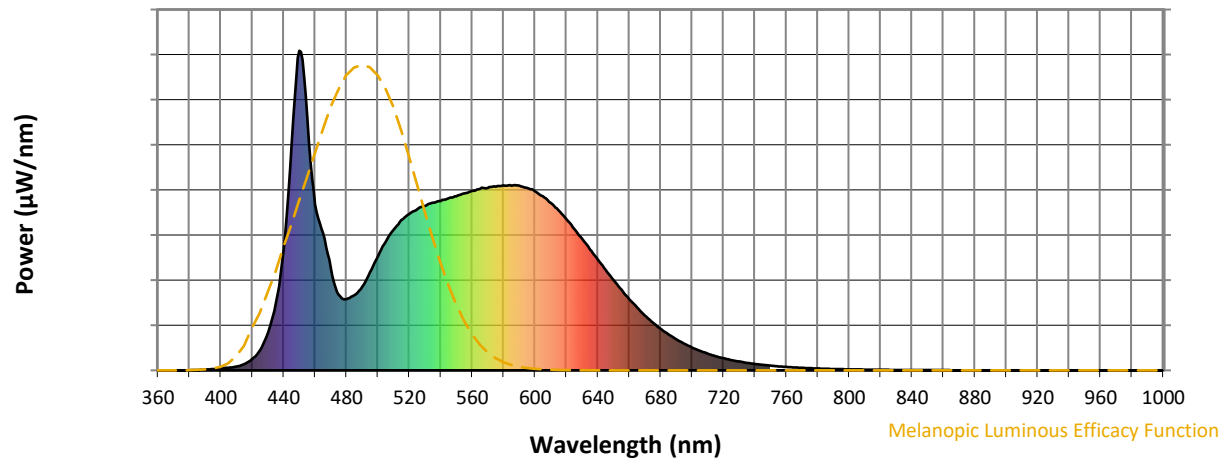

Melanopic Lumens: NR

M/P: 4.11


λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	262	NR	620	472	NR	750	15	NR	880	0	NR
365	0	NR	495	307	NR	625	443	NR	755	13	NR	885	0	NR
370	0	NR	500	358	NR	630	412	NR	760	11	NR	890	0	NR
375	0	NR	505	403	NR	635	379	NR	765	9	NR	895	0	NR
380	0	NR	510	440	NR	640	346	NR	770	8	NR	900	0	NR
385	1	NR	515	471	NR	645	313	NR	775	7	NR	905	0	NR
390	3	NR	520	490	NR	650	282	NR	780	6	NR	910	0	NR
395	4	NR	525	504	NR	655	252	NR	785	5	NR	915	0	NR
400	6	NR	530	515	NR	660	223	NR	790	4	NR	920	0	NR
405	9	NR	535	524	NR	665	197	NR	795	4	NR	925	0	NR
410	12	NR	540	530	NR	670	171	NR	800	3	NR	930	0	NR
415	20	NR	545	539	NR	675	149	NR	805	3	NR	935	0	NR
420	36	NR	550	545	NR	680	130	NR	810	2	NR	940	0	NR
425	64	NR	555	554	NR	685	112	NR	815	2	NR	945	0	NR
430	117	NR	560	562	NR	690	97	NR	820	2	NR	950	0	NR
435	212	NR	565	567	NR	695	83	NR	825	2	NR	955	0	NR
440	378	NR	570	571	NR	700	71	NR	830	1	NR	960	0	NR
445	709	NR	575	574	NR	705	61	NR	835	1	NR	965	0	NR
450	1000	NR	580	579	NR	710	52	NR	840	1	NR	970	0	NR
455	789	NR	585	578	NR	715	44	NR	845	1	NR	975	0	NR
460	519	NR	590	578	NR	720	38	NR	850	1	NR	980	0	NR
465	429	NR	595	571	NR	725	32	NR	855	1	NR	985	0	NR
470	316	NR	600	560	NR	730	28	NR	860	1	NR	990	0	NR
475	236	NR	605	545	NR	735	24	NR	865	1	NR	995	0	NR
480	224	NR	610	524	NR	740	20	NR	870	0	NR	1000	0	NR
485	235	NR	615	501	NR	745	17	NR	875	0	NR			

REPORT NUMBER: SP1-2506-458-7





TM-30-18

Summary

$R_f = 84$
 $R_g = 96.2$
 $CIE R_a = 83.1$
 $R_9 = 10.3$

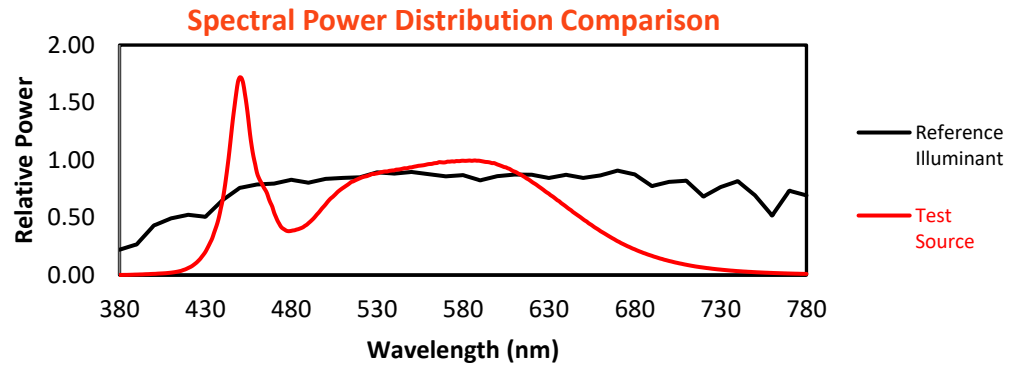


Color Vector Graphics

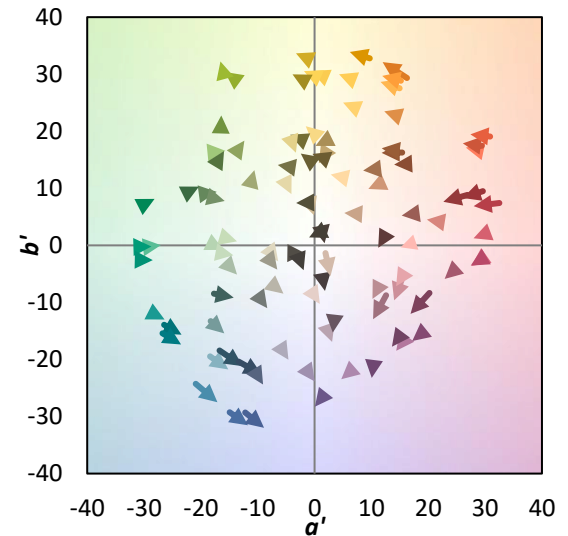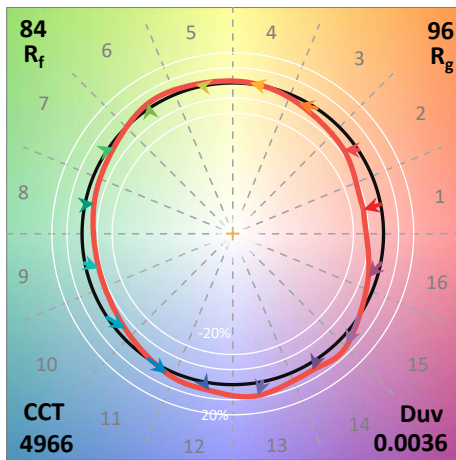
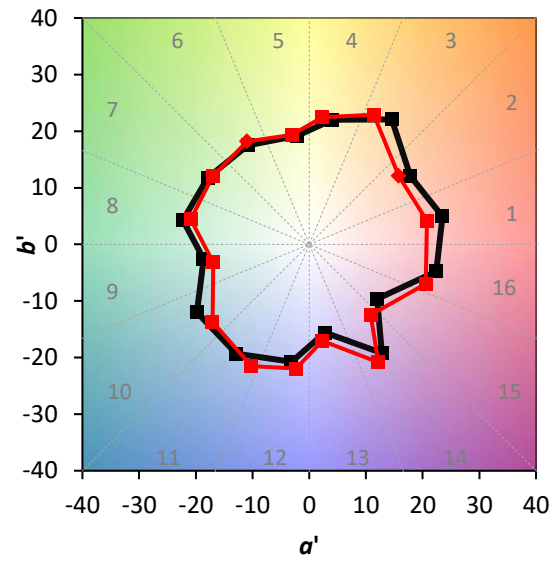
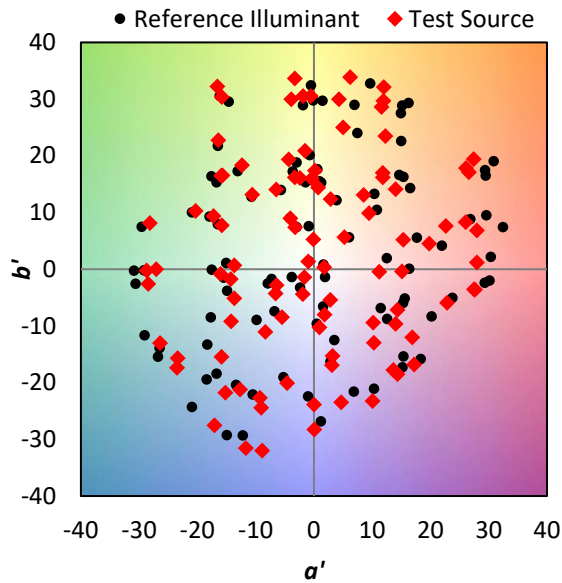


Individual Sample Fidelity Index ($R_{f,i}$)



CES01 = 85	CES26 = 80	CES51 = 95	CES76 = 72
CES02 = 60	CES27 = 93	CES52 = 95	CES77 = 81
CES03 = 30	CES28 = 90	CES53 = 89	CES78 = 71
CES04 = 69	CES29 = 85	CES54 = 90	CES79 = 91
CES05 = 47	CES30 = 97	CES55 = 89	CES80 = 87
CES06 = 50	CES31 = 87	CES56 = 86	CES81 = 84
CES07 = 40	CES32 = 79	CES57 = 85	CES82 = 95
CES08 = 39	CES33 = 92	CES58 = 85	CES83 = 95
CES09 = 29	CES34 = 84	CES59 = 92	CES84 = 90
CES10 = 73	CES35 = 91	CES60 = 91	CES85 = 81
CES11 = 56	CES36 = 83	CES61 = 88	CES86 = 79
CES12 = 62	CES37 = 90	CES62 = 85	CES87 = 84
CES13 = 42	CES38 = 93	CES63 = 85	CES88 = 89
CES14 = 74	CES39 = 98	CES64 = 79	CES89 = 79
CES15 = 71	CES40 = 94	CES65 = 76	CES90 = 89
CES16 = 46	CES41 = 99	CES66 = 75	CES91 = 72
CES17 = 48	CES42 = 89	CES67 = 73	CES92 = 67
CES18 = 55	CES43 = 88	CES68 = 78	CES93 = 80
CES19 = 70	CES44 = 99	CES69 = 82	CES94 = 65
CES20 = 64	CES45 = 93	CES70 = 73	CES95 = 73
CES21 = 85	CES46 = 91	CES71 = 67	CES96 = 84
CES22 = 77	CES47 = 96	CES72 = 89	CES97 = 92
CES23 = 91	CES48 = 87	CES73 = 66	CES98 = 86
CES24 = 90	CES49 = 90	CES74 = 92	CES99 = 77
CES25 = 71	CES50 = 95	CES75 = 68	

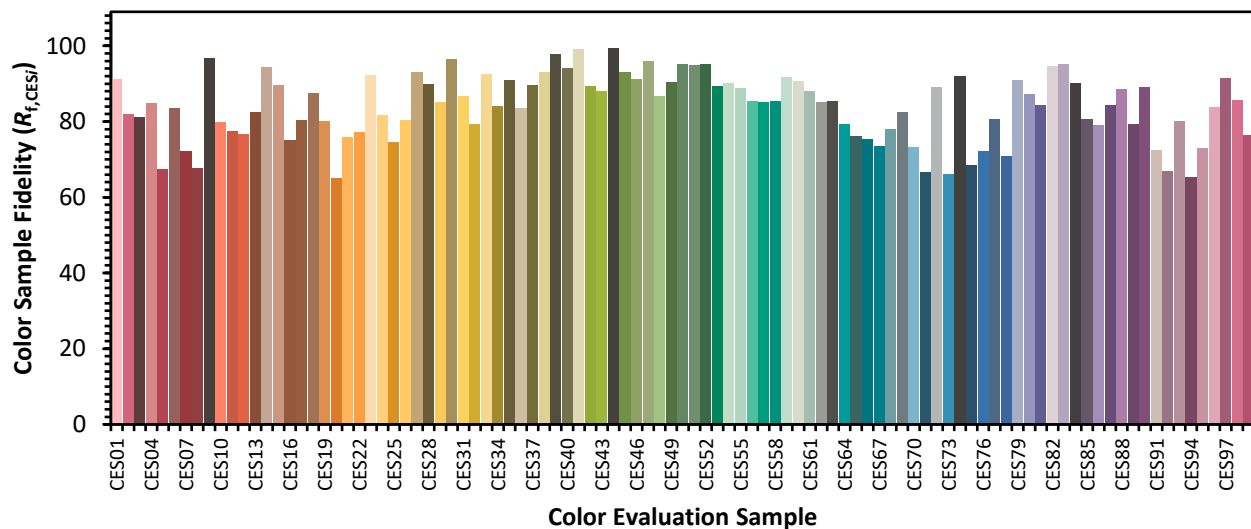

Color Rendition by Hue-Angle Bin

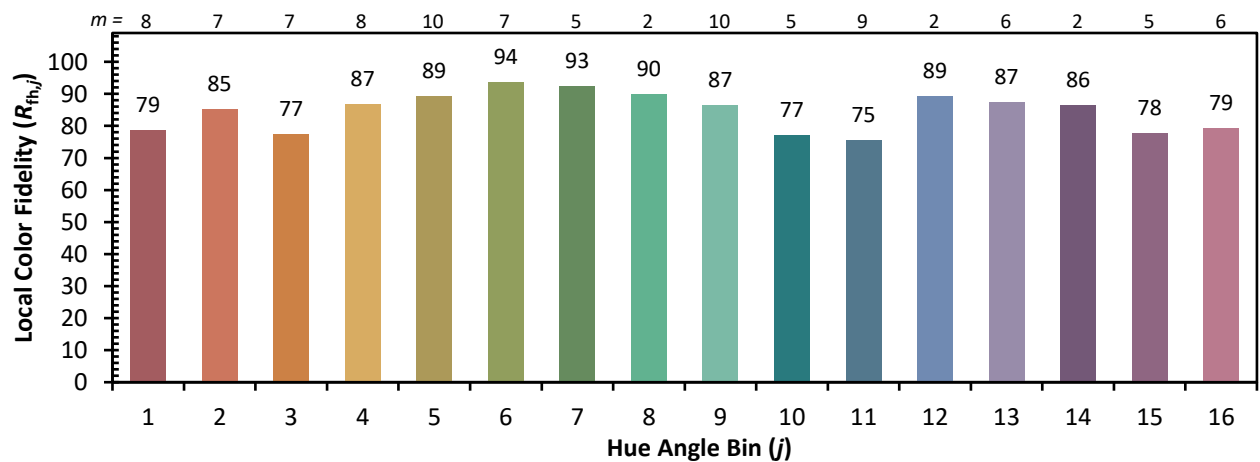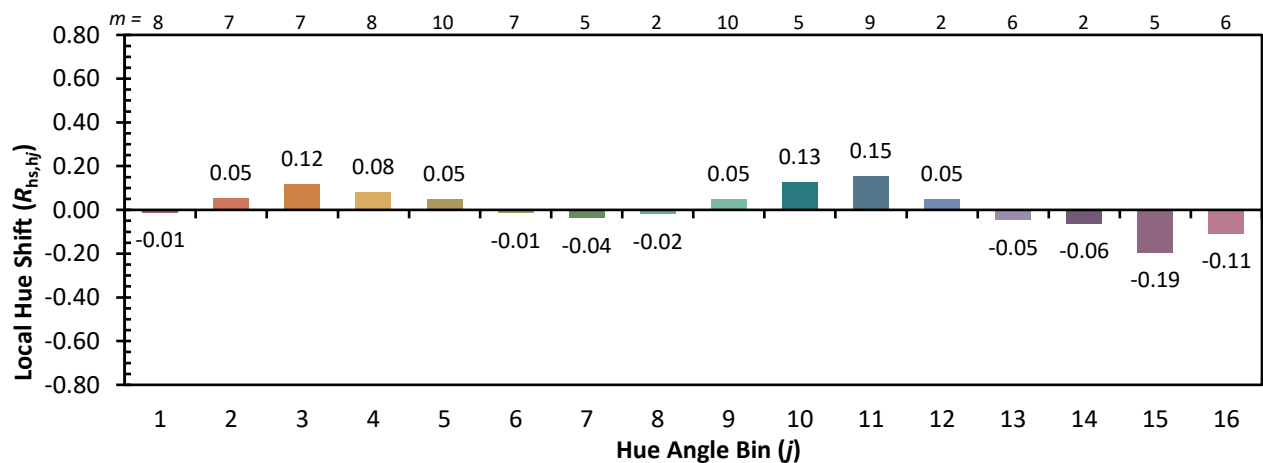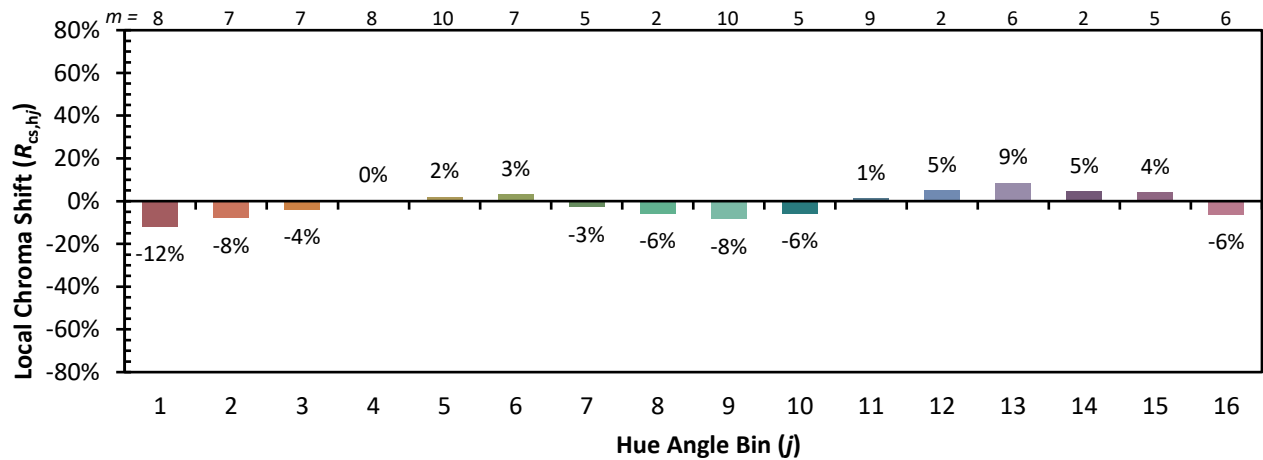

Measure Comparisons

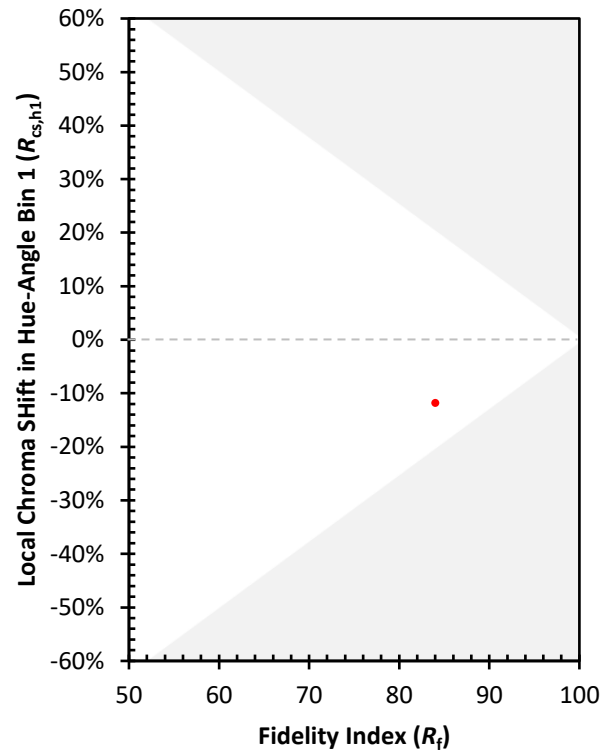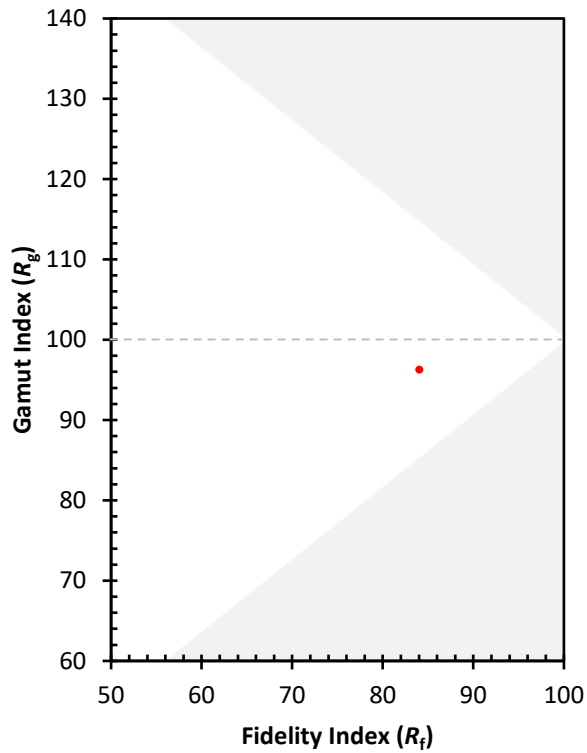

(END OF REPORT)