

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1216310

Luminaire Tested: 24-ID2-60-DBD-L935-U

Issue Date: 12/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1216310
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2508-510-11)
Test Lab: INNOVATION CENTER
Issue Date: 12/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: 24-ID2-60-DBD-L935-U
Description: 2X4 IN DEPTH TROFFER WITH 2INCH DOUBLE BARREL DROP
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5337.3 lumens
Efficiency: N/A
Efficacy: 102.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.21 / 1.31
Luminous Opening: Rectangular w/ Sides (W: 2' x L: 4' x H: 0.15')
CIE Type: Direct

Input Watts (W): 51.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P1216310
CATALOG NUMBER: 24-ID2-60-DBD-L935-U

Luminous Intensity Polar Plot

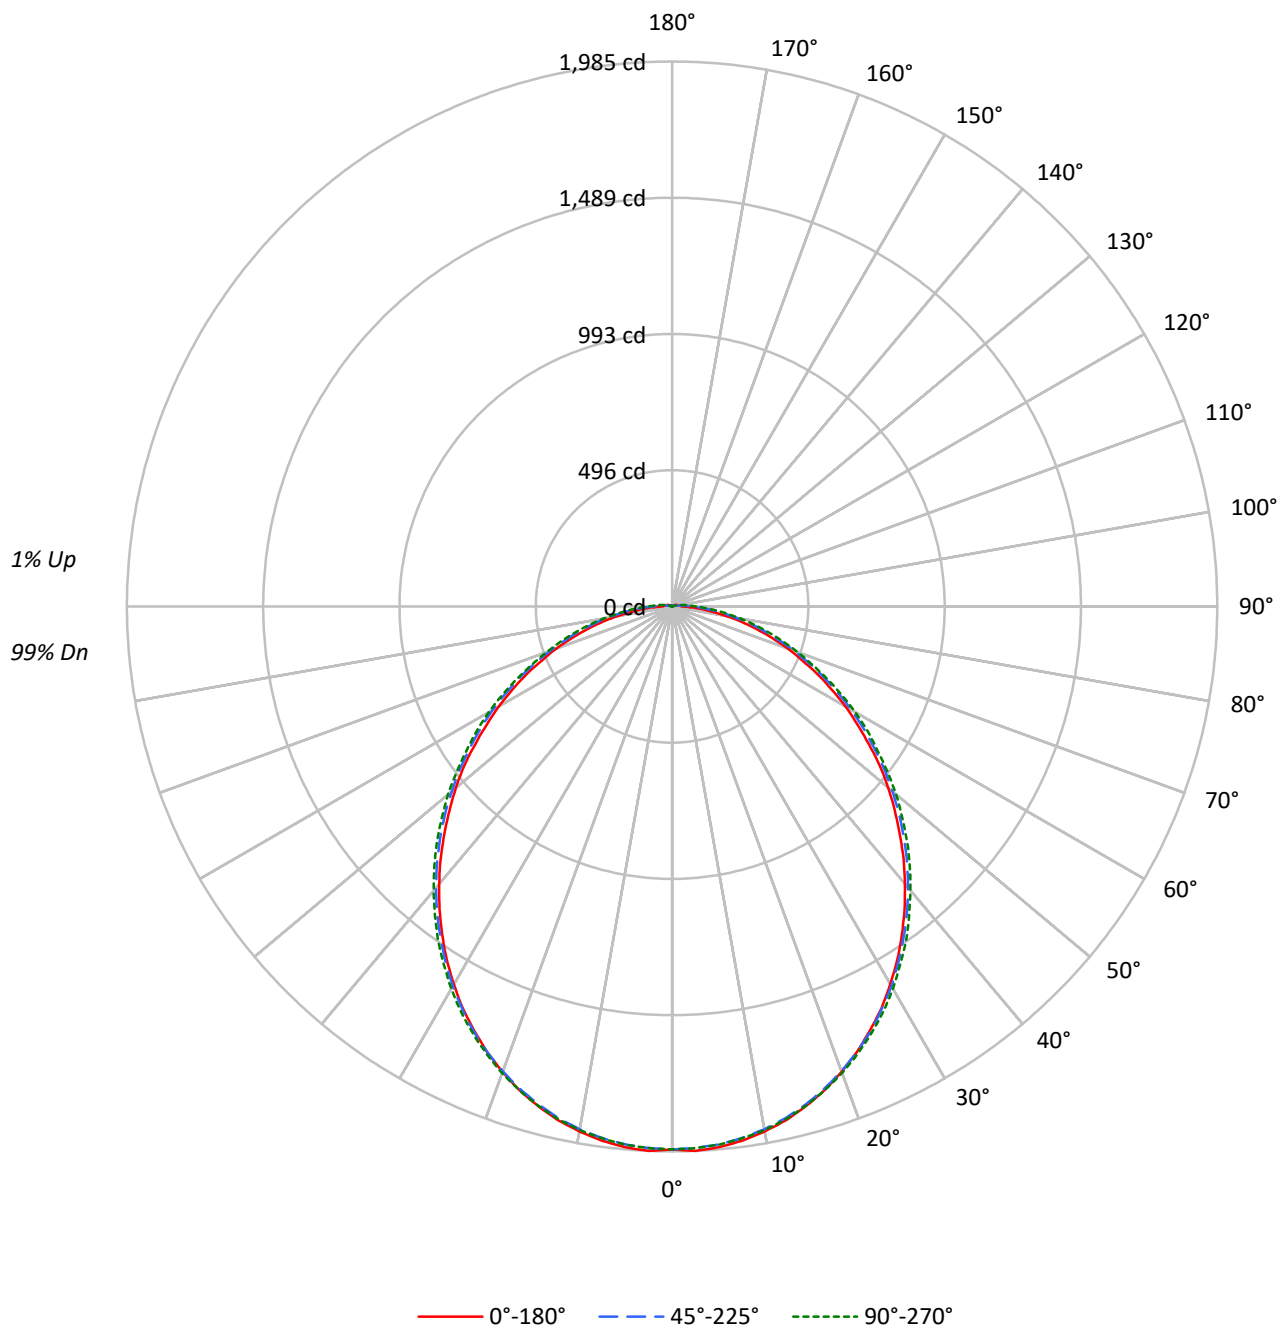

TEST NUMBER: P1216310

CATALOG NUMBER: 24-ID2-60-DBD-L935-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	110	110	110		105	105	105		99
1	108	103	99	95	105	101	97	93	96	93	90		92	90	87		82
2	98	90	83	77	96	88	82	76	84	79	74		81	76	73		68
3	90	79	71	65	87	78	70	64	74	68	63		71	66	61		58
4	82	70	62	55	80	69	61	54	66	59	54		64	58	53		50
5	76	63	54	47	74	62	53	47	60	52	46		57	51	46		43
6	70	57	48	41	68	56	47	41	54	46	41		52	45	40		38
7	65	52	43	37	63	51	42	37	49	42	36		47	41	36		33
8	61	47	39	33	59	46	38	33	45	38	32		44	37	32		30
9	57	43	35	30	55	43	35	29	41	34	29		40	34	29		27
10	53	40	32	27	52	39	32	27	38	31	27		37	31	26		25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2661	2661	2661
5°	2661	2638	2640
10°	2636	2605	2611
15°	2598	2562	2571
20°	2548	2507	2522
25°	2487	2446	2462
30°	2416	2372	2394
35°	2335	2287	2318
40°	2246	2200	2231
45°	2149	2104	2142
50°	2058	2001	2046
55°	1947	1892	1932
60°	1842	1783	1835
65°	1722	1660	1703
70°	1601	1525	1579
75°	1450	1392	1470
80°	1292	1260	1366
85°	1155	1143	1303

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2149 cd/sqm

TEST NUMBER: P1216310
 CATALOG NUMBER: 24-ID2-60-DBD-L935-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	186.8	3.5
10°-20°	529.9	9.9
20°-30°	786.6	14.7
30°-40°	919.7	17.2
40°-50°	920.2	17.2
50°-60°	802.8	15.0
60°-70°	601.1	11.3
70°-80°	366.2	6.9
80°-90°	154.5	2.9
90°-100°	45.6	0.9
100°-110°	14.1	0.3
110°-120°	5.3	0.1
120°-130°	2.7	0.1
130°-140°	1.2	0.0
140°-150°	0.6	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1503.3	28.2
0°-40°	2422.9	45.4
0°-60°	4145.9	77.7
0°-90°	5267.7	98.7
90°-120°	65.1	1.2
90°-150°	69.6	1.3
90°-180°	70.0	1.3
0°-180°	5337.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1978	1978	1978	1978	1978	
5°	1977	1970	1967	1964	1967	188
15°	1884	1880	1878	1879	1882	531
25°	1704	1704	1709	1712	1716	785
35°	1459	1461	1470	1480	1486	912
45°	1172	1179	1194	1206	1210	905
55°	875	880	898	910	912	784
65°	584	592	610	619	621	579
75°	318	330	347	360	362	338
85°	107	122	141	155	157	107
90°	35	54	70	81	84	23
95°	29	29	40	50	54	23
105°	19	15	9	9	11	20
115°	12	10	5	1	0	12
125°	7	6	3	0	0	6
135°	4	3	1	1	0	3
145°	2	2	1	1	1	1
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P1216310

CATALOG NUMBER: 24-ID2-60-DBD-L935-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1977.7	1977.7	1977.7	1977.7	1977.7
2.5°	1985.0	1978.4	1974.0	1971.8	1974.8
5°	1977.0	1970.4	1966.7	1963.8	1967.4
7.5°	1962.3	1955.7	1952.8	1951.3	1954.3
10°	1941.8	1935.2	1933.8	1931.6	1936.7
12.5°	1916.9	1910.3	1908.8	1908.1	1913.2
15°	1883.9	1879.5	1878.1	1878.8	1882.5
17.5°	1848.1	1842.9	1842.2	1843.7	1848.1
20°	1804.1	1801.2	1801.9	1805.6	1809.2
22.5°	1757.2	1754.3	1757.2	1758.7	1764.5
25°	1704.5	1703.8	1708.9	1711.8	1716.2
27.5°	1650.3	1650.3	1653.2	1658.3	1664.9
30°	1588.8	1589.5	1596.8	1601.2	1607.8
32.5°	1526.5	1528.0	1534.6	1541.9	1546.3
35°	1459.1	1460.6	1470.1	1480.3	1485.5
37.5°	1390.3	1393.9	1404.9	1414.4	1418.1
40°	1319.2	1323.6	1336.0	1347.8	1350.0
42.5°	1247.4	1251.8	1266.5	1278.9	1281.1
45°	1172.0	1178.6	1193.9	1206.4	1210.1
47.5°	1099.5	1106.0	1121.4	1134.6	1136.1
50°	1026.9	1031.3	1046.7	1059.2	1065.0
52.5°	954.4	958.8	973.5	988.9	988.1
55°	874.6	880.4	898.0	910.5	911.9
57.5°	799.9	807.9	826.2	838.7	843.1
60°	728.8	735.4	753.7	764.0	770.6
62.5°	654.8	662.9	680.5	692.2	695.1
65°	584.5	591.8	610.2	618.9	621.1
67.5°	512.0	522.3	539.1	550.1	551.6
70°	449.0	456.3	472.5	483.4	484.2
72.5°	380.9	391.1	407.3	420.4	424.1
75°	317.9	329.6	347.2	360.4	361.8
77.5°	257.8	270.3	292.3	305.4	306.2
80°	202.2	216.1	235.9	251.2	251.2
82.5°	150.2	166.3	189.0	202.9	202.2
85°	106.9	121.6	141.4	155.3	156.8
87.5°	66.7	82.0	101.1	112.8	115.7
90°	35.2	53.5	69.6	81.3	84.2
92.5°	32.2	38.8	54.2	65.2	67.4
95°	29.3	28.6	40.3	50.5	53.5
97.5°	26.4	22.0	28.6	37.4	40.3
100°	23.4	19.8	20.5	26.4	28.6
102.5°	21.2	17.6	12.5	16.8	19.0
105°	19.0	15.4	8.8	8.8	11.0
107.5°	16.8	13.9	8.1	3.7	5.1
110°	14.6	12.5	6.6	1.5	0.7

TEST NUMBER: P1216310

CATALOG NUMBER: 24-ID2-60-DBD-L935-U

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	13.2	11.0	5.9	0.7	0.0
115°	11.7	9.5	5.1	0.7	0.0
117.5°	10.3	8.8	4.4	0.0	0.0
120°	8.8	7.3	3.7	0.0	0.0
122.5°	8.1	6.6	2.9	0.0	0.0
125°	6.6	5.9	2.9	0.0	0.0
127.5°	5.9	5.1	2.2	0.0	0.0
130°	5.1	4.4	1.5	0.0	0.0
132.5°	4.4	3.7	1.5	0.0	0.0
135°	3.7	2.9	0.7	0.7	0.0
137.5°	2.9	2.2	0.7	0.7	0.0
140°	2.2	2.2	0.7	0.7	0.0
142.5°	2.2	1.5	0.7	0.7	0.0
145°	1.5	1.5	0.7	0.7	0.7
147.5°	1.5	0.7	0.7	0.7	0.7
150°	0.7	0.7	0.7	0.7	0.7
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1216310

CATALOG NUMBER: 24-ID2-60-DBD-L935-U

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.84	15.43	14.22	15.78	16.12	14.23	15.83	14.62	16.17	16.52
	3H	15.49	16.94	15.89	17.29	17.68	16.00	17.45	16.40	17.80	18.19
	4H	16.10	17.47	16.52	17.84	18.25	16.72	18.08	17.14	18.46	18.87
	6H	16.56	17.82	16.99	18.21	18.64	17.34	18.60	17.77	18.99	19.41
	8H	16.71	17.92	17.15	18.33	18.76	17.59	18.80	18.03	19.21	19.64
	12H	16.82	17.98	17.27	18.39	18.85	17.81	18.97	18.26	19.38	19.84
4H	2H	14.47	15.83	14.89	16.21	16.61	14.78	16.15	15.20	16.52	16.93
	3H	16.34	17.49	16.77	17.91	18.34	16.77	17.92	17.21	18.35	18.78
	4H	17.08	18.12	17.53	18.56	19.03	17.64	18.68	18.09	19.12	19.58
	6H	17.67	18.58	18.14	19.04	19.53	18.40	19.32	18.88	19.78	20.27
	8H	17.87	18.72	18.35	19.19	19.68	18.73	19.58	19.21	20.05	20.54
	12H	18.03	18.80	18.53	19.29	19.79	19.03	19.80	19.53	20.30	20.80
8H	4H	17.43	18.28	17.91	18.75	19.24	17.92	18.77	18.40	19.24	19.74
	6H	18.15	18.86	18.66	19.37	19.88	18.83	19.55	19.34	20.06	20.56
	8H	18.43	19.07	18.96	19.60	20.12	19.25	19.90	19.78	20.43	20.94
	12H	18.67	19.25	19.20	19.76	20.35	19.68	20.25	20.20	20.76	21.35
12H	4H	17.48	18.25	17.98	18.75	19.25	17.95	18.72	18.45	19.22	19.72
	6H	18.24	18.88	18.77	19.41	19.93	18.89	19.53	19.42	20.06	20.58
	8H	18.59	19.16	19.12	19.67	20.26	19.38	19.95	19.91	20.46	21.05

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Corelite

Report Number: SP1-2506-458-10

Test Date: 08/26/2025

Luminaire Tested: 22ID2-55-CFR1-L935-U

Data in this report applies to families of products including 22ID2-55-CFR1-L935-U

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-458-10
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/27/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Corelite
 Catalog Number: **22ID2-55-CFR1-L935-U**
 Description: 2X2 CGTX WITH INDEPTH FRAME AND CFR1 LENS - 5500 LUMEN 3500K 90CRI

Spectral Parameters

CCT (K): 3377
 CIE u' : 0.2392
 CIE v' : 0.5128
 Duv: -0.0007
 CIE x: 0.4116
 CIE y: 0.3922
 CIE z: 0.1962
 Peak Wavelength (nm): 618
 Dominant Wavelength (nm): 581
 Purity: 41.24368
 R_f: 91.8
 R_g: 99.6

CRI (Ra): 93.6
 R1: 94.1
 R2: 96.6
 R3: 97.5
 R4: 94.0
 R5: 93.6
 R6: 94.8
 R7: 93.4
 R8: 84.8
 R9: 64.2
 R10: 91.1
 R11: 94.7
 R12: 78.5
 R13: 95.0
 R14: 98.1
 R15: 91.0



Test Conditions

Stabilization Time: 32M
 Operation Time: 1H 32M
 Sphere Temperature (°C): 25.2

REPORT NUMBER: SP1-2506-458-10

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-458-10

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2506-458-10

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	362	NR	620	996	NR	750	68	NR	880	1	NR
365	0	NR	495	412	NR	625	989	NR	755	58	NR	885	1	NR
370	0	NR	500	463	NR	630	973	NR	760	49	NR	890	1	NR
375	0	NR	505	509	NR	635	947	NR	765	42	NR	895	1	NR
380	0	NR	510	548	NR	640	914	NR	770	36	NR	900	1	NR
385	0	NR	515	582	NR	645	872	NR	775	31	NR	905	1	NR
390	1	NR	520	605	NR	650	822	NR	780	26	NR	910	1	NR
395	2	NR	525	626	NR	655	770	NR	785	22	NR	915	1	NR
400	4	NR	530	646	NR	660	712	NR	790	19	NR	920	0	NR
405	6	NR	535	666	NR	665	656	NR	795	16	NR	925	0	NR
410	9	NR	540	683	NR	670	596	NR	800	14	NR	930	0	NR
415	15	NR	545	702	NR	675	538	NR	805	12	NR	935	0	NR
420	27	NR	550	720	NR	680	486	NR	810	10	NR	940	0	NR
425	48	NR	555	740	NR	685	432	NR	815	9	NR	945	0	NR
430	85	NR	560	757	NR	690	385	NR	820	7	NR	950	0	NR
435	152	NR	565	776	NR	695	339	NR	825	6	NR	955	0	NR
440	274	NR	570	794	NR	700	297	NR	830	5	NR	960	0	NR
445	536	NR	575	816	NR	705	260	NR	835	5	NR	965	0	NR
450	793	NR	580	842	NR	710	225	NR	840	4	NR	970	0	NR
455	659	NR	585	867	NR	715	194	NR	845	3	NR	975	0	NR
460	484	NR	590	899	NR	720	169	NR	850	3	NR	980	0	NR
465	441	NR	595	927	NR	725	146	NR	855	2	NR	985	0	NR
470	353	NR	600	950	NR	730	125	NR	860	2	NR	990	0	NR
475	293	NR	605	974	NR	735	107	NR	865	2	NR	995	0	NR
480	300	NR	610	986	NR	740	92	NR	870	2	NR	1000	0	NR
485	325	NR	615	998	NR	745	79	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-10

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.58

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	362	NR	620	996	NR	750	68	NR	880	1	NR
365	0	NR	495	412	NR	625	989	NR	755	58	NR	885	1	NR
370	0	NR	500	463	NR	630	973	NR	760	49	NR	890	1	NR
375	0	NR	505	509	NR	635	947	NR	765	42	NR	895	1	NR
380	0	NR	510	548	NR	640	914	NR	770	36	NR	900	1	NR
385	0	NR	515	582	NR	645	872	NR	775	31	NR	905	1	NR
390	1	NR	520	605	NR	650	822	NR	780	26	NR	910	1	NR
395	2	NR	525	626	NR	655	770	NR	785	22	NR	915	1	NR
400	4	NR	530	646	NR	660	712	NR	790	19	NR	920	0	NR
405	6	NR	535	666	NR	665	656	NR	795	16	NR	925	0	NR
410	9	NR	540	683	NR	670	596	NR	800	14	NR	930	0	NR
415	15	NR	545	702	NR	675	538	NR	805	12	NR	935	0	NR
420	27	NR	550	720	NR	680	486	NR	810	10	NR	940	0	NR
425	48	NR	555	740	NR	685	432	NR	815	9	NR	945	0	NR
430	85	NR	560	757	NR	690	385	NR	820	7	NR	950	0	NR
435	152	NR	565	776	NR	695	339	NR	825	6	NR	955	0	NR
440	274	NR	570	794	NR	700	297	NR	830	5	NR	960	0	NR
445	536	NR	575	816	NR	705	260	NR	835	5	NR	965	0	NR
450	793	NR	580	842	NR	710	225	NR	840	4	NR	970	0	NR
455	659	NR	585	867	NR	715	194	NR	845	3	NR	975	0	NR
460	484	NR	590	899	NR	720	169	NR	850	3	NR	980	0	NR
465	441	NR	595	927	NR	725	146	NR	855	2	NR	985	0	NR
470	353	NR	600	950	NR	730	125	NR	860	2	NR	990	0	NR
475	293	NR	605	974	NR	735	107	NR	865	2	NR	995	0	NR
480	300	NR	610	986	NR	740	92	NR	870	2	NR	1000	0	NR
485	325	NR	615	998	NR	745	79	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-10

Melanopic Flux vs. Wavelength


Melanopic Lumens: NR
M/P: 3.19

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	362	NR	620	996	NR	750	68	NR	880	1	NR
365	0	NR	495	412	NR	625	989	NR	755	58	NR	885	1	NR
370	0	NR	500	463	NR	630	973	NR	760	49	NR	890	1	NR
375	0	NR	505	509	NR	635	947	NR	765	42	NR	895	1	NR
380	0	NR	510	548	NR	640	914	NR	770	36	NR	900	1	NR
385	0	NR	515	582	NR	645	872	NR	775	31	NR	905	1	NR
390	1	NR	520	605	NR	650	822	NR	780	26	NR	910	1	NR
395	2	NR	525	626	NR	655	770	NR	785	22	NR	915	1	NR
400	4	NR	530	646	NR	660	712	NR	790	19	NR	920	0	NR
405	6	NR	535	666	NR	665	656	NR	795	16	NR	925	0	NR
410	9	NR	540	683	NR	670	596	NR	800	14	NR	930	0	NR
415	15	NR	545	702	NR	675	538	NR	805	12	NR	935	0	NR
420	27	NR	550	720	NR	680	486	NR	810	10	NR	940	0	NR
425	48	NR	555	740	NR	685	432	NR	815	9	NR	945	0	NR
430	85	NR	560	757	NR	690	385	NR	820	7	NR	950	0	NR
435	152	NR	565	776	NR	695	339	NR	825	6	NR	955	0	NR
440	274	NR	570	794	NR	700	297	NR	830	5	NR	960	0	NR
445	536	NR	575	816	NR	705	260	NR	835	5	NR	965	0	NR
450	793	NR	580	842	NR	710	225	NR	840	4	NR	970	0	NR
455	659	NR	585	867	NR	715	194	NR	845	3	NR	975	0	NR
460	484	NR	590	899	NR	720	169	NR	850	3	NR	980	0	NR
465	441	NR	595	927	NR	725	146	NR	855	2	NR	985	0	NR
470	353	NR	600	950	NR	730	125	NR	860	2	NR	990	0	NR
475	293	NR	605	974	NR	735	107	NR	865	2	NR	995	0	NR
480	300	NR	610	986	NR	740	92	NR	870	2	NR	1000	0	NR
485	325	NR	615	998	NR	745	79	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-10

TM-30-18

Summary

$R_f = 91.8$
 $R_g = 99.6$
 $CIE R_a = 93.6$
 $R_9 = 64.2$



Color Vector Graphics



Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 94	CES51 = 97	CES76 = 88
CES02 = 62	CES27 = 92	CES52 = 99	CES77 = 89
CES03 = 31	CES28 = 96	CES53 = 97	CES78 = 85
CES04 = 70	CES29 = 96	CES54 = 93	CES79 = 95
CES05 = 50	CES30 = 92	CES55 = 92	CES80 = 93
CES06 = 51	CES31 = 97	CES56 = 95	CES81 = 86
CES07 = 43	CES32 = 91	CES57 = 93	CES82 = 97
CES08 = 42	CES33 = 99	CES58 = 94	CES83 = 97
CES09 = 29	CES34 = 94	CES59 = 97	CES84 = 94
CES10 = 75	CES35 = 96	CES60 = 92	CES85 = 83
CES11 = 58	CES36 = 82	CES61 = 92	CES86 = 86
CES12 = 64	CES37 = 95	CES62 = 87	CES87 = 91
CES13 = 43	CES38 = 87	CES63 = 93	CES88 = 97
CES14 = 74	CES39 = 99	CES64 = 90	CES89 = 87
CES15 = 72	CES40 = 98	CES65 = 89	CES90 = 96
CES16 = 48	CES41 = 97	CES66 = 88	CES91 = 75
CES17 = 50	CES42 = 95	CES67 = 87	CES92 = 80
CES18 = 56	CES43 = 94	CES68 = 88	CES93 = 88
CES19 = 71	CES44 = 99	CES69 = 89	CES94 = 81
CES20 = 67	CES45 = 97	CES70 = 86	CES95 = 84
CES21 = 86	CES46 = 97	CES71 = 82	CES96 = 92
CES22 = 78	CES47 = 96	CES72 = 94	CES97 = 96
CES23 = 91	CES48 = 92	CES73 = 82	CES98 = 95
CES24 = 90	CES49 = 96	CES74 = 92	CES99 = 92
CES25 = 71	CES50 = 98	CES75 = 84	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)