

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1216312

Luminaire Tested: 24-ID2-60-DBD-L950-U

Issue Date: 12/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1216312
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2508-510-11)
Test Lab: INNOVATION CENTER
Issue Date: 12/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: 24-ID2-60-DBD-L950-U
Description: 2X4 IN DEPTH TROFFER WITH 2INCH DOUBLE BARREL DROP
Light Source: 5000K CCT, 90 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5464.1 lumens
Efficiency: N/A
Efficacy: 105.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.21 / 1.31
Luminous Opening: Rectangular w/ Sides (W: 2' x L: 4' x H: 0.15')
CIE Type: Direct

Input Watts (W): 51.9
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P1216312
CATALOG NUMBER: 24-ID2-60-DBD-L950-U

Luminous Intensity Polar Plot

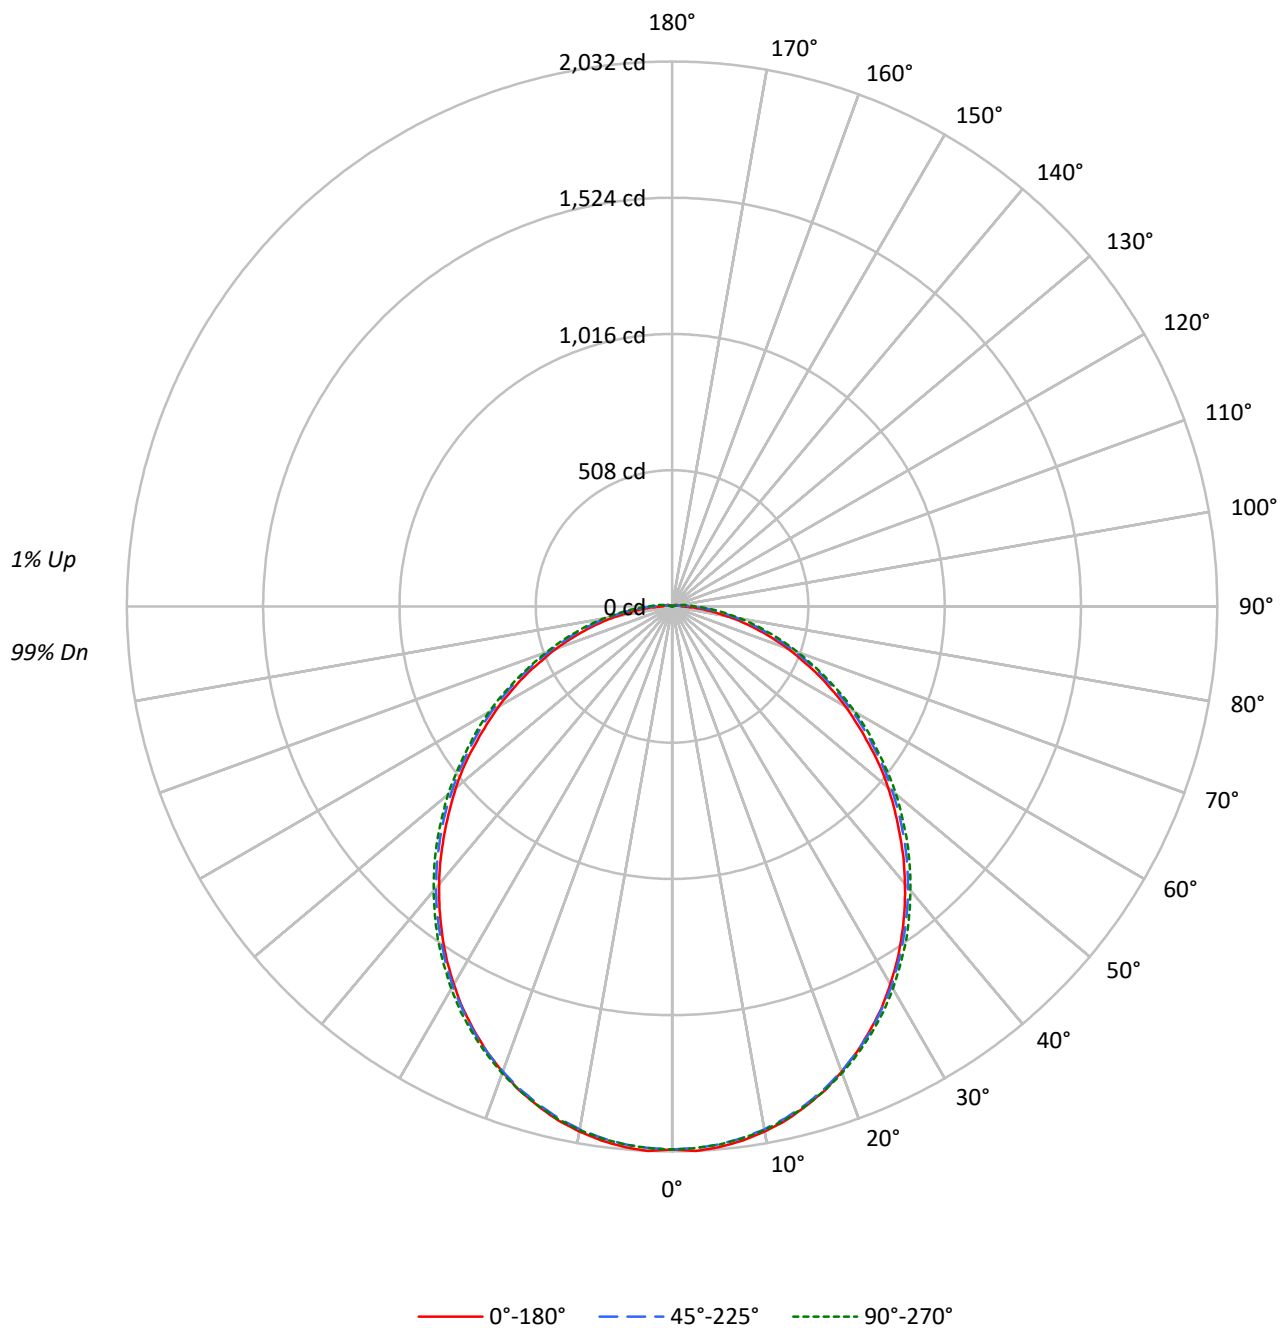

TEST NUMBER: P1216312

CATALOG NUMBER: 24-ID2-60-DBD-L950-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	0
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			99
1	108	103	99	95	105	101	97	93	96	93	90	92	90	87	88	86	84			82
2	98	90	83	77	96	88	82	76	84	79	74	81	76	73	78	74	71			68
3	90	79	71	65	87	78	70	64	74	68	63	71	66	61	69	64	60			58
4	82	70	62	55	80	69	61	54	66	59	54	64	58	53	61	56	52			50
5	76	63	54	47	74	62	53	47	60	52	46	57	51	46	55	50	45			43
6	70	57	48	41	68	56	47	41	54	46	41	52	45	40	50	44	40			38
7	65	52	43	37	63	51	42	37	49	42	36	47	41	36	46	40	35			33
8	61	47	39	33	59	46	38	33	45	38	32	44	37	32	42	36	32			30
9	57	43	35	30	55	43	35	29	41	34	29	40	34	29	39	33	29			27
10	53	40	32	27	52	39	32	27	38	31	27	37	31	26	36	31	26			25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2724	2724	2724
5°	2725	2701	2703
10°	2698	2667	2673
15°	2660	2622	2632
20°	2609	2567	2582
25°	2546	2504	2520
30°	2473	2428	2451
35°	2391	2342	2373
40°	2300	2252	2284
45°	2200	2154	2193
50°	2107	2049	2095
55°	1994	1937	1978
60°	1886	1825	1879
65°	1763	1699	1744
70°	1640	1562	1617
75°	1484	1425	1505
80°	1323	1289	1398
85°	1183	1170	1334

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2200 cd/sqm

TEST NUMBER: P1216312
 CATALOG NUMBER: 24-ID2-60-DBD-L950-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	191.3	3.5
10°-20°	542.5	9.9
20°-30°	805.3	14.7
30°-40°	941.6	17.2
40°-50°	942.0	17.2
50°-60°	821.9	15.0
60°-70°	615.4	11.3
70°-80°	374.9	6.9
80°-90°	158.1	2.9
90°-100°	46.7	0.9
100°-110°	14.4	0.3
110°-120°	5.4	0.1
120°-130°	2.7	0.1
130°-140°	1.2	0.0
140°-150°	0.6	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1539.0	28.2
0°-40°	2480.6	45.4
0°-60°	4244.5	77.7
0°-90°	5393.0	98.7
90°-120°	66.5	1.2
90°-150°	71.1	1.3
90°-180°	71.0	1.3
0°-180°	5464.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2025	2025	2025	2025	2025	
5°	2024	2017	2014	2010	2014	192
15°	1929	1924	1923	1924	1927	544
25°	1745	1744	1750	1752	1757	804
35°	1494	1495	1505	1516	1521	934
45°	1200	1207	1222	1235	1239	927
55°	895	901	919	932	934	803
65°	598	606	625	634	636	593
75°	326	338	356	369	370	346
85°	110	124	145	159	160	109
90°	36	55	71	83	86	24
95°	30	29	41	52	55	23
105°	20	16	9	9	11	21
115°	12	10	5	1	0	12
125°	7	6	3	0	0	6
135°	4	3	1	1	0	3
145°	2	2	1	1	1	1
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P1216312

CATALOG NUMBER: 24-ID2-60-DBD-L950-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2024.7	2024.7	2024.7	2024.7	2024.7
2.5°	2032.2	2025.5	2021.0	2018.7	2021.7
5°	2024.0	2017.2	2013.5	2010.5	2014.2
7.5°	2009.0	2002.2	1999.2	1997.7	2000.7
10°	1988.0	1981.2	1979.7	1977.5	1982.7
12.5°	1962.5	1955.7	1954.2	1953.5	1958.7
15°	1928.7	1924.2	1922.7	1923.5	1927.2
17.5°	1892.0	1886.8	1886.0	1887.5	1892.0
20°	1847.0	1844.0	1844.8	1848.5	1852.3
22.5°	1799.0	1796.0	1799.0	1800.5	1806.5
25°	1745.0	1744.3	1749.5	1752.5	1757.0
27.5°	1689.5	1689.5	1692.5	1697.8	1704.5
30°	1626.5	1627.3	1634.8	1639.3	1646.0
32.5°	1562.8	1564.3	1571.0	1578.5	1583.0
35°	1493.8	1495.3	1505.1	1515.5	1520.8
37.5°	1423.3	1427.1	1438.3	1448.1	1451.8
40°	1350.6	1355.1	1367.8	1379.8	1382.1
42.5°	1277.1	1281.6	1296.6	1309.3	1311.6
45°	1199.8	1206.6	1222.3	1235.1	1238.8
47.5°	1125.6	1132.4	1148.1	1161.6	1163.1
50°	1051.4	1055.9	1071.6	1084.4	1090.4
52.5°	977.1	981.6	996.6	1012.4	1011.6
55°	895.4	901.4	919.4	932.1	933.6
57.5°	818.9	827.1	845.9	858.6	863.1
60°	746.2	752.9	771.6	782.1	788.9
62.5°	670.4	678.7	696.7	708.7	711.7
65°	598.4	605.9	624.7	633.7	635.9
67.5°	524.2	534.7	551.9	563.2	564.7
70°	459.7	467.2	483.7	494.9	495.7
72.5°	389.9	400.4	416.9	430.4	434.2
75°	325.5	337.5	355.5	369.0	370.5
77.5°	264.0	276.7	299.2	312.7	313.5
80°	207.0	221.2	241.5	257.2	257.2
82.5°	153.7	170.2	193.5	207.7	207.0
85°	109.5	124.5	144.7	159.0	160.5
87.5°	68.2	84.0	103.5	115.5	118.5
90°	36.0	54.7	71.2	83.2	86.2
92.5°	33.0	39.7	55.5	66.7	69.0
95°	30.0	29.2	41.2	51.7	54.7
97.5°	27.0	22.5	29.2	38.2	41.2
100°	24.0	20.2	21.0	27.0	29.2
102.5°	21.7	18.0	12.7	17.2	19.5
105°	19.5	15.7	9.0	9.0	11.2
107.5°	17.2	14.2	8.2	3.7	5.2
110°	15.0	12.7	6.7	1.5	0.7

TEST NUMBER: P1216312

CATALOG NUMBER: 24-ID2-60-DBD-L950-U

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	13.5	11.2	6.0	0.7	0.0
115°	12.0	9.7	5.2	0.7	0.0
117.5°	10.5	9.0	4.5	0.0	0.0
120°	9.0	7.5	3.7	0.0	0.0
122.5°	8.2	6.7	3.0	0.0	0.0
125°	6.7	6.0	3.0	0.0	0.0
127.5°	6.0	5.2	2.2	0.0	0.0
130°	5.2	4.5	1.5	0.0	0.0
132.5°	4.5	3.7	1.5	0.0	0.0
135°	3.7	3.0	0.7	0.7	0.0
137.5°	3.0	2.2	0.7	0.7	0.0
140°	2.2	2.2	0.7	0.7	0.0
142.5°	2.2	1.5	0.7	0.7	0.0
145°	1.5	1.5	0.7	0.7	0.7
147.5°	1.5	0.7	0.7	0.7	0.7
150°	0.7	0.7	0.7	0.7	0.7
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1216312

CATALOG NUMBER: 24-ID2-60-DBD-L950-U

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.92	15.51	14.30	15.86	16.20	14.31	15.91	14.70	16.25	16.60
	3H	15.57	17.02	15.97	17.37	17.77	16.08	17.53	16.48	17.88	18.27
	4H	16.19	17.55	16.60	17.92	18.33	16.80	18.16	17.22	18.54	18.95
	6H	16.64	17.91	17.07	18.30	18.72	17.42	18.68	17.85	19.07	19.50
	8H	16.79	18.00	17.24	18.41	18.85	17.67	18.88	18.11	19.29	19.72
	12H	16.90	18.06	17.35	18.47	18.93	17.90	19.05	18.35	19.46	19.92
4H	2H	14.55	15.91	14.97	16.29	16.70	14.86	16.23	15.28	16.60	17.01
	3H	16.42	17.57	16.85	17.99	18.42	16.86	18.00	17.29	18.43	18.86
	4H	17.16	18.20	17.62	18.64	19.11	17.72	18.76	18.17	19.20	19.66
	6H	17.75	18.66	18.22	19.12	19.61	18.49	19.40	18.96	19.86	20.35
	8H	17.95	18.80	18.43	19.27	19.77	18.81	19.66	19.29	20.13	20.62
	12H	18.11	18.88	18.61	19.38	19.88	19.11	19.88	19.61	20.38	20.88
8H	4H	17.51	18.37	17.99	18.83	19.33	18.00	18.86	18.48	19.32	19.82
	6H	18.23	18.94	18.74	19.46	19.96	18.91	19.63	19.43	20.14	20.64
	8H	18.51	19.16	19.04	19.68	20.20	19.34	19.98	19.86	20.51	21.02
	12H	18.76	19.33	19.28	19.84	20.43	19.76	20.33	20.28	20.84	21.43
12H	4H	17.56	18.33	18.06	18.83	19.33	18.03	18.80	18.53	19.30	19.80
	6H	18.32	18.96	18.85	19.49	20.01	18.97	19.62	19.50	20.14	20.66
	8H	18.67	19.24	19.20	19.76	20.34	19.46	20.03	19.99	20.55	21.14

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Corelite

Report Number: SP1-2506-458-13

Test Date: 08/27/2025

Luminaire Tested: 22ID2-55-CFR1-L950-U

Data in this report applies to families of products including 22ID2-55-CFR1-L950-U

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-458-13
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/27/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Corelite
 Catalog Number: **22ID2-55-CFR1-L950-U**
 Description: 2X2 CGTX WITH INDEPTH FRAME AND CFR1 LENS - 5500 LUMEN 5000K 90CRI

Spectral Parameters

CCT (K): 4919
 CIE u' : 0.2096
 CIE v' : 0.4901
 Duv: 0.0038
 CIE x: 0.3483
 CIE y: 0.3619
 CIE z: 0.2898
 Peak Wavelength (nm): 453
 Dominant Wavelength (nm): 570
 Purity: 13.10873
 R_f: 90.8
 R_g: 97.4

CRI (Ra): 94.0
 R1: 94.8
 R2: 97.7
 R3: 98.4
 R4: 90.8
 R5: 92.2
 R6: 94.3
 R7: 94.0
 R8: 90.0
 R9: 77.7
 R10: 93.1
 R11: 92.0
 R12: 65.9
 R13: 95.9
 R14: 99.0
 R15: 91.4



Test Conditions

Stabilization Time: M
 Operation Time: 1H 0M
 Sphere Temperature (°C): 25.0

REPORT NUMBER: SP1-2506-458-13

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-458-13

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 5000K 4-step quadrangle

REPORT NUMBER: SP1-2506-458-13

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	419	NR	620	583	NR	750	44	NR	880	1	NR
365	0	NR	495	441	NR	625	580	NR	755	37	NR	885	1	NR
370	0	NR	500	472	NR	630	572	NR	760	32	NR	890	1	NR
375	0	NR	505	501	NR	635	559	NR	765	27	NR	895	0	NR
380	0	NR	510	524	NR	640	543	NR	770	23	NR	900	0	NR
385	0	NR	515	545	NR	645	522	NR	775	20	NR	905	0	NR
390	1	NR	520	559	NR	650	496	NR	780	17	NR	910	0	NR
395	3	NR	525	572	NR	655	468	NR	785	14	NR	915	0	NR
400	4	NR	530	581	NR	660	435	NR	790	12	NR	920	0	NR
405	7	NR	535	590	NR	665	403	NR	795	10	NR	925	0	NR
410	9	NR	540	595	NR	670	368	NR	800	9	NR	930	0	NR
415	14	NR	545	599	NR	675	335	NR	805	8	NR	935	0	NR
420	23	NR	550	599	NR	680	304	NR	810	6	NR	940	0	NR
425	40	NR	555	599	NR	685	271	NR	815	6	NR	945	0	NR
430	72	NR	560	595	NR	690	243	NR	820	5	NR	950	0	NR
435	132	NR	565	589	NR	695	215	NR	825	4	NR	955	0	NR
440	243	NR	570	581	NR	700	189	NR	830	3	NR	960	0	NR
445	488	NR	575	575	NR	705	165	NR	835	3	NR	965	0	NR
450	879	NR	580	573	NR	710	144	NR	840	3	NR	970	0	NR
455	974	NR	585	570	NR	715	124	NR	845	2	NR	975	0	NR
460	726	NR	590	572	NR	720	108	NR	850	2	NR	980	0	NR
465	627	NR	595	574	NR	725	93	NR	855	2	NR	985	0	NR
470	546	NR	600	576	NR	730	80	NR	860	1	NR	990	0	NR
475	434	NR	605	581	NR	735	69	NR	865	1	NR	995	0	NR
480	395	NR	610	582	NR	740	59	NR	870	1	NR	1000	0	NR
485	403	NR	615	586	NR	745	51	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-13

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 2.09

λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)	λ (nm)	Power W ^λ /nm	Lumens (Φ/nm)
360	0	NR	490	419	NR	620	583	NR	750	44	NR	880	1	NR
365	0	NR	495	441	NR	625	580	NR	755	37	NR	885	1	NR
370	0	NR	500	472	NR	630	572	NR	760	32	NR	890	1	NR
375	0	NR	505	501	NR	635	559	NR	765	27	NR	895	0	NR
380	0	NR	510	524	NR	640	543	NR	770	23	NR	900	0	NR
385	0	NR	515	545	NR	645	522	NR	775	20	NR	905	0	NR
390	1	NR	520	559	NR	650	496	NR	780	17	NR	910	0	NR
395	3	NR	525	572	NR	655	468	NR	785	14	NR	915	0	NR
400	4	NR	530	581	NR	660	435	NR	790	12	NR	920	0	NR
405	7	NR	535	590	NR	665	403	NR	795	10	NR	925	0	NR
410	9	NR	540	595	NR	670	368	NR	800	9	NR	930	0	NR
415	14	NR	545	599	NR	675	335	NR	805	8	NR	935	0	NR
420	23	NR	550	599	NR	680	304	NR	810	6	NR	940	0	NR
425	40	NR	555	599	NR	685	271	NR	815	6	NR	945	0	NR
430	72	NR	560	595	NR	690	243	NR	820	5	NR	950	0	NR
435	132	NR	565	589	NR	695	215	NR	825	4	NR	955	0	NR
440	243	NR	570	581	NR	700	189	NR	830	3	NR	960	0	NR
445	488	NR	575	575	NR	705	165	NR	835	3	NR	965	0	NR
450	879	NR	580	573	NR	710	144	NR	840	3	NR	970	0	NR
455	974	NR	585	570	NR	715	124	NR	845	2	NR	975	0	NR
460	726	NR	590	572	NR	720	108	NR	850	2	NR	980	0	NR
465	627	NR	595	574	NR	725	93	NR	855	2	NR	985	0	NR
470	546	NR	600	576	NR	730	80	NR	860	1	NR	990	0	NR
475	434	NR	605	581	NR	735	69	NR	865	1	NR	995	0	NR
480	395	NR	610	582	NR	740	59	NR	870	1	NR	1000	0	NR
485	403	NR	615	586	NR	745	51	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-13

Melanopic Flux vs. Wavelength


Melanopic Lumens: NR
M/P: 4.55

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	419	NR	620	583	NR	750	44	NR	880	1	NR
365	0	NR	495	441	NR	625	580	NR	755	37	NR	885	1	NR
370	0	NR	500	472	NR	630	572	NR	760	32	NR	890	1	NR
375	0	NR	505	501	NR	635	559	NR	765	27	NR	895	0	NR
380	0	NR	510	524	NR	640	543	NR	770	23	NR	900	0	NR
385	0	NR	515	545	NR	645	522	NR	775	20	NR	905	0	NR
390	1	NR	520	559	NR	650	496	NR	780	17	NR	910	0	NR
395	3	NR	525	572	NR	655	468	NR	785	14	NR	915	0	NR
400	4	NR	530	581	NR	660	435	NR	790	12	NR	920	0	NR
405	7	NR	535	590	NR	665	403	NR	795	10	NR	925	0	NR
410	9	NR	540	595	NR	670	368	NR	800	9	NR	930	0	NR
415	14	NR	545	599	NR	675	335	NR	805	8	NR	935	0	NR
420	23	NR	550	599	NR	680	304	NR	810	6	NR	940	0	NR
425	40	NR	555	599	NR	685	271	NR	815	6	NR	945	0	NR
430	72	NR	560	595	NR	690	243	NR	820	5	NR	950	0	NR
435	132	NR	565	589	NR	695	215	NR	825	4	NR	955	0	NR
440	243	NR	570	581	NR	700	189	NR	830	3	NR	960	0	NR
445	488	NR	575	575	NR	705	165	NR	835	3	NR	965	0	NR
450	879	NR	580	573	NR	710	144	NR	840	3	NR	970	0	NR
455	974	NR	585	570	NR	715	124	NR	845	2	NR	975	0	NR
460	726	NR	590	572	NR	720	108	NR	850	2	NR	980	0	NR
465	627	NR	595	574	NR	725	93	NR	855	2	NR	985	0	NR
470	546	NR	600	576	NR	730	80	NR	860	1	NR	990	0	NR
475	434	NR	605	581	NR	735	69	NR	865	1	NR	995	0	NR
480	395	NR	610	582	NR	740	59	NR	870	1	NR	1000	0	NR
485	403	NR	615	586	NR	745	51	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-13



TM-30-18

Summary

$R_f = 90.8$
 $R_g = 97.4$
 $\text{CIE } R_a = 94.0$
 $R_9 = 77.7$



Color Vector Graphics

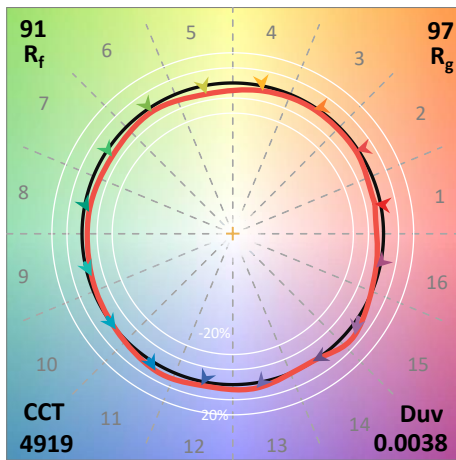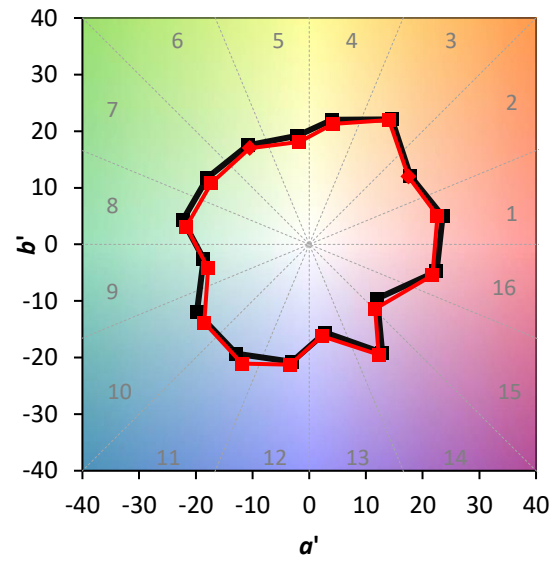

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 98	CES51 = 93	CES76 = 91
CES02 = 61	CES27 = 86	CES52 = 96	CES77 = 89
CES03 = 31	CES28 = 98	CES53 = 93	CES78 = 87
CES04 = 68	CES29 = 90	CES54 = 89	CES79 = 97
CES05 = 48	CES30 = 80	CES55 = 86	CES80 = 94
CES06 = 50	CES31 = 92	CES56 = 89	CES81 = 89
CES07 = 41	CES32 = 97	CES57 = 87	CES82 = 97
CES08 = 40	CES33 = 89	CES58 = 87	CES83 = 96
CES09 = 29	CES34 = 98	CES59 = 96	CES84 = 94
CES10 = 73	CES35 = 98	CES60 = 89	CES85 = 84
CES11 = 56	CES36 = 74	CES61 = 90	CES86 = 90
CES12 = 62	CES37 = 97	CES62 = 78	CES87 = 92
CES13 = 42	CES38 = 75	CES63 = 89	CES88 = 95
CES14 = 74	CES39 = 97	CES64 = 85	CES89 = 90
CES15 = 71	CES40 = 97	CES65 = 87	CES90 = 92
CES16 = 47	CES41 = 91	CES66 = 82	CES91 = 69
CES17 = 48	CES42 = 99	CES67 = 82	CES92 = 81
CES18 = 56	CES43 = 97	CES68 = 86	CES93 = 88
CES19 = 70	CES44 = 99	CES69 = 87	CES94 = 86
CES20 = 65	CES45 = 97	CES70 = 86	CES95 = 83
CES21 = 84	CES46 = 94	CES71 = 77	CES96 = 94
CES22 = 77	CES47 = 90	CES72 = 93	CES97 = 97
CES23 = 91	CES48 = 83	CES73 = 82	CES98 = 94
CES24 = 89	CES49 = 95	CES74 = 89	CES99 = 92
CES25 = 70	CES50 = 94	CES75 = 81	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)