

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1215601

Luminaire Tested: 24-ID2-70-CFR1-L830-U

Issue Date: 12/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1215601
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2508-510-6)
Test Lab: INNOVATION CENTER
Issue Date: 12/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: 24-ID2-70-CFR1-L830-U
Description: 2X4 IN DEPTH TROFFER WITH 1INCH CUBE REGRESS LENS
Light Source: 3000K CCT, 80 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7189.0 lumens
Efficiency: N/A
Efficacy: 119.0 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.19 / 1.3
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 60.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P1215601
CATALOG NUMBER: 24-ID2-70-CFR1-L830-U

Luminous Intensity Polar Plot

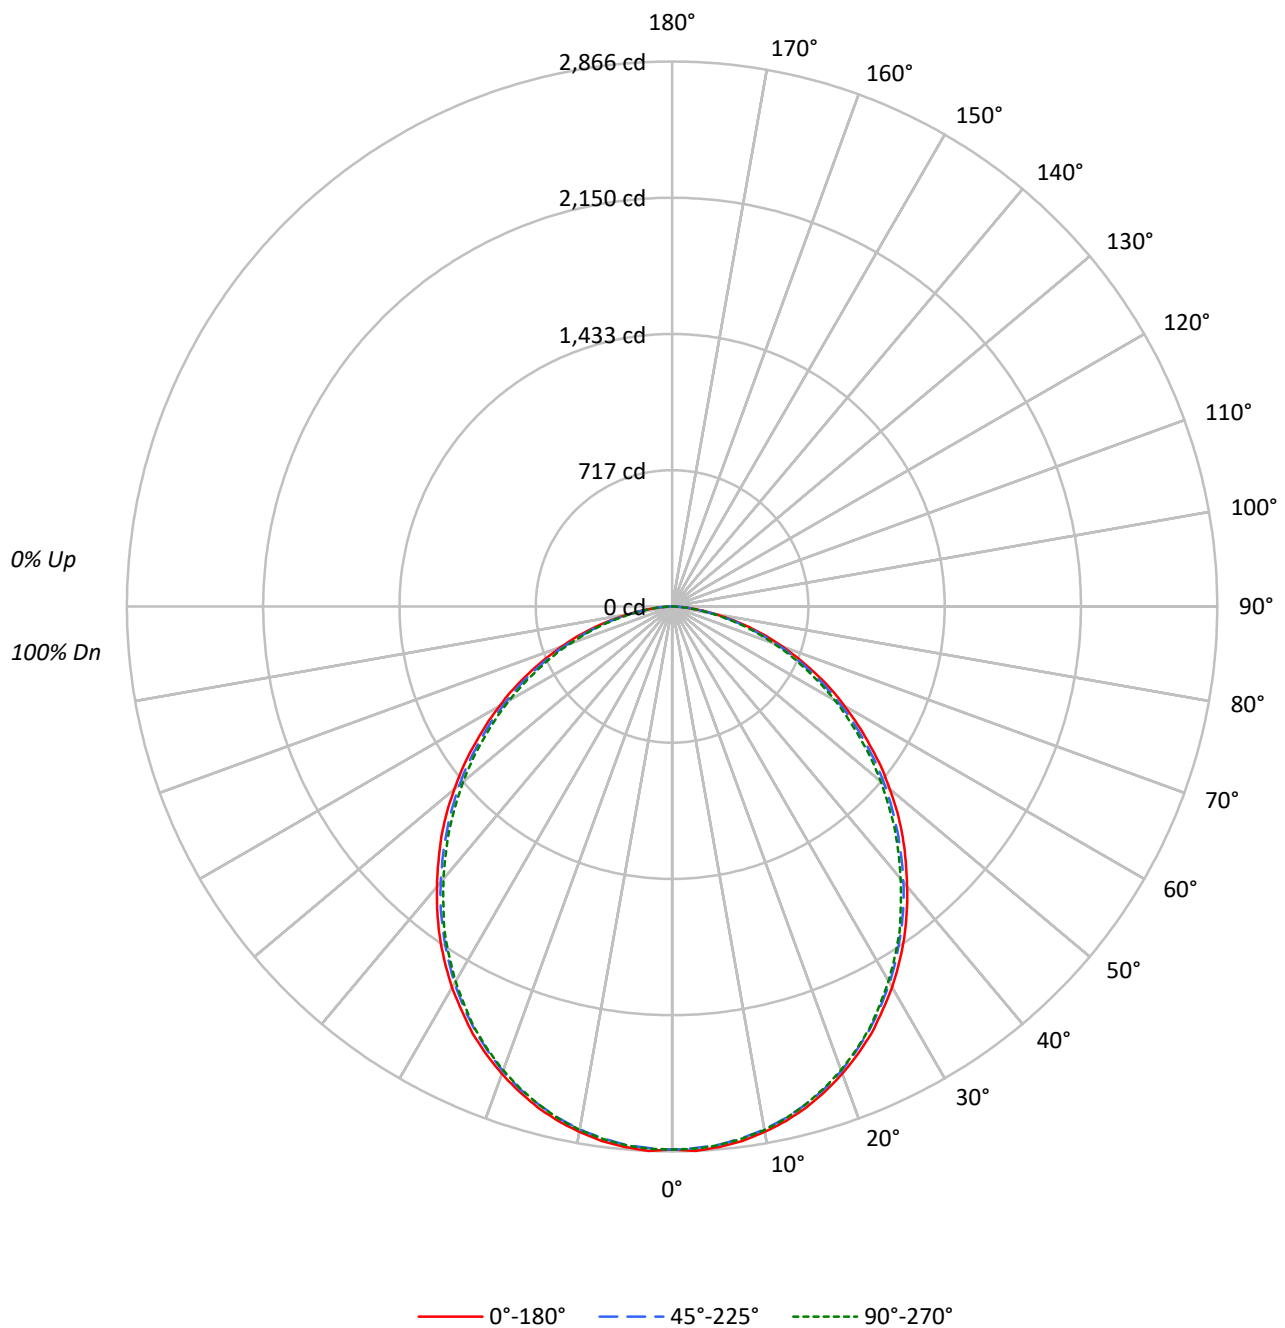

TEST NUMBER: P1215601

CATALOG NUMBER: 24-ID2-70-CFR1-L830-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	102	102	100
1	109	105	101	97	107	103	99	95	98	95	92	94	92	90	91	89	87	87	87	85
2	100	92	85	80	97	90	84	79	86	81	77	83	79	75	80	77	74	74	74	71
3	91	81	73	67	89	79	72	66	77	70	65	74	68	64	71	67	63	63	63	61
4	84	72	64	57	81	71	63	57	68	61	56	66	60	55	64	59	54	54	54	52
5	77	65	56	49	75	64	55	49	61	54	49	59	53	48	58	52	48	48	48	45
6	71	58	50	43	70	57	49	43	56	48	43	54	47	42	52	47	42	42	42	40
7	66	53	44	38	65	52	44	38	51	43	38	49	43	38	48	42	37	37	37	36
8	62	49	40	34	60	48	40	34	47	39	34	45	39	34	44	38	34	34	34	32
9	58	45	37	31	56	44	36	31	43	36	31	42	35	31	41	35	31	31	31	29
10	54	41	33	28	53	41	33	28	40	33	28	39	32	28	38	32	28	28	28	26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3843	3843	3843
5°	3854	3837	3841
10°	3834	3815	3819
15°	3799	3778	3776
20°	3745	3723	3716
25°	3680	3645	3640
30°	3594	3553	3536
35°	3495	3443	3425
40°	3376	3323	3283
45°	3263	3189	3149
50°	3125	3051	3000
55°	2974	2892	2827
60°	2815	2725	2659
65°	2646	2536	2452
70°	2434	2322	2229
75°	2170	2043	1971
80°	1774	1674	1591
85°	1243	1213	1122

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3263 cd/sqm

TEST NUMBER: P1215601
 CATALOG NUMBER: 24-ID2-70-CFR1-L830-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	269.8	3.8
10°-20°	764.8	10.6
20°-30°	1131.3	15.7
30°-40°	1312.7	18.3
40°-50°	1295.7	18.0
50°-60°	1105.6	15.4
60°-70°	792.6	11.0
70°-80°	420.0	5.8
80°-90°	96.5	1.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2166.0	30.1
0°-40°	3478.7	48.4
0°-60°	5879.9	81.8
0°-90°	7189.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7189.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2856	2856	2856	2856	2856	
5°	2853	2844	2841	2837	2844	271
15°	2728	2717	2712	2707	2711	769
25°	2479	2467	2456	2448	2452	1140
35°	2128	2115	2096	2085	2085	1329
45°	1715	1698	1676	1660	1655	1321
55°	1268	1254	1233	1215	1205	1136
65°	831	819	797	782	770	822
75°	417	407	393	383	379	442
85°	80	82	79	75	73	101
90°	0	0	0	0	0	

TEST NUMBER: P1215601

CATALOG NUMBER: 24-ID2-70-CFR1-L830-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2856.3	2856.3	2856.3	2856.3	2856.3
2.5°	2866.1	2855.3	2851.4	2848.4	2854.3
5°	2853.3	2844.5	2840.6	2836.6	2843.5
7.5°	2834.7	2824.9	2819.9	2817.0	2822.9
10°	2806.2	2797.4	2792.4	2789.5	2795.4
12.5°	2770.8	2762.0	2756.1	2753.2	2759.0
15°	2727.6	2716.8	2711.9	2707.0	2710.9
17.5°	2674.6	2666.7	2660.8	2653.0	2656.9
20°	2615.6	2605.8	2599.9	2593.1	2595.0
22.5°	2549.8	2542.0	2531.2	2525.3	2525.3
25°	2479.1	2467.3	2455.5	2447.7	2451.6
27.5°	2395.6	2385.8	2373.0	2362.2	2363.2
30°	2313.1	2300.4	2286.6	2276.8	2275.8
32.5°	2221.8	2212.9	2193.3	2183.5	2180.5
35°	2127.5	2114.7	2096.1	2085.2	2085.2
37.5°	2027.3	2016.5	1997.8	1982.1	1975.2
40°	1922.2	1911.4	1891.8	1875.1	1869.2
42.5°	1818.1	1812.2	1783.7	1770.0	1761.1
45°	1715.0	1698.3	1675.7	1659.9	1655.0
47.5°	1606.9	1592.2	1566.6	1549.0	1541.1
50°	1493.0	1483.1	1457.6	1436.0	1433.1
52.5°	1384.9	1368.2	1348.6	1325.0	1321.1
55°	1268.0	1254.3	1232.7	1215.0	1205.2
57.5°	1158.0	1147.2	1125.6	1102.0	1097.1
60°	1046.1	1035.3	1012.7	995.0	988.1
62.5°	941.0	925.2	907.6	885.0	878.1
65°	831.0	819.2	796.6	781.8	770.1
67.5°	720.9	712.1	693.4	679.7	671.8
70°	618.8	608.0	590.3	573.6	566.7
72.5°	518.6	504.9	488.2	476.4	473.4
75°	417.4	406.6	392.9	383.1	379.1
77.5°	318.2	314.3	302.5	291.7	287.8
80°	228.9	225.9	216.1	209.2	205.3
82.5°	148.3	146.4	142.4	136.5	135.5
85°	80.5	82.5	78.6	74.6	72.7
87.5°	28.5	27.5	26.5	25.5	23.6
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1215601

CATALOG NUMBER: 24-ID2-70-CFR1-L830-U

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.78	17.37	16.14	17.69	18.00	15.48	17.07	15.85	17.39	17.70
	3H	17.43	18.86	17.80	19.19	19.55	17.07	18.51	17.45	18.83	19.19
	4H	18.01	19.36	18.41	19.71	20.08	17.62	18.97	18.02	19.32	19.69
	6H	18.39	19.64	18.80	20.01	20.40	17.97	19.22	18.38	19.58	19.97
	8H	18.49	19.68	18.92	20.07	20.47	18.06	19.25	18.49	19.64	20.04
	12H	18.54	19.68	18.97	20.06	20.49	18.11	19.25	18.54	19.63	20.06
4H	2H	16.32	17.67	16.72	18.02	18.40	16.08	17.43	16.48	17.78	18.16
	3H	18.18	19.31	18.59	19.70	20.10	17.88	19.00	18.29	19.40	19.80
	4H	18.88	19.90	19.31	20.31	20.75	18.54	19.55	18.97	19.97	20.41
	6H	19.38	20.26	19.83	20.70	21.16	18.99	19.88	19.45	20.32	20.78
	8H	19.51	20.34	19.97	20.78	21.25	19.12	19.95	19.58	20.39	20.85
	12H	19.59	20.33	20.07	20.81	21.28	19.19	19.93	19.67	20.41	20.88
8H	4H	19.11	19.94	19.58	20.39	20.85	18.81	19.64	19.27	20.08	20.54
	6H	19.70	20.39	20.20	20.88	21.36	19.36	20.04	19.85	20.53	21.01
	8H	19.89	20.51	20.40	21.02	21.50	19.53	20.14	20.04	20.65	21.14
	12H	20.02	20.57	20.53	21.06	21.62	19.65	20.19	20.16	20.68	21.25
12H	4H	19.13	19.87	19.61	20.35	20.82	18.83	19.57	19.31	20.05	20.52
	6H	19.73	20.34	20.24	20.85	21.34	19.39	20.01	19.90	20.51	21.00
	8H	19.96	20.51	20.47	21.00	21.56	19.61	20.15	20.12	20.64	21.21

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Corelite

Report Number: SP1-2506-458-3

Test Date: 07/24/2025

Luminaire Tested: 22ID2-55-CFR1-L830-U

Data in this report applies to families of products including 22ID2-55-CFR1-L830-U

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-458-3
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/27/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Corelite
 Catalog Number: **22ID2-55-CFR1-L830-U**
 Description: 2X2 CGTX WITH INDEPTH FRAME AND CFR1 LENS - 5500 LUMEN 3000K 80CRI

Spectral Parameters

CCT (K): 3031
 CIE u' : 0.2493
 CIE v' : 0.5215
 Duv: 0.0005
 CIE x: 0.4355
 CIE y: 0.4049
 CIE z: 0.1596
 Peak Wavelength (nm): 603
 Dominant Wavelength (nm): 582
 Purity: 52.24762
 Rf: 84.8
 Rg: 95.8

CRI (Ra): 82.5
 R1: 80.7
 R2: 90.5
 R3: 96.7
 R4: 80.7
 R5: 80.9
 R6: 88.5
 R7: 83.0
 R8: 58.8
 R9: 5.8
 R10: 78.6
 R11: 80.2
 R12: 69.8
 R13: 83.0
 R14: 98.8
 R15: 73.0



Test Conditions

Stabilization Time: 38M
 Operation Time: 1H 38M
 Sphere Temperature (°C): 24.0

REPORT NUMBER: SP1-2506-458-3

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-458-3

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 3000K 4-step quadrangle

REPORT NUMBER: SP1-2506-458-3

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	229	NR	620	922	NR	750	29	NR	880	1	NR
365	0	NR	495	275	NR	625	875	NR	755	25	NR	885	1	NR
370	0	NR	500	326	NR	630	822	NR	760	21	NR	890	1	NR
375	0	NR	505	372	NR	635	764	NR	765	18	NR	895	0	NR
380	0	NR	510	411	NR	640	704	NR	770	15	NR	900	0	NR
385	0	NR	515	447	NR	645	638	NR	775	13	NR	905	0	NR
390	0	NR	520	473	NR	650	577	NR	780	11	NR	910	0	NR
395	1	NR	525	495	NR	655	517	NR	785	10	NR	915	0	NR
400	3	NR	530	515	NR	660	457	NR	790	8	NR	920	0	NR
405	4	NR	535	537	NR	665	404	NR	795	7	NR	925	0	NR
410	7	NR	540	559	NR	670	353	NR	800	6	NR	930	0	NR
415	12	NR	545	584	NR	675	307	NR	805	5	NR	935	0	NR
420	22	NR	550	612	NR	680	267	NR	810	5	NR	940	0	NR
425	40	NR	555	648	NR	685	230	NR	815	4	NR	945	0	NR
430	69	NR	560	688	NR	690	199	NR	820	3	NR	950	0	NR
435	120	NR	565	730	NR	695	170	NR	825	3	NR	955	0	NR
440	212	NR	570	777	NR	700	145	NR	830	3	NR	960	0	NR
445	400	NR	575	824	NR	705	124	NR	835	2	NR	965	0	NR
450	578	NR	580	873	NR	710	106	NR	840	2	NR	970	0	NR
455	478	NR	585	918	NR	715	90	NR	845	2	NR	975	0	NR
460	332	NR	590	958	NR	720	76	NR	850	1	NR	980	0	NR
465	295	NR	595	983	NR	725	65	NR	855	1	NR	985	0	NR
470	231	NR	600	997	NR	730	55	NR	860	1	NR	990	0	NR
475	183	NR	605	998	NR	735	47	NR	865	1	NR	995	0	NR
480	184	NR	610	982	NR	740	40	NR	870	1	NR	1000	0	NR
485	201	NR	615	958	NR	745	34	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-3

Scotopic Flux vs. Wavelength




Scotopic Lumens: NR

S/P: 1.35

λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)
360	0	NR	490	229	NR	620	922	NR	750	29	NR	880	1	NR
365	0	NR	495	275	NR	625	875	NR	755	25	NR	885	1	NR
370	0	NR	500	326	NR	630	822	NR	760	21	NR	890	1	NR
375	0	NR	505	372	NR	635	764	NR	765	18	NR	895	0	NR
380	0	NR	510	411	NR	640	704	NR	770	15	NR	900	0	NR
385	0	NR	515	447	NR	645	638	NR	775	13	NR	905	0	NR
390	0	NR	520	473	NR	650	577	NR	780	11	NR	910	0	NR
395	1	NR	525	495	NR	655	517	NR	785	10	NR	915	0	NR
400	3	NR	530	515	NR	660	457	NR	790	8	NR	920	0	NR
405	4	NR	535	537	NR	665	404	NR	795	7	NR	925	0	NR
410	7	NR	540	559	NR	670	353	NR	800	6	NR	930	0	NR
415	12	NR	545	584	NR	675	307	NR	805	5	NR	935	0	NR
420	22	NR	550	612	NR	680	267	NR	810	5	NR	940	0	NR
425	40	NR	555	648	NR	685	230	NR	815	4	NR	945	0	NR
430	69	NR	560	688	NR	690	199	NR	820	3	NR	950	0	NR
435	120	NR	565	730	NR	695	170	NR	825	3	NR	955	0	NR
440	212	NR	570	777	NR	700	145	NR	830	3	NR	960	0	NR
445	400	NR	575	824	NR	705	124	NR	835	2	NR	965	0	NR
450	578	NR	580	873	NR	710	106	NR	840	2	NR	970	0	NR
455	478	NR	585	918	NR	715	90	NR	845	2	NR	975	0	NR
460	332	NR	590	958	NR	720	76	NR	850	1	NR	980	0	NR
465	295	NR	595	983	NR	725	65	NR	855	1	NR	985	0	NR
470	231	NR	600	997	NR	730	55	NR	860	1	NR	990	0	NR
475	183	NR	605	998	NR	735	47	NR	865	1	NR	995	0	NR
480	184	NR	610	982	NR	740	40	NR	870	1	NR	1000	0	NR
485	201	NR	615	958	NR	745	34	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-3

Melanopic Flux vs. Wavelength

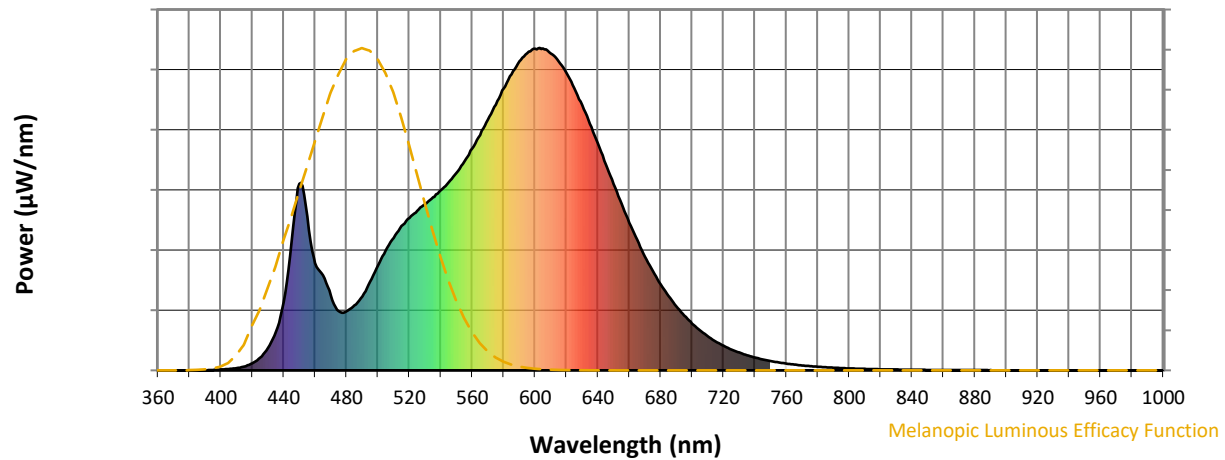
Melanopic Lumens: NR
M/P: 2.59

λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	229	NR	620	922	NR	750	29	NR	880	1	NR
365	0	NR	495	275	NR	625	875	NR	755	25	NR	885	1	NR
370	0	NR	500	326	NR	630	822	NR	760	21	NR	890	1	NR
375	0	NR	505	372	NR	635	764	NR	765	18	NR	895	0	NR
380	0	NR	510	411	NR	640	704	NR	770	15	NR	900	0	NR
385	0	NR	515	447	NR	645	638	NR	775	13	NR	905	0	NR
390	0	NR	520	473	NR	650	577	NR	780	11	NR	910	0	NR
395	1	NR	525	495	NR	655	517	NR	785	10	NR	915	0	NR
400	3	NR	530	515	NR	660	457	NR	790	8	NR	920	0	NR
405	4	NR	535	537	NR	665	404	NR	795	7	NR	925	0	NR
410	7	NR	540	559	NR	670	353	NR	800	6	NR	930	0	NR
415	12	NR	545	584	NR	675	307	NR	805	5	NR	935	0	NR
420	22	NR	550	612	NR	680	267	NR	810	5	NR	940	0	NR
425	40	NR	555	648	NR	685	230	NR	815	4	NR	945	0	NR
430	69	NR	560	688	NR	690	199	NR	820	3	NR	950	0	NR
435	120	NR	565	730	NR	695	170	NR	825	3	NR	955	0	NR
440	212	NR	570	777	NR	700	145	NR	830	3	NR	960	0	NR
445	400	NR	575	824	NR	705	124	NR	835	2	NR	965	0	NR
450	578	NR	580	873	NR	710	106	NR	840	2	NR	970	0	NR
455	478	NR	585	918	NR	715	90	NR	845	2	NR	975	0	NR
460	332	NR	590	958	NR	720	76	NR	850	1	NR	980	0	NR
465	295	NR	595	983	NR	725	65	NR	855	1	NR	985	0	NR
470	231	NR	600	997	NR	730	55	NR	860	1	NR	990	0	NR
475	183	NR	605	998	NR	735	47	NR	865	1	NR	995	0	NR
480	184	NR	610	982	NR	740	40	NR	870	1	NR	1000	0	NR
485	201	NR	615	958	NR	745	34	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-3

TM-30-18

Summary

$R_f = 84.8$
 $R_g = 95.8$
 $CIE R_a = 82.5$
 $R_9 = 5.8$



Color Vector Graphics





Individual Sample Fidelity Index (R_{fi})

CES01 = 86	CES26 = 84	CES51 = 94	CES76 = 80
CES02 = 63	CES27 = 94	CES52 = 94	CES77 = 85
CES03 = 31	CES28 = 93	CES53 = 89	CES78 = 79
CES04 = 70	CES29 = 87	CES54 = 91	CES79 = 91
CES05 = 50	CES30 = 96	CES55 = 90	CES80 = 90
CES06 = 51	CES31 = 89	CES56 = 87	CES81 = 74
CES07 = 42	CES32 = 82	CES57 = 86	CES82 = 95
CES08 = 41	CES33 = 92	CES58 = 87	CES83 = 94
CES09 = 29	CES34 = 90	CES59 = 91	CES84 = 92
CES10 = 76	CES35 = 94	CES60 = 92	CES85 = 77
CES11 = 59	CES36 = 86	CES61 = 88	CES86 = 69
CES12 = 65	CES37 = 94	CES62 = 90	CES87 = 84
CES13 = 43	CES38 = 95	CES63 = 87	CES88 = 88
CES14 = 74	CES39 = 98	CES64 = 81	CES89 = 75
CES15 = 72	CES40 = 95	CES65 = 79	CES90 = 89
CES16 = 47	CES41 = 97	CES66 = 79	CES91 = 77
CES17 = 50	CES42 = 95	CES67 = 78	CES92 = 65
CES18 = 56	CES43 = 90	CES68 = 81	CES93 = 79
CES19 = 72	CES44 = 99	CES69 = 86	CES94 = 62
CES20 = 67	CES45 = 93	CES70 = 78	CES95 = 74
CES21 = 87	CES46 = 90	CES71 = 75	CES96 = 84
CES22 = 79	CES47 = 94	CES72 = 91	CES97 = 89
CES23 = 92	CES48 = 85	CES73 = 73	CES98 = 85
CES24 = 91	CES49 = 90	CES74 = 92	CES99 = 77
CES25 = 72	CES50 = 94	CES75 = 78	



Color Rendition by Hue-Angle Bin

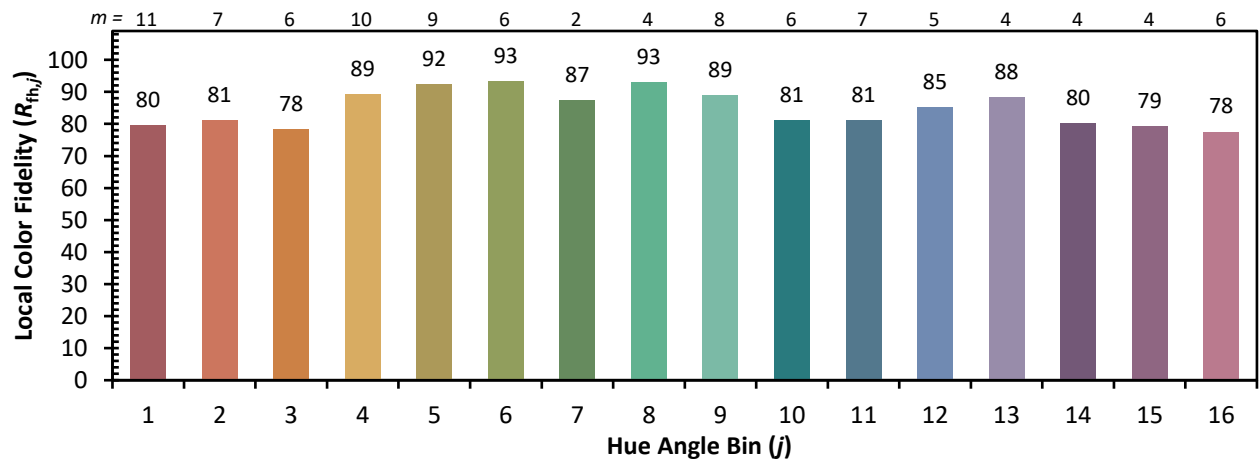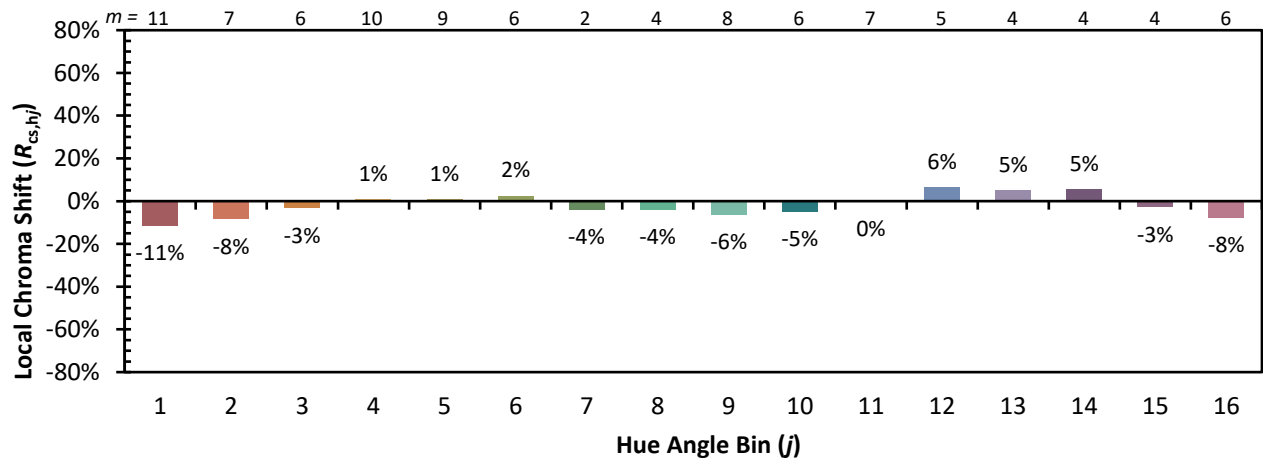

Measure Comparisons



(END OF REPORT)