

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1215723

Luminaire Tested: 24-ID2-70-CFR2-L840-U

Issue Date: 12/5/2025

Test Information

Test Method: LM-79-2019
Report Number: P1215723
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2508-510-7)
Test Lab: INNOVATION CENTER
Issue Date: 12/5/2025
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: 24-ID2-70-CFR2-L840-U
Description: 2X4 IN DEPTH TROFFER WITH 2INCH CUBE REGRESS LENS
Light Source: 4000K CCT, 80 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 7489.7 lumens
Efficiency: N/A
Efficacy: 124.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.18 / 1.29
Luminous Opening: Rectangular (W 2' x L: 4' x H: 0')
CIE Type: Direct

Input Watts (W): 60.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P1215723
CATALOG NUMBER: 24-ID2-70-CFR2-L840-U

Luminous Intensity Polar Plot

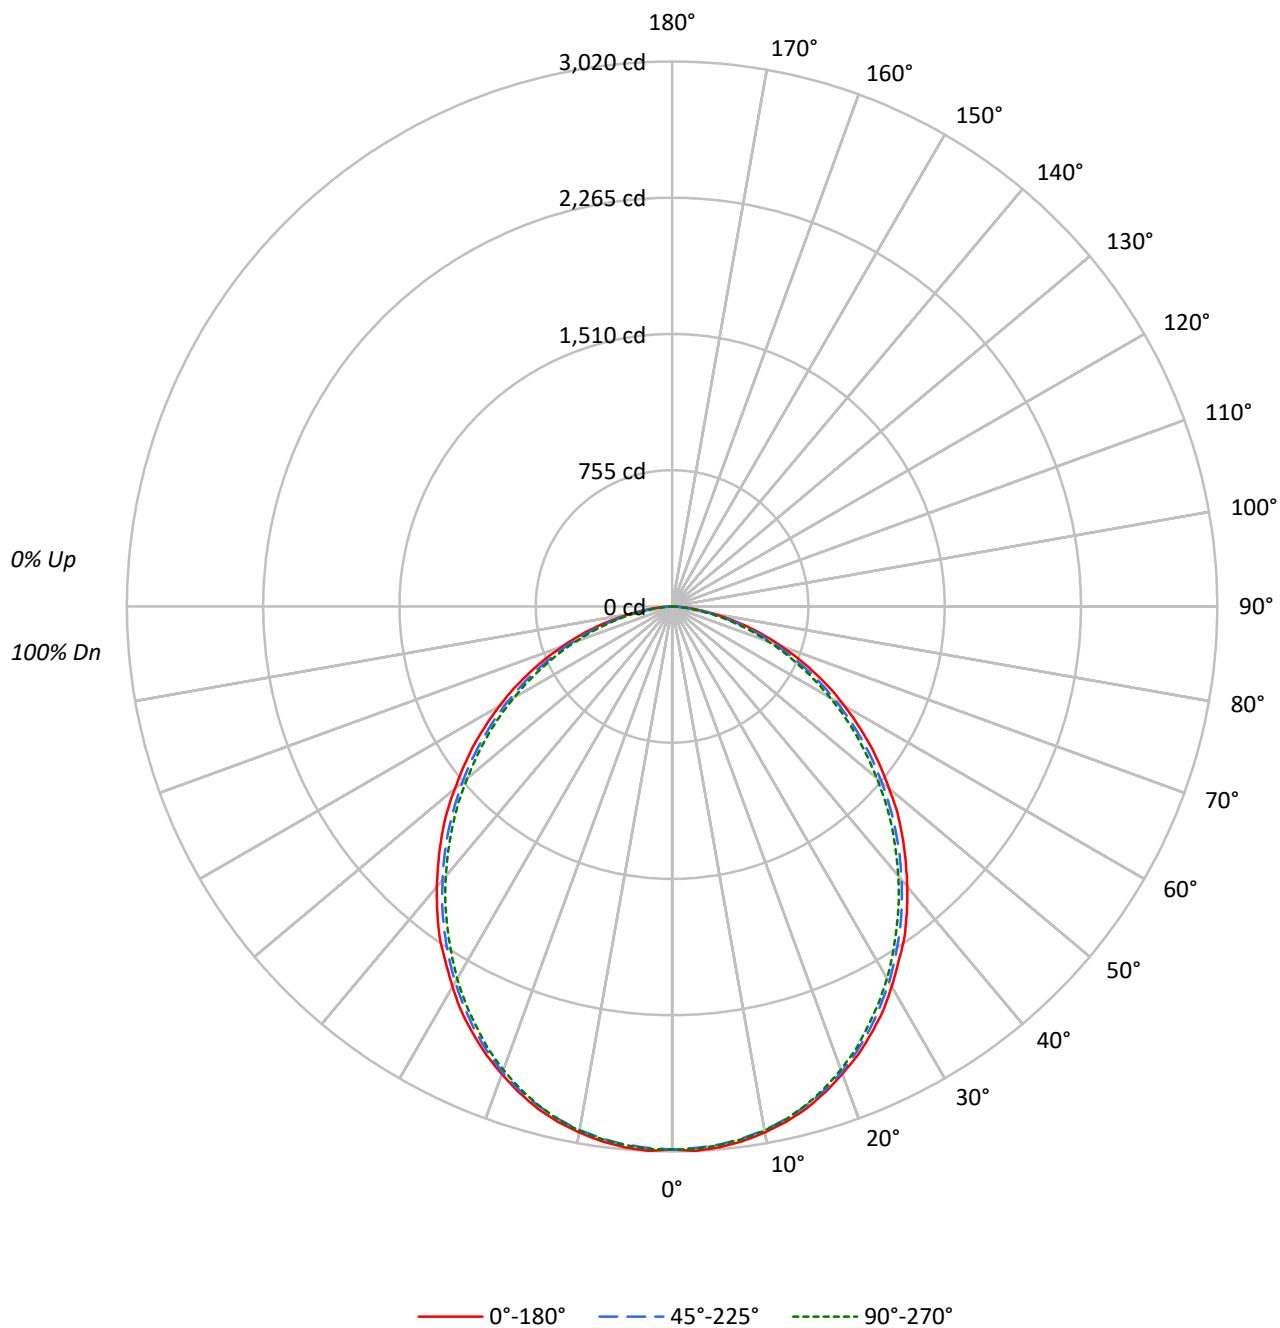

TEST NUMBER: P1215723

CATALOG NUMBER: 24-ID2-70-CFR2-L840-U

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	109	105	101	97	107	103	99	96	98	95	93		95	92	90		85
2	100	92	86	80	97	90	84	79	87	82	77		83	79	76		72
3	91	81	74	67	89	80	73	67	77	71	65		74	69	64		61
4	84	72	64	57	82	71	63	57	69	62	56		66	60	55		53
5	77	65	56	50	75	64	56	49	62	54	49		60	53	48		46
6	72	59	50	44	70	58	49	43	56	49	43		54	48	43		40
7	67	53	45	39	65	53	44	39	51	44	38		50	43	38		36
8	62	49	40	35	60	48	40	35	47	40	34		46	39	34		32
9	58	45	37	31	57	44	37	31	43	36	31		42	36	31		29
10	54	41	34	29	53	41	33	28	40	33	28		39	33	28		26

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4049	4049	4049
5°	4064	4043	4047
10°	4045	4025	4031
15°	4011	3990	3986
20°	3948	3933	3913
25°	3876	3843	3811
30°	3780	3735	3700
35°	3685	3611	3564
40°	3560	3474	3425
45°	3434	3329	3273
50°	3286	3172	3098
55°	3142	3001	2924
60°	2972	2815	2716
65°	2777	2608	2487
70°	2535	2369	2241
75°	2244	2041	1893
80°	1807	1609	1474
85°	1200	1027	837

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3434 cd/sqm

TEST NUMBER: P1215723
 CATALOG NUMBER: 24-ID2-70-CFR2-L840-U

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	284.5	3.8
10°-20°	807.2	10.8
20°-30°	1191.2	15.9
30°-40°	1377.4	18.4
40°-50°	1354.7	18.1
50°-60°	1150.5	15.4
60°-70°	815.5	10.9
70°-80°	420.4	5.6
80°-90°	88.4	1.2
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2282.9	30.5
0°-40°	3660.2	48.9
0°-60°	6165.4	82.3
0°-90°	7489.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7489.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3010	3010	3010	3010	3010	
5°	3009	2997	2993	2990	2996	286
15°	2880	2868	2864	2858	2861	811
25°	2611	2602	2588	2572	2567	1202
35°	2244	2231	2199	2179	2170	1400
45°	1805	1790	1750	1725	1720	1392
55°	1340	1319	1279	1257	1247	1196
65°	872	851	819	792	781	864
75°	432	413	393	370	364	457
85°	78	74	66	59	54	98
90°	0	0	0	0	0	

TEST NUMBER: P1215723

CATALOG NUMBER: 24-ID2-70-CFR2-L840-U

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3009.6	3009.6	3009.6	3009.6	3009.6
2.5°	3019.8	3009.6	3003.5	3001.4	3008.6
5°	3008.6	2997.3	2993.2	2990.2	2996.3
7.5°	2989.2	2977.9	2973.8	2970.7	2976.9
10°	2960.5	2950.3	2946.2	2943.1	2950.3
12.5°	2924.7	2914.5	2909.4	2906.3	2911.4
15°	2879.7	2868.5	2864.4	2858.3	2861.3
17.5°	2822.5	2814.3	2811.2	2800.0	2801.0
20°	2757.0	2750.9	2746.8	2730.4	2732.5
22.5°	2689.5	2681.3	2671.1	2656.8	2656.8
25°	2610.8	2601.6	2588.3	2571.9	2566.8
27.5°	2529.0	2518.7	2497.3	2483.0	2477.8
30°	2432.8	2426.7	2404.2	2385.8	2381.7
32.5°	2334.7	2330.6	2301.9	2286.6	2276.4
35°	2243.7	2231.4	2198.7	2179.2	2170.0
37.5°	2136.3	2125.0	2090.3	2072.9	2062.7
40°	2026.9	2012.5	1977.8	1963.5	1950.2
42.5°	1915.4	1905.2	1865.3	1842.8	1833.6
45°	1804.9	1789.6	1749.7	1725.2	1720.1
47.5°	1693.5	1672.0	1633.1	1607.6	1602.5
50°	1569.7	1554.4	1515.5	1489.0	1479.8
52.5°	1453.2	1434.8	1400.0	1374.4	1362.1
55°	1339.6	1319.2	1279.3	1256.8	1246.6
57.5°	1220.0	1201.6	1165.8	1137.2	1129.0
60°	1104.4	1080.9	1046.2	1022.6	1009.3
62.5°	990.9	967.4	933.7	904.0	897.9
65°	872.3	850.8	819.1	792.5	781.3
67.5°	757.8	736.3	705.6	685.2	674.9
70°	644.3	626.9	602.3	575.7	569.6
72.5°	535.9	519.5	493.9	471.4	466.3
75°	431.6	413.1	392.7	370.2	364.1
77.5°	326.2	317.0	295.5	283.3	276.1
80°	233.2	221.9	207.6	196.3	190.2
82.5°	145.2	141.1	131.9	121.7	115.6
85°	77.7	73.6	66.5	59.3	54.2
87.5°	21.5	23.5	23.5	22.5	22.5
90°	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P1215723

CATALOG NUMBER: 24-ID2-70-CFR2-L840-U

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.97	17.56	16.34	17.87	18.19	15.56	17.15	15.93	17.46	17.78
	3H	17.60	19.03	17.98	19.35	19.71	17.08	18.51	17.46	18.84	19.20
	4H	18.17	19.51	18.56	19.86	20.23	17.58	18.92	17.98	19.27	19.65
	6H	18.53	19.77	18.94	20.13	20.53	17.88	19.12	18.29	19.49	19.88
	8H	18.61	19.80	19.04	20.19	20.59	17.95	19.13	18.37	19.52	19.92
	12H	18.65	19.79	19.08	20.17	20.60	17.96	19.10	18.39	19.48	19.91
4H	2H	16.49	17.83	16.89	18.18	18.56	16.16	17.50	16.56	17.85	18.23
	3H	18.32	19.44	18.73	19.84	20.24	17.88	19.00	18.29	19.40	19.80
	4H	19.00	20.01	19.44	20.43	20.86	18.48	19.49	18.91	19.90	20.34
	6H	19.47	20.35	19.93	20.79	21.25	18.88	19.76	19.34	20.20	20.66
	8H	19.59	20.41	20.05	20.86	21.32	18.97	19.79	19.43	20.23	20.70
	12H	19.66	20.39	20.14	20.87	21.34	19.01	19.74	19.49	20.22	20.69
8H	4H	19.21	20.03	19.67	20.47	20.94	18.74	19.56	19.20	20.00	20.47
	6H	19.76	20.44	20.26	20.93	21.41	19.22	19.90	19.72	20.39	20.87
	8H	19.93	20.54	20.44	21.05	21.53	19.35	19.96	19.86	20.47	20.95
	12H	20.04	20.58	20.55	21.07	21.63	19.42	19.96	19.93	20.45	21.02
12H	4H	19.22	19.95	19.70	20.43	20.90	18.76	19.49	19.24	19.97	20.44
	6H	19.78	20.39	20.29	20.89	21.38	19.25	19.86	19.76	20.37	20.85
	8H	19.98	20.52	20.49	21.01	21.57	19.42	19.96	19.93	20.45	21.01

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Corelite

Report Number: SP1-2506-458-5

Test Date: 08/26/2025

Luminaire Tested: 22ID2-55-CFR1-L840-U

Data in this report applies to families of products including 22ID2-55-CFR1-L840-U


Test Information

Test Method: LM-79-2019
 Report Number: SP1-2506-458-5
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 08/27/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Corelite
 Catalog Number: **22ID2-55-CFR1-L840-U**
 Description: 2X2 CGTX WITH INDEPTH FRAME AND CFR1 LENS - 5500 LUMEN 4000K 80CRI

Spectral Parameters

CCT (K): 3915
 CIE u' : 0.2259
 CIE v' : 0.5051
 Duv: 0.0015
 CIE x: 0.3854
 CIE y: 0.3830
 CIE z: 0.2316
 Peak Wavelength (nm): 453
 Dominant Wavelength (nm): 578
 Purity: 30.6207
 R_f: 83.2
 R_g: 94.6

CRI (Ra): 82.3
 R1: 80.6
 R2: 88.9
 R3: 94.6
 R4: 80.5
 R5: 80.0
 R6: 84.0
 R7: 86.1
 R8: 64.0
 R9: 7.6
 R10: 72.9
 R11: 78.7
 R12: 57.3
 R13: 82.7
 R14: 97.1
 R15: 74.3

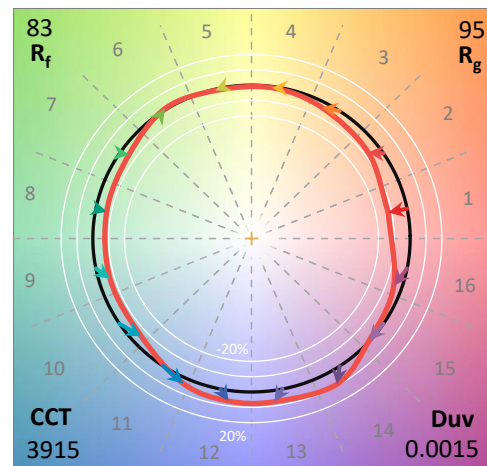

Test Conditions


Stabilization Time: 34M
 Operation Time: 1H 34M
 Sphere Temperature (°C): 25.2

REPORT NUMBER: SP1-2506-458-5

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2506-458-5

Photopic Flux vs. Wavelength

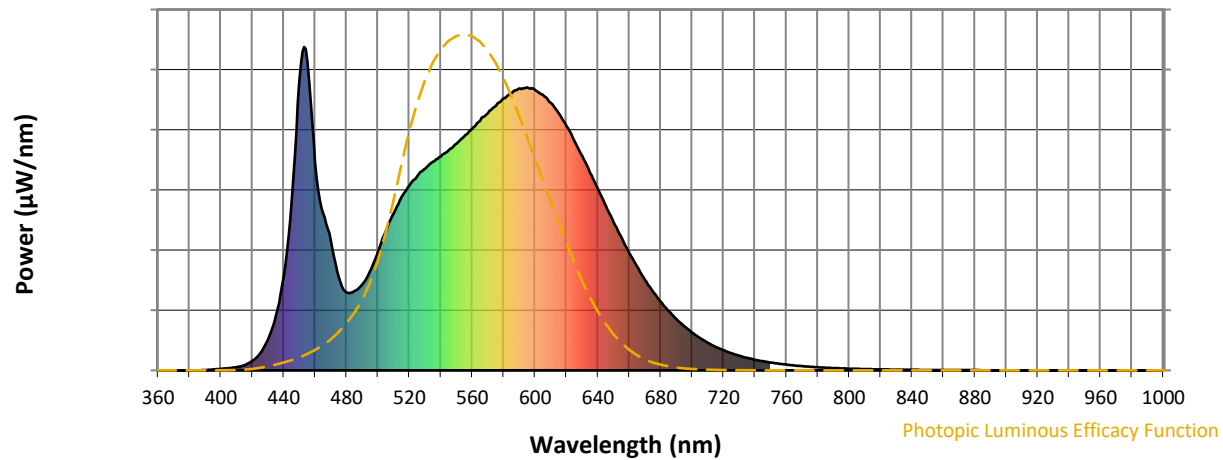


Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	266	NR	620	755	NR	750	24	NR	880	1	NR
365	0	NR	495	307	NR	625	710	NR	755	21	NR	885	0	NR
370	0	NR	500	366	NR	630	663	NR	760	18	NR	890	0	NR
375	0	NR	505	430	NR	635	612	NR	765	15	NR	895	0	NR
380	0	NR	510	486	NR	640	561	NR	770	13	NR	900	0	NR
385	0	NR	515	536	NR	645	509	NR	775	11	NR	905	0	NR
390	1	NR	520	571	NR	650	458	NR	780	10	NR	910	0	NR
395	3	NR	525	600	NR	655	410	NR	785	8	NR	915	0	NR
400	5	NR	530	624	NR	660	363	NR	790	7	NR	920	0	NR
405	7	NR	535	645	NR	665	321	NR	795	6	NR	925	0	NR
410	10	NR	540	661	NR	670	280	NR	800	5	NR	930	0	NR
415	16	NR	545	681	NR	675	244	NR	805	5	NR	935	0	NR
420	30	NR	550	701	NR	680	213	NR	810	4	NR	940	0	NR
425	53	NR	555	724	NR	685	183	NR	815	3	NR	945	0	NR
430	95	NR	560	747	NR	690	159	NR	820	3	NR	950	0	NR
435	170	NR	565	772	NR	695	136	NR	825	3	NR	955	0	NR
440	289	NR	570	795	NR	700	117	NR	830	2	NR	960	0	NR
445	522	NR	575	817	NR	705	100	NR	835	2	NR	965	0	NR
450	895	NR	580	841	NR	710	85	NR	840	2	NR	970	0	NR
455	957	NR	585	857	NR	715	72	NR	845	1	NR	975	0	NR
460	642	NR	590	871	NR	720	62	NR	850	1	NR	980	0	NR
465	487	NR	595	875	NR	725	53	NR	855	1	NR	985	0	NR
470	397	NR	600	866	NR	730	45	NR	860	1	NR	990	0	NR
475	289	NR	605	852	NR	735	39	NR	865	1	NR	995	0	NR
480	241	NR	610	827	NR	740	33	NR	870	1	NR	1000	0	NR
485	245	NR	615	796	NR	745	28	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-5

Scotopic Flux vs. Wavelength

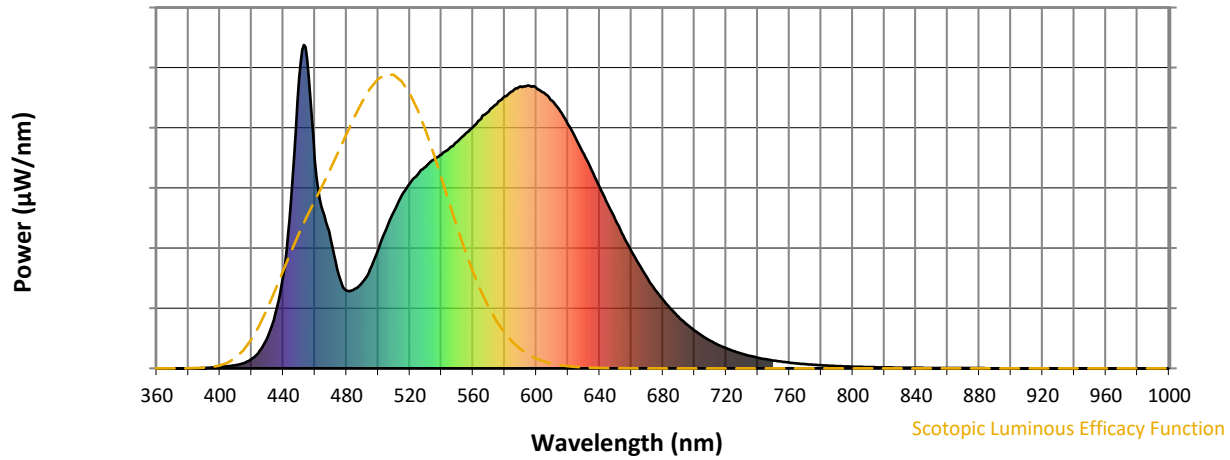


Scotopic Lumens: NR

S/P: 1.65

λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)	λ (nm)	Power W [^] /nm	Lumens (Φ/nm)
360	0	NR	490	266	NR	620	755	NR	750	24	NR	880	1	NR
365	0	NR	495	307	NR	625	710	NR	755	21	NR	885	0	NR
370	0	NR	500	366	NR	630	663	NR	760	18	NR	890	0	NR
375	0	NR	505	430	NR	635	612	NR	765	15	NR	895	0	NR
380	0	NR	510	486	NR	640	561	NR	770	13	NR	900	0	NR
385	0	NR	515	536	NR	645	509	NR	775	11	NR	905	0	NR
390	1	NR	520	571	NR	650	458	NR	780	10	NR	910	0	NR
395	3	NR	525	600	NR	655	410	NR	785	8	NR	915	0	NR
400	5	NR	530	624	NR	660	363	NR	790	7	NR	920	0	NR
405	7	NR	535	645	NR	665	321	NR	795	6	NR	925	0	NR
410	10	NR	540	661	NR	670	280	NR	800	5	NR	930	0	NR
415	16	NR	545	681	NR	675	244	NR	805	5	NR	935	0	NR
420	30	NR	550	701	NR	680	213	NR	810	4	NR	940	0	NR
425	53	NR	555	724	NR	685	183	NR	815	3	NR	945	0	NR
430	95	NR	560	747	NR	690	159	NR	820	3	NR	950	0	NR
435	170	NR	565	772	NR	695	136	NR	825	3	NR	955	0	NR
440	289	NR	570	795	NR	700	117	NR	830	2	NR	960	0	NR
445	522	NR	575	817	NR	705	100	NR	835	2	NR	965	0	NR
450	895	NR	580	841	NR	710	85	NR	840	2	NR	970	0	NR
455	957	NR	585	857	NR	715	72	NR	845	1	NR	975	0	NR
460	642	NR	590	871	NR	720	62	NR	850	1	NR	980	0	NR
465	487	NR	595	875	NR	725	53	NR	855	1	NR	985	0	NR
470	397	NR	600	866	NR	730	45	NR	860	1	NR	990	0	NR
475	289	NR	605	852	NR	735	39	NR	865	1	NR	995	0	NR
480	241	NR	610	827	NR	740	33	NR	870	1	NR	1000	0	NR
485	245	NR	615	796	NR	745	28	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-5

Melanopic Flux vs. Wavelength

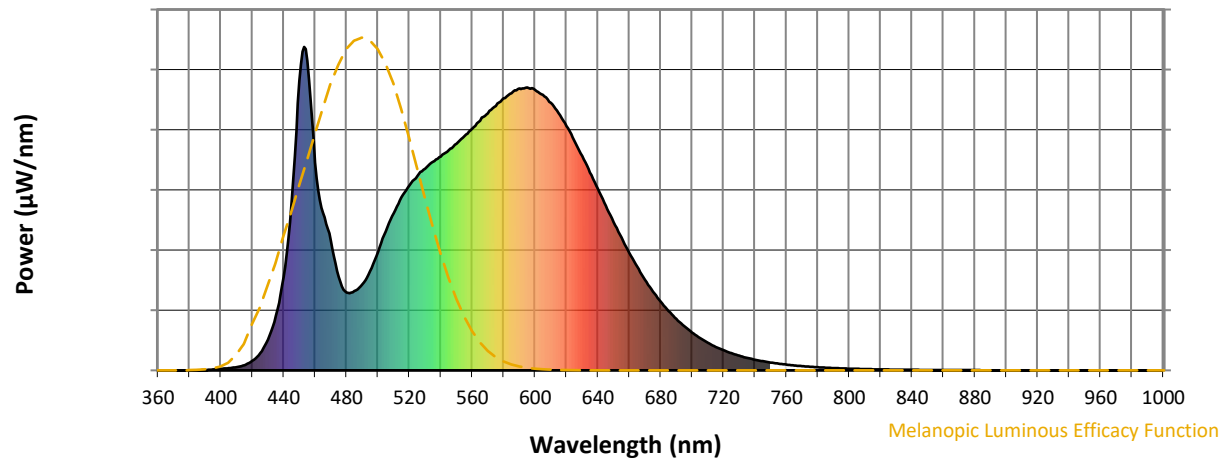
Melanopic Lumens: NR
M/P: 3.36


λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^\wedge/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	266	NR	620	755	NR	750	24	NR	880	1	NR
365	0	NR	495	307	NR	625	710	NR	755	21	NR	885	0	NR
370	0	NR	500	366	NR	630	663	NR	760	18	NR	890	0	NR
375	0	NR	505	430	NR	635	612	NR	765	15	NR	895	0	NR
380	0	NR	510	486	NR	640	561	NR	770	13	NR	900	0	NR
385	0	NR	515	536	NR	645	509	NR	775	11	NR	905	0	NR
390	1	NR	520	571	NR	650	458	NR	780	10	NR	910	0	NR
395	3	NR	525	600	NR	655	410	NR	785	8	NR	915	0	NR
400	5	NR	530	624	NR	660	363	NR	790	7	NR	920	0	NR
405	7	NR	535	645	NR	665	321	NR	795	6	NR	925	0	NR
410	10	NR	540	661	NR	670	280	NR	800	5	NR	930	0	NR
415	16	NR	545	681	NR	675	244	NR	805	5	NR	935	0	NR
420	30	NR	550	701	NR	680	213	NR	810	4	NR	940	0	NR
425	53	NR	555	724	NR	685	183	NR	815	3	NR	945	0	NR
430	95	NR	560	747	NR	690	159	NR	820	3	NR	950	0	NR
435	170	NR	565	772	NR	695	136	NR	825	3	NR	955	0	NR
440	289	NR	570	795	NR	700	117	NR	830	2	NR	960	0	NR
445	522	NR	575	817	NR	705	100	NR	835	2	NR	965	0	NR
450	895	NR	580	841	NR	710	85	NR	840	2	NR	970	0	NR
455	957	NR	585	857	NR	715	72	NR	845	1	NR	975	0	NR
460	642	NR	590	871	NR	720	62	NR	850	1	NR	980	0	NR
465	487	NR	595	875	NR	725	53	NR	855	1	NR	985	0	NR
470	397	NR	600	866	NR	730	45	NR	860	1	NR	990	0	NR
475	289	NR	605	852	NR	735	39	NR	865	1	NR	995	0	NR
480	241	NR	610	827	NR	740	33	NR	870	1	NR	1000	0	NR
485	245	NR	615	796	NR	745	28	NR	875	1	NR			

REPORT NUMBER: SP1-2506-458-5





TM-30-18

Summary

$R_f = 83.2$
 $R_g = 94.6$
 $CIE R_a = 82.3$
 $R_9 = 7.6$

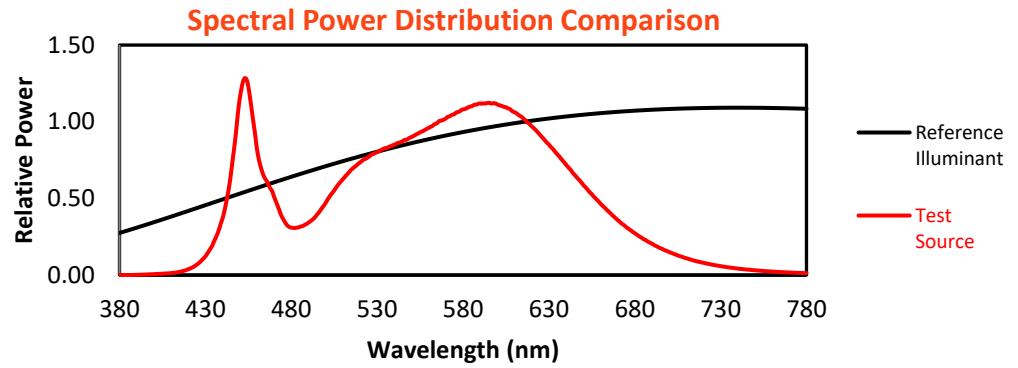


Color Vector Graphics

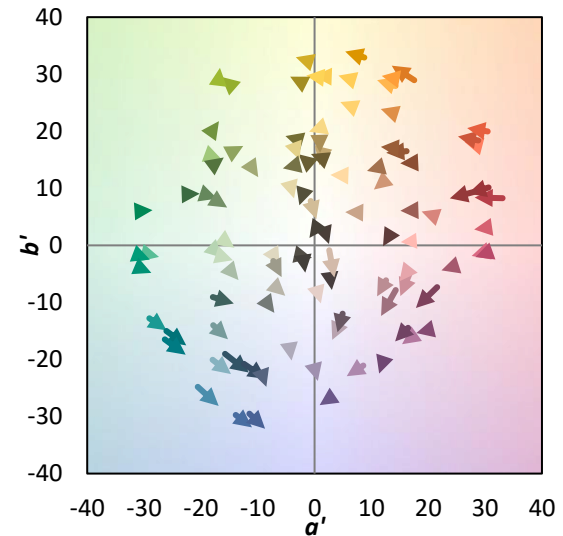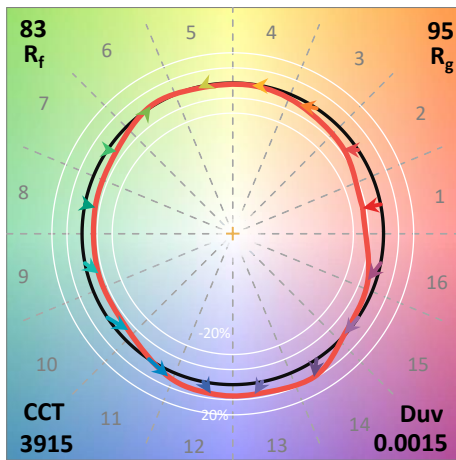
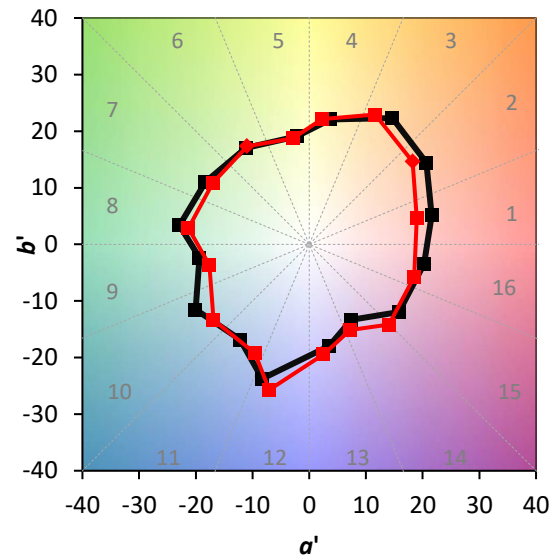
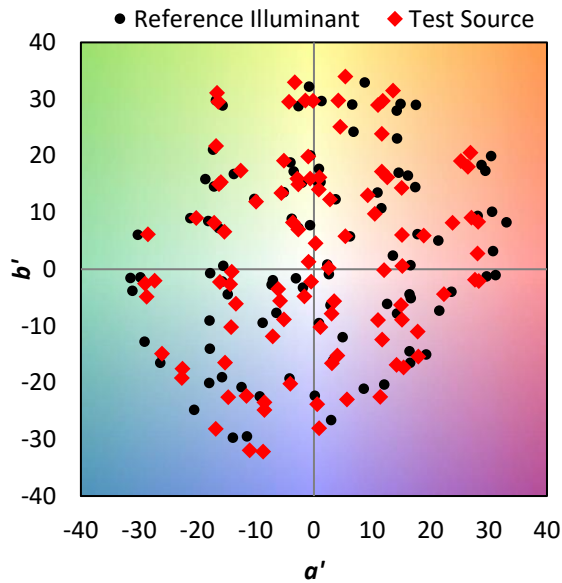


Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 83	CES51 = 92	CES76 = 75
CES02 = 61	CES27 = 91	CES52 = 93	CES77 = 82
CES03 = 31	CES28 = 91	CES53 = 88	CES78 = 74
CES04 = 70	CES29 = 90	CES54 = 88	CES79 = 92
CES05 = 48	CES30 = 90	CES55 = 85	CES80 = 89
CES06 = 50	CES31 = 91	CES56 = 83	CES81 = 81
CES07 = 41	CES32 = 83	CES57 = 82	CES82 = 95
CES08 = 40	CES33 = 97	CES58 = 82	CES83 = 96
CES09 = 29	CES34 = 87	CES59 = 90	CES84 = 90
CES10 = 74	CES35 = 92	CES60 = 88	CES85 = 77
CES11 = 57	CES36 = 78	CES61 = 85	CES86 = 75
CES12 = 63	CES37 = 91	CES62 = 79	CES87 = 84
CES13 = 42	CES38 = 84	CES63 = 82	CES88 = 89
CES14 = 74	CES39 = 98	CES64 = 75	CES89 = 77
CES15 = 71	CES40 = 96	CES65 = 74	CES90 = 90
CES16 = 47	CES41 = 95	CES66 = 70	CES91 = 67
CES17 = 49	CES42 = 93	CES67 = 69	CES92 = 64
CES18 = 56	CES43 = 91	CES68 = 76	CES93 = 78
CES19 = 71	CES44 = 99	CES69 = 80	CES94 = 63
CES20 = 65	CES45 = 94	CES70 = 72	CES95 = 72
CES21 = 86	CES46 = 91	CES71 = 64	CES96 = 84
CES22 = 78	CES47 = 95	CES72 = 88	CES97 = 91
CES23 = 91	CES48 = 83	CES73 = 66	CES98 = 86
CES24 = 90	CES49 = 90	CES74 = 90	CES99 = 77
CES25 = 71	CES50 = 93	CES75 = 68	

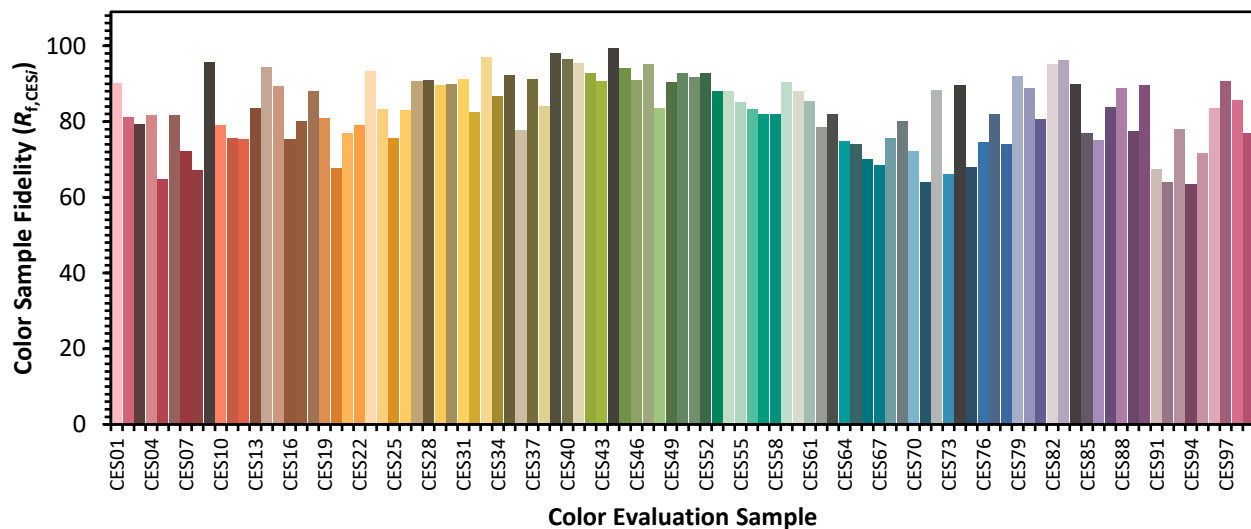

Color Rendition by Hue-Angle Bin

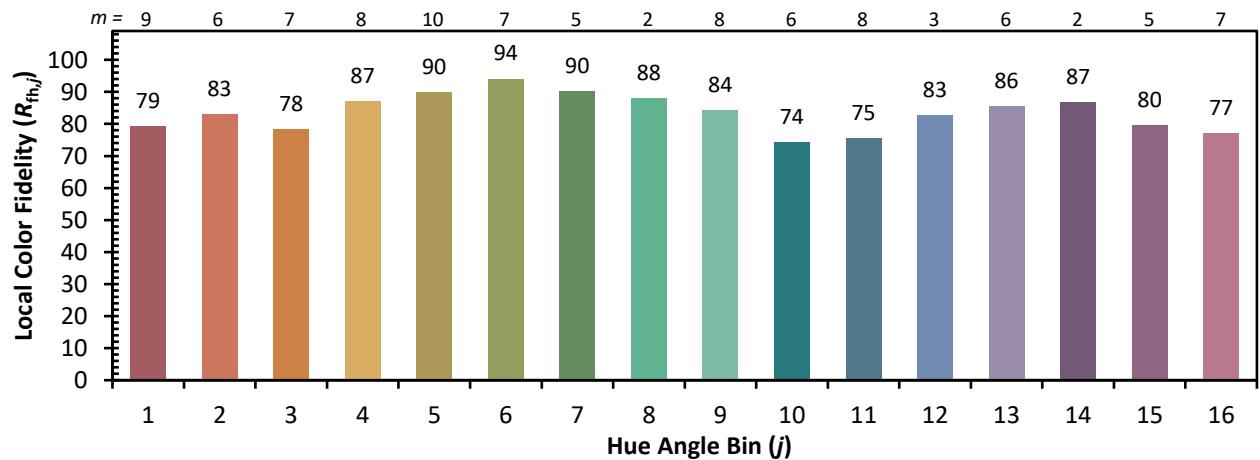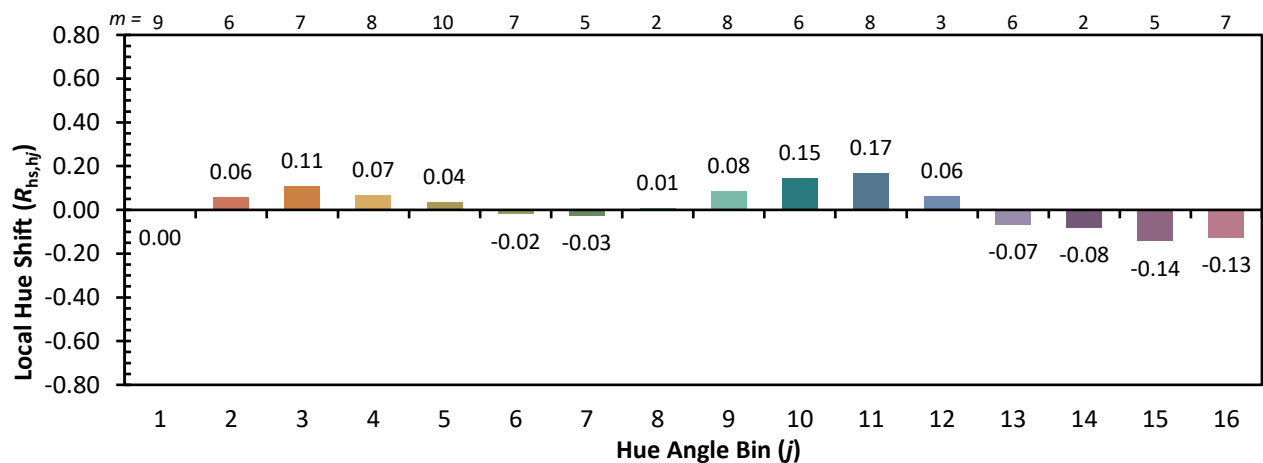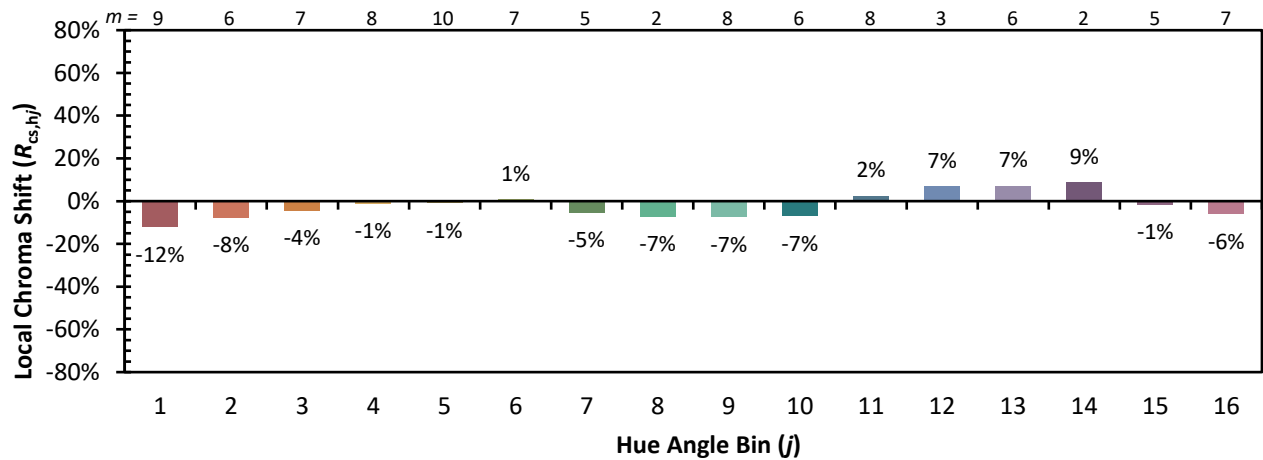

Measure Comparisons

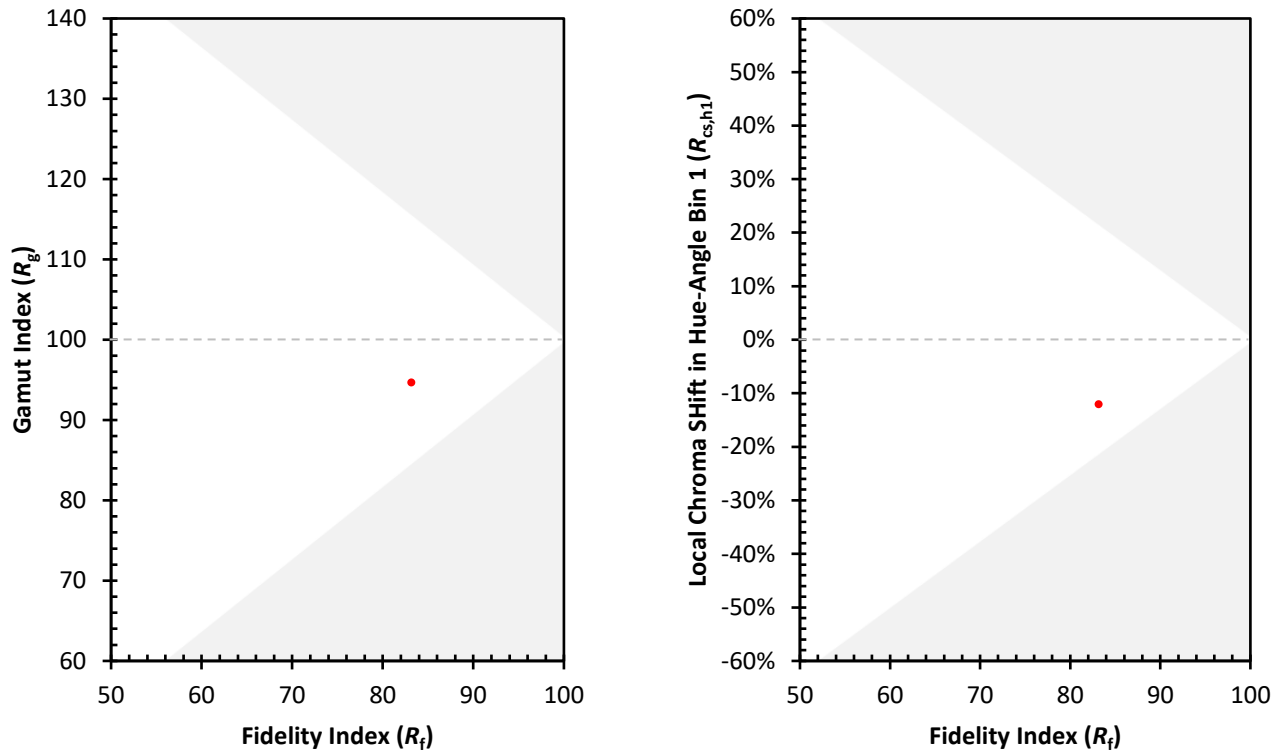

(END OF REPORT)