

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1439091

Luminaire Tested: CB2-D-125U-085D-930-1D-UNV-STD-W-4

Issue Date: 3/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1439091
REPORT IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2312-242-13, G2-2312-242-18)
Test Lab: INNOVATION CENTER
Issue Date: 3/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: CB2-D-125U-085D-930-1D-UNV-STD-W-4
Description: CORELITE BASIC SLOT LED LUMINAIRE, DIFFUSER DUST COVER UPLIGHT
2-INCH APERTURE
DOWNLIGHT 850 LUMENS PER FOOT
UPLIGHT 1250 LUMENS PER FOOT
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 8639.8 lumens
Efficiency: N/A
Efficacy: 127.4 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.09 / 1.24
Luminous Opening: Rectangular (W 0.15' x L: 4' x H: 0')
CIE Type: General Diffuse

Input Watts (W): 67.8
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1439091

CATALOG NUMBER: CB2-D-125U-085D-930-1D-UNV-STD-W-4

Luminous Intensity Polar Plot

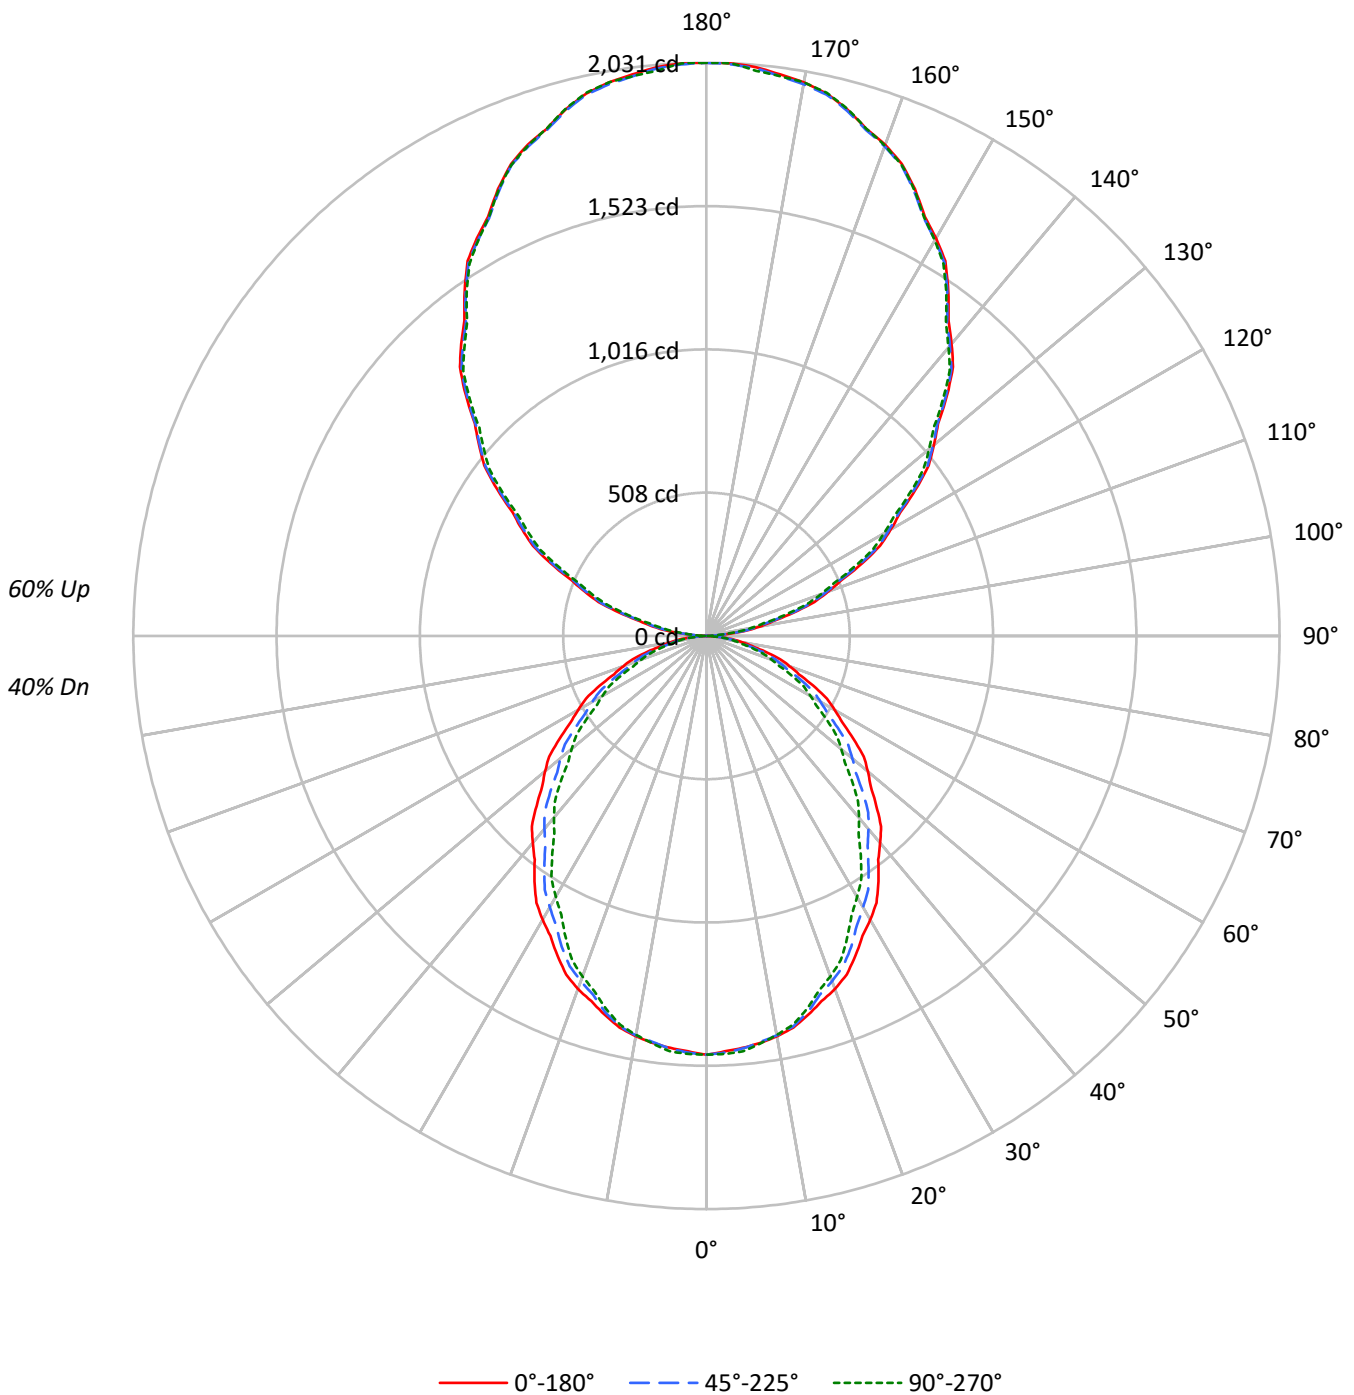



TEST NUMBER: P1439091

CATALOG NUMBER: CB2-D-125U-085D-930-1D-UNV-STD-W-4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20										
RC	80									70									50									30									10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0														
RCR																																						
0	105	105	105	105	95	95	95	95	78	78	78	62	62	62	47	47	47	40																				
1	96	91	88	84	87	83	80	77	68	66	64	54	53	52	42	41	40	34																				
2	87	80	74	69	79	73	68	64	60	56	53	48	46	43	37	35	34	29																				
3	80	70	63	58	72	64	58	53	53	49	45	43	39	37	33	31	29	25																				
4	73	62	55	49	66	57	50	45	47	42	38	38	34	32	29	27	25	21																				
5	67	56	48	42	61	51	44	39	42	37	33	34	30	27	27	24	22	18																				
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	24	21	19	16																				
7	57	45	37	32	52	41	35	30	35	29	25	28	24	21	22	19	17	15																				
8	53	41	33	28	48	38	31	26	31	26	23	26	22	19	20	18	16	13																				
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14	12																				
10	46	34	27	22	42	32	25	21	27	22	18	22	18	15	17	15	13	11																				

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	25842	25842	25842
5°	25623	25663	25841
10°	25477	25417	25395
15°	25073	24909	24705
20°	24678	24131	23794
25°	24015	23338	22683
30°	23350	22322	21477
35°	22585	21280	20265
40°	21775	20302	19115
45°	20959	19279	17994
50°	20225	18285	16900
55°	19319	17248	15869
60°	18281	16264	14840
65°	17182	15170	13810
70°	15965	13943	12497
75°	14522	12611	11312
80°	12989	11053	10251
85°	9992	9073	7494

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 20959 cd/sqm



TEST NUMBER: P1439091

CATALOG NUMBER: CB2-D-125U-085D-930-1D-UNV-STD-W-4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	139.5	1.6
10°-20°	388.9	4.5
20°-30°	559.2	6.5
30°-40°	628.5	7.3
40°-50°	607.2	7.0
50°-60°	513.0	5.9
60°-70°	368.5	4.3
70°-80°	201.4	2.3
80°-90°	53.6	0.6
90°-100°	78.5	0.9
100°-110°	323.6	3.7
110°-120°	587.5	6.8
120°-130°	799.4	9.3
130°-140°	922.8	10.7
140°-150°	929.9	10.8
150°-160°	802.5	9.3
160°-170°	543.9	6.3
170°-180°	191.9	2.2
0°-30°	1087.6	12.6
0°-40°	1716.2	19.9
0°-60°	2836.4	32.8
0°-90°	3459.8	40.0
90°-120°	989.5	11.5
90°-150°	3641.7	42.1
90°-180°	5180.0	60.0
0°-180°	8639.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1484	1484	1484	1484	1484	
5°	1466	1486	1468	1468	1478	139
15°	1390	1403	1381	1368	1370	392
25°	1250	1251	1214	1187	1180	575
35°	1062	1050	1001	962	953	664
45°	851	833	783	742	730	657
55°	636	613	568	533	523	569
65°	417	401	368	342	335	413
75°	216	202	187	173	168	231
85°	50	47	45	40	38	59
90°	0	0	2	0	2	5
95°	76	67	63	49	49	88
105°	320	315	307	290	287	340
115°	608	607	596	578	577	600
125°	905	914	895	876	878	808
135°	1206	1220	1199	1177	1185	928
145°	1494	1511	1488	1470	1481	933
155°	1748	1765	1740	1729	1743	804
165°	1931	1951	1926	1916	1933	544
175°	2023	2045	2018	2006	2010	192
180°	2031	2031	2031	2031	2031	

TEST NUMBER: P1439091

CATALOG NUMBER: CB2-D-125U-085D-930-1D-UNV-STD-W-4

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1483.7	1483.7	1483.7	1483.7	1483.7
2.5°	1473.7	1491.4	1478.2	1480.1	1482.8
5°	1465.5	1485.5	1467.8	1468.0	1478.0
7.5°	1455.0	1473.9	1451.6	1447.5	1456.8
10°	1440.5	1459.4	1437.1	1429.3	1435.9
12.5°	1421.4	1439.4	1418.0	1405.6	1411.4
15°	1390.5	1402.7	1381.4	1367.8	1370.1
17.5°	1356.9	1364.4	1333.7	1322.3	1320.1
20°	1331.4	1338.1	1301.9	1285.9	1283.7
22.5°	1298.7	1304.5	1266.4	1246.8	1243.7
25°	1249.6	1250.7	1214.4	1187.0	1180.3
27.5°	1198.3	1194.7	1154.4	1122.0	1113.3
30°	1161.0	1156.6	1109.9	1075.6	1067.9
32.5°	1121.0	1113.0	1066.3	1029.3	1021.5
35°	1062.2	1050.0	1000.8	962.0	953.1
37.5°	999.5	985.7	937.5	895.2	885.2
40°	957.7	942.1	892.9	850.7	840.7
42.5°	915.9	898.5	848.4	806.1	795.2
45°	850.9	833.1	782.7	741.6	730.5
47.5°	789.1	766.4	717.5	676.6	665.5
50°	746.4	721.9	674.8	634.8	623.7
52.5°	702.8	677.4	632.1	593.9	582.8
55°	636.2	612.9	568.0	532.6	522.6
57.5°	570.3	547.9	506.9	473.0	463.3
60°	524.8	506.0	466.9	434.9	426.0
62.5°	481.2	464.1	426.9	397.6	388.8
65°	416.9	401.4	368.1	341.8	335.1
67.5°	354.4	338.9	312.0	288.4	280.8
70°	313.5	298.0	273.8	252.0	245.4
72.5°	274.5	258.0	238.3	218.5	213.6
75°	215.8	202.5	187.4	172.6	168.1
77.5°	164.0	151.2	140.2	129.7	128.6
80°	129.5	118.4	110.2	103.4	102.2
82.5°	96.8	88.3	82.9	77.9	77.7
85°	50.0	46.7	45.4	39.7	37.5
87.5°	14.5	14.5	13.0	10.9	11.2
90°	0.0	0.0	1.6	0.0	1.6
92.5°	19.0	16.5	15.5	10.2	11.7
95°	76.0	66.8	63.4	49.1	49.1
97.5°	143.5	134.2	129.3	114.6	111.5
100°	191.7	182.4	177.4	161.5	158.4
102.5°	241.1	236.8	228.1	211.0	207.9
105°	320.0	315.4	307.4	289.9	286.8
107.5°	401.2	402.1	390.1	375.7	371.4
110°	459.5	457.9	448.4	434.0	430.9



TEST NUMBER: P1439091

CATALOG NUMBER: CB2-D-125U-085D-930-1D-UNV-STD-W-4

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	519.0	516.2	506.7	492.3	489.2
115°	608.4	606.8	595.7	578.2	576.7
117.5°	693.3	698.3	685.1	666.7	666.1
120°	754.1	760.3	744.6	728.7	725.6
122.5°	813.7	821.1	805.5	787.1	787.7
125°	904.7	913.9	895.1	876.2	877.7
127.5°	992.4	1003.9	986.4	967.1	969.0
130°	1052.0	1065.9	1047.2	1026.7	1029.8
132.5°	1112.8	1126.8	1108.1	1086.3	1091.9
135°	1205.7	1219.6	1199.3	1177.3	1185.1
137.5°	1293.1	1307.1	1284.9	1266.4	1275.7
140°	1351.4	1365.4	1341.9	1324.7	1334.0
142.5°	1408.5	1424.9	1400.2	1381.8	1393.6
145°	1494.0	1511.1	1487.7	1470.5	1481.3
147.5°	1575.1	1592.2	1568.5	1551.9	1563.1
150°	1627.1	1644.1	1619.2	1605.2	1617.6
152.5°	1675.3	1694.8	1668.6	1654.7	1670.8
155°	1747.5	1764.6	1739.6	1728.8	1742.8
157.5°	1810.3	1830.1	1805.2	1795.9	1807.1
160°	1852.1	1870.7	1845.7	1836.5	1848.9
162.5°	1883.8	1903.6	1880.0	1869.5	1884.4
165°	1931.3	1951.4	1926.5	1915.8	1932.9
167.5°	1968.7	1990.1	1964.9	1953.9	1971.2
170°	1991.5	2011.6	1985.2	1972.9	1991.5
172.5°	2006.7	2028.1	2000.4	1988.0	2000.4
175°	2023.2	2044.9	2018.4	2005.9	2010.5
177.5°	2031.1	2048.5	2027.3	2016.2	2031.1
180°	2031.1	2031.1	2031.1	2031.1	2031.1



TEST NUMBER: P1439091
 CATALOG NUMBER: CB2-D-125U-085D-930-1D-UNV-STD-W-4

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.30	18.07	18.34	19.12	20.52	16.20	16.97	17.24	18.02	19.42
	3H	18.94	19.63	19.99	20.68	22.11	17.72	18.41	18.77	19.46	20.89
	4H	19.56	20.22	20.62	21.27	22.71	18.29	18.94	19.35	20.00	21.43
	6H	19.96	20.56	21.03	21.62	23.07	18.66	19.26	19.73	20.32	21.76
	8H	20.11	20.68	21.18	21.75	23.19	18.79	19.37	19.87	20.44	21.88
	12H	20.18	20.72	21.26	21.79	23.25	18.85	19.40	19.94	20.47	21.93
4H	2H	17.70	18.35	18.77	19.41	20.84	16.82	17.48	17.89	18.53	19.97
	3H	19.56	20.10	20.64	21.19	22.63	18.55	19.10	19.63	20.18	21.62
	4H	20.30	20.80	21.38	21.87	23.34	19.22	19.72	20.30	20.79	22.26
	6H	20.82	21.24	21.91	22.34	23.80	19.69	20.12	20.78	21.22	22.68
	8H	21.02	21.42	22.11	22.51	23.99	19.88	20.28	20.97	21.37	22.85
	12H	21.12	21.48	22.23	22.59	24.07	19.96	20.32	21.07	21.43	22.91
8H	4H	20.45	20.85	21.54	21.94	23.42	19.49	19.89	20.58	20.98	22.45
	6H	21.09	21.42	22.20	22.55	24.03	20.09	20.42	21.20	21.55	23.02
	8H	21.38	21.67	22.50	22.78	24.28	20.36	20.65	21.48	21.76	23.26
	12H	21.55	21.80	22.67	22.91	24.44	20.51	20.76	21.63	21.87	23.40
12H	4H	20.43	20.79	21.53	21.89	23.37	19.49	19.85	20.59	20.95	22.43
	6H	21.12	21.41	22.24	22.52	24.01	20.15	20.44	21.27	21.55	23.05
	8H	21.43	21.68	22.55	22.79	24.33	20.45	20.71	21.57	21.82	23.35