

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1438870

Luminaire Tested: CB2-B-030U-085D-935-1D-UNV-STD-W-8

Issue Date: 3/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1438870
REPORT IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2405-119-1, G2-2312-242-18)
Test Lab: INNOVATION CENTER
Issue Date: 3/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: CB2-B-030U-085D-935-1D-UNV-STD-W-8
Description: CORELITE BASIC SLOT LED LUMINAIRE, BATWING UPLIGHT
2-INCH APERTURE
DOWNLIGHT 850 LUMENS PER FOOT
UPLIGHT 300 LUMENS PER FOOT
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10173.8 lumens
Efficiency: N/A
Efficacy: 137.3 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.09 / 1.24
Luminous Opening: Rectangular (W 0.15' x L: 8' x H: 0')
CIE Type: Semi-Direct

Input Watts (W): 74.1
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1438870

CATALOG NUMBER: CB2-B-030U-085D-935-1D-UNV-STD-W-8

Luminous Intensity Polar Plot

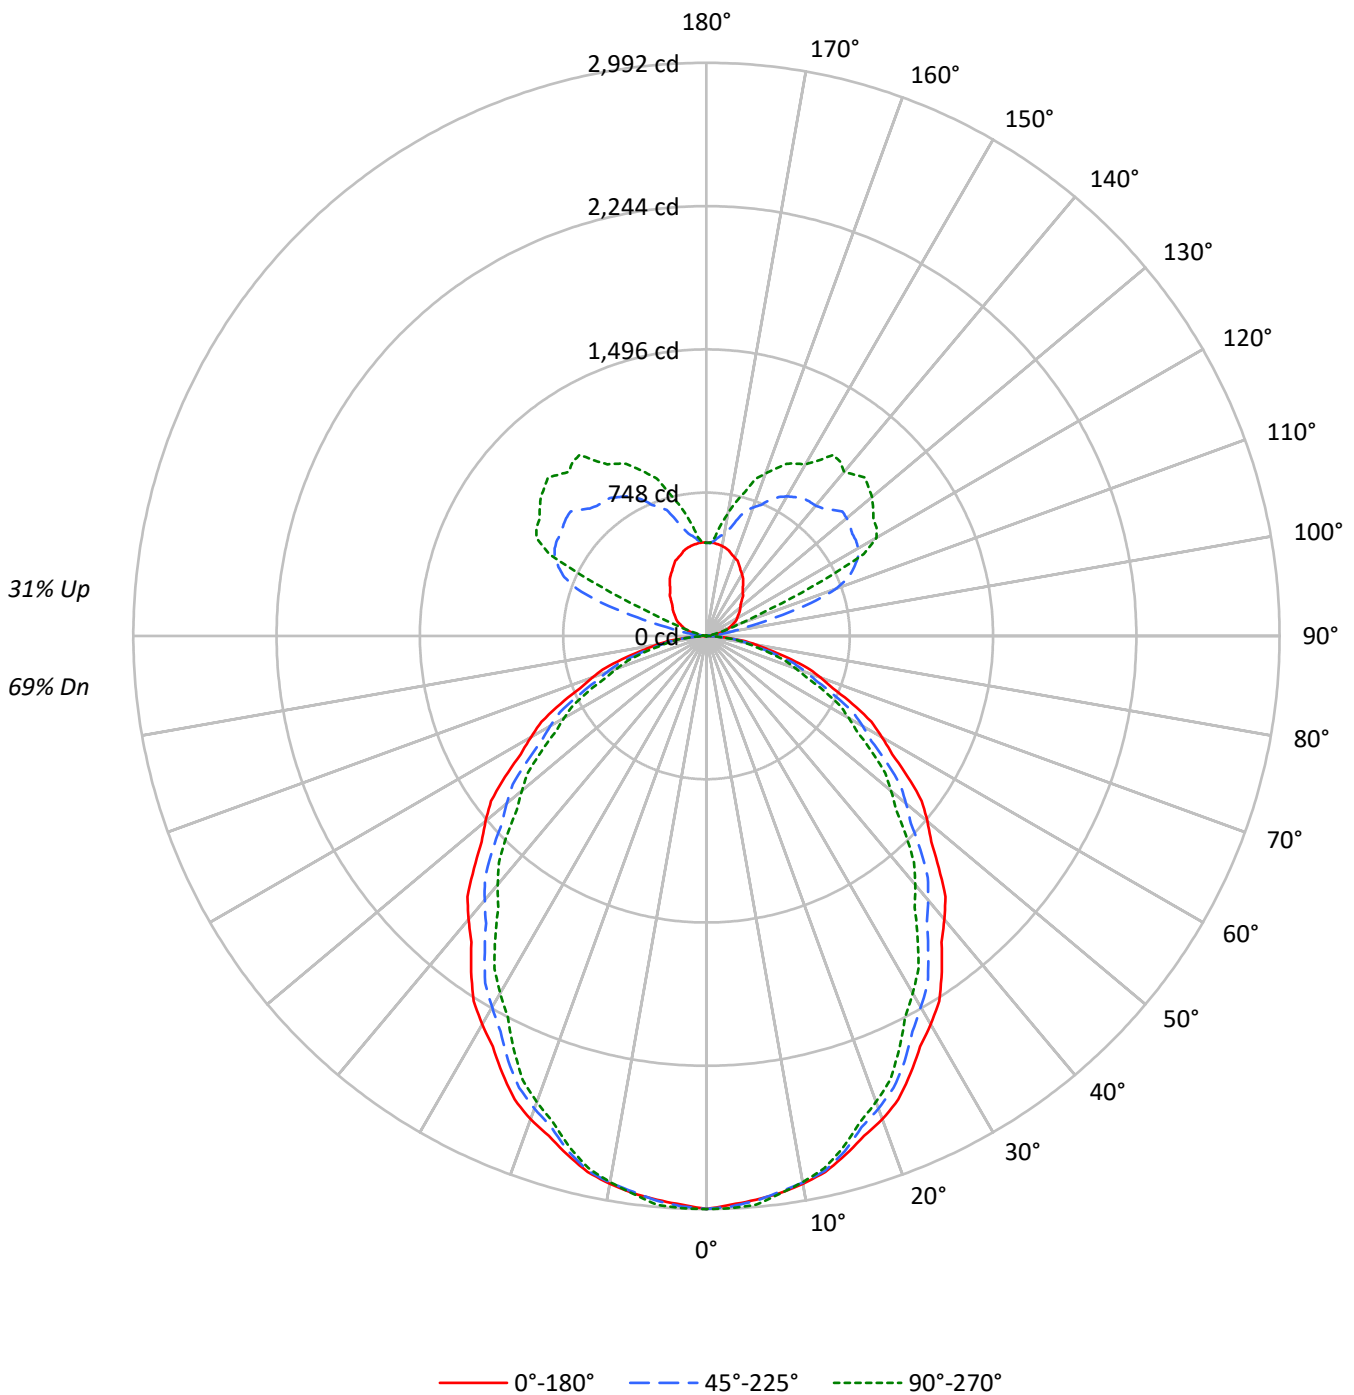



TEST NUMBER: P1438870

CATALOG NUMBER: CB2-B-030U-085D-935-1D-UNV-STD-W-8

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20																		
RC	80									70									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																														
0	112	112	112	112	105	105	105	105	94	94	94	83	83	83	73	73	73	69																												
1	102	98	94	90	96	93	89	86	83	80	78	73	72	70	65	64	62	58																												
2	93	86	80	74	88	81	76	71	73	68	65	65	62	59	58	55	53	49																												
3	85	76	68	62	80	72	65	60	64	59	55	58	53	50	51	48	45	42																												
4	78	67	59	53	74	64	57	51	57	52	47	52	47	43	46	42	39	36																												
5	72	60	52	46	68	57	50	44	52	45	41	46	41	38	42	38	34	32																												
6	66	54	46	40	63	52	44	39	47	40	36	42	37	33	38	34	30	28																												
7	62	49	41	35	58	47	39	34	43	36	32	38	33	29	35	30	27	25																												
8	57	45	37	31	54	43	36	30	39	33	28	35	30	26	32	28	25	22																												
9	54	41	33	28	51	39	32	27	36	30	26	33	28	24	30	25	22	20																												
10	50	38	30	26	47	36	29	25	33	27	23	30	25	22	27	23	20	18																												

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	26054	26054	26054
5°	25833	25874	26054
10°	25686	25625	25605
15°	25280	25115	24908
20°	24882	24329	23990
25°	24213	23530	22870
30°	23543	22506	21653
35°	22771	21456	20432
40°	21953	20469	19272
45°	21132	19438	18141
50°	20390	18435	17038
55°	19477	17391	15998
60°	18433	16398	14961
65°	17324	15294	13926
70°	16097	14058	12599
75°	14643	12719	11407
80°	13094	11144	10341
85°	10072	9153	7554

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 21132 cd/sqm



TEST NUMBER: P1438870

CATALOG NUMBER: CB2-B-030U-085D-935-1D-UNV-STD-W-8

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	281.3	2.8
10°-20°	784.2	7.7
20°-30°	1127.6	11.1
30°-40°	1267.4	12.5
40°-50°	1224.3	12.0
50°-60°	1034.5	10.2
60°-70°	743.0	7.3
70°-80°	406.1	4.0
80°-90°	107.9	1.1
90°-100°	36.5	0.4
100°-110°	225.8	2.2
110°-120°	569.4	5.6
120°-130°	684.5	6.7
130°-140°	620.6	6.1
140°-150°	494.9	4.9
150°-160°	337.6	3.3
160°-170°	178.5	1.8
170°-180°	49.7	0.5
0°-30°	2193.2	21.6
0°-40°	3460.6	34.0
0°-60°	5719.4	56.2
0°-90°	6976.4	68.6
90°-120°	831.7	8.2
90°-150°	2631.6	25.9
90°-180°	3197.0	31.4
0°-180°	10173.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2992	2992	2992	2992	2992	
5°	2955	2995	2960	2960	2980	281
15°	2804	2828	2786	2758	2763	790
25°	2520	2522	2449	2394	2380	1160
35°	2142	2117	2018	1940	1922	1338
45°	1716	1680	1578	1495	1473	1326
55°	1283	1236	1145	1074	1054	1147
65°	841	809	742	689	676	834
75°	435	408	378	348	339	466
85°	101	94	92	80	76	120
90°	0	0	0	0	0	5
95°	19	48	15	10	10	24
105°	92	258	373	94	63	97
115°	159	352	852	793	604	156
125°	208	427	929	1057	1063	186
135°	260	473	931	1090	1170	202
145°	334	498	879	1059	1154	208
155°	405	507	782	943	992	186
165°	459	502	631	743	778	129
175°	487	493	501	510	520	46
180°	487	487	487	487	487	



TEST NUMBER: P1438870

CATALOG NUMBER: CB2-B-030U-085D-935-1D-UNV-STD-W-8

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2991.7	2991.7	2991.7	2991.7	2991.7
2.5°	2971.6	3007.4	2980.7	2984.5	2989.9
5°	2955.1	2995.4	2959.7	2960.1	2980.3
7.5°	2934.0	2972.1	2927.1	2918.9	2937.7
10°	2904.7	2942.8	2897.8	2882.1	2895.5
12.5°	2866.2	2902.5	2859.3	2834.4	2846.0
15°	2803.9	2828.5	2785.6	2758.2	2762.7
17.5°	2736.1	2751.3	2689.4	2666.3	2661.9
20°	2684.8	2698.2	2625.2	2593.0	2588.6
22.5°	2618.8	2630.4	2553.7	2514.2	2507.9
25°	2519.8	2522.1	2448.8	2393.5	2380.1
27.5°	2416.3	2409.1	2327.9	2262.4	2244.9
30°	2341.2	2332.2	2238.1	2169.0	2153.3
32.5°	2260.5	2244.4	2150.1	2075.5	2059.8
35°	2141.9	2117.2	2018.2	1939.9	1921.9
37.5°	2015.4	1987.6	1890.3	1805.1	1785.0
40°	1931.1	1899.8	1800.5	1715.3	1695.2
42.5°	1846.8	1811.9	1710.7	1625.5	1603.5
45°	1715.8	1679.9	1578.3	1495.4	1473.0
47.5°	1591.2	1545.5	1446.8	1364.3	1341.9
50°	1505.0	1455.8	1360.7	1280.0	1257.6
52.5°	1417.1	1366.0	1274.6	1197.6	1175.2
55°	1282.8	1235.8	1145.4	1073.9	1053.7
57.5°	1150.0	1104.7	1022.1	953.9	934.2
60°	1058.3	1020.3	941.5	877.0	859.0
62.5°	970.4	935.9	860.9	801.8	783.9
65°	840.7	809.4	742.2	689.2	675.8
67.5°	714.7	683.4	629.0	581.5	566.3
70°	632.2	600.9	552.1	508.2	494.8
72.5°	553.4	520.3	480.6	440.5	430.7
75°	435.2	408.4	378.0	348.0	339.0
77.5°	330.8	304.8	282.7	261.6	259.3
80°	261.1	238.7	222.2	208.4	206.2
82.5°	195.2	178.1	167.2	157.1	156.7
85°	100.8	94.1	91.6	80.1	75.6
87.5°	29.3	29.3	25.7	22.0	22.0
90°	0.0	0.0	0.0	0.0	0.0
92.5°	5.0	8.3	3.4	3.4	3.4
95°	18.9	47.6	14.7	10.5	10.5
97.5°	39.4	114.1	79.3	21.3	18.5
100°	54.5	165.3	136.3	31.3	25.2
102.5°	69.6	209.9	215.2	49.7	38.6
105°	92.3	258.4	373.3	93.7	62.9
107.5°	114.5	290.1	572.2	193.3	116.6
110°	127.9	308.4	721.5	301.4	180.4

TEST NUMBER: P1438870

CATALOG NUMBER: CB2-B-030U-085D-935-1D-UNV-STD-W-8

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	141.4	326.8	803.7	483.1	311.3
115°	159.4	352.2	851.6	792.7	604.1
117.5°	174.5	375.5	892.7	980.3	925.0
120°	184.6	393.8	914.5	1007.2	1025.6
122.5°	194.6	407.1	926.2	1017.6	1052.5
125°	207.6	427.1	929.2	1057.2	1063.4
127.5°	220.6	442.1	943.0	1093.7	1096.5
130°	230.7	452.2	956.4	1105.9	1128.4
132.5°	242.5	460.7	961.5	1112.8	1146.9
135°	260.1	473.4	931.3	1090.4	1170.4
137.5°	282.3	482.5	902.3	1089.7	1141.4
140°	295.7	484.4	887.2	1113.8	1117.9
142.5°	310.8	489.7	883.9	1111.2	1146.5
145°	333.5	497.6	878.8	1059.2	1153.6
147.5°	356.1	502.6	859.5	1001.9	1084.4
150°	371.2	504.5	841.1	982.8	1034.0
152.5°	386.3	506.5	817.6	970.8	1013.9
155°	404.8	507.3	782.3	942.9	992.1
157.5°	424.1	504.9	740.0	891.8	945.5
160°	434.2	501.8	713.1	854.7	901.9
162.5°	444.2	500.4	689.6	806.3	861.6
165°	459.3	502.4	631.3	743.3	778.1
167.5°	469.4	500.6	576.8	668.5	717.7
170°	476.1	500.7	543.2	611.3	652.3
172.5°	481.1	492.6	523.1	559.0	586.9
175°	486.6	492.8	501.3	509.9	520.2
177.5°	488.3	491.6	484.9	483.3	486.6
180°	486.6	486.6	486.6	486.6	486.6



TEST NUMBER: P1438870
 CATALOG NUMBER: CB2-B-030U-085D-935-1D-UNV-STD-W-8

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.89	20.93	20.68	21.74	22.72	18.79	19.83	19.58	20.64	21.62
	3H	21.55	22.48	22.35	23.30	24.31	20.33	21.27	21.13	22.08	23.09
	4H	22.19	23.07	23.00	23.89	24.91	20.92	21.80	21.73	22.62	23.64
	6H	22.60	23.41	23.43	24.24	25.27	21.30	22.11	22.12	22.94	23.97
	8H	22.75	23.53	23.59	24.37	25.41	21.44	22.22	22.28	23.06	24.10
	12H	22.83	23.57	23.67	24.41	25.47	21.51	22.25	22.35	23.09	24.15
4H	2H	20.32	21.20	21.14	22.03	23.05	19.45	20.33	20.27	21.15	22.17
	3H	22.21	22.94	23.04	23.80	24.83	21.20	21.93	22.03	22.79	23.83
	4H	22.96	23.63	23.80	24.48	25.55	21.88	22.55	22.72	23.40	24.47
	6H	23.49	24.07	24.35	24.95	26.01	22.37	22.94	23.22	23.82	24.89
	8H	23.70	24.24	24.56	25.11	26.19	22.56	23.10	23.42	23.97	25.05
	12H	23.82	24.30	24.70	25.19	26.28	22.66	23.14	23.54	24.03	25.12
8H	4H	23.13	23.67	23.99	24.54	25.62	22.17	22.71	23.03	23.58	24.66
	6H	23.78	24.23	24.67	25.14	26.22	22.78	23.23	23.67	24.14	25.22
	8H	24.07	24.47	24.97	25.38	26.47	23.06	23.45	23.96	24.36	25.46
	12H	24.26	24.60	25.16	25.50	26.66	23.21	23.56	24.12	24.46	25.61
12H	4H	23.12	23.61	24.00	24.50	25.58	22.18	22.67	23.06	23.56	24.64
	6H	23.81	24.21	24.71	25.12	26.21	22.84	23.24	23.74	24.15	25.25
	8H	24.14	24.49	25.04	25.38	26.54	23.16	23.51	24.06	24.41	25.56