

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1439458

Luminaire Tested: CB3-B-085U-120D-927-1D-UNV-STD-W-8

Issue Date: 3/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1439458
REPORT IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2405-119-2, G2-2312-242-8)
Test Lab: INNOVATION CENTER
Issue Date: 3/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: CB3-B-085U-120D-927-1D-UNV-STD-W-8
Description: CORELITE BASIC SLOT LED LUMINAIRE, BATWING UPLIGHT
3-INCH APERTURE
DOWNLIGHT 1200 LUMENS PER FOOT
UPLIGHT 850 LUMENS PER FOOT
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17462.7 lumens
Efficiency: N/A
Efficacy: 131.2 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.13 / 1.26
Luminous Opening: Rectangular (W 0.24' x L: 8' x H: 0')
CIE Type: General Diffuse

Input Watts (W): 133.1
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1439458

CATALOG NUMBER: CB3-B-085U-120D-927-1D-UNV-STD-W-8

Luminous Intensity Polar Plot

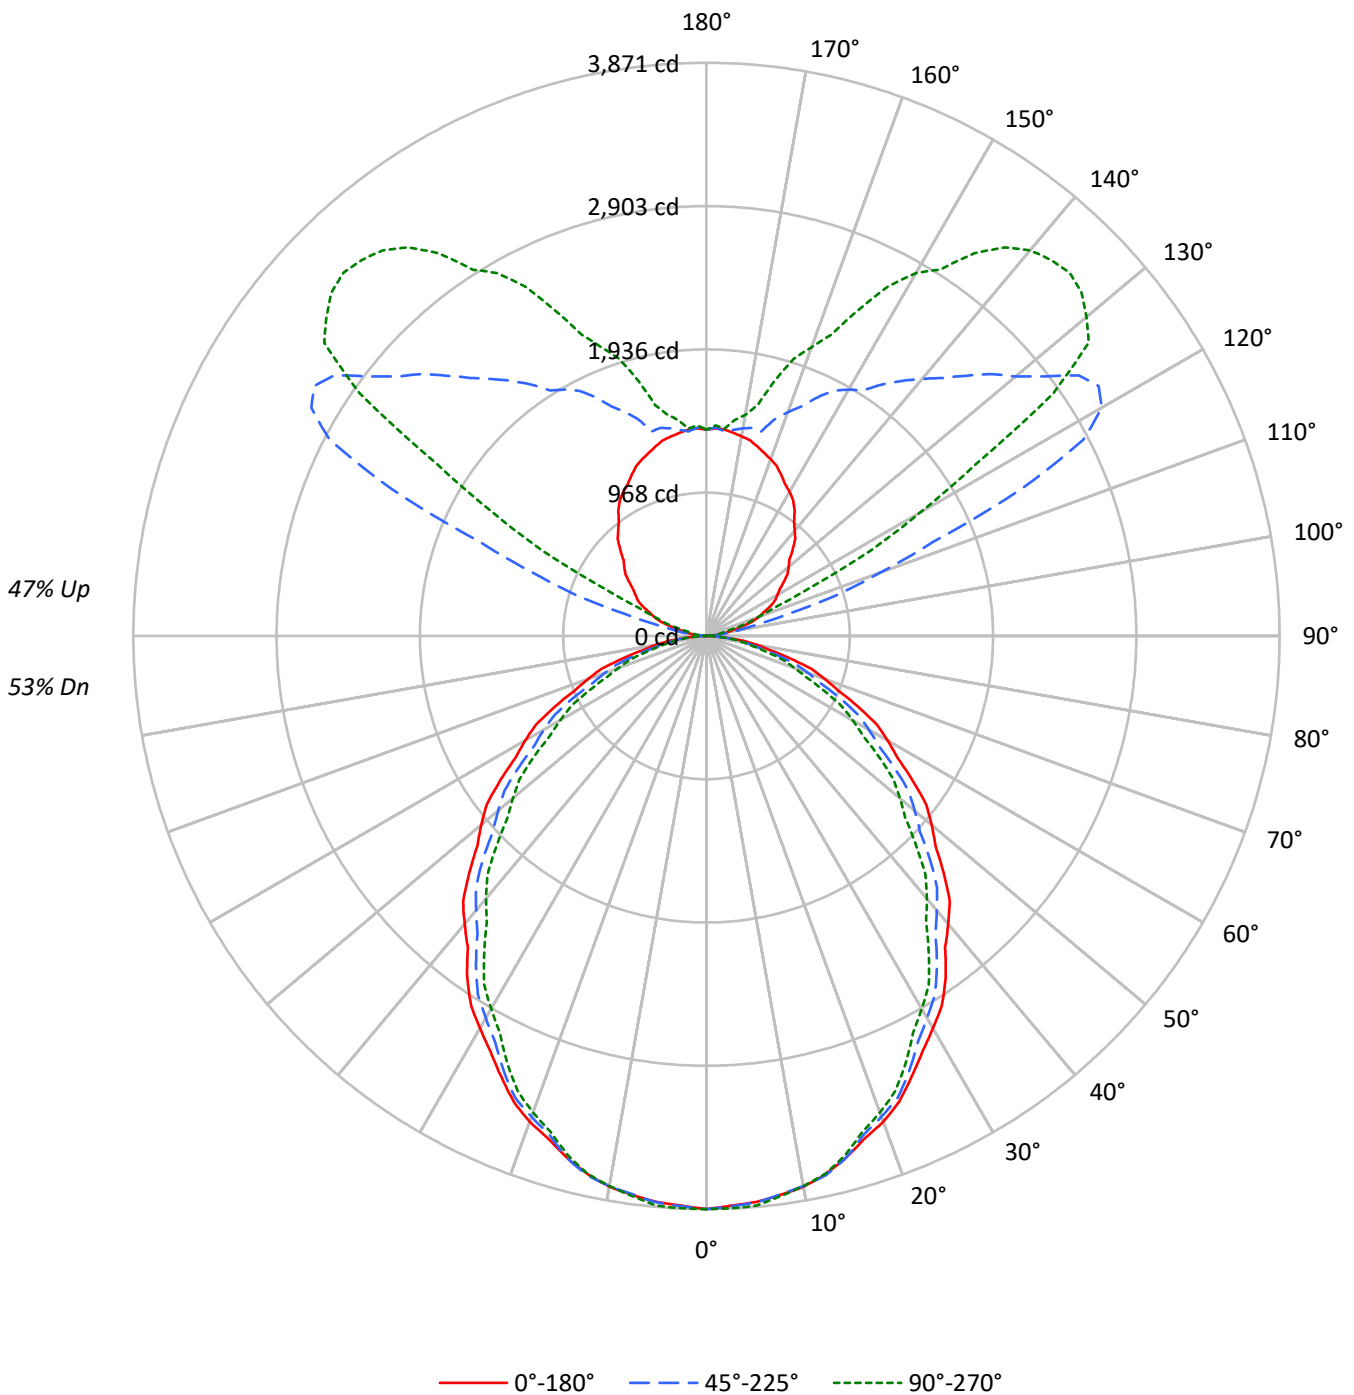



TEST NUMBER: P1439458

CATALOG NUMBER: CB3-B-085U-120D-927-1D-UNV-STD-W-8

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20					
RC	80					70					50					30					10					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																										
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	59	59	59	53								
1	99	94	91	87	91	88	84	81	75	72	70	63	61	60	52	51	50	45								
2	90	83	77	71	83	77	72	67	66	62	58	56	53	50	46	44	43	38								
3	82	73	66	60	76	68	61	56	58	53	49	49	46	43	41	39	36	32								
4	75	65	57	51	70	60	53	48	52	46	42	44	40	37	37	34	32	28								
5	69	58	50	44	64	54	47	41	47	41	37	40	35	32	33	30	28	24								
6	64	52	44	38	59	48	41	36	42	36	32	36	32	28	30	27	24	22								
7	59	47	39	33	55	44	37	32	38	32	28	33	28	25	28	24	22	19								
8	55	43	35	30	51	40	33	28	35	29	25	30	26	22	26	22	20	17								
9	51	39	31	26	47	37	30	25	32	26	23	28	23	20	24	20	18	16								
10	48	36	29	24	44	34	27	23	29	24	20	26	21	18	22	19	16	14								

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	21899	21899	21899
5°	21796	21811	21936
10°	21700	21668	21668
15°	21368	21368	21239
20°	21021	20805	20623
25°	20490	20233	19873
30°	19989	19468	19001
35°	19462	18740	18076
40°	18760	17867	17096
45°	18125	17091	16035
50°	17470	16163	15002
55°	16759	15266	14020
60°	15989	14340	12910
65°	15089	13286	11740
70°	14051	12052	10459
75°	12739	10577	9314
80°	11106	8868	8239
85°	8568	7497	7497

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 18125 cd/sqm



TEST NUMBER: P1439458

CATALOG NUMBER: CB3-B-085U-120D-927-1D-UNV-STD-W-8

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.2	2.1
10°-20°	1026.1	5.9
20°-30°	1490.8	8.5
30°-40°	1694.9	9.7
40°-50°	1645.4	9.4
50°-60°	1389.2	8.0
60°-70°	988.4	5.7
70°-80°	528.1	3.0
80°-90°	139.5	0.8
90°-100°	94.2	0.5
100°-110°	493.8	2.8
110°-120°	1242.9	7.1
120°-130°	1917.5	11.0
130°-140°	1755.3	10.1
140°-150°	1295.5	7.4
150°-160°	825.8	4.7
160°-170°	434.8	2.5
170°-180°	135.4	0.8
0°-30°	2882.1	16.5
0°-40°	4577.1	26.2
0°-60°	7611.7	43.6
0°-90°	9267.6	53.1
90°-120°	1830.9	10.5
90°-150°	6799.2	38.9
90°-180°	8195.0	46.9
0°-180°	17462.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3871	3871	3871	3871	3871	
5°	3838	3886	3841	3836	3863	364
15°	3648	3680	3648	3626	3626	1028
25°	3283	3293	3241	3197	3184	1512
35°	2818	2791	2714	2633	2617	1756
45°	2265	2230	2136	2034	2004	1747
55°	1699	1653	1548	1448	1421	1519
65°	1127	1087	992	904	877	1116
75°	583	551	484	434	426	621
85°	132	121	116	116	116	156
90°	0	0	0	0	0	7
95°	49	139	55	31	31	62
105°	252	780	565	232	190	269
115°	479	977	2345	1019	773	466
125°	638	986	3069	3094	2860	571
135°	822	1099	2486	3390	3468	635
145°	1037	1199	2075	2885	3155	645
155°	1197	1287	1780	2203	2431	552
165°	1326	1362	1430	1672	1786	374
175°	1399	1430	1387	1394	1406	132
180°	1393	1393	1393	1393	1393	



TEST NUMBER: P1439458

CATALOG NUMBER: CB3-B-085U-120D-927-1D-UNV-STD-W-8

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3871.0	3871.0	3871.0	3871.0	3871.0
2.5°	3851.2	3889.9	3855.6	3860.2	3868.8
5°	3838.0	3886.4	3840.7	3835.9	3862.7
7.5°	3808.3	3852.4	3805.0	3794.0	3818.2
10°	3777.5	3825.9	3772.0	3758.6	3772.0
12.5°	3722.5	3773.1	3730.2	3707.9	3719.2
15°	3648.3	3680.5	3648.3	3626.3	3626.3
17.5°	3557.6	3591.4	3530.6	3515.1	3509.2
20°	3491.6	3521.2	3455.8	3433.7	3425.6
22.5°	3403.6	3431.0	3376.7	3339.0	3328.8
25°	3282.6	3293.4	3241.4	3197.1	3183.7
27.5°	3161.1	3163.8	3092.4	3038.6	3020.9
30°	3059.9	3062.6	2980.2	2922.2	2908.7
32.5°	2958.8	2950.7	2872.4	2803.5	2794.4
35°	2818.0	2791.1	2713.5	2633.4	2617.3
37.5°	2648.1	2632.0	2540.3	2460.1	2435.9
40°	2540.3	2513.5	2419.4	2339.1	2314.9
42.5°	2432.6	2401.4	2305.0	2215.9	2189.5
45°	2265.4	2230.5	2136.2	2033.8	2004.2
47.5°	2097.1	2059.0	1955.3	1856.1	1823.3
50°	1985.0	1944.7	1836.5	1739.5	1704.6
52.5°	1870.6	1828.1	1719.9	1620.9	1592.4
55°	1699.1	1653.4	1547.8	1448.3	1421.4
57.5°	1527.5	1482.3	1377.4	1283.2	1250.9
60°	1413.1	1370.1	1267.4	1173.2	1141.0
62.5°	1296.6	1255.7	1155.2	1063.3	1033.2
65°	1127.2	1086.9	992.5	903.9	877.0
67.5°	959.5	925.1	831.9	750.6	729.1
70°	849.5	817.3	728.6	653.8	632.3
72.5°	744.0	709.5	625.2	561.6	546.6
75°	582.8	550.6	483.9	434.2	426.1
77.5°	435.5	409.1	351.4	323.2	318.9
80°	340.9	316.7	272.2	252.9	252.9
82.5°	252.9	233.0	204.0	195.7	195.7
85°	132.0	121.2	115.5	115.5	115.5
87.5°	39.6	39.6	37.4	35.2	35.2
90°	0.0	0.0	0.0	0.0	0.0
92.5°	14.7	33.9	9.8	5.0	9.8
95°	49.1	139.1	55.2	30.7	30.7
97.5°	101.9	310.7	142.4	75.9	68.7
100°	141.2	441.2	221.0	110.2	98.2
102.5°	185.4	571.9	333.9	149.3	127.7
105°	251.7	779.8	564.7	232.3	190.3
107.5°	325.3	921.9	930.5	358.1	288.5
110°	374.4	980.6	1239.9	470.2	362.1



TEST NUMBER: P1439458

CATALOG NUMBER: CB3-B-085U-120D-927-1D-UNV-STD-W-8

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	418.6	996.0	1652.3	641.2	494.7
115°	478.8	976.9	2344.7	1019.4	773.4
117.5°	523.0	929.9	2870.1	1621.8	1250.9
120°	552.4	930.5	3081.2	2077.5	1663.4
122.5°	586.8	936.1	3140.2	2530.0	2149.5
125°	638.3	986.4	3069.0	3094.3	2860.3
127.5°	689.9	1023.6	2877.5	3326.3	3253.1
130°	724.3	1048.4	2725.2	3405.3	3351.3
132.5°	758.6	1073.1	2617.2	3407.2	3434.8
135°	822.5	1098.6	2485.9	3389.9	3467.9
137.5°	887.5	1130.0	2363.1	3282.6	3444.6
140°	926.8	1154.9	2264.9	3166.3	3400.4
142.5°	971.0	1175.1	2171.6	3058.6	3307.1
145°	1037.3	1199.3	2074.6	2884.8	3154.9
147.5°	1088.9	1212.5	1965.4	2709.4	2932.7
150°	1123.2	1213.3	1921.2	2553.5	2829.6
152.5°	1152.7	1237.9	1867.2	2410.6	2662.6
155°	1196.9	1286.9	1780.0	2202.6	2430.6
157.5°	1241.1	1327.5	1676.9	2047.4	2202.3
160°	1270.5	1342.6	1608.1	1972.6	2074.6
162.5°	1295.1	1357.5	1534.5	1845.2	1961.7
165°	1325.8	1361.8	1430.1	1672.1	1786.1
167.5°	1354.0	1372.0	1438.7	1502.2	1594.6
170°	1368.8	1386.8	1424.0	1486.1	1516.1
172.5°	1383.5	1411.1	1404.4	1446.7	1471.9
175°	1399.4	1429.5	1387.2	1393.6	1405.6
177.5°	1403.1	1417.5	1408.0	1408.4	1422.8
180°	1393.3	1393.3	1393.3	1393.3	1393.3



TEST NUMBER: P1439458

CATALOG NUMBER: CB3-B-085U-120D-927-1D-UNV-STD-W-8

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	18.15	19.03	19.08	19.98	21.21	17.07	17.95	18.01	18.90	20.13
	3H	19.82	20.61	20.76	21.56	22.82	18.49	19.28	19.43	20.23	21.48
	4H	20.45	21.20	21.41	22.16	23.42	19.01	19.75	19.97	20.71	21.97
	6H	20.84	21.52	21.81	22.49	23.76	19.33	20.01	20.30	20.98	22.25
	8H	20.98	21.63	21.95	22.61	23.88	19.45	20.10	20.43	21.09	22.36
	12H	21.04	21.66	22.02	22.64	23.94	19.53	20.15	20.51	21.12	22.42
4H	2H	18.56	19.31	19.53	20.27	21.53	17.70	18.45	18.67	19.41	20.67
	3H	20.45	21.07	21.43	22.07	23.34	19.32	19.94	20.30	20.94	22.21
	4H	21.20	21.77	22.19	22.76	24.05	19.93	20.50	20.92	21.48	22.78
	6H	21.71	22.19	22.70	23.20	24.50	20.35	20.83	21.34	21.84	23.14
	8H	21.90	22.35	22.89	23.36	24.67	20.52	20.97	21.51	21.97	23.28
	12H	22.00	22.41	23.01	23.43	24.74	20.62	21.03	21.64	22.05	23.37
8H	4H	21.33	21.79	22.33	22.79	24.10	20.19	20.65	21.19	21.65	22.96
	6H	21.95	22.33	22.98	23.37	24.68	20.72	21.10	21.75	22.14	23.45
	8H	22.23	22.56	23.26	23.59	24.92	20.98	21.31	22.01	22.34	23.67
	12H	22.39	22.69	23.43	23.71	25.08	21.15	21.45	22.19	22.47	23.84
12H	4H	21.31	21.72	22.32	22.74	24.05	20.20	20.61	21.21	21.63	22.94
	6H	21.97	22.30	23.00	23.33	24.66	20.78	21.11	21.81	22.14	23.47
	8H	22.27	22.56	23.30	23.59	24.96	21.06	21.36	22.10	22.38	23.75