

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1439365

Luminaire Tested: CB3-125U-120D-935-1D-UNV-STD-W-4

Issue Date: 3/31/2026

Test Information

Test Method: LM-79-2024
Report Number: P1439365
REPORT IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2506-466-2, G2-2312-242-8)
Test Lab: INNOVATION CENTER
Issue Date: 3/31/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: CORELITE
Catalog Number: CB3-125U-120D-935-1D-UNV-STD-W-4
Description: CORELITE BASIC SLOT LED LUMINAIRE, OPEN UPLIGHT
3-INCH APERTURE
DOWNLIGHT 1200 LUMENS PER FOOT
UPLIGHT 1250 LUMENS PER FOOT
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11049.6 lumens
Efficiency: N/A
Efficacy: 146.5 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.13 / 1.26
Luminous Opening: Rectangular (W 0.24' x L: 4' x H: 0')
CIE Type: General Diffuse

Input Watts (W): 75.4
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1439365

CATALOG NUMBER: CB3-125U-120D-935-1D-UNV-STD-W-4

Luminous Intensity Polar Plot

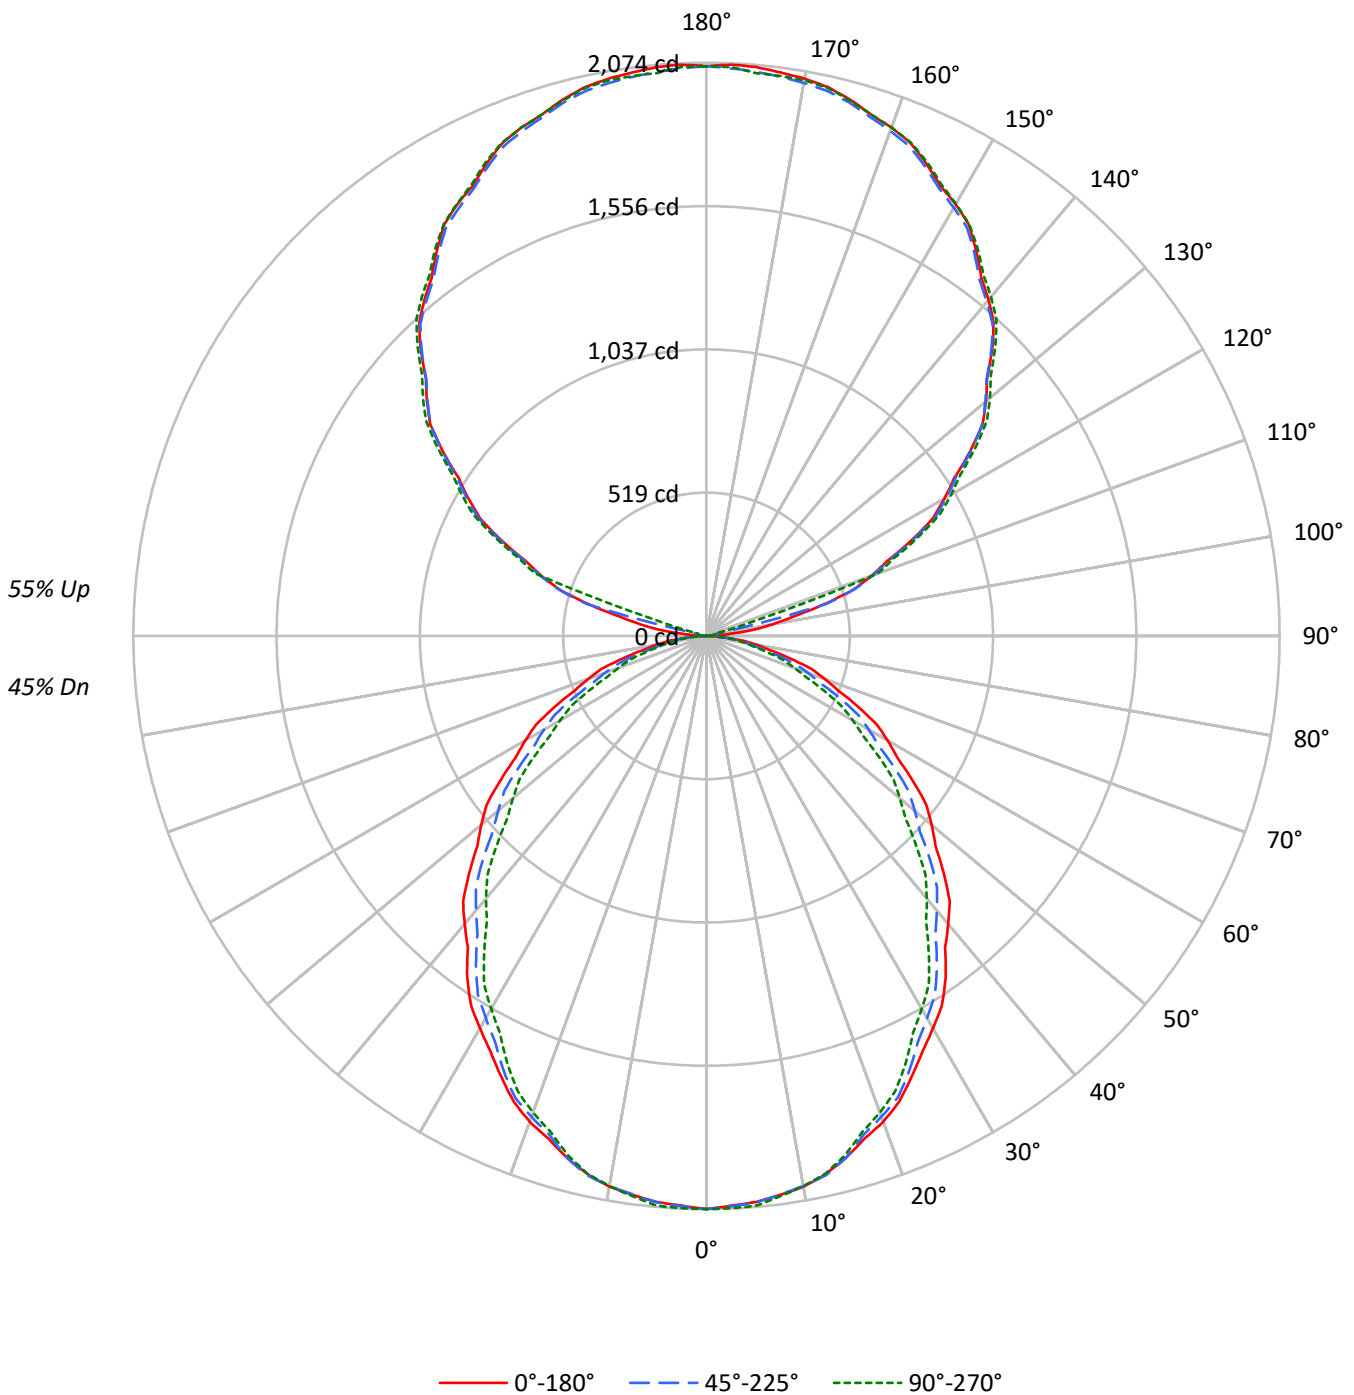



TEST NUMBER: P1439365

CATALOG NUMBER: CB3-125U-120D-935-1D-UNV-STD-W-4

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	106	106	106	106	97	97	97	97	81	81	81	65	65	65	51	51	51	45				
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44	38				
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	40	39	37	32				
3	81	71	64	58	74	66	59	54	55	50	47	45	42	39	36	34	32	27				
4	74	63	55	50	67	58	51	46	49	44	40	40	37	34	32	30	27	24				
5	68	56	48	42	62	52	45	40	44	38	34	36	32	29	29	26	24	21				
6	62	51	43	37	57	47	40	35	40	34	30	33	29	26	26	24	21	18				
7	58	46	38	32	53	42	35	30	36	30	26	30	26	23	24	21	19	16				
8	54	41	34	29	49	38	32	27	33	27	24	27	23	20	22	19	17	15				
9	50	38	30	25	46	35	29	24	30	25	21	25	21	18	21	18	15	13				
10	47	35	28	23	43	32	26	22	28	23	19	23	19	16	19	16	14	12				

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	23465	23465	23465
5°	23354	23371	23505
10°	23252	23218	23218
15°	22896	22896	22757
20°	22525	22293	22098
25°	21956	21680	21294
30°	21419	20861	20360
35°	20854	20081	19369
40°	20102	19145	18318
45°	19421	18313	17182
50°	18720	17319	16074
55°	17957	16359	15022
60°	17133	15365	13833
65°	16168	14235	12580
70°	15055	12912	11208
75°	13653	11331	9980
80°	11898	9500	8829
85°	9178	8036	8036

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 19421 cd/sqm



TEST NUMBER: P1439365

CATALOG NUMBER: CB3-125U-120D-935-1D-UNV-STD-W-4

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.7	1.8
10°-20°	549.7	5.0
20°-30°	798.7	7.2
30°-40°	908.1	8.2
40°-50°	881.5	8.0
50°-60°	744.3	6.7
60°-70°	529.5	4.8
70°-80°	282.9	2.6
80°-90°	74.8	0.7
90°-100°	47.6	0.4
100°-110°	344.8	3.1
110°-120°	819.7	7.4
120°-130°	1047.2	9.5
130°-140°	1129.6	10.2
140°-150°	1064.9	9.6
150°-160°	868.7	7.9
160°-170°	566.0	5.1
170°-180°	195.7	1.8
0°-30°	1544.1	14.0
0°-40°	2452.2	22.2
0°-60°	4078.0	36.9
0°-90°	4965.3	44.9
90°-120°	1212.1	11.0
90°-150°	4453.9	40.3
90°-180°	6084.0	55.1
0°-180°	11049.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2074	2074	2074	2074	2074	
5°	2056	2082	2058	2055	2070	195
15°	1955	1972	1955	1943	1943	551
25°	1759	1764	1737	1713	1706	810
35°	1510	1495	1454	1411	1402	941
45°	1214	1195	1144	1090	1074	936
55°	910	886	829	776	762	814
65°	604	582	532	484	470	598
75°	312	295	259	233	228	333
85°	71	65	62	62	62	84
90°	0	0	0	2	0	6
95°	87	16	20	22	22	107
105°	437	443	449	33	34	460
115°	819	825	826	839	844	808
125°	1164	1171	1168	1181	1188	1038
135°	1462	1470	1457	1468	1478	1126
145°	1701	1712	1690	1701	1710	1064
155°	1884	1900	1874	1879	1891	869
165°	2009	2019	1998	1992	2006	567
175°	2066	2077	2049	2038	2044	197
180°	2062	2062	2062	2062	2062	



TEST NUMBER: P1439365

CATALOG NUMBER: CB3-125U-120D-935-1D-UNV-STD-W-4

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2073.9	2073.9	2073.9	2073.9	2073.9
2.5°	2063.3	2084.1	2065.7	2068.1	2072.7
5°	2056.2	2082.2	2057.7	2055.1	2069.5
7.5°	2040.3	2064.0	2038.6	2032.7	2045.6
10°	2023.8	2049.8	2020.9	2013.7	2020.9
12.5°	1994.4	2021.5	1998.5	1986.6	1992.6
15°	1954.6	1971.9	1954.6	1942.8	1942.8
17.5°	1906.0	1924.2	1891.6	1883.3	1880.1
20°	1870.7	1886.5	1851.5	1839.6	1835.3
22.5°	1823.5	1838.2	1809.1	1788.9	1783.5
25°	1758.7	1764.5	1736.6	1712.9	1705.7
27.5°	1693.6	1695.0	1656.8	1628.0	1618.5
30°	1639.4	1640.8	1596.7	1565.6	1558.4
32.5°	1585.2	1580.9	1538.9	1502.0	1497.1
35°	1509.8	1495.4	1453.8	1410.9	1402.3
37.5°	1418.8	1410.1	1361.0	1318.0	1305.0
40°	1361.0	1346.6	1296.2	1253.2	1240.2
42.5°	1303.3	1286.6	1234.9	1187.2	1173.1
45°	1213.7	1195.0	1144.5	1089.6	1073.8
47.5°	1123.6	1103.1	1047.6	994.4	976.9
50°	1063.5	1041.9	983.9	932.0	913.2
52.5°	1002.2	979.4	921.5	868.4	853.1
55°	910.3	885.8	829.3	775.9	761.5
57.5°	818.4	794.2	738.0	687.5	670.2
60°	757.1	734.1	679.0	628.6	611.3
62.5°	694.6	672.8	618.9	569.7	553.5
65°	603.9	582.3	531.7	484.3	469.9
67.5°	514.1	495.6	445.7	402.1	390.6
70°	455.1	437.9	390.3	350.3	338.8
72.5°	398.6	380.1	335.0	300.9	292.8
75°	312.3	295.0	259.2	232.6	228.3
77.5°	233.3	219.2	188.2	173.2	170.9
80°	182.6	169.7	145.8	135.5	135.5
82.5°	135.5	124.9	109.3	104.9	104.9
85°	70.7	64.9	61.9	61.9	61.9
87.5°	21.2	21.2	20.0	19.2	18.9
90°	0.0	0.0	0.0	1.5	0.0
92.5°	23.6	9.0	7.5	9.0	8.7
95°	87.0	15.6	20.2	21.8	21.8
97.5°	175.2	171.9	23.6	28.3	28.6
100°	242.4	250.0	24.9	29.6	31.1
102.5°	316.9	323.3	46.0	30.8	32.3
105°	436.6	442.6	449.0	32.7	34.2
107.5°	555.6	560.1	564.3	507.9	190.2
110°	633.9	638.4	640.1	655.7	658.7



TEST NUMBER: P1439365

CATALOG NUMBER: CB3-125U-120D-935-1D-UNV-STD-W-4

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	707.2	713.0	715.9	729.1	734.5
115°	818.7	824.8	826.5	839.0	843.6
117.5°	924.7	931.1	934.0	944.1	951.4
120°	994.3	1001.9	1003.6	1016.2	1022.3
122.5°	1062.6	1071.5	1070.7	1082.1	1090.6
125°	1163.6	1171.2	1168.3	1180.9	1188.5
127.5°	1259.6	1264.2	1257.8	1273.1	1279.5
130°	1320.5	1325.1	1317.4	1331.6	1339.2
132.5°	1376.5	1383.5	1374.6	1387.5	1395.1
135°	1461.9	1469.5	1457.3	1468.3	1477.5
137.5°	1538.0	1547.2	1532.5	1545.4	1553.3
140°	1587.8	1596.9	1578.4	1592.6	1601.7
142.5°	1633.7	1645.3	1623.2	1636.2	1646.5
145°	1701.2	1711.8	1690.3	1701.4	1710.5
147.5°	1765.2	1774.3	1753.7	1761.6	1768.0
150°	1803.7	1812.8	1789.7	1797.7	1805.3
152.5°	1834.8	1847.5	1824.5	1830.1	1841.3
155°	1884.5	1899.7	1873.6	1878.6	1890.7
157.5°	1930.2	1943.8	1917.7	1922.0	1932.7
160°	1957.5	1971.2	1945.1	1946.9	1957.5
162.5°	1978.6	1991.1	1968.7	1965.6	1978.6
165°	2008.8	2019.4	1997.9	1992.0	2005.7
167.5°	2033.9	2046.1	2019.7	2014.7	2030.2
170°	2047.6	2059.8	2032.1	2024.7	2041.4
172.5°	2056.3	2067.3	2040.8	2030.8	2043.9
175°	2066.3	2076.9	2049.2	2038.4	2044.5
177.5°	2069.1	2077.6	2055.4	2045.8	2060.4
180°	2061.6	2061.6	2061.6	2061.6	2061.6



TEST NUMBER: P1439365

CATALOG NUMBER: CB3-125U-120D-935-1D-UNV-STD-W-4

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.62	18.43	18.63	19.44	20.79	16.55	17.35	17.55	18.37	19.71
	3H	19.29	20.01	20.30	21.03	22.39	17.96	18.68	18.97	19.70	21.06
	4H	19.91	20.60	20.94	21.62	22.99	18.47	19.16	19.50	20.18	21.55
	6H	20.30	20.93	21.33	21.96	23.34	18.79	19.42	19.82	20.44	21.83
	8H	20.43	21.03	21.47	22.08	23.46	18.91	19.51	19.95	20.55	21.93
	12H	20.50	21.07	21.54	22.11	23.51	18.98	19.55	20.03	20.59	21.99
4H	2H	18.03	18.71	19.06	19.73	21.10	17.17	17.85	18.20	18.87	20.25
	3H	19.91	20.48	20.95	21.53	22.92	18.78	19.35	19.82	20.40	21.79
	4H	20.66	21.18	21.70	22.22	23.63	19.39	19.91	20.43	20.95	22.36
	6H	21.16	21.61	22.21	22.67	24.07	19.79	20.24	20.85	21.31	22.71
	8H	21.35	21.77	22.40	22.82	24.24	19.96	20.38	21.02	21.44	22.86
	12H	21.44	21.82	22.52	22.89	24.32	20.07	20.45	21.14	21.52	22.94
8H	4H	20.78	21.20	21.84	22.26	23.68	19.64	20.06	20.70	21.12	22.54
	6H	21.40	21.75	22.48	22.85	24.26	20.17	20.52	21.25	21.62	23.03
	8H	21.67	21.98	22.76	23.06	24.50	20.42	20.73	21.51	21.81	23.24
	12H	21.84	22.10	22.93	23.18	24.66	20.60	20.86	21.69	21.94	23.42
12H	4H	20.75	21.13	21.83	22.20	23.63	19.64	20.02	20.72	21.09	22.52
	6H	21.42	21.72	22.50	22.80	24.24	20.23	20.53	21.31	21.61	23.05
	8H	21.71	21.98	22.80	23.06	24.53	20.51	20.77	21.60	21.85	23.33