

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2024 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: CORELITE

Report Number: P1439221

Luminaire Tested: CB3-085U-030D-840-1D-UNV-STD-W-4

Issue Date: 3/31/2026

**Test Information**

Test Method: LM-79-2024  
Report Number: P1439221  
REPORT IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2506-466-2, G2-2312-242-8)  
Test Lab: INNOVATION CENTER  
Issue Date: 3/31/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: CORELITE  
Catalog Number: CB3-085U-030D-840-1D-UNV-STD-W-4  
Description: CORELITE BASIC SLOT LED LUMINAIRE, OPEN UPLIGHT  
3-INCH APERTURE  
DOWNLIGHT 300 LUMENS PER FOOT  
UPLIGHT 850 LUMENS PER FOOT  
Light Source: 4000K CCT, 80 CRI LEDS  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 5004.7 lumens  
Efficiency: N/A  
Efficacy: 154.5 lumens/watt  
Spacing Criteria (0/90/45): 1.18 / 1.13 / 1.26  
Luminous Opening: Rectangular (W 0.24' x L: 4' x H: 0')  
CIE Type: Semi-Indirect

Input Watts (W): 32.4  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1439221

CATALOG NUMBER: CB3-085U-030D-840-1D-UNV-STD-W-4

### Luminous Intensity Polar Plot

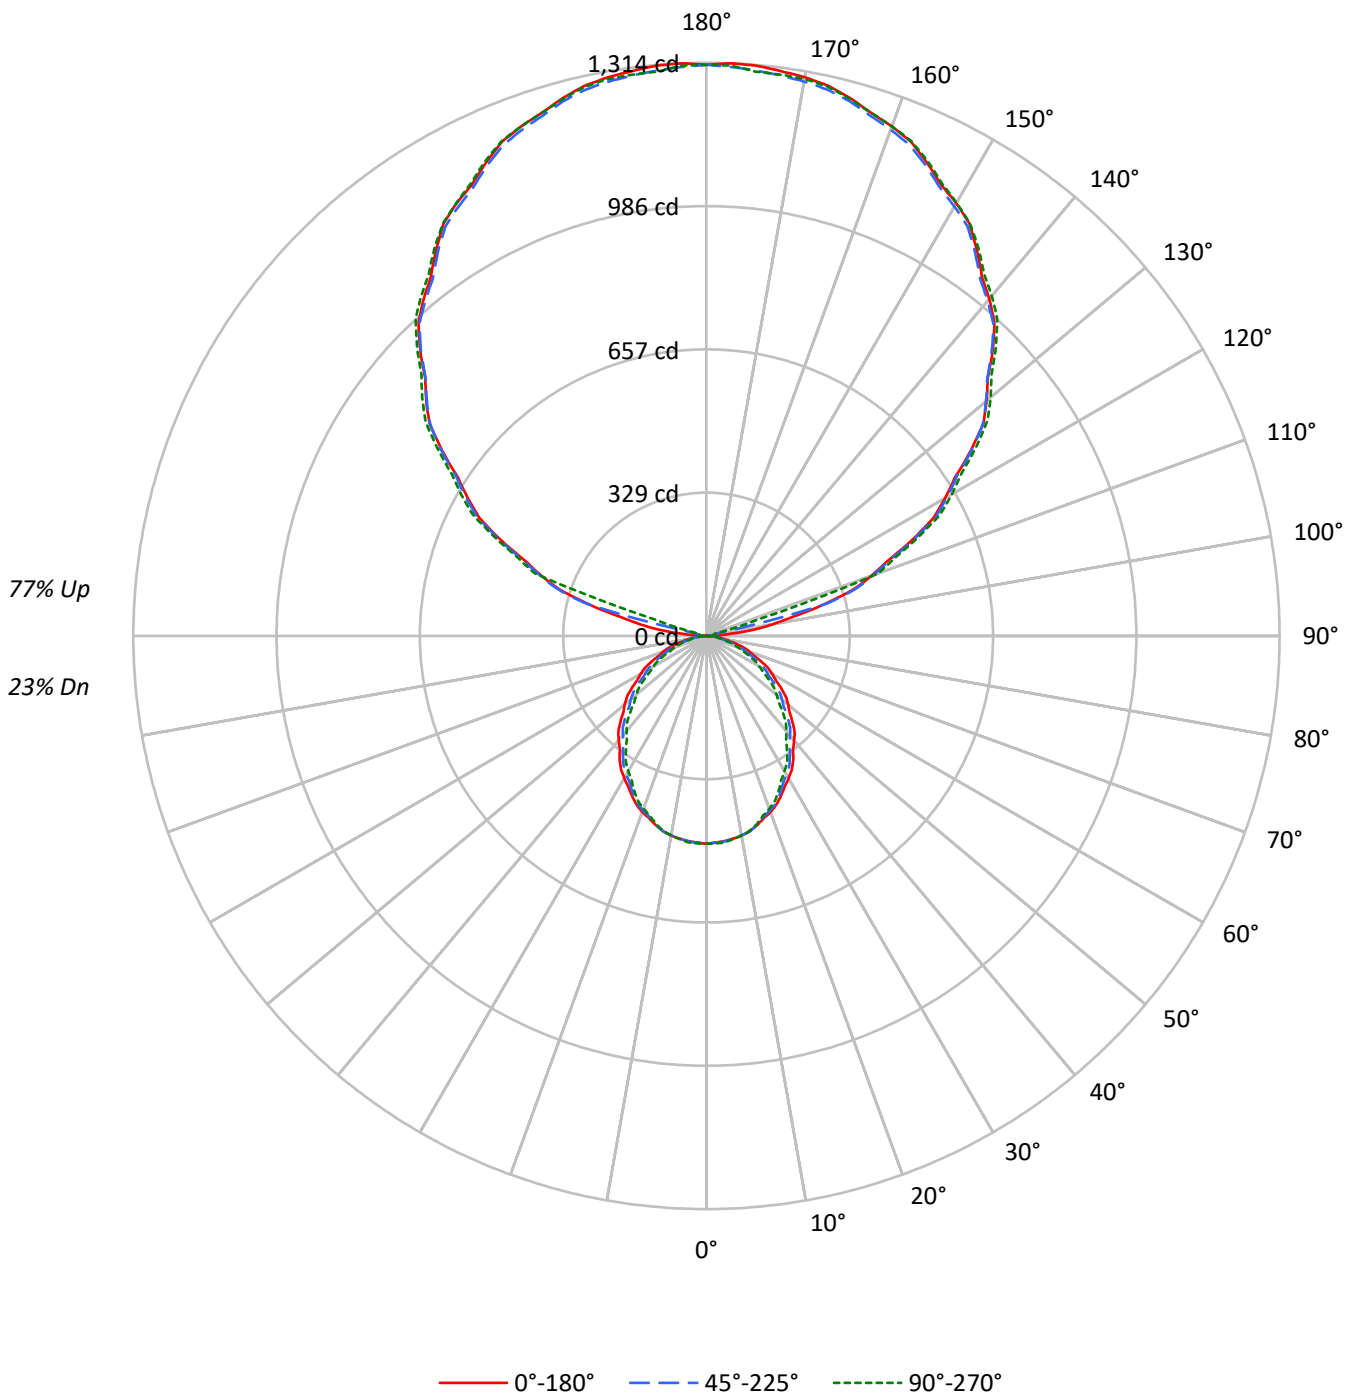



TEST NUMBER: P1439221

CATALOG NUMBER: CB3-085U-030D-840-1D-UNV-STD-W-4

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20										
RC	80									70									50									30									10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0														
RCR																																						
0	101	101	101	101	89	89	89	89	68	68	68	49	49	49	31	31	31	23																				
1	92	88	84	81	81	78	75	72	60	58	56	43	42	41	28	27	26	19																				
2	84	77	71	66	74	68	63	59	52	49	46	38	36	34	24	23	22	16																				
3	76	67	60	55	67	60	54	49	46	42	39	33	31	29	22	20	19	14																				
4	70	59	52	46	62	53	47	42	41	37	33	30	27	25	19	18	16	12																				
5	64	53	45	39	56	47	41	36	37	32	28	27	24	21	17	16	14	10																				
6	59	47	40	34	52	42	36	31	33	28	25	24	21	19	16	14	13	9																				
7	54	42	35	30	48	38	32	27	30	25	22	22	19	16	14	13	11	8																				
8	50	38	31	26	44	34	28	24	27	22	19	20	17	15	13	11	10	7																				
9	47	35	28	23	41	31	25	21	25	20	17	18	15	13	12	10	9	7																				
10	43	32	25	20	38	29	23	19	23	18	15	17	14	12	11	9	8	6																				

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	5390	5390	5390
5°	5365	5369	5399
10°	5341	5333	5333
15°	5259	5259	5228
20°	5174	5121	5076
25°	5044	4980	4891
30°	4920	4792	4677
35°	4790	4613	4449
40°	4619	4399	4208
45°	4461	4207	3948
50°	4300	3978	3693
55°	4125	3758	3450
60°	3935	3530	3177
65°	3713	3272	2889
70°	3460	2967	2574
75°	3134	2605	2291
80°	2737	2183	2026
85°	2103	1843	1843

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 4461 cd/sqm



TEST NUMBER: P1439221

CATALOG NUMBER: CB3-085U-030D-840-1D-UNV-STD-W-4

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	45.0	0.9
10°-20°	126.3	2.5
20°-30°	183.5	3.7
30°-40°	208.6	4.2
40°-50°	202.5	4.0
50°-60°	171.0	3.4
60°-70°	121.7	2.4
70°-80°	65.0	1.3
80°-90°	17.2	0.3
90°-100°	30.2	0.6
100°-110°	219.0	4.4
110°-120°	520.6	10.4
120°-130°	665.1	13.3
130°-140°	717.4	14.3
140°-150°	676.3	13.5
150°-160°	551.7	11.0
160°-170°	359.5	7.2
170°-180°	124.3	2.5
0°-30°	354.7	7.1
0°-40°	563.3	11.3
0°-60°	936.8	18.7
0°-90°	1140.7	22.8
90°-120°	769.8	15.4
90°-150°	2828.6	56.5
90°-180°	3864.0	77.2
0°-180°	5004.7	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	476	476	476	476	476	
5°	472	478	473	472	475	45
15°	449	453	449	446	446	126
25°	404	405	399	394	392	186
35°	347	344	334	324	322	216
45°	279	274	263	250	247	215
55°	209	204	190	178	175	187
65°	139	134	122	111	108	137
75°	72	68	60	53	52	76
85°	16	15	14	14	14	19
90°	0	0	0	1	0	3
95°	55	10	13	14	14	68
105°	277	281	285	21	22	292
115°	520	524	525	533	536	513
125°	739	744	742	750	755	660
135°	928	933	926	932	938	715
145°	1080	1087	1074	1080	1086	676
155°	1197	1206	1190	1193	1201	552
165°	1276	1282	1269	1265	1274	360
175°	1312	1319	1301	1295	1298	125
180°	1309	1309	1309	1309	1309	

TEST NUMBER: P1439221

CATALOG NUMBER: CB3-085U-030D-840-1D-UNV-STD-W-4

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	476.4	476.4	476.4	476.4	476.4
2.5°	474.0	478.8	474.5	475.1	476.2
5°	472.4	478.3	472.7	472.1	475.4
7.5°	468.7	474.1	468.3	467.0	469.9
10°	464.9	470.9	464.2	462.6	464.2
12.5°	458.2	464.4	459.1	456.4	457.7
15°	449.0	453.0	449.0	446.3	446.3
17.5°	437.9	442.0	434.5	432.6	431.9
20°	429.7	433.4	425.3	422.6	421.6
22.5°	418.9	422.3	415.6	411.0	409.7
25°	404.0	405.3	398.9	393.5	391.8
27.5°	389.1	389.4	380.6	374.0	371.8
30°	376.6	376.9	366.8	359.7	358.0
32.5°	364.2	363.2	353.5	345.0	343.9
35°	346.8	343.5	334.0	324.1	322.1
37.5°	325.9	323.9	312.7	302.8	299.8
40°	312.7	309.3	297.8	287.9	284.9
42.5°	299.4	295.6	283.7	272.7	269.5
45°	278.8	274.5	262.9	250.3	246.7
47.5°	258.1	253.4	240.6	228.4	224.4
50°	244.3	239.3	226.0	214.1	209.8
52.5°	230.2	225.0	211.7	199.5	196.0
55°	209.1	203.5	190.5	178.2	174.9
57.5°	188.0	182.4	169.5	157.9	154.0
60°	173.9	168.6	156.0	144.4	140.4
62.5°	159.6	154.5	142.2	130.9	127.2
65°	138.7	133.8	122.2	111.2	107.9
67.5°	118.1	113.9	102.4	92.4	89.7
70°	104.6	100.6	89.7	80.5	77.8
72.5°	91.6	87.3	76.9	69.1	67.3
75°	71.7	67.8	59.6	53.4	52.4
77.5°	53.6	50.4	43.2	39.8	39.3
80°	42.0	39.0	33.5	31.1	31.1
82.5°	31.1	28.7	25.1	24.1	24.1
85°	16.2	14.9	14.2	14.2	14.2
87.5°	4.9	4.9	4.6	4.5	4.3
90°	0.0	0.0	0.0	1.0	0.0
92.5°	15.0	5.7	4.7	5.7	5.5
95°	55.3	9.9	12.8	13.8	13.8
97.5°	111.3	109.2	15.0	18.0	18.2
100°	153.9	158.7	15.8	18.8	19.7
102.5°	201.3	205.3	29.2	19.6	20.5
105°	277.3	281.1	285.1	20.7	21.7
107.5°	352.8	355.7	358.4	322.6	120.8
110°	402.6	405.5	406.5	416.4	418.3



TEST NUMBER: P1439221

CATALOG NUMBER: CB3-085U-030D-840-1D-UNV-STD-W-4

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°
112.5°	449.1	452.8	454.7	463.0	466.5
115°	520.0	523.8	524.9	532.9	535.8
117.5°	587.3	591.3	593.2	599.6	604.2
120°	631.5	636.3	637.4	645.4	649.2
122.5°	674.9	680.5	680.0	687.2	692.6
125°	739.0	743.8	742.0	750.0	754.8
127.5°	800.0	802.9	798.8	808.6	812.6
130°	838.7	841.6	836.7	845.7	850.5
132.5°	874.2	878.6	873.0	881.2	886.0
135°	928.5	933.3	925.5	932.5	938.3
137.5°	976.8	982.6	973.3	981.5	986.5
140°	1008.4	1014.2	1002.5	1011.5	1017.3
142.5°	1037.6	1044.9	1030.9	1039.1	1045.7
145°	1080.4	1087.2	1073.5	1080.5	1086.3
147.5°	1121.1	1126.8	1113.8	1118.8	1122.8
150°	1145.5	1151.3	1136.6	1141.7	1146.5
152.5°	1165.3	1173.4	1158.7	1162.3	1169.4
155°	1196.8	1206.5	1189.9	1193.1	1200.8
157.5°	1225.8	1234.5	1217.9	1220.7	1227.4
160°	1243.2	1251.9	1235.3	1236.4	1243.2
162.5°	1256.6	1264.5	1250.3	1248.3	1256.6
165°	1275.8	1282.5	1268.9	1265.1	1273.8
167.5°	1291.7	1299.5	1282.7	1279.5	1289.4
170°	1300.4	1308.1	1290.6	1285.9	1296.5
172.5°	1306.0	1312.9	1296.1	1289.8	1298.1
175°	1312.3	1319.0	1301.4	1294.6	1298.5
177.5°	1314.0	1319.4	1305.4	1299.3	1308.5
180°	1309.3	1309.3	1309.3	1309.3	1309.3



TEST NUMBER: P1439221

CATALOG NUMBER: CB3-085U-030D-840-1D-UNV-STD-W-4

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.68	10.34	10.84	11.48	13.10	8.60	9.26	9.77	10.41	12.02
	3H	11.33	11.92	12.50	13.08	14.70	10.00	10.59	11.17	11.74	13.37
	4H	11.95	12.51	13.13	13.67	15.30	10.51	11.07	11.69	12.22	13.86
	6H	12.33	12.84	13.51	14.00	15.64	10.82	11.33	12.00	12.49	14.13
	8H	12.46	12.95	13.65	14.12	15.76	10.93	11.42	12.12	12.59	14.23
	12H	12.52	12.98	13.71	14.15	15.81	11.00	11.47	12.19	12.63	14.29
4H	2H	10.07	10.62	11.25	11.78	13.41	9.21	9.77	10.39	10.92	12.55
	3H	11.94	12.40	13.13	13.58	15.23	10.81	11.27	12.00	12.45	14.10
	4H	12.68	13.11	13.87	14.27	15.94	11.40	11.83	12.60	13.00	14.66
	6H	13.17	13.53	14.36	14.73	16.38	11.81	12.17	13.00	13.36	15.01
	8H	13.36	13.70	14.55	14.88	16.55	11.97	12.31	13.16	13.49	15.16
	12H	13.44	13.75	14.65	14.94	16.62	12.07	12.38	13.28	13.57	15.24
8H	4H	12.79	13.13	13.98	14.31	15.98	11.65	11.99	12.84	13.17	14.84
	6H	13.40	13.68	14.61	14.91	16.57	12.17	12.45	13.38	13.68	15.34
	8H	13.68	13.92	14.89	15.12	16.81	12.42	12.67	13.64	13.87	15.55
	12H	13.83	14.04	15.05	15.24	16.96	12.59	12.80	13.81	14.00	15.72
12H	4H	12.75	13.06	13.96	14.26	15.93	11.64	11.95	12.85	13.14	14.82
	6H	13.42	13.66	14.63	14.86	16.55	12.23	12.47	13.44	13.67	15.36
	8H	13.71	13.92	14.93	15.12	16.84	12.50	12.71	13.72	13.91	15.63