

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P1356915

Luminaire Tested: 2ASL4-30VHE-3-65-UNV

Issue Date: 2/17/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1356915  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2511-597-12)  
Test Lab: INNOVATION CENTER  
Issue Date: 2/17/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: FAIL-SAFE  
Catalog Number: 2ASL4-30VHE-3-65-UNV  
Description: 2FT 3000 LUMEN PER FOOT 4ASL LED LUMINAIRE WITH OPL LENS AND 6500K LEDS 3 ROW  
Light Source: -  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 6006.0 lumens  
Efficiency: N/A  
Efficacy: 114.2 lumens/watt  
Spacing Criteria (0/90/45): 1.21 / 1.3 / 1.39  
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 1.98' x H: 0.1')  
CIE Type: Direct

Input Watts (W): 52.6  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1356915  
CATALOG NUMBER: 2ASL4-30VHE-3-65-UNV

### Luminous Intensity Polar Plot

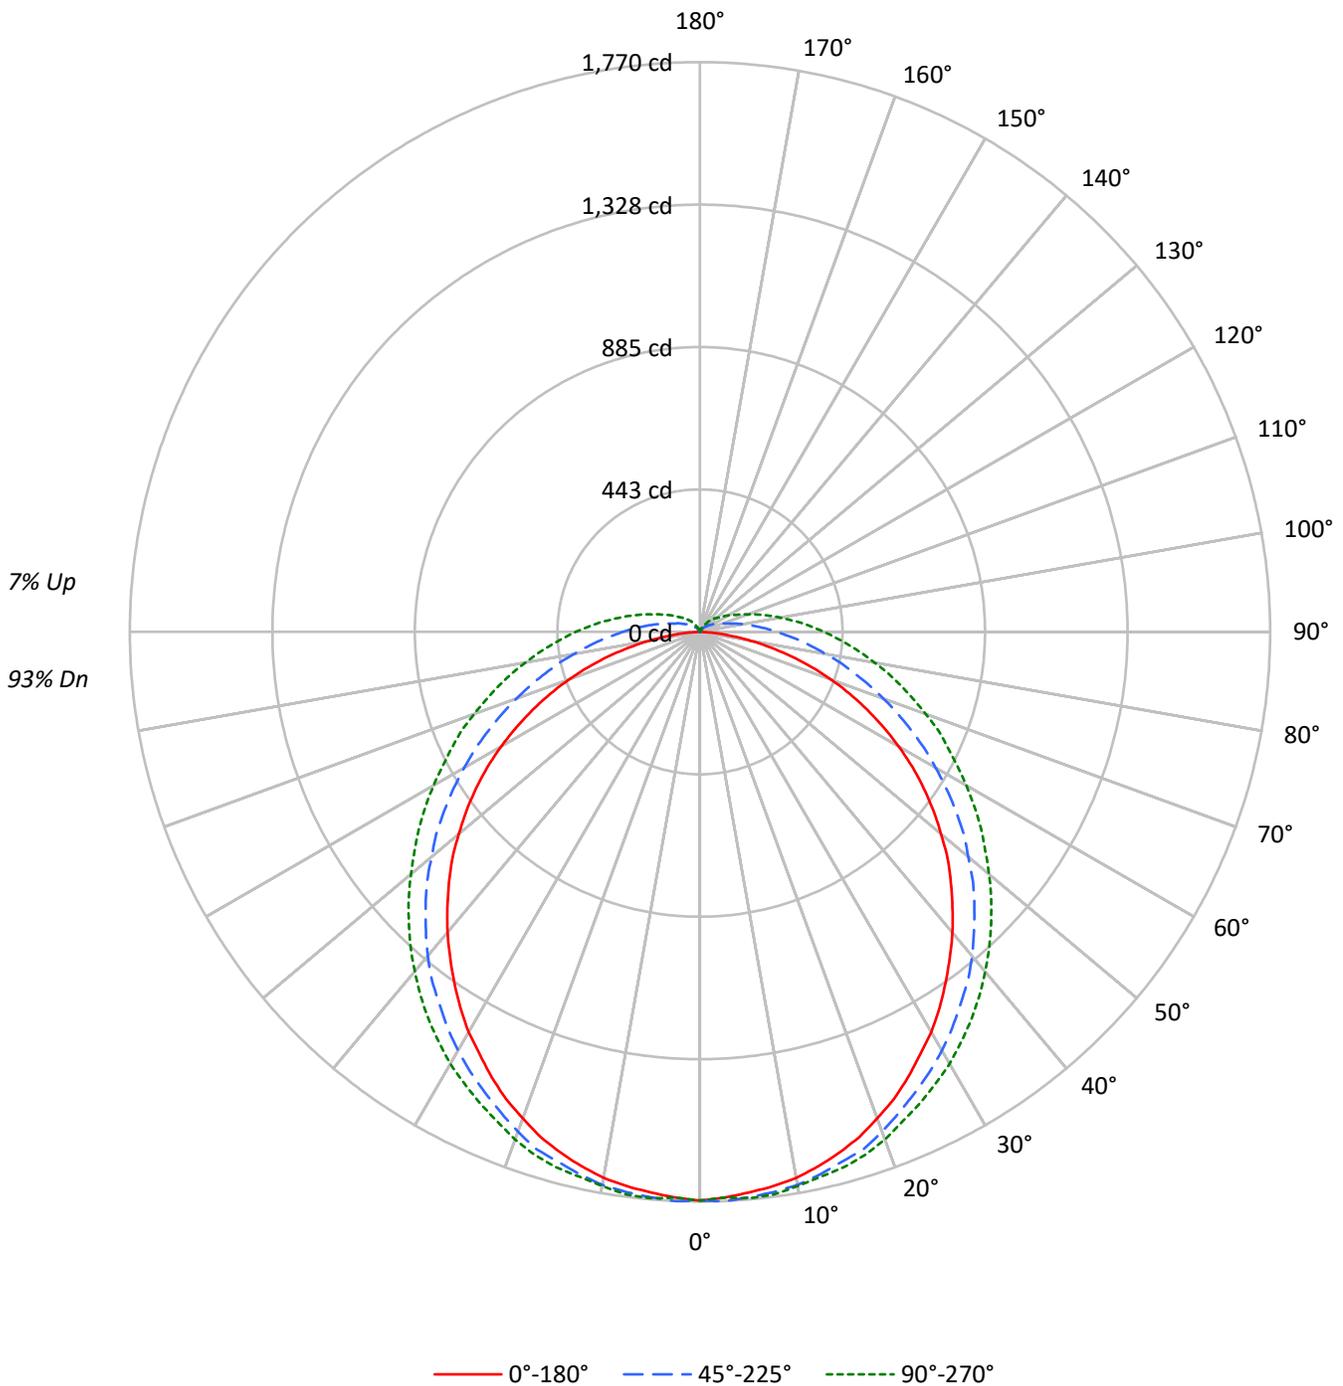



TEST NUMBER: P1356915  
 CATALOG NUMBER: 2ASL4-30VHE-3-65-UNV

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	117	117	117	117	114	114	114	114	107	107	107	101	101	101	96	96	96	96	96	96	93
1	105	100	95	91	102	97	92	88	91	88	84	86	83	80	81	79	77	77	77	77	74
2	95	86	79	72	92	84	77	71	79	73	68	75	70	66	71	67	63	63	63	63	61
3	86	75	67	60	83	73	65	59	69	62	57	65	60	55	62	57	53	53	53	53	50
4	79	66	57	50	76	65	56	49	61	54	48	58	52	47	55	50	45	45	45	45	43
5	73	59	50	43	70	58	49	42	55	47	41	52	45	40	49	44	39	39	39	39	37
6	67	53	44	37	64	52	43	37	49	42	36	47	40	35	45	39	34	34	34	34	32
7	62	48	39	33	60	47	38	32	45	37	32	43	36	31	41	35	30	30	30	30	28
8	58	44	35	29	56	43	35	29	41	34	28	39	32	28	37	32	27	27	27	27	25
9	54	40	32	26	52	39	31	26	38	30	25	36	30	25	35	29	24	24	24	24	22
10	50	37	29	24	49	36	29	23	35	28	23	33	27	23	32	26	22	22	22	22	20

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	28821	28821	28821
5°	28500	28234	28161
10°	28274	27642	27449
15°	27893	26921	26846
20°	27404	26229	26164
25°	26844	25375	25391
30°	26255	24627	24735
35°	25538	23788	24007
40°	24871	23016	23239
45°	24150	22091	22468
50°	23333	21099	21667
55°	22444	20149	20947
60°	21308	19047	20215
65°	19875	17978	19609
70°	18059	16912	19135
75°	15480	15918	18811
80°	11694	15122	18671
85°	6440	14792	18946

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 24150 cd/sqm



TEST NUMBER: P1356915  
 CATALOG NUMBER: 2ASL4-30VHE-3-65-UNV

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	167.5	2.8
10°-20°	480.9	8.0
20°-30°	727.1	12.1
30°-40°	880.5	14.7
40°-50°	924.7	15.4
50°-60°	862.7	14.4
60°-70°	713.0	11.9
70°-80°	513.4	8.5
80°-90°	319.0	5.3
90°-100°	186.9	3.1
100°-110°	106.9	1.8
110°-120°	60.4	1.0
120°-130°	34.7	0.6
130°-140°	18.7	0.3
140°-150°	7.9	0.1
150°-160°	1.5	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1375.6	22.9
0°-40°	2256.0	37.6
0°-60°	4043.5	67.3
0°-90°	5589.0	93.1
90°-120°	354.2	5.9
90°-150°	415.6	6.9
90°-180°	417.0	6.9
0°-180°	6006.0	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	1766	1766	1766	1766	1766	
5°	1748	1763	1763	1763	1766	166
15°	1675	1697	1704	1715	1722	472
25°	1528	1553	1579	1601	1616	704
35°	1329	1366	1410	1451	1469	832
45°	1102	1142	1205	1256	1278	850
55°	848	896	970	1039	1065	758
65°	573	628	724	815	848	567
75°	294	367	496	602	646	311
85°	55	165	312	422	463	67
90°	0	99	239	342	386	3
95°	0	62	180	275	316	0
105°	0	22	99	173	202	0
115°	0	11	59	106	125	0
125°	0	7	37	70	81	0
135°	0	0	22	44	55	0
145°	0	0	11	26	29	0
155°	0	0	0	7	11	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0



TEST NUMBER: P1356915  
 CATALOG NUMBER: 2ASL4-30VHE-3-65-UNV

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	1766.4	1766.4	1766.4	1766.4	1766.4
2.5°	1759.1	1770.1	1770.1	1759.1	1759.1
5°	1748.1	1762.8	1762.8	1762.8	1766.4
7.5°	1737.1	1755.4	1755.4	1755.4	1762.8
10°	1722.4	1740.7	1744.4	1744.4	1748.1
12.5°	1700.3	1722.4	1726.0	1729.7	1733.4
15°	1674.6	1696.7	1704.0	1715.0	1722.4
17.5°	1645.3	1671.0	1685.7	1696.7	1704.0
20°	1608.5	1634.2	1652.6	1667.3	1678.3
22.5°	1571.8	1593.8	1615.9	1634.2	1645.3
25°	1527.7	1553.4	1579.2	1601.2	1615.9
27.5°	1480.0	1509.4	1542.4	1568.1	1582.8
30°	1435.9	1465.3	1502.0	1535.1	1549.8
32.5°	1384.5	1417.6	1458.0	1491.0	1509.4
35°	1329.4	1366.1	1410.2	1450.6	1469.0
37.5°	1274.3	1311.1	1366.1	1406.5	1424.9
40°	1219.3	1256.0	1314.7	1358.8	1377.2
42.5°	1160.5	1197.2	1259.6	1307.4	1329.4
45°	1101.7	1142.1	1204.6	1256.0	1278.0
47.5°	1043.0	1083.4	1149.5	1204.6	1226.6
50°	976.9	1020.9	1087.0	1149.5	1171.5
52.5°	914.4	958.5	1032.0	1094.4	1116.4
55°	848.3	896.1	969.5	1039.3	1065.0
57.5°	782.2	830.0	907.1	980.5	1009.9
60°	712.5	763.9	844.7	921.8	954.8
62.5°	642.7	697.8	785.9	866.7	899.7
65°	572.9	628.0	723.5	815.3	848.3
67.5°	503.1	561.9	664.7	760.2	800.6
70°	433.3	495.8	606.0	705.1	745.5
72.5°	363.6	429.7	550.9	653.7	694.1
75°	293.8	367.2	495.8	602.3	646.4
77.5°	224.0	308.5	448.0	554.5	598.6
80°	161.6	257.1	396.6	506.8	550.9
82.5°	102.8	205.7	352.6	462.7	506.8
85°	55.1	165.3	312.2	422.3	462.7
87.5°	18.4	128.5	271.8	381.9	422.3
90°	0.0	99.2	238.7	341.5	385.6
92.5°	0.0	77.1	209.3	308.5	348.9
95°	0.0	62.4	179.9	275.4	315.8
97.5°	0.0	51.4	157.9	246.1	282.8
100°	0.0	40.4	135.9	220.3	253.4
102.5°	0.0	33.1	117.5	194.6	227.7
105°	0.0	22.0	99.2	172.6	202.0
107.5°	0.0	18.4	84.5	154.2	179.9
110°	0.0	14.7	77.1	132.2	157.9



TEST NUMBER: P1356915  
 CATALOG NUMBER: 2ASL4-30VHE-3-65-UNV

**CANDELA DISTRIBUTION (continued):**

	0°	22.5°	45°	67.5°	90°
112.5°	0.0	11.0	69.8	117.5	143.2
115°	0.0	11.0	58.8	106.5	124.9
117.5°	0.0	11.0	51.4	95.5	113.8
120°	0.0	7.3	47.7	84.5	102.8
122.5°	0.0	7.3	40.4	77.1	91.8
125°	0.0	7.3	36.7	69.8	80.8
127.5°	0.0	3.7	33.1	62.4	73.4
130°	0.0	3.7	29.4	55.1	66.1
132.5°	0.0	3.7	25.7	51.4	62.4
135°	0.0	0.0	22.0	44.1	55.1
137.5°	0.0	0.0	18.4	40.4	47.7
140°	0.0	0.0	14.7	33.1	44.1
142.5°	0.0	0.0	11.0	29.4	36.7
145°	0.0	0.0	11.0	25.7	29.4
147.5°	0.0	0.0	7.3	18.4	25.7
150°	0.0	0.0	3.7	14.7	18.4
152.5°	0.0	0.0	0.0	11.0	14.7
155°	0.0	0.0	0.0	7.3	11.0
157.5°	0.0	0.0	0.0	0.0	3.7
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P1356915  
 CATALOG NUMBER: 2ASL4-30VHE-3-65-UNV

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	20.98	22.52	21.45	22.97	23.46	22.92	24.46	23.39	24.92	25.40
	3H	22.48	23.88	22.96	24.35	24.87	25.35	26.75	25.83	27.22	27.74
	4H	22.96	24.29	23.46	24.77	25.31	26.52	27.85	27.02	28.33	28.87
	6H	23.24	24.48	23.75	24.97	25.53	27.72	28.96	28.24	29.46	30.01
	8H	23.29	24.48	23.82	25.00	25.56	28.33	29.52	28.86	30.04	30.60
	12H	23.30	24.44	23.84	24.96	25.55	28.98	30.12	29.51	30.63	31.22
4H	2H	21.84	23.17	22.34	23.65	24.19	23.36	24.69	23.86	25.18	25.71
	3H	23.58	24.71	24.09	25.24	25.80	26.01	27.15	26.53	27.67	28.24
	4H	24.18	25.22	24.72	25.76	26.35	27.35	28.39	27.89	28.93	29.52
	6H	24.58	25.50	25.14	26.06	26.67	28.75	29.67	29.30	30.23	30.84
	8H	24.68	25.54	25.24	26.10	26.72	29.46	30.33	30.02	30.89	31.51
	12H	24.72	25.50	25.30	26.09	26.72	30.24	31.02	30.82	31.61	32.24
8H	4H	24.84	25.71	25.40	26.27	26.89	27.57	28.44	28.13	29.00	29.62
	6H	25.42	26.15	26.02	26.76	27.38	29.14	29.87	29.73	30.48	31.10
	8H	25.60	26.27	26.21	26.88	27.52	30.00	30.66	30.60	31.27	31.91
	12H	25.72	26.31	26.33	26.91	27.62	30.96	31.55	31.56	32.15	32.85
12H	4H	25.03	25.81	25.61	26.40	27.03	27.58	28.37	28.16	28.96	29.58
	6H	25.70	26.37	26.31	26.98	27.62	29.18	29.84	29.78	30.46	31.09
	8H	25.98	26.57	26.59	27.18	27.88	30.11	30.69	30.71	31.30	32.00

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Fail-Safe

Report Number: SP1-2511-597-6

Test Date: 11/18/2025

Luminaire Tested: 4ASL-2-65-UNV-OPL-1\_600mA

Data in this report applies to families of products including 4ASL


**Test Information**

Test Method: LM-79-2019  
 Report Number: SP1-2511-597-6  
 Test Lab: COOPER LIGHTING SOLUTIONS  
 Photometer: SP1 - 76IN SPHERE  
 Measurement Geometry: 4π  
 Issue Date: 11/18/2025  
 Manufacturer: COOPER LIGHTING SOLUTIONS  
 Product Line: Fail-Safe  
 Catalog Number: **4ASL-2-65-UNV-OPL-1\_600mA**  
 Description: 2foot 4ASL LED LUMINAIRE WITH OPL LENS AND 6500K LEDs with 1 rows at 600mA

**Spectral Parameters**

CCT (K): 6972  
 CIE u': 0.1979  
 CIE v': 0.4612  
 Duv: 0.0005  
 CIE x: 0.3066  
 CIE y: 0.3177  
 CIE z: 0.3758  
 Peak Wavelength (nm): 455  
 Dominant Wavelength (nm): 483  
 Purity: 10.33335  
 Rf: 88.2  
 Rg: 97.1

CRI (Ra):	94.3		
R1:	96.1	R9:	82.6
R2:	98.8	R10:	95.4
R3:	96.4	R11:	95.2
R4:	92.8	R12:	63.5
R5:	92.9	R13:	99.3
R6:	92.2	R14:	98.1
R7:	93.5	R15:	93.7
R8:	91.4		

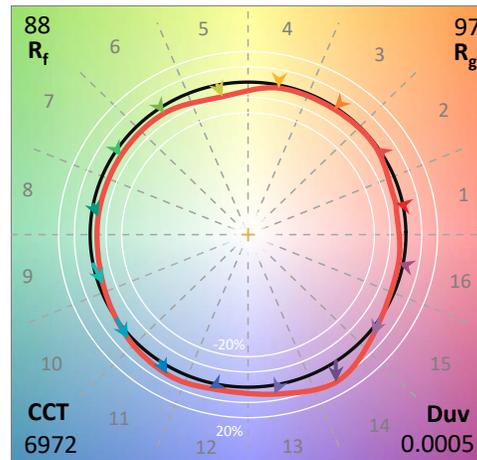

**Test Conditions**


Stabilization Time: 20M  
 Operation Time: 1H 20M  
 Sphere Temperature (°C): 24.1

REPORT NUMBER: SP1-2511-597-6

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	10/21/2025	10/21/2026
AC Power Source	CHROMA 61603 IN0063	10/21/2025	10/21/2026
DC Power Source	AGILENT E3634A IN0208	10/21/2025	10/21/2026
Sphere Thermometer	ONSET IN0085	10/21/2025	10/21/2026
Room Thermometer	ONSET IN0046	10/21/2025	10/21/2026

REPORT NUMBER: SP1-2511-597-6

**CIE 1931 Chromaticity Diagram**

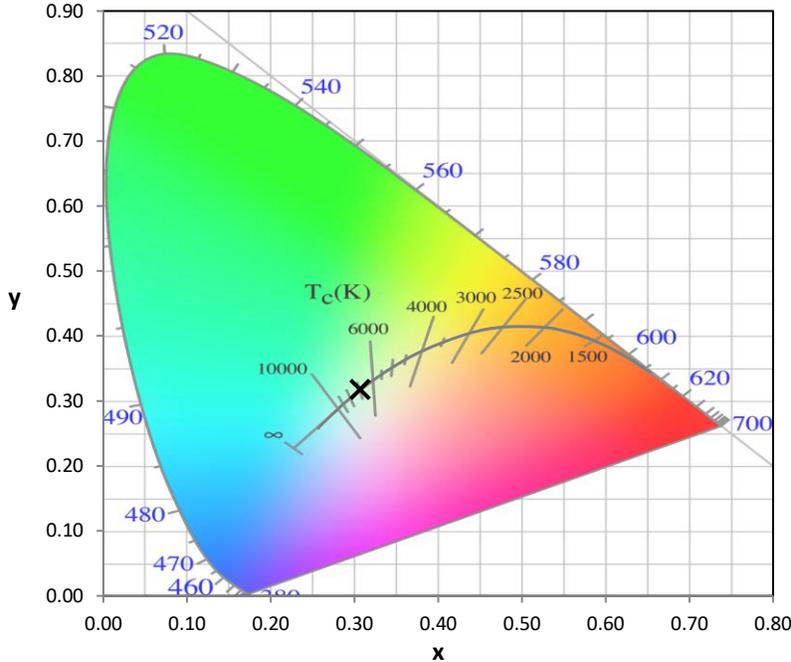

**CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles**



Point lies inside the ANSI 6500K 7-step quadrangle

REPORT NUMBER: SP1-2511-597-6

**Photopic Flux vs. Wavelength**



**Photopic Lumens: NR**

$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)	$\lambda$ (nm)	Power W <sup>^</sup> /nm	Lumens ( $\phi$ /nm)
360	0	NR	490	260	NR	620	255	NR	750	6	NR	880	0	NR
365	0	NR	495	274	NR	625	252	NR	755	6	NR	885	0	NR
370	0	NR	500	297	NR	630	778	NR	760	5	NR	890	0	NR
375	0	NR	505	320	NR	635	431	NR	765	4	NR	895	0	NR
380	1	NR	510	337	NR	640	160	NR	770	4	NR	900	0	NR
385	2	NR	515	349	NR	645	165	NR	775	3	NR	905	0	NR
390	2	NR	520	354	NR	650	135	NR	780	3	NR	910	0	NR
395	3	NR	525	356	NR	655	115	NR	785	2	NR	915	0	NR
400	5	NR	530	356	NR	660	99	NR	790	2	NR	920	0	NR
405	6	NR	535	355	NR	665	84	NR	795	2	NR	925	0	NR
410	8	NR	540	354	NR	670	77	NR	800	2	NR	930	0	NR
415	12	NR	545	351	NR	675	64	NR	805	1	NR	935	0	NR
420	19	NR	550	350	NR	680	55	NR	810	1	NR	940	0	NR
425	33	NR	555	348	NR	685	47	NR	815	1	NR	945	0	NR
430	60	NR	560	344	NR	690	41	NR	820	1	NR	950	0	NR
435	113	NR	565	339	NR	695	35	NR	825	1	NR	955	0	NR
440	206	NR	570	331	NR	700	30	NR	830	1	NR	960	0	NR
445	392	NR	575	323	NR	705	26	NR	835	1	NR	965	0	NR
450	764	NR	580	315	NR	710	22	NR	840	1	NR	970	0	NR
455	1000	NR	585	307	NR	715	19	NR	845	0	NR	975	0	NR
460	736	NR	590	299	NR	720	16	NR	850	0	NR	980	0	NR
465	513	NR	595	290	NR	725	14	NR	855	0	NR	985	0	NR
470	430	NR	600	282	NR	730	12	NR	860	0	NR	990	0	NR
475	325	NR	605	276	NR	735	10	NR	865	0	NR	995	0	NR
480	256	NR	610	287	NR	740	9	NR	870	0	NR	1000	0	NR
485	250	NR	615	284	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2511-597-6

**Scotopic Flux vs. Wavelength**




**Scotopic Lumens: NR**

**S/P: 2.48**

λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)	λ (nm)	Power W <sup>^</sup> /nm	Lumens (φ/nm)
360	0	NR	490	260	NR	620	255	NR	750	6	NR	880	0	NR
365	0	NR	495	274	NR	625	252	NR	755	6	NR	885	0	NR
370	0	NR	500	297	NR	630	778	NR	760	5	NR	890	0	NR
375	0	NR	505	320	NR	635	431	NR	765	4	NR	895	0	NR
380	1	NR	510	337	NR	640	160	NR	770	4	NR	900	0	NR
385	2	NR	515	349	NR	645	165	NR	775	3	NR	905	0	NR
390	2	NR	520	354	NR	650	135	NR	780	3	NR	910	0	NR
395	3	NR	525	356	NR	655	115	NR	785	2	NR	915	0	NR
400	5	NR	530	356	NR	660	99	NR	790	2	NR	920	0	NR
405	6	NR	535	355	NR	665	84	NR	795	2	NR	925	0	NR
410	8	NR	540	354	NR	670	77	NR	800	2	NR	930	0	NR
415	12	NR	545	351	NR	675	64	NR	805	1	NR	935	0	NR
420	19	NR	550	350	NR	680	55	NR	810	1	NR	940	0	NR
425	33	NR	555	348	NR	685	47	NR	815	1	NR	945	0	NR
430	60	NR	560	344	NR	690	41	NR	820	1	NR	950	0	NR
435	113	NR	565	339	NR	695	35	NR	825	1	NR	955	0	NR
440	206	NR	570	331	NR	700	30	NR	830	1	NR	960	0	NR
445	392	NR	575	323	NR	705	26	NR	835	1	NR	965	0	NR
450	764	NR	580	315	NR	710	22	NR	840	1	NR	970	0	NR
455	1000	NR	585	307	NR	715	19	NR	845	0	NR	975	0	NR
460	736	NR	590	299	NR	720	16	NR	850	0	NR	980	0	NR
465	513	NR	595	290	NR	725	14	NR	855	0	NR	985	0	NR
470	430	NR	600	282	NR	730	12	NR	860	0	NR	990	0	NR
475	325	NR	605	276	NR	735	10	NR	865	0	NR	995	0	NR
480	256	NR	610	287	NR	740	9	NR	870	0	NR	1000	0	NR
485	250	NR	615	284	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2511-597-6

Melanopic Flux vs. Wavelength

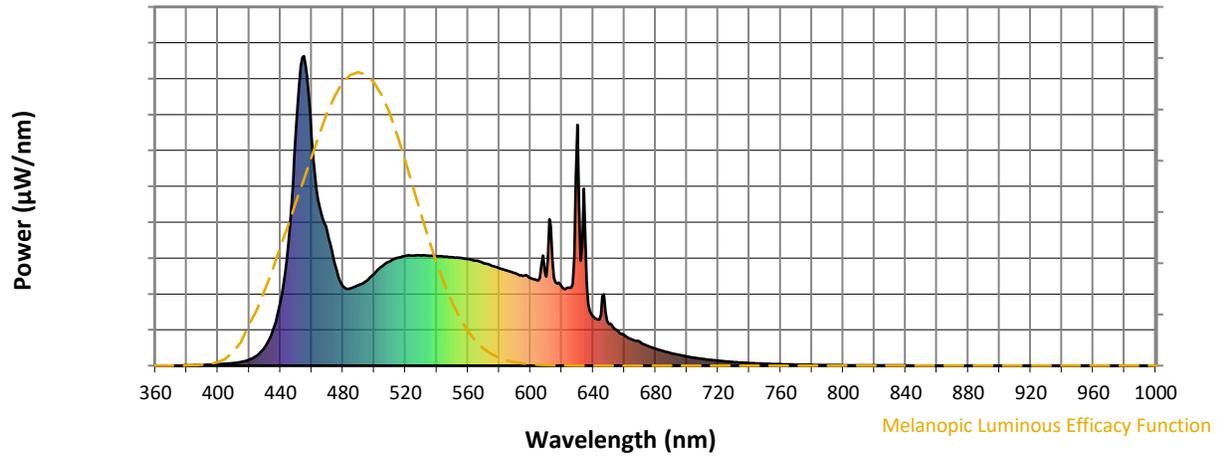


Melanopic Lumens: NR

M/P: 5.67





$\lambda$ (nm)	Power $W^{\wedge}/nm$	Lumens ( $\phi/nm$ )	$\lambda$ (nm)	Power $W^{\wedge}/nm$	Lumens ( $\phi/nm$ )	$\lambda$ (nm)	Power $W^{\wedge}/nm$	Lumens ( $\phi/nm$ )	$\lambda$ (nm)	Power $W^{\wedge}/nm$	Lumens ( $\phi/nm$ )	$\lambda$ (nm)	Power $W^{\wedge}/nm$	Lumens ( $\phi/nm$ )
360	0	NR	490	260	NR	620	255	NR	750	6	NR	880	0	NR
365	0	NR	495	274	NR	625	252	NR	755	6	NR	885	0	NR
370	0	NR	500	297	NR	630	778	NR	760	5	NR	890	0	NR
375	0	NR	505	320	NR	635	431	NR	765	4	NR	895	0	NR
380	1	NR	510	337	NR	640	160	NR	770	4	NR	900	0	NR
385	2	NR	515	349	NR	645	165	NR	775	3	NR	905	0	NR
390	2	NR	520	354	NR	650	135	NR	780	3	NR	910	0	NR
395	3	NR	525	356	NR	655	115	NR	785	2	NR	915	0	NR
400	5	NR	530	356	NR	660	99	NR	790	2	NR	920	0	NR
405	6	NR	535	355	NR	665	84	NR	795	2	NR	925	0	NR
410	8	NR	540	354	NR	670	77	NR	800	2	NR	930	0	NR
415	12	NR	545	351	NR	675	64	NR	805	1	NR	935	0	NR
420	19	NR	550	350	NR	680	55	NR	810	1	NR	940	0	NR
425	33	NR	555	348	NR	685	47	NR	815	1	NR	945	0	NR
430	60	NR	560	344	NR	690	41	NR	820	1	NR	950	0	NR
435	113	NR	565	339	NR	695	35	NR	825	1	NR	955	0	NR
440	206	NR	570	331	NR	700	30	NR	830	1	NR	960	0	NR
445	392	NR	575	323	NR	705	26	NR	835	1	NR	965	0	NR
450	764	NR	580	315	NR	710	22	NR	840	1	NR	970	0	NR
455	1000	NR	585	307	NR	715	19	NR	845	0	NR	975	0	NR
460	736	NR	590	299	NR	720	16	NR	850	0	NR	980	0	NR
465	513	NR	595	290	NR	725	14	NR	855	0	NR	985	0	NR
470	430	NR	600	282	NR	730	12	NR	860	0	NR	990	0	NR
475	325	NR	605	276	NR	735	10	NR	865	0	NR	995	0	NR
480	256	NR	610	287	NR	740	9	NR	870	0	NR	1000	0	NR
485	250	NR	615	284	NR	745	7	NR	875	0	NR			

**Summary**

$R_f = 88.2$   
 $R_g = 97.1$   
 $CIE R_a = 94.3$   
 $R_9 = 82.6$

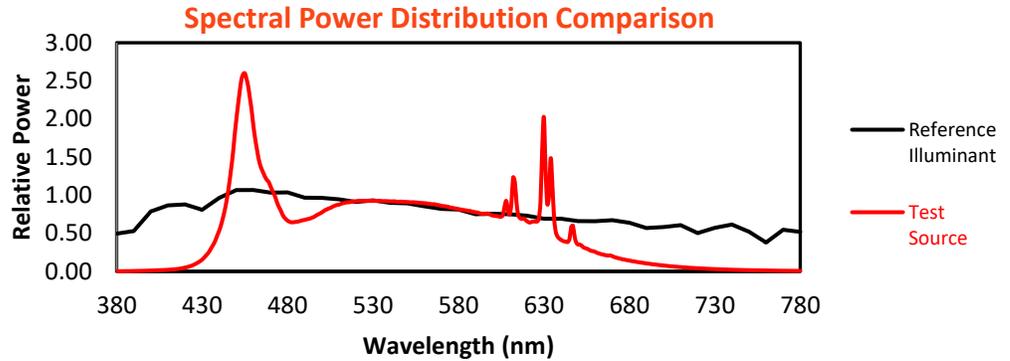


**Color Vector Graphics**

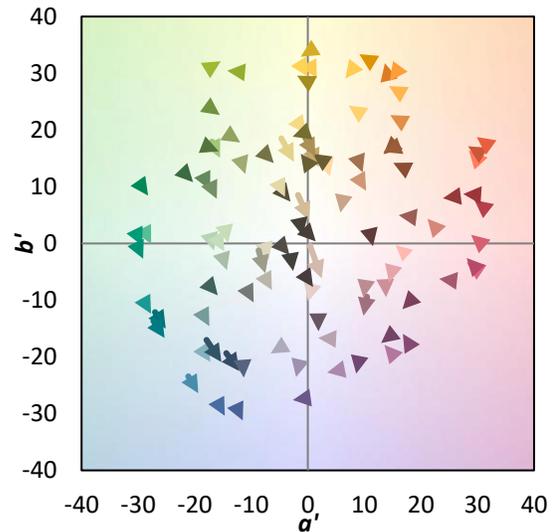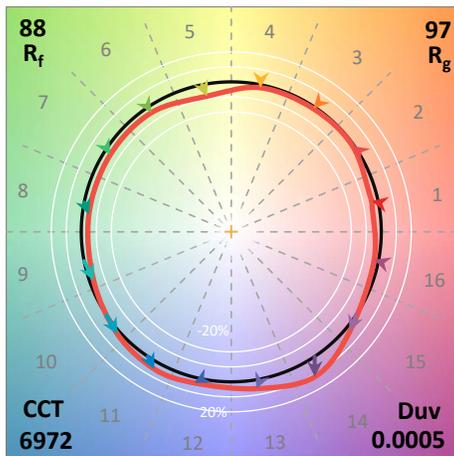
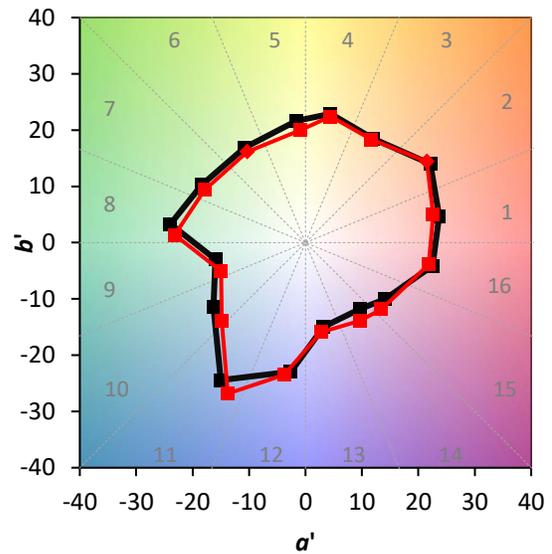
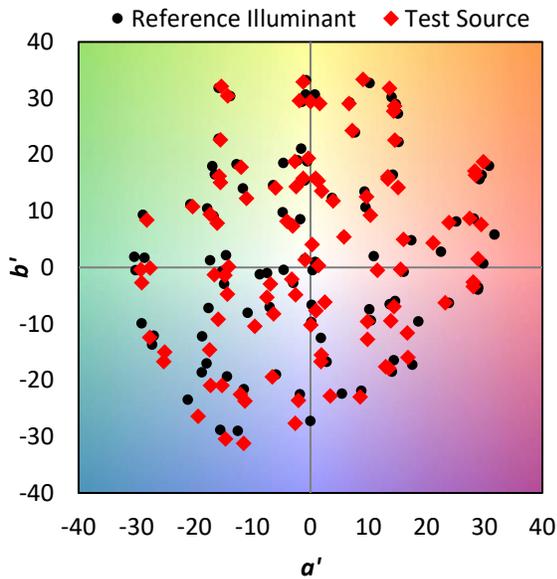


**Individual Sample Fidelity Index ( $R_{f,i}$ )**



CES01 = 85	CES26 = 97	CES51 = 91	CES76 = 88
CES02 = 60	CES27 = 83	CES52 = 96	CES77 = 86
CES03 = 31	CES28 = 97	CES53 = 92	CES78 = 83
CES04 = 68	CES29 = 88	CES54 = 86	CES79 = 94
CES05 = 47	CES30 = 74	CES55 = 82	CES80 = 93
CES06 = 49	CES31 = 90	CES56 = 86	CES81 = 81
CES07 = 40	CES32 = 96	CES57 = 83	CES82 = 96
CES08 = 39	CES33 = 86	CES58 = 83	CES83 = 94
CES09 = 29	CES34 = 96	CES59 = 94	CES84 = 91
CES10 = 72	CES35 = 97	CES60 = 87	CES85 = 80
CES11 = 55	CES36 = 67	CES61 = 87	CES86 = 86
CES12 = 61	CES37 = 96	CES62 = 72	CES87 = 93
CES13 = 42	CES38 = 68	CES63 = 86	CES88 = 94
CES14 = 74	CES39 = 96	CES64 = 81	CES89 = 88
CES15 = 71	CES40 = 96	CES65 = 83	CES90 = 90
CES16 = 46	CES41 = 88	CES66 = 76	CES91 = 60
CES17 = 48	CES42 = 97	CES67 = 76	CES92 = 77
CES18 = 55	CES43 = 97	CES68 = 82	CES93 = 85
CES19 = 69	CES44 = 99	CES69 = 82	CES94 = 81
CES20 = 64	CES45 = 98	CES70 = 82	CES95 = 80
CES21 = 84	CES46 = 93	CES71 = 68	CES96 = 93
CES22 = 76	CES47 = 87	CES72 = 91	CES97 = 95
CES23 = 91	CES48 = 79	CES73 = 77	CES98 = 93
CES24 = 89	CES49 = 95	CES74 = 86	CES99 = 91
CES25 = 69	CES50 = 92	CES75 = 74	

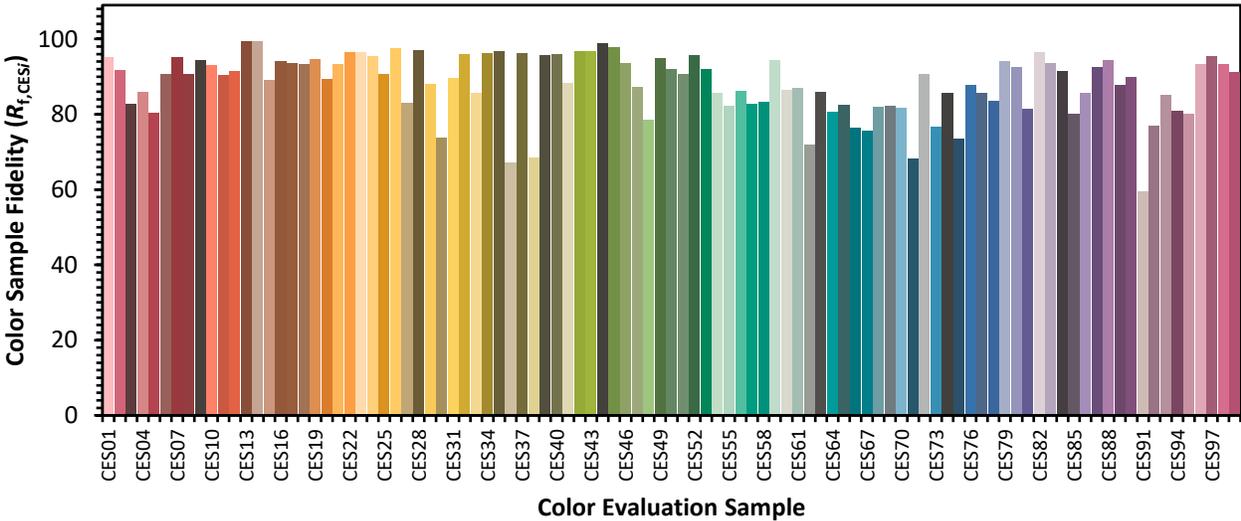

Color Rendition by Hue-Angle Bin

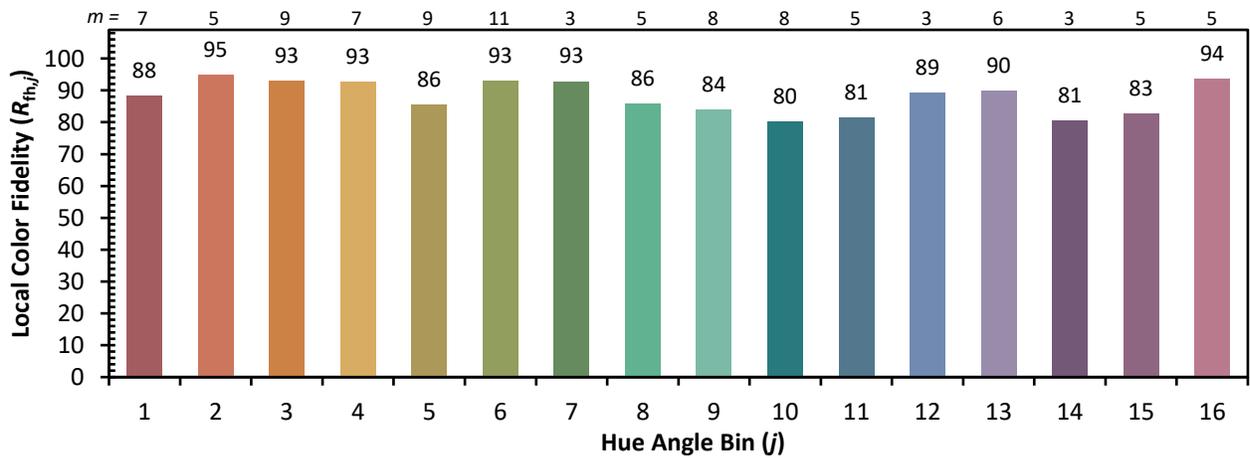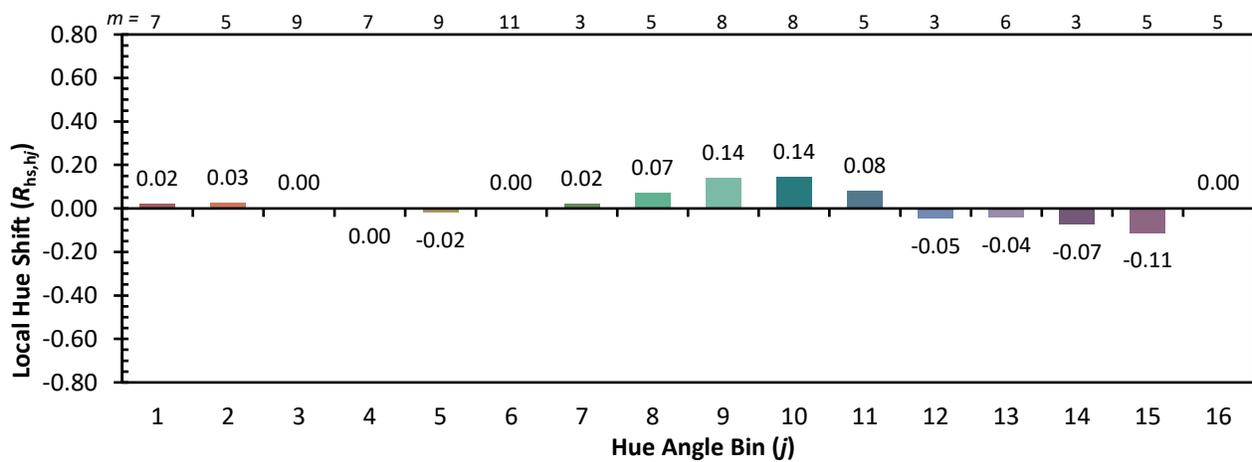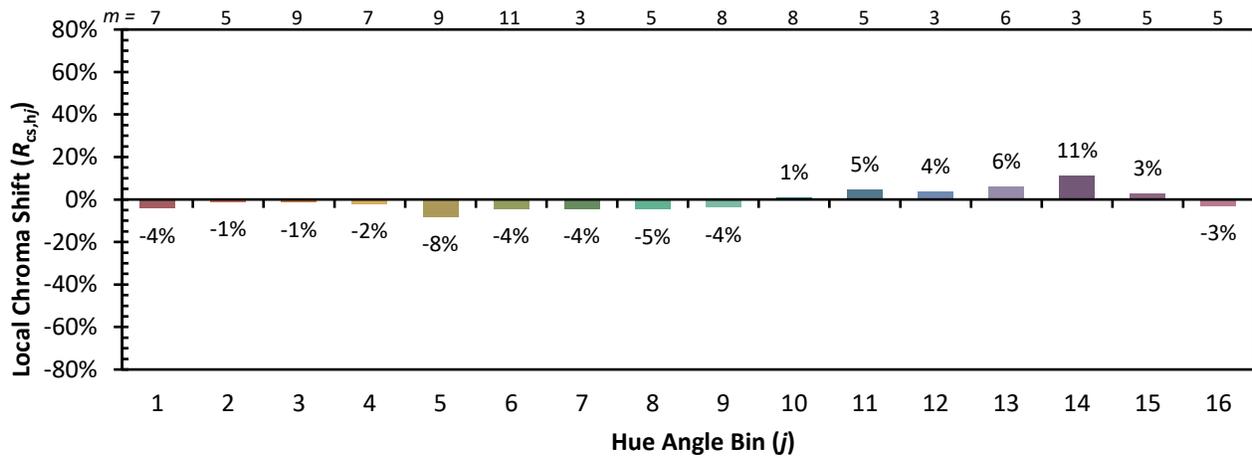

Measure Comparisons

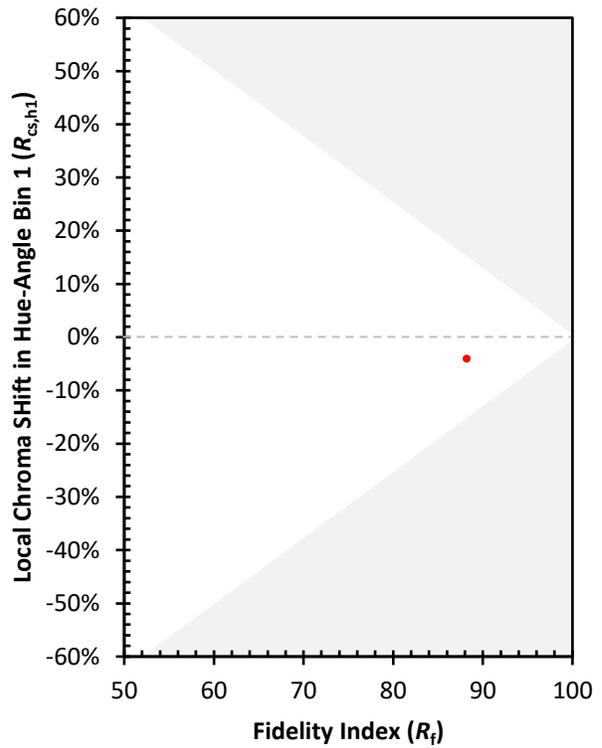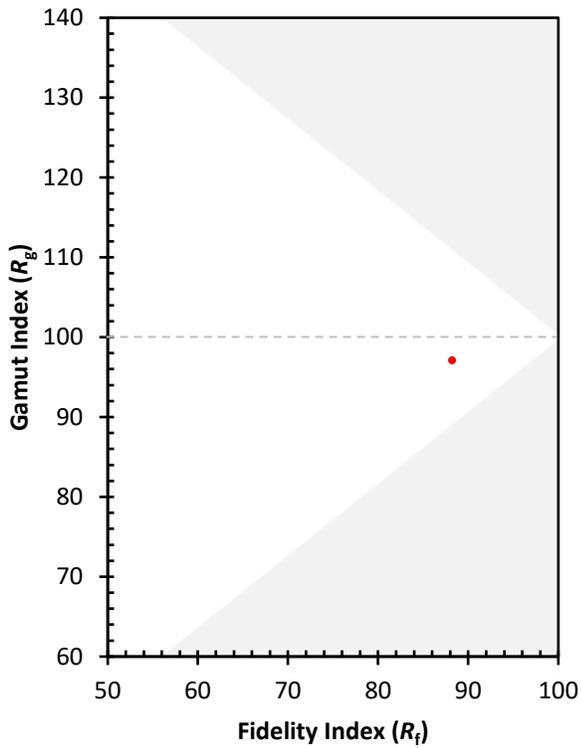

(END OF REPORT)