

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P1357288

Luminaire Tested: 6ASL4-10-1-40-UNV

Issue Date: 2/17/2026

Test Information

Test Method: LM-79-2019
Report Number: P1357288
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G2-2511-597-6)
Test Lab: INNOVATION CENTER
Issue Date: 2/17/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: 6ASL4-10-1-40-UNV
Description: 6FT 1000 LUMEN PER FOOT 4ASL LED LUMINAIRE WITH OPL LENS AND 4000K LEDS 1 ROW
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6228.0 lumens
Efficiency: N/A
Efficacy: 118.0 lumens/watt
Spacing Criteria (0/90/45): 1.21 / 1.3 / 1.39
Luminous Opening: Rectangular w/ Sides (W: 0.33' x L: 5.98' x H: 0.1')
CIE Type: Direct

Input Watts (W): 52.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1357288
CATALOG NUMBER: 6ASL4-10-1-40-UNV

Luminous Intensity Polar Plot

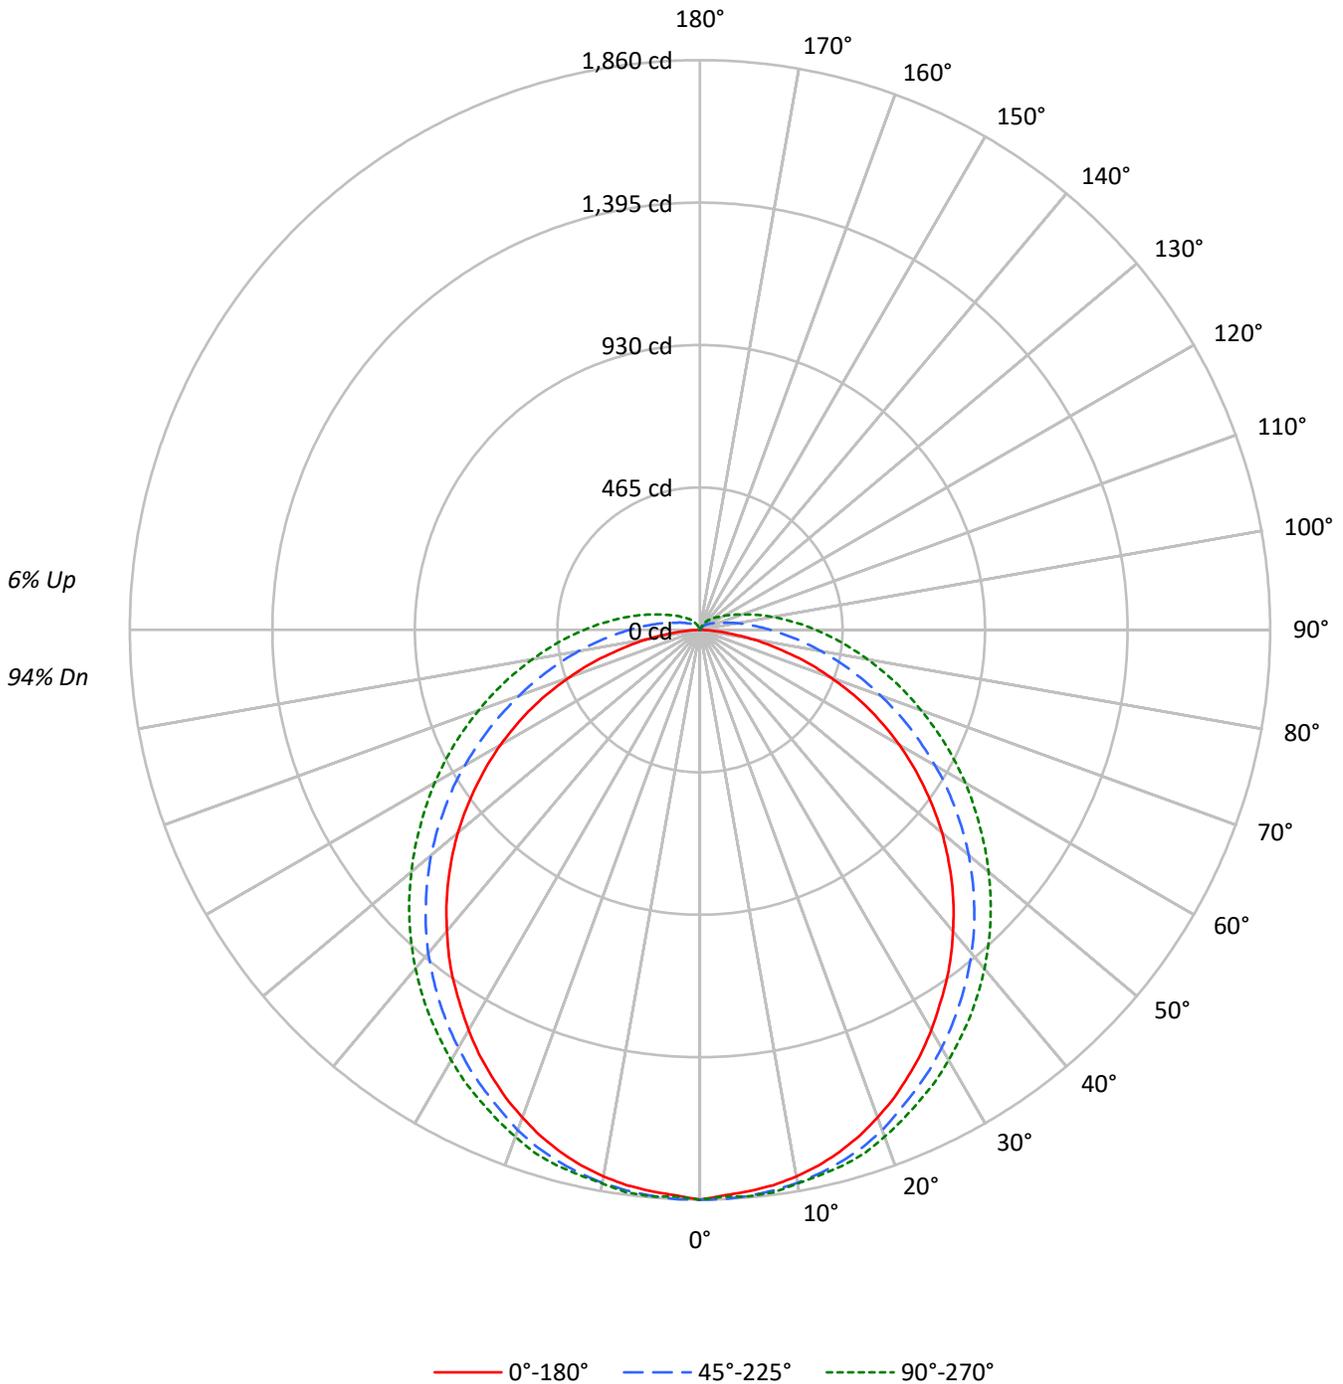



TEST NUMBER: P1357288
 CATALOG NUMBER: 6ASL4-10-1-40-UNV

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	118	118	118	118	114	114	114	114	108	108	108	102	102	102	96	96	96	96	96	96	94
1	106	100	95	91	102	97	93	89	92	88	85	87	84	81	82	80	78	78	78	78	75
2	95	86	79	73	92	84	77	71	79	74	69	75	70	66	71	67	64	64	64	64	61
3	87	76	67	60	84	73	65	59	69	63	57	66	60	55	62	58	54	54	54	54	51
4	79	67	57	50	76	65	56	50	62	54	48	58	52	47	56	50	46	46	46	46	43
5	73	59	50	43	70	58	49	43	55	47	42	52	46	41	50	44	40	40	40	40	37
6	67	53	44	38	65	52	43	37	50	42	36	47	41	35	45	39	35	35	35	35	32
7	62	48	39	33	60	47	39	33	45	37	32	43	36	31	41	35	31	31	31	31	29
8	58	44	35	29	56	43	35	29	41	34	29	39	33	28	38	32	27	27	27	27	25
9	54	40	32	26	52	39	32	26	38	31	26	36	30	25	35	29	25	25	25	25	23
10	51	37	29	24	49	36	29	24	35	28	23	34	27	23	32	27	22	22	22	22	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	10047	10047	10047
5°	9956	9850	9794
10°	9906	9655	9538
15°	9814	9446	9337
20°	9675	9208	9089
25°	9503	8923	8822
30°	9316	8663	8572
35°	9129	8396	8321
40°	8920	8127	8063
45°	8720	7832	7801
50°	8487	7526	7523
55°	8197	7179	7247
60°	7877	6815	7005
65°	7467	6435	6762
70°	6817	6034	6526
75°	5978	5681	6345
80°	4826	5381	6233
85°	2935	5192	6275

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8720 cd/sqm



TEST NUMBER: P1357288
 CATALOG NUMBER: 6ASL4-10-1-40-UNV

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	176.2	2.8
10°-20°	505.7	8.1
20°-30°	764.6	12.3
30°-40°	924.2	14.8
40°-50°	971.7	15.6
50°-60°	905.2	14.5
60°-70°	743.7	11.9
70°-80°	527.9	8.5
80°-90°	318.3	5.1
90°-100°	178.3	2.9
100°-110°	98.7	1.6
110°-120°	55.1	0.9
120°-130°	31.7	0.5
130°-140°	17.3	0.3
140°-150°	7.7	0.1
150°-160°	1.8	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1446.4	23.2
0°-40°	2370.6	38.1
0°-60°	4247.5	68.2
0°-90°	5837.4	93.7
90°-120°	332.1	5.3
90°-150°	388.8	6.2
90°-180°	391.0	6.3
0°-180°	6228.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1860	1860	1860	1860	1860	
5°	1839	1856	1854	1852	1856	175
15°	1764	1787	1795	1803	1810	497
25°	1608	1637	1660	1684	1696	741
35°	1402	1437	1482	1519	1538	876
45°	1162	1204	1265	1317	1340	896
55°	892	943	1016	1084	1113	798
65°	606	661	756	844	884	598
75°	305	383	509	614	659	326
85°	57	164	307	421	463	71
90°	0	97	229	337	377	2
95°	0	57	168	265	303	0
105°	0	21	88	160	189	0
115°	0	10	55	97	116	0
125°	0	6	34	63	74	0
135°	0	2	21	40	50	0
145°	2	0	8	23	30	1
155°	2	2	0	6	8	1
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0



TEST NUMBER: P1357288
 CATALOG NUMBER: 6ASL4-10-1-40-UNV

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1860.3	1860.3	1860.3	1860.3	1860.3
2.5°	1847.6	1864.5	1860.3	1851.8	1851.8
5°	1839.2	1856.0	1853.9	1851.8	1856.0
7.5°	1828.7	1845.5	1845.5	1847.6	1851.8
10°	1811.9	1832.9	1832.9	1832.9	1835.0
12.5°	1790.8	1811.9	1816.1	1818.2	1822.4
15°	1763.5	1786.6	1795.0	1803.4	1809.7
17.5°	1731.9	1755.0	1769.8	1780.3	1790.8
20°	1694.0	1719.3	1738.2	1750.8	1761.3
22.5°	1654.0	1679.3	1698.2	1717.2	1729.8
25°	1607.7	1637.2	1660.3	1683.5	1696.1
27.5°	1561.4	1590.9	1620.4	1647.7	1662.4
30°	1508.8	1542.5	1576.2	1607.7	1622.5
32.5°	1454.1	1489.9	1529.9	1563.5	1580.4
35°	1401.5	1437.3	1481.5	1519.3	1538.3
37.5°	1344.7	1380.5	1431.0	1473.0	1492.0
40°	1283.7	1323.6	1378.4	1422.5	1443.6
42.5°	1224.7	1264.7	1323.6	1372.0	1393.1
45°	1161.6	1203.7	1264.7	1317.3	1340.5
47.5°	1096.4	1140.6	1205.8	1260.5	1285.8
50°	1031.1	1077.4	1144.8	1203.7	1228.9
52.5°	961.7	1010.1	1081.6	1144.8	1172.1
55°	892.2	942.8	1016.4	1083.7	1113.2
57.5°	822.8	873.3	953.3	1024.8	1056.4
60°	751.3	803.9	885.9	963.8	999.6
62.5°	677.6	732.3	818.6	902.8	940.6
65°	606.1	660.8	755.5	843.8	883.8
67.5°	530.3	589.2	690.2	782.8	824.9
70°	452.4	519.8	627.1	726.0	768.1
72.5°	383.0	452.4	568.2	669.2	713.4
75°	305.1	383.0	509.3	614.5	658.7
77.5°	237.8	322.0	454.5	561.9	606.1
80°	170.5	263.0	401.9	511.4	555.6
82.5°	109.4	210.4	353.5	465.1	507.1
85°	56.8	164.1	307.2	420.9	463.0
87.5°	16.8	126.3	265.1	376.7	418.8
90°	0.0	96.8	229.4	336.7	376.7
92.5°	0.0	73.7	197.8	300.9	340.9
95°	0.0	56.8	168.3	265.1	303.0
97.5°	0.0	44.2	145.2	233.6	271.5
100°	0.0	35.8	124.2	206.2	242.0
102.5°	0.0	29.5	107.3	183.1	214.6
105°	0.0	21.0	88.4	159.9	189.4
107.5°	0.0	14.7	77.9	141.0	166.2
110°	0.0	12.6	69.4	122.1	147.3



TEST NUMBER: P1357288
 CATALOG NUMBER: 6ASL4-10-1-40-UNV

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.0	10.5	61.0	109.4	130.5
115°	0.0	10.5	54.7	96.8	115.7
117.5°	0.0	8.4	46.3	86.3	103.1
120°	0.0	8.4	42.1	77.9	92.6
122.5°	0.0	6.3	37.9	69.4	84.2
125°	0.0	6.3	33.7	63.1	73.7
127.5°	0.0	4.2	29.5	56.8	67.3
130°	0.0	4.2	27.4	50.5	61.0
132.5°	0.0	2.1	25.3	46.3	54.7
135°	0.0	2.1	21.0	40.0	50.5
137.5°	0.0	0.0	18.9	35.8	44.2
140°	0.0	0.0	14.7	31.6	40.0
142.5°	2.1	0.0	12.6	27.4	33.7
145°	2.1	0.0	8.4	23.1	29.5
147.5°	2.1	2.1	6.3	18.9	23.1
150°	2.1	2.1	4.2	12.6	18.9
152.5°	2.1	2.1	2.1	8.4	12.6
155°	2.1	2.1	0.0	6.3	8.4
157.5°	2.1	2.1	0.0	2.1	4.2
160°	2.1	2.1	0.0	0.0	2.1
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P1357288
 CATALOG NUMBER: 6ASL4-10-1-40-UNV

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.43	18.98	17.89	19.43	19.89	19.44	20.99	19.90	21.44	21.90
	3H	18.92	20.34	19.39	20.79	21.30	21.86	23.28	22.34	23.73	24.24
	4H	19.40	20.74	19.89	21.21	21.73	23.04	24.38	23.53	24.85	25.37
	6H	19.67	20.92	20.18	21.41	21.95	24.27	25.51	24.77	26.00	26.54
	8H	19.73	20.92	20.24	21.43	21.97	24.90	26.10	25.42	26.61	27.15
	12H	19.74	20.89	20.26	21.39	21.96	25.61	26.75	26.13	27.26	27.83
4H	2H	18.30	19.64	18.79	20.11	20.63	19.87	21.22	20.37	21.69	22.21
	3H	20.03	21.17	20.54	21.68	22.23	22.52	23.66	23.03	24.18	24.72
	4H	20.63	21.67	21.15	22.20	22.78	23.86	24.91	24.39	25.43	26.01
	6H	21.02	21.95	21.57	22.50	23.09	25.28	26.20	25.82	26.75	27.34
	8H	21.12	21.98	21.67	22.53	23.14	26.02	26.89	26.57	27.44	28.04
	12H	21.16	21.95	21.73	22.53	23.14	26.85	27.63	27.42	28.21	28.82
8H	4H	21.29	22.15	21.84	22.70	23.31	24.08	24.94	24.63	25.49	26.10
	6H	21.85	22.59	22.44	23.18	23.79	25.66	26.39	26.24	26.98	27.60
	8H	22.03	22.69	22.63	23.30	23.92	26.53	27.20	27.13	27.80	28.42
	12H	22.14	22.73	22.74	23.32	24.01	27.55	28.14	28.14	28.73	29.42
12H	4H	21.47	22.26	22.04	22.84	23.45	24.08	24.87	24.66	25.45	26.06
	6H	22.13	22.80	22.73	23.40	24.02	25.69	26.35	26.29	26.96	27.58
	8H	22.40	22.99	23.00	23.59	24.28	26.64	27.23	27.23	27.82	28.51

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Fail-Safe

Report Number: SP1-2511-597-4

Test Date: 11/18/2025

Luminaire Tested: 4ASL-2-40-UNV-OPL-1_600mA

Data in this report applies to families of products including 4ASL

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2511-597-4
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 11/18/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: Fail-Safe
 Catalog Number: **4ASL-2-40-UNV-OPL-1_600mA**
 Description: 2foot 4ASL LED LUMINAIRE WITH OPL LENS AND 4000K LEDs with 1 rows at 600mA

Spectral Parameters

CCT (K): 4015
 CIE u': 0.2259
 CIE v': 0.4990
 Duv: -0.0019
 CIE x: 0.3785
 CIE y: 0.3715
 CIE z: 0.2500
 Peak Wavelength (nm): 630
 Dominant Wavelength (nm): 580
 Purity: 25.06827
 R_f: 90.7
 R_g: 100.2

CRI (Ra): 93.9
 R1: 95.7
 R2: 96.3
 R3: 94.8
 R4: 95.2
 R5: 94.6
 R6: 93.5
 R7: 94.0
 R8: 87.2
 R9: 66.3
 R10: 89.1
 R11: 95.0
 R12: 73.8
 R13: 96.0
 R14: 96.4
 R15: 93.2



Test Conditions


Stabilization Time: 23M
 Operation Time: 1H 23M
 Sphere Temperature (°C): 24.1

REPORT NUMBER: SP1-2511-597-4


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	10/21/2025	10/21/2026
AC Power Source	CHROMA 61603 IN0063	10/21/2025	10/21/2026
DC Power Source	AGILENT E3634A IN0208	10/21/2025	10/21/2026
Sphere Thermometer	ONSET IN0085	10/21/2025	10/21/2026
Room Thermometer	ONSET IN0046	10/21/2025	10/21/2026

REPORT NUMBER: SP1-2511-597-4

CIE 1931 Chromaticity Diagram

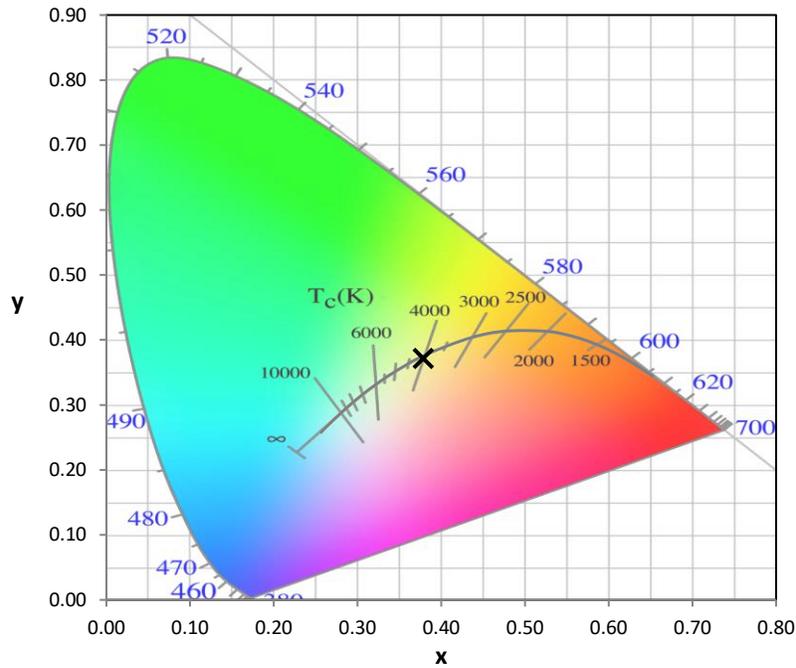


CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

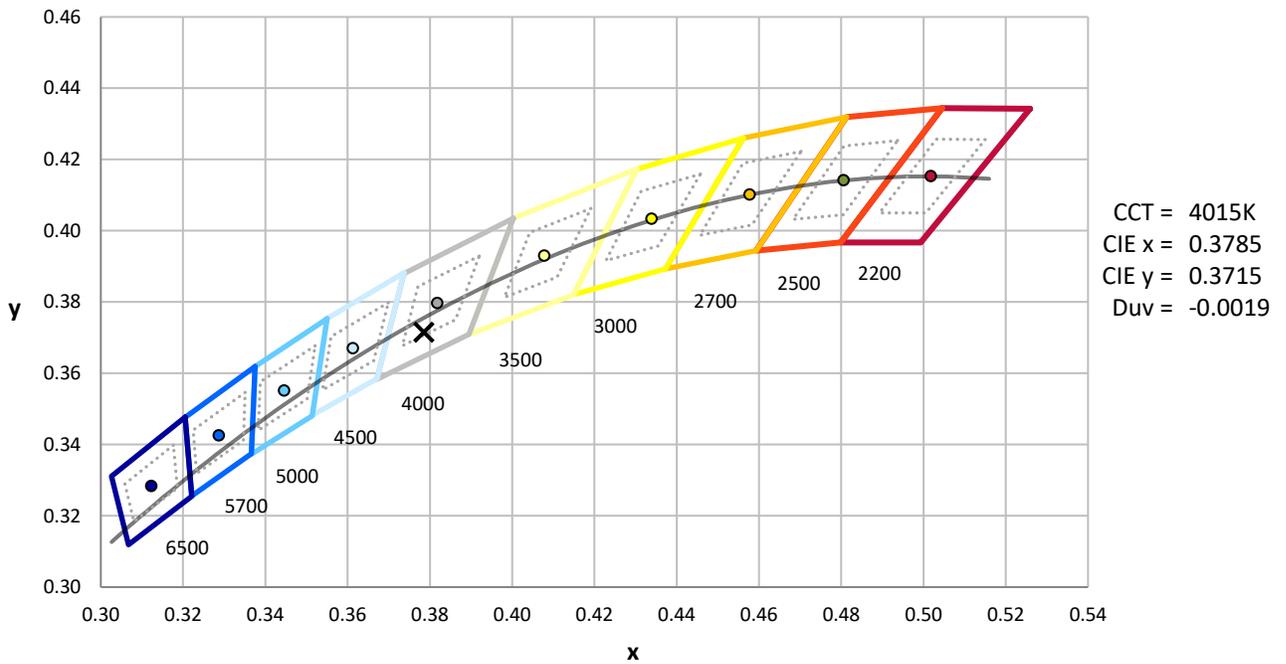

Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2511-597-4

Photopic Flux vs. Wavelength

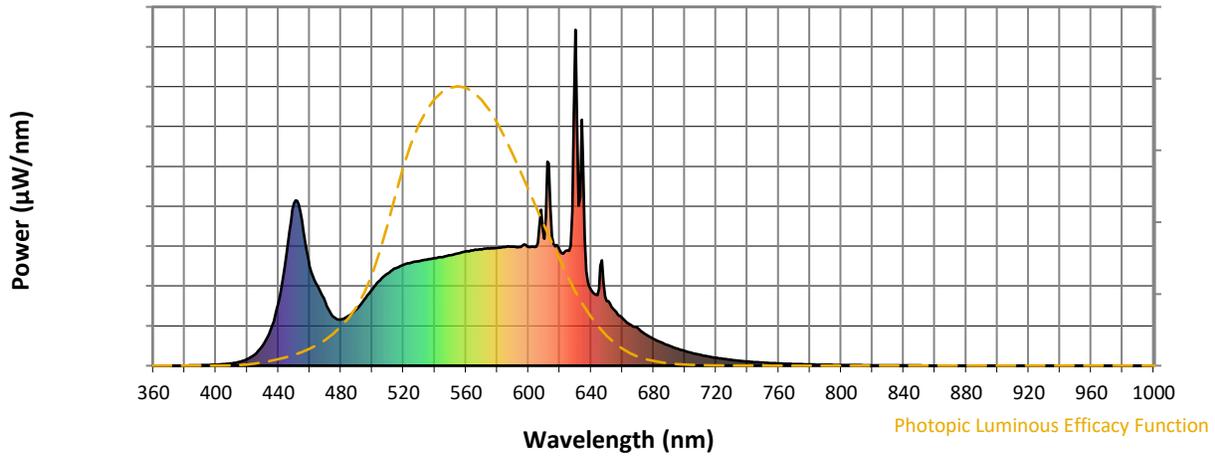

Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)	λ (nm)	Power W [^] /nm	Lumens (ϕ /nm)
360	0	NR	490	169	NR	620	343	NR	750	9	NR	880	0	NR
365	0	NR	495	197	NR	625	343	NR	755	8	NR	885	0	NR
370	0	NR	500	228	NR	630	1000	NR	760	7	NR	890	0	NR
375	0	NR	505	254	NR	635	591	NR	765	6	NR	895	0	NR
380	0	NR	510	274	NR	640	225	NR	770	5	NR	900	0	NR
385	1	NR	515	290	NR	645	229	NR	775	4	NR	905	0	NR
390	1	NR	520	300	NR	650	193	NR	780	4	NR	910	0	NR
395	2	NR	525	307	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	311	NR	660	142	NR	790	3	NR	920	0	NR
405	5	NR	535	316	NR	665	122	NR	795	2	NR	925	0	NR
410	7	NR	540	320	NR	670	112	NR	800	2	NR	930	0	NR
415	11	NR	545	323	NR	675	93	NR	805	2	NR	935	0	NR
420	20	NR	550	329	NR	680	80	NR	810	2	NR	940	0	NR
425	35	NR	555	334	NR	685	69	NR	815	1	NR	945	0	NR
430	61	NR	560	340	NR	690	59	NR	820	1	NR	950	0	NR
435	108	NR	565	344	NR	695	51	NR	825	1	NR	955	0	NR
440	187	NR	570	346	NR	700	43	NR	830	1	NR	960	0	NR
445	329	NR	575	349	NR	705	37	NR	835	1	NR	965	0	NR
450	484	NR	580	351	NR	710	32	NR	840	1	NR	970	0	NR
455	433	NR	585	353	NR	715	27	NR	845	1	NR	975	0	NR
460	296	NR	590	354	NR	720	23	NR	850	1	NR	980	0	NR
465	237	NR	595	353	NR	725	20	NR	855	0	NR	985	0	NR
470	188	NR	600	354	NR	730	17	NR	860	0	NR	990	0	NR
475	146	NR	605	354	NR	735	15	NR	865	0	NR	995	0	NR
480	138	NR	610	378	NR	740	12	NR	870	0	NR	1000	0	NR
485	149	NR	615	385	NR	745	11	NR	875	0	NR			

REPORT NUMBER: SP1-2511-597-4

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.79

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	169	NR	620	343	NR	750	9	NR	880	0	NR
365	0	NR	495	197	NR	625	343	NR	755	8	NR	885	0	NR
370	0	NR	500	228	NR	630	1000	NR	760	7	NR	890	0	NR
375	0	NR	505	254	NR	635	591	NR	765	6	NR	895	0	NR
380	0	NR	510	274	NR	640	225	NR	770	5	NR	900	0	NR
385	1	NR	515	290	NR	645	229	NR	775	4	NR	905	0	NR
390	1	NR	520	300	NR	650	193	NR	780	4	NR	910	0	NR
395	2	NR	525	307	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	311	NR	660	142	NR	790	3	NR	920	0	NR
405	5	NR	535	316	NR	665	122	NR	795	2	NR	925	0	NR
410	7	NR	540	320	NR	670	112	NR	800	2	NR	930	0	NR
415	11	NR	545	323	NR	675	93	NR	805	2	NR	935	0	NR
420	20	NR	550	329	NR	680	80	NR	810	2	NR	940	0	NR
425	35	NR	555	334	NR	685	69	NR	815	1	NR	945	0	NR
430	61	NR	560	340	NR	690	59	NR	820	1	NR	950	0	NR
435	108	NR	565	344	NR	695	51	NR	825	1	NR	955	0	NR
440	187	NR	570	346	NR	700	43	NR	830	1	NR	960	0	NR
445	329	NR	575	349	NR	705	37	NR	835	1	NR	965	0	NR
450	484	NR	580	351	NR	710	32	NR	840	1	NR	970	0	NR
455	433	NR	585	353	NR	715	27	NR	845	1	NR	975	0	NR
460	296	NR	590	354	NR	720	23	NR	850	1	NR	980	0	NR
465	237	NR	595	353	NR	725	20	NR	855	0	NR	985	0	NR
470	188	NR	600	354	NR	730	17	NR	860	0	NR	990	0	NR
475	146	NR	605	354	NR	735	15	NR	865	0	NR	995	0	NR
480	138	NR	610	378	NR	740	12	NR	870	0	NR	1000	0	NR
485	149	NR	615	385	NR	745	11	NR	875	0	NR			

REPORT NUMBER: SP1-2511-597-4

Melanopic Flux vs. Wavelength




Melanopic Lumens: NR

M/P: 3.74




λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	169	NR	620	343	NR	750	9	NR	880	0	NR
365	0	NR	495	197	NR	625	343	NR	755	8	NR	885	0	NR
370	0	NR	500	228	NR	630	1000	NR	760	7	NR	890	0	NR
375	0	NR	505	254	NR	635	591	NR	765	6	NR	895	0	NR
380	0	NR	510	274	NR	640	225	NR	770	5	NR	900	0	NR
385	1	NR	515	290	NR	645	229	NR	775	4	NR	905	0	NR
390	1	NR	520	300	NR	650	193	NR	780	4	NR	910	0	NR
395	2	NR	525	307	NR	655	165	NR	785	3	NR	915	0	NR
400	3	NR	530	311	NR	660	142	NR	790	3	NR	920	0	NR
405	5	NR	535	316	NR	665	122	NR	795	2	NR	925	0	NR
410	7	NR	540	320	NR	670	112	NR	800	2	NR	930	0	NR
415	11	NR	545	323	NR	675	93	NR	805	2	NR	935	0	NR
420	20	NR	550	329	NR	680	80	NR	810	2	NR	940	0	NR
425	35	NR	555	334	NR	685	69	NR	815	1	NR	945	0	NR
430	61	NR	560	340	NR	690	59	NR	820	1	NR	950	0	NR
435	108	NR	565	344	NR	695	51	NR	825	1	NR	955	0	NR
440	187	NR	570	346	NR	700	43	NR	830	1	NR	960	0	NR
445	329	NR	575	349	NR	705	37	NR	835	1	NR	965	0	NR
450	484	NR	580	351	NR	710	32	NR	840	1	NR	970	0	NR
455	433	NR	585	353	NR	715	27	NR	845	1	NR	975	0	NR
460	296	NR	590	354	NR	720	23	NR	850	1	NR	980	0	NR
465	237	NR	595	353	NR	725	20	NR	855	0	NR	985	0	NR
470	188	NR	600	354	NR	730	17	NR	860	0	NR	990	0	NR
475	146	NR	605	354	NR	735	15	NR	865	0	NR	995	0	NR
480	138	NR	610	378	NR	740	12	NR	870	0	NR	1000	0	NR
485	149	NR	615	385	NR	745	11	NR	875	0	NR			

Summary

$R_f = 90.7$
 $R_g = 100.2$
 CIE $R_a = 93.9$
 $R_9 = 66.3$

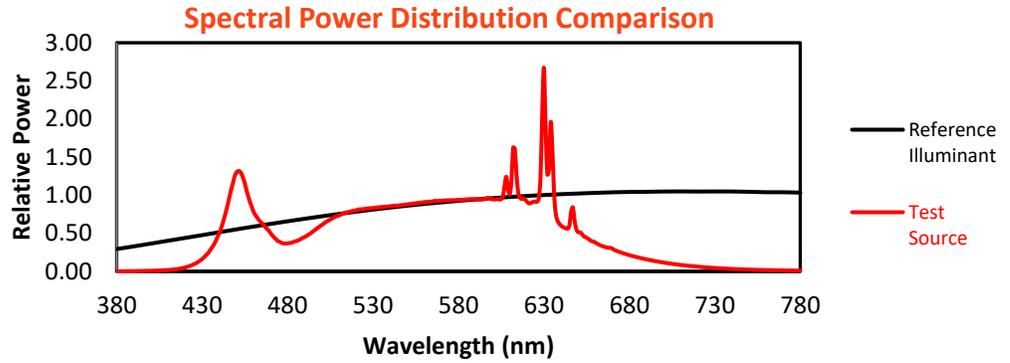


Color Vector Graphics

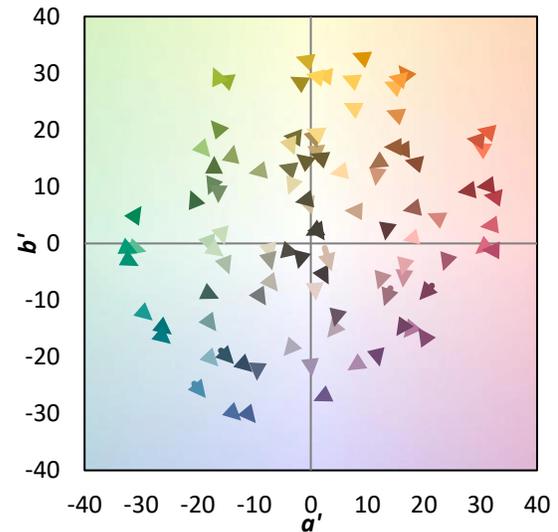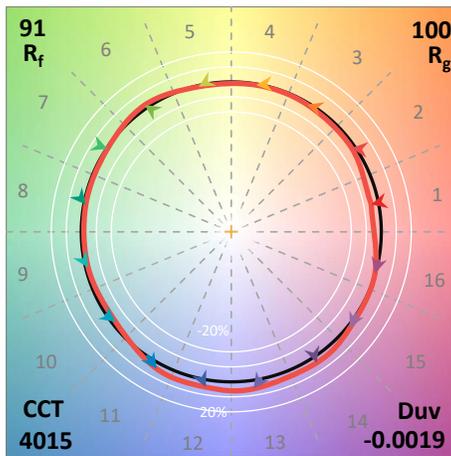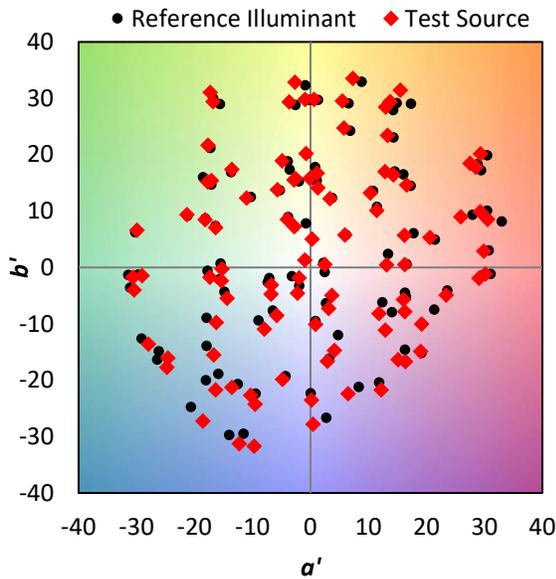

Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 86	CES26 = 92	CES51 = 98	CES76 = 84
CES02 = 62	CES27 = 91	CES52 = 98	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 97	CES78 = 81
CES04 = 69	CES29 = 95	CES54 = 93	CES79 = 94
CES05 = 49	CES30 = 93	CES55 = 92	CES80 = 92
CES06 = 50	CES31 = 95	CES56 = 95	CES81 = 81
CES07 = 42	CES32 = 87	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 99	CES58 = 94	CES83 = 96
CES09 = 29	CES34 = 91	CES59 = 97	CES84 = 93
CES10 = 74	CES35 = 95	CES60 = 92	CES85 = 81
CES11 = 57	CES36 = 80	CES61 = 92	CES86 = 84
CES12 = 63	CES37 = 93	CES62 = 85	CES87 = 91
CES13 = 43	CES38 = 87	CES63 = 92	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 90	CES89 = 85
CES15 = 71	CES40 = 97	CES65 = 88	CES90 = 98
CES16 = 47	CES41 = 97	CES66 = 86	CES91 = 71
CES17 = 49	CES42 = 91	CES67 = 85	CES92 = 77
CES18 = 56	CES43 = 91	CES68 = 87	CES93 = 86
CES19 = 71	CES44 = 99	CES69 = 87	CES94 = 76
CES20 = 66	CES45 = 95	CES70 = 84	CES95 = 82
CES21 = 85	CES46 = 96	CES71 = 78	CES96 = 92
CES22 = 78	CES47 = 94	CES72 = 93	CES97 = 95
CES23 = 91	CES48 = 92	CES73 = 78	CES98 = 95
CES24 = 90	CES49 = 95	CES74 = 91	CES99 = 94
CES25 = 71	CES50 = 99	CES75 = 80	

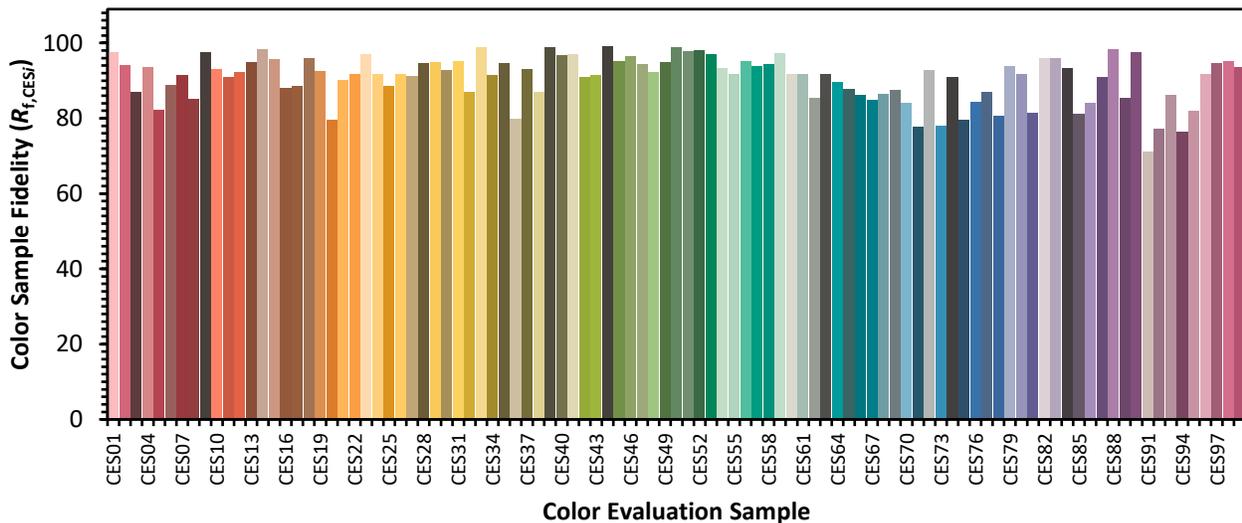

Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)