

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517439

Luminaire Tested: HVL12-4-LD4-1HI-35-UNV-C-EDD-90

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517439
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-1HI-35-UNV-C-EDD-90
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 3500K, 90 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4938.0 lumens
Efficiency: N/A
Efficacy: 112.0 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 44.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517439

CATALOG NUMBER: HVL12-4-LD4-1HI-35-UNV-C-EDD-90

Luminous Intensity Polar Plot

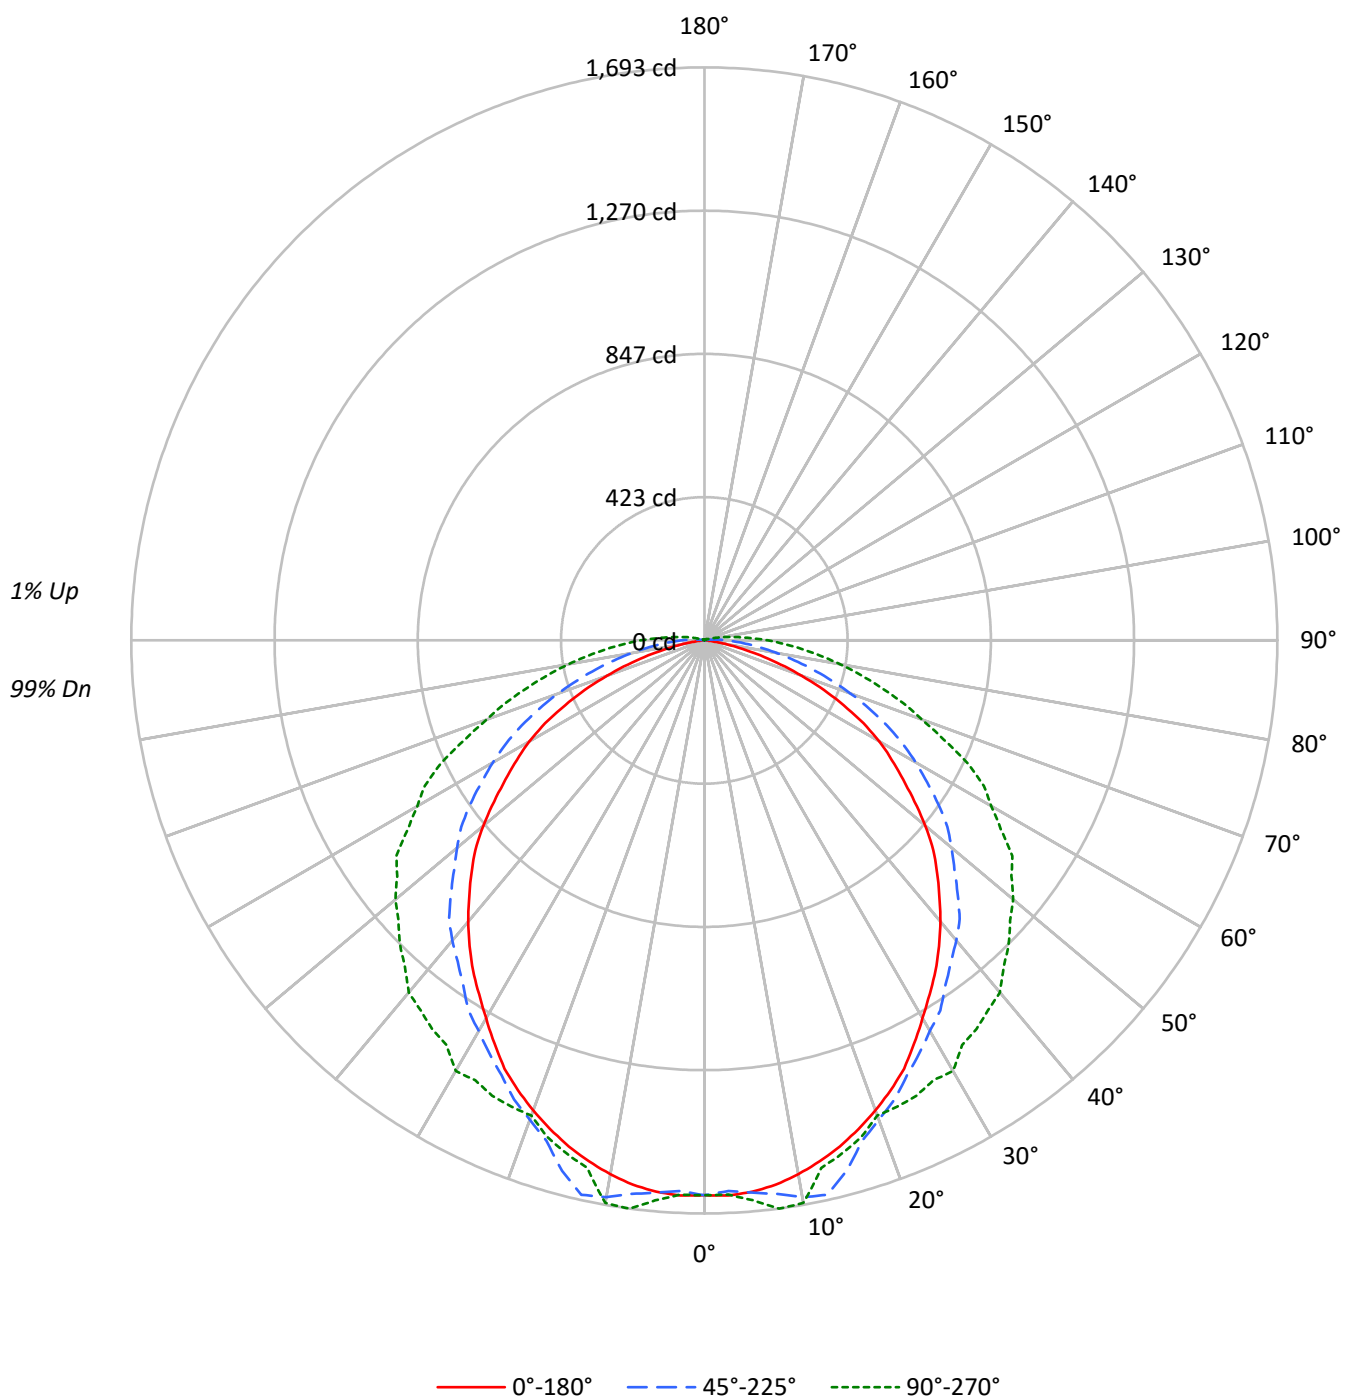

CATALOG NUMBER: HVL12-4-LD4-1HI-35-UNV-C-EDD-90

RF	20					20					20					20					20	
RC	80					70					50					30					0	
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		0			
RCR																						
0	119	119	119	119		116	116	116	116		110	110	110		105	105	105		101	101	101	99
1	108	103	98	94		105	100	96	92		96	92	89		91	89	86		87	85	83	81
2	98	89	82	76		95	87	80	75		83	78	73		80	75	71		76	72	69	67
3	89	78	69	63		86	76	68	62		73	66	61		70	64	59		67	62	58	56
4	81	69	60	53		79	67	59	52		65	57	51		62	56	51		60	54	50	47
5	75	61	52	45		72	60	51	45		58	50	44		56	49	44		54	48	43	41
6	69	55	46	39		67	54	46	39		52	45	39		50	44	38		49	43	38	36
7	64	50	41	35		62	49	41	35		47	40	34		46	39	34		44	38	34	32
8	59	46	37	31		58	45	37	31		43	36	31		42	35	30		41	35	30	28
9	55	42	34	28		54	41	33	28		40	33	28		39	32	27		38	32	27	25
10	52	39	31	25		51	38	30	25		37	30	25		36	29	25		35	29	25	23

	0°	45°	90°
0°	4411	4411	4411
5°	4401	4367	4421
10°	4343	4448	4480
15°	4264	4349	4187
20°	4168	4095	4033
25°	4066	3938	4087
30°	3912	3815	4164
35°	3802	3700	4123
40°	3683	3619	4184
45°	3556	3510	4147
50°	3401	3395	4160
55°	3174	3272	4209
60°	3000	3094	4087
65°	2652	2877	4027
70°	2164	2586	3692
75°	1544	2224	3471
80°	866	1861	3250
85°	322	1486	3058

Luminance: 4209 cd/sqm

TEST NUMBER: P517439

CATALOG NUMBER: HVL12-4-LD4-1HI-35-UNV-C-EDD-90

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	157.5	3.2
10°-20°	448.6	9.1
20°-30°	667.5	13.5
30°-40°	802.4	16.2
40°-50°	844.5	17.1
50°-60°	783.6	15.9
60°-70°	619.6	12.5
70°-80°	378.5	7.7
80°-90°	164.9	3.3
90°-100°	51.3	1.0
100°-110°	11.5	0.2
110°-120°	4.6	0.1
120°-130°	2.6	0.1
130°-140°	0.7	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1273.7	25.8
0°-40°	2076.1	42.0
0°-60°	3704.2	75.0
0°-90°	4867.2	98.6
90°-120°	67.5	1.4
90°-150°	70.8	1.4
90°-180°	71.0	1.4
0°-180°	4938.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1639	1639	1639	1639	1639	
5°	1635	1632	1638	1656	1660	155
15°	1548	1607	1623	1569	1570	436
25°	1396	1485	1417	1460	1484	641
35°	1191	1224	1242	1355	1401	744
45°	973	978	1058	1226	1272	750
55°	717	729	844	1029	1111	644
65°	454	468	595	787	858	449
75°	172	227	332	510	542	187
85°	15	53	129	251	288	24
90°	0	16	68	159	187	1
95°	0	4	30	87	106	0
105°	0	2	6	17	24	0
115°	0	1	5	8	8	1
125°	0	1	2	5	7	1
135°	1	1	1	2	2	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517439

CATALOG NUMBER: HVL12-4-LD4-1HI-35-UNV-C-EDD-90

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1639.1	1639.1	1639.1	1639.1	1639.1
2.5°	1641.2	1636.8	1627.8	1636.5	1638.8
5°	1635.1	1631.8	1637.5	1655.8	1660.5
7.5°	1621.5	1634.1	1649.2	1682.6	1693.2
10°	1601.1	1625.1	1670.2	1698.6	1687.6
12.5°	1576.4	1617.1	1677.5	1622.1	1596.4
15°	1547.7	1607.1	1622.8	1569.0	1570.0
17.5°	1513.9	1598.7	1550.3	1549.0	1539.3
20°	1477.5	1570.7	1506.6	1503.9	1493.6
22.5°	1438.5	1533.6	1467.9	1462.5	1490.6
25°	1396.1	1485.2	1417.4	1459.8	1483.5
27.5°	1343.0	1421.8	1375.4	1435.5	1465.2
30°	1289.2	1356.3	1332.3	1416.1	1468.9
32.5°	1238.8	1287.9	1296.9	1408.8	1417.4
35°	1191.0	1224.1	1242.5	1355.3	1401.4
37.5°	1138.6	1147.6	1196.4	1333.0	1377.4
40°	1085.2	1079.5	1157.7	1296.2	1357.7
42.5°	1027.8	1025.8	1116.6	1277.9	1308.6
45°	973.3	977.7	1058.1	1225.8	1271.5
47.5°	917.6	923.3	1002.7	1168.7	1225.4
50°	852.8	860.1	953.3	1117.9	1191.0
52.5°	782.7	796.7	905.2	1069.8	1143.6
55°	716.9	728.6	844.1	1028.8	1110.6
57.5°	656.8	663.8	781.0	977.0	1038.8
60°	597.7	599.4	721.6	919.6	978.7
62.5°	529.9	532.9	660.5	851.8	930.9
65°	453.8	468.1	594.7	787.0	858.5
67.5°	382.7	407.7	527.6	727.6	765.0
70°	306.5	348.9	461.8	657.8	684.2
72.5°	236.7	286.5	394.3	579.7	616.7
75°	171.6	227.4	331.6	509.5	541.6
77.5°	115.5	172.3	272.8	432.1	474.5
80°	69.1	125.9	220.4	360.3	408.0
82.5°	35.4	84.5	171.0	302.2	344.9
85°	15.4	53.4	129.2	250.8	287.8
87.5°	4.3	30.4	95.2	202.7	234.1
90°	0.3	16.0	67.8	158.9	187.3
92.5°	0.3	7.7	47.7	120.2	141.9
95°	0.3	4.0	29.7	87.1	106.5
97.5°	0.3	2.3	18.0	61.8	78.1
100°	0.3	2.0	10.7	41.1	55.8
102.5°	0.3	2.3	7.3	26.0	36.4
105°	0.3	2.3	6.0	17.0	24.0
107.5°	0.7	2.3	5.3	12.7	16.7
110°	0.3	2.0	5.7	9.7	13.0

TEST NUMBER: P517439

CATALOG NUMBER: HVL12-4-LD4-1HI-35-UNV-C-EDD-90

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.7	1.7	5.3	8.0	9.7
115°	0.3	1.3	4.7	7.7	8.0
117.5°	0.7	1.0	3.7	7.7	8.0
120°	0.7	0.7	3.0	7.3	8.3
122.5°	0.7	0.7	2.3	6.7	8.0
125°	0.3	0.7	2.0	5.0	7.0
127.5°	0.7	0.7	1.7	4.0	5.3
130°	0.7	0.7	1.3	3.0	4.0
132.5°	0.7	0.7	1.0	2.3	3.0
135°	0.7	0.7	0.7	1.7	2.3
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)