

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517448

Luminaire Tested: HVL12-4-LD4-1HI-50-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517448
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-1HI-50-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 5000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5072.0 lumens
Efficiency: N/A
Efficacy: 115.0 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 44.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517448

CATALOG NUMBER: HVL12-4-LD4-1HI-50-UNV-C-EDD

Luminous Intensity Polar Plot

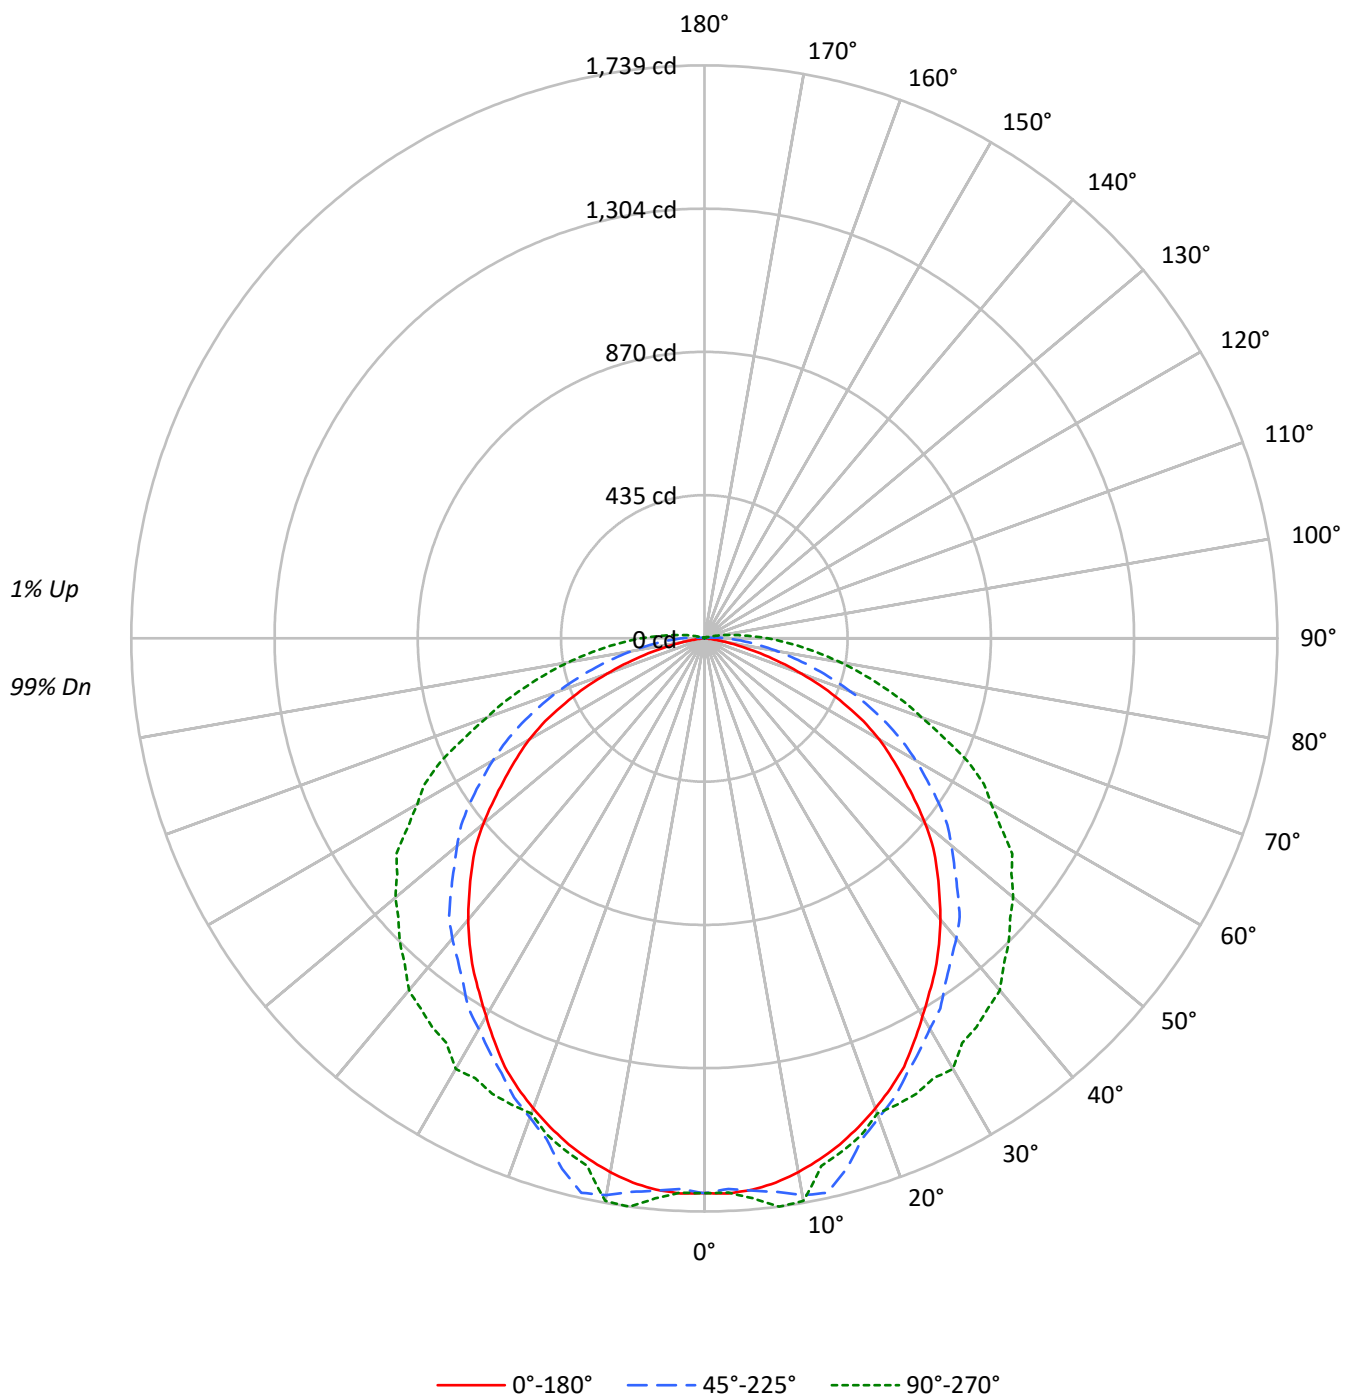

TEST NUMBER: P517448

CATALOG NUMBER: HVL12-4-LD4-1HI-50-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	110	110	110		105	105	105		101
1	108	103	98	94	105	100	96	92	96	92	89		91	89	86		87
2	98	89	82	76	95	87	80	75	83	78	73		80	75	71		76
3	89	78	69	63	86	76	68	62	73	66	61		70	64	59		67
4	81	69	60	53	79	67	59	52	65	57	51		62	56	51		60
5	75	61	52	45	72	60	51	45	58	50	44		56	49	44		54
6	69	55	46	39	67	54	46	39	52	45	39		50	44	38		49
7	64	50	41	35	62	49	41	35	47	40	34		46	39	34		44
8	59	46	37	31	58	45	37	31	43	36	31		42	35	30		41
9	55	42	34	28	54	41	33	28	40	33	28		39	32	27		38
10	52	39	31	25	51	38	30	25	37	30	25		36	29	25		35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4531	4531	4531
5°	4520	4485	4541
10°	4461	4569	4601
15°	4380	4467	4300
20°	4281	4206	4142
25°	4176	4045	4198
30°	4018	3919	4276
35°	3905	3800	4234
40°	3783	3717	4298
45°	3653	3605	4260
50°	3493	3487	4273
55°	3261	3360	4323
60°	3082	3178	4198
65°	2724	2955	4136
70°	2222	2656	3792
75°	1586	2285	3566
80°	890	1911	3338
85°	330	1526	3141

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 4323 cd/sqm

TEST NUMBER: P517448

CATALOG NUMBER: HVL12-4-LD4-1HI-50-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	161.8	3.2
10°-20°	460.8	9.1
20°-30°	685.6	13.5
30°-40°	824.1	16.2
40°-50°	867.5	17.1
50°-60°	804.9	15.9
60°-70°	636.4	12.5
70°-80°	388.8	7.7
80°-90°	169.4	3.3
90°-100°	52.7	1.0
100°-110°	11.8	0.2
110°-120°	4.8	0.1
120°-130°	2.7	0.1
130°-140°	0.7	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1308.3	25.8
0°-40°	2132.4	42.0
0°-60°	3804.7	75.0
0°-90°	4999.3	98.6
90°-120°	69.3	1.4
90°-150°	72.7	1.4
90°-180°	73.0	1.4
0°-180°	5072.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1684	1684	1684	1684	1684	
5°	1680	1676	1682	1701	1706	159
15°	1590	1651	1667	1612	1613	448
25°	1434	1526	1456	1500	1524	658
35°	1223	1257	1276	1392	1439	765
45°	1000	1004	1087	1259	1306	771
55°	736	748	867	1057	1141	662
65°	466	481	611	808	882	462
75°	176	234	341	523	556	192
85°	16	55	133	258	296	24
90°	0	16	70	163	192	1
95°	0	4	30	90	109	0
105°	0	2	6	18	25	0
115°	0	1	5	8	8	1
125°	0	1	2	5	7	1
135°	1	1	1	2	2	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517448

CATALOG NUMBER: HVL12-4-LD4-1HI-50-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1683.6	1683.6	1683.6	1683.6	1683.6
2.5°	1685.7	1681.2	1672.0	1680.9	1683.3
5°	1679.5	1676.1	1681.9	1700.8	1705.6
7.5°	1665.5	1678.5	1693.9	1728.2	1739.2
10°	1644.5	1669.2	1715.5	1744.7	1733.4
12.5°	1619.2	1661.0	1723.1	1666.1	1639.7
15°	1589.7	1650.7	1666.8	1611.6	1612.6
17.5°	1555.0	1642.1	1592.4	1591.0	1581.1
20°	1517.6	1613.3	1547.5	1544.7	1534.1
22.5°	1477.5	1575.3	1507.7	1502.2	1531.0
25°	1433.9	1525.5	1455.9	1499.5	1523.8
27.5°	1379.4	1460.4	1412.7	1474.4	1504.9
30°	1324.2	1393.1	1368.4	1454.5	1508.7
32.5°	1272.4	1322.8	1332.1	1447.0	1455.9
35°	1223.4	1257.3	1276.2	1392.1	1439.4
37.5°	1169.5	1178.8	1228.9	1369.1	1414.7
40°	1114.6	1108.8	1189.1	1331.4	1394.5
42.5°	1055.7	1053.6	1146.9	1312.5	1344.1
45°	999.8	1004.2	1086.9	1259.0	1306.0
47.5°	942.5	948.3	1029.9	1200.4	1258.7
50°	875.9	883.5	979.2	1148.3	1223.4
52.5°	803.9	818.3	929.8	1098.9	1174.7
55°	736.4	748.4	867.0	1056.7	1140.7
57.5°	674.6	681.8	802.2	1003.5	1067.0
60°	613.9	615.6	741.2	944.5	1005.2
62.5°	544.3	547.4	678.4	874.9	956.2
65°	466.1	480.8	610.8	808.4	881.8
67.5°	393.0	418.8	541.9	747.3	785.7
70°	314.8	358.4	474.3	675.6	702.7
72.5°	243.2	294.3	405.0	595.4	633.5
75°	176.3	233.6	340.6	523.4	556.3
77.5°	118.7	177.0	280.2	443.8	487.4
80°	71.0	129.3	226.4	370.1	419.1
82.5°	36.4	86.8	175.6	310.4	354.3
85°	15.8	54.9	132.7	257.6	295.6
87.5°	4.5	31.2	97.7	208.2	240.4
90°	0.3	16.5	69.6	163.3	192.4
92.5°	0.3	7.9	49.0	123.5	145.8
95°	0.3	4.1	30.5	89.5	109.4
97.5°	0.3	2.4	18.5	63.4	80.3
100°	0.3	2.1	11.0	42.2	57.3
102.5°	0.3	2.4	7.5	26.8	37.4
105°	0.3	2.4	6.2	17.5	24.7
107.5°	0.7	2.4	5.5	13.0	17.1
110°	0.3	2.1	5.8	9.9	13.4

TEST NUMBER: P517448

CATALOG NUMBER: HVL12-4-LD4-1HI-50-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.7	1.7	5.5	8.2	9.9
115°	0.3	1.4	4.8	7.9	8.2
117.5°	0.7	1.0	3.8	7.9	8.2
120°	0.7	0.7	3.1	7.5	8.6
122.5°	0.7	0.7	2.4	6.9	8.2
125°	0.3	0.7	2.1	5.1	7.2
127.5°	0.7	0.7	1.7	4.1	5.5
130°	0.7	0.7	1.4	3.1	4.1
132.5°	0.7	0.7	1.0	2.4	3.1
135°	0.7	0.7	0.7	1.7	2.4
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)