

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517456

Luminaire Tested: HVL12-4-LD4-1LO-35-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517456
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-1LO-35-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 3500K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2978.9 lumens
Efficiency: N/A
Efficacy: 126.2 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 23.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517456

CATALOG NUMBER: HVL12-4-LD4-1LO-35-UNV-C-EDD

Luminous Intensity Polar Plot

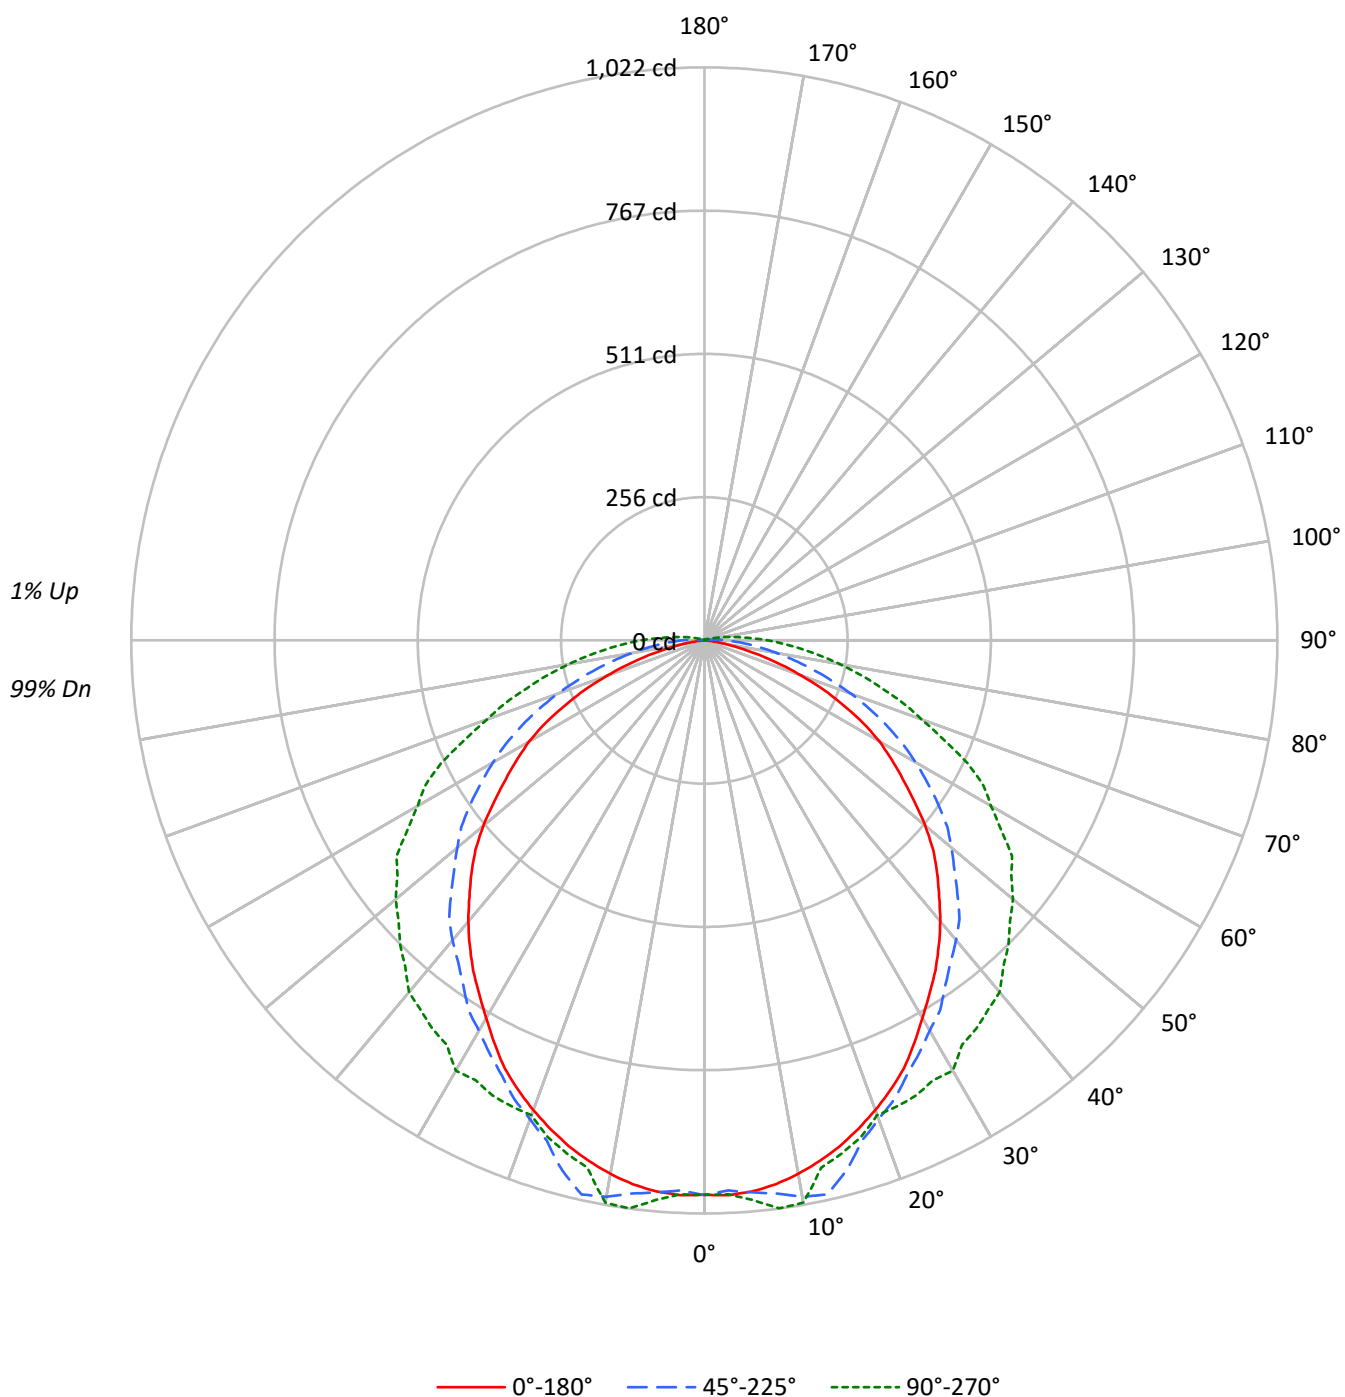

TEST NUMBER: P517456

CATALOG NUMBER: HVL12-4-LD4-1LO-35-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			99
1	108	103	98	94	105	100	96	92	96	92	89	91	89	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	78	73	80	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	51	62	56	51	60	54	50			47
5	75	61	52	45	72	60	51	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	39	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2661	2661	2661
5°	2655	2635	2667
10°	2620	2684	2703
15°	2572	2624	2526
20°	2515	2470	2433
25°	2453	2376	2466
30°	2360	2302	2512
35°	2293	2232	2487
40°	2222	2183	2524
45°	2145	2118	2502
50°	2052	2048	2509
55°	1915	1974	2539
60°	1810	1866	2466
65°	1600	1736	2429
70°	1305	1560	2227
75°	931	1342	2094
80°	523	1122	1961
85°	194	897	1845

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 2539 cd/sqm

TEST NUMBER: P517456

CATALOG NUMBER: HVL12-4-LD4-1LO-35-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	95.0	3.2
10°-20°	270.7	9.1
20°-30°	402.7	13.5
30°-40°	484.0	16.2
40°-50°	509.5	17.1
50°-60°	472.7	15.9
60°-70°	373.8	12.5
70°-80°	228.3	7.7
80°-90°	99.5	3.3
90°-100°	31.0	1.0
100°-110°	7.0	0.2
110°-120°	2.8	0.1
120°-130°	1.6	0.1
130°-140°	0.4	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	768.4	25.8
0°-40°	1252.4	42.0
0°-60°	2234.7	75.0
0°-90°	2936.3	98.6
90°-120°	40.7	1.4
90°-150°	42.7	1.4
90°-180°	43.0	1.4
0°-180°	2978.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	989	989	989	989	989	
5°	986	984	988	999	1002	93
15°	934	970	979	947	947	263
25°	842	896	855	881	895	387
35°	718	738	750	818	845	449
45°	587	590	638	740	767	453
55°	432	440	509	621	670	389
65°	274	282	359	475	518	271
75°	104	137	200	307	327	113
85°	9	32	78	151	174	14
90°	0	10	41	96	113	0
95°	0	2	18	53	64	0
105°	0	1	4	10	14	0
115°	0	1	3	5	5	0
125°	0	0	1	3	4	0
135°	0	0	0	1	1	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517456

CATALOG NUMBER: HVL12-4-LD4-1LO-35-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	988.9	988.9	988.9	988.9	988.9
2.5°	990.1	987.5	982.0	987.3	988.7
5°	986.4	984.4	987.9	998.9	1001.8
7.5°	978.2	985.8	994.9	1015.1	1021.5
10°	965.9	980.4	1007.6	1024.7	1018.1
12.5°	951.0	975.6	1012.0	978.6	963.1
15°	933.7	969.5	979.0	946.6	947.2
17.5°	913.3	964.5	935.3	934.5	928.6
20°	891.4	947.6	908.9	907.3	901.0
22.5°	867.8	925.2	885.5	882.3	899.2
25°	842.2	896.0	855.1	880.7	895.0
27.5°	810.2	857.7	829.7	866.0	883.9
30°	777.8	818.2	803.7	854.3	886.1
32.5°	747.3	777.0	782.4	849.9	855.1
35°	718.5	738.5	749.6	817.6	845.4
37.5°	686.9	692.3	721.8	804.1	830.9
40°	654.7	651.3	698.4	782.0	819.1
42.5°	620.0	618.8	673.6	770.9	789.4
45°	587.2	589.8	638.4	739.5	767.1
47.5°	553.6	557.0	604.9	705.0	739.3
50°	514.5	518.9	575.1	674.4	718.5
52.5°	472.2	480.6	546.1	645.4	689.9
55°	432.5	439.5	509.2	620.6	670.0
57.5°	396.2	400.5	471.2	589.4	626.7
60°	360.6	361.6	435.3	554.8	590.4
62.5°	319.7	321.5	398.4	513.9	561.6
65°	273.8	282.4	358.8	474.8	517.9
67.5°	230.8	246.0	318.3	438.9	461.5
70°	184.9	210.5	278.6	396.8	412.7
72.5°	142.8	172.8	237.9	349.7	372.1
75°	103.5	137.2	200.0	307.4	326.7
77.5°	69.7	103.9	164.6	260.7	286.2
80°	41.7	75.9	132.9	217.4	246.2
82.5°	21.4	51.0	103.1	182.3	208.1
85°	9.3	32.2	78.0	151.3	173.6
87.5°	2.6	18.3	57.4	122.3	141.2
90°	0.2	9.7	40.9	95.9	113.0
92.5°	0.2	4.6	28.8	72.5	85.6
95°	0.2	2.4	17.9	52.6	64.3
97.5°	0.2	1.4	10.9	37.3	47.1
100°	0.2	1.2	6.4	24.8	33.6
102.5°	0.2	1.4	4.4	15.7	22.0
105°	0.2	1.4	3.6	10.3	14.5
107.5°	0.4	1.4	3.2	7.7	10.1
110°	0.2	1.2	3.4	5.8	7.9

TEST NUMBER: P517456

CATALOG NUMBER: HVL12-4-LD4-1LO-35-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.4	1.0	3.2	4.8	5.8
115°	0.2	0.8	2.8	4.6	4.8
117.5°	0.4	0.6	2.2	4.6	4.8
120°	0.4	0.4	1.8	4.4	5.0
122.5°	0.4	0.4	1.4	4.0	4.8
125°	0.2	0.4	1.2	3.0	4.2
127.5°	0.4	0.4	1.0	2.4	3.2
130°	0.4	0.4	0.8	1.8	2.4
132.5°	0.4	0.4	0.6	1.4	1.8
135°	0.4	0.4	0.4	1.0	1.4
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)