

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517464

Luminaire Tested: HVL12-4-LD4-1LO-50-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517464
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-1LO-50-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 5000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3060.0 lumens
Efficiency: N/A
Efficacy: 129.7 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 23.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517464

CATALOG NUMBER: HVL12-4-LD4-1LO-50-UNV-C-EDD

Luminous Intensity Polar Plot

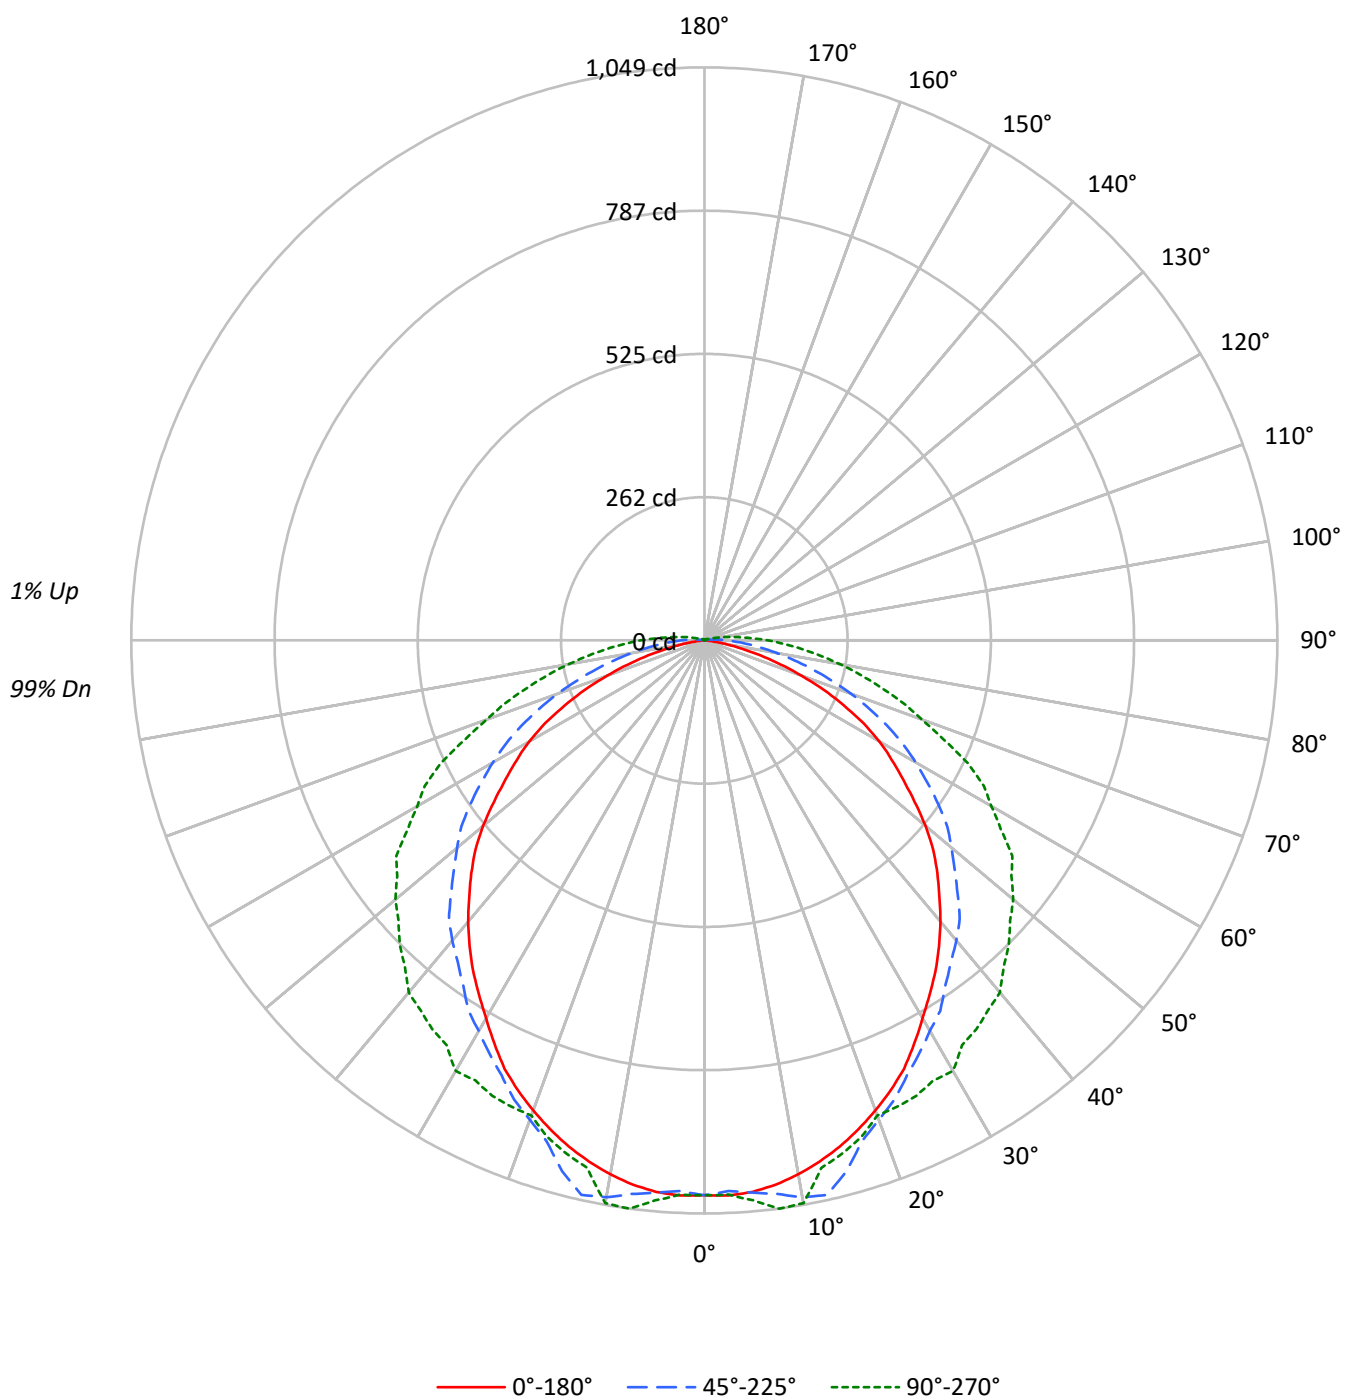

TEST NUMBER: P517464

CATALOG NUMBER: HVL12-4-LD4-1LO-50-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			99
1	108	103	98	94	105	100	96	92	96	92	89	91	89	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	78	73	80	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	51	62	56	51	60	54	50			47
5	75	61	52	45	72	60	51	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	39	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2733	2733	2733
5°	2727	2706	2740
10°	2691	2757	2776
15°	2642	2695	2595
20°	2583	2537	2499
25°	2520	2440	2533
30°	2424	2364	2580
35°	2356	2293	2555
40°	2283	2243	2593
45°	2204	2175	2570
50°	2108	2104	2578
55°	1967	2028	2608
60°	1859	1917	2533
65°	1644	1783	2495
70°	1341	1603	2288
75°	957	1379	2151
80°	536	1153	2015
85°	199	921	1896

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 2608 cd/sqm

TEST NUMBER: P517464

CATALOG NUMBER: HVL12-4-LD4-1LO-50-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	97.6	3.2
10°-20°	278.0	9.1
20°-30°	413.7	13.5
30°-40°	497.2	16.2
40°-50°	523.3	17.1
50°-60°	485.6	15.9
60°-70°	383.9	12.5
70°-80°	234.5	7.7
80°-90°	102.2	3.3
90°-100°	31.8	1.0
100°-110°	7.1	0.2
110°-120°	2.9	0.1
120°-130°	1.6	0.1
130°-140°	0.4	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	789.3	25.8
0°-40°	1286.5	42.0
0°-60°	2295.5	75.0
0°-90°	3016.1	98.6
90°-120°	41.8	1.4
90°-150°	43.9	1.4
90°-180°	44.0	1.4
0°-180°	3060.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1016	1016	1016	1016	1016	
5°	1013	1011	1015	1026	1029	96
15°	959	996	1006	972	973	270
25°	865	920	878	905	919	397
35°	738	759	770	840	868	461
45°	603	606	656	760	788	465
55°	444	452	523	638	688	399
65°	281	290	368	488	532	278
75°	106	141	206	316	336	116
85°	10	33	80	155	178	15
90°	0	10	42	98	116	0
95°	0	2	18	54	66	0
105°	0	1	4	11	15	0
115°	0	1	3	5	5	0
125°	0	0	1	3	4	0
135°	0	0	0	1	1	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517464

CATALOG NUMBER: HVL12-4-LD4-1LO-50-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1015.8	1015.8	1015.8	1015.8	1015.8
2.5°	1017.0	1014.3	1008.7	1014.1	1015.5
5°	1013.3	1011.2	1014.7	1026.1	1029.0
7.5°	1004.8	1012.6	1022.0	1042.7	1049.3
10°	992.2	1007.1	1035.0	1052.6	1045.8
12.5°	976.9	1002.1	1039.5	1005.2	989.3
15°	959.1	995.9	1005.6	972.3	972.9
17.5°	938.2	990.7	960.7	959.9	953.9
20°	915.6	973.3	933.6	932.0	925.5
22.5°	891.4	950.4	909.6	906.3	923.7
25°	865.1	920.4	878.4	904.6	919.3
27.5°	832.2	881.1	852.3	889.5	908.0
30°	798.9	840.5	825.6	877.5	910.2
32.5°	767.7	798.1	803.7	873.0	878.4
35°	738.1	758.6	769.9	839.9	868.4
37.5°	705.6	711.2	741.4	826.0	853.5
40°	672.5	669.0	717.4	803.3	841.3
42.5°	636.9	635.6	691.9	791.9	810.9
45°	603.2	605.9	655.7	759.6	787.9
47.5°	568.6	572.1	621.4	724.2	759.4
50°	528.5	533.0	590.7	692.8	738.1
52.5°	485.0	493.7	561.0	663.0	708.7
55°	444.2	451.5	523.1	637.5	688.2
57.5°	407.0	411.4	484.0	605.4	643.7
60°	370.4	371.4	447.1	569.8	606.5
62.5°	328.4	330.2	409.3	527.8	576.9
65°	281.2	290.1	368.5	487.7	532.0
67.5°	237.1	252.6	326.9	450.9	474.0
70°	189.9	216.2	286.2	407.6	424.0
72.5°	146.7	177.5	244.4	359.2	382.2
75°	106.4	140.9	205.5	315.8	335.6
77.5°	71.6	106.8	169.1	267.8	294.0
80°	42.8	78.0	136.6	223.3	252.9
82.5°	21.9	52.3	105.9	187.3	213.7
85°	9.5	33.1	80.1	155.4	178.4
87.5°	2.7	18.8	59.0	125.6	145.0
90°	0.2	9.9	42.0	98.5	116.1
92.5°	0.2	4.8	29.6	74.5	87.9
95°	0.2	2.5	18.4	54.0	66.0
97.5°	0.2	1.4	11.2	38.3	48.4
100°	0.2	1.2	6.6	25.5	34.6
102.5°	0.2	1.4	4.6	16.1	22.6
105°	0.2	1.4	3.7	10.6	14.9
107.5°	0.4	1.4	3.3	7.9	10.3
110°	0.2	1.2	3.5	6.0	8.1

TEST NUMBER: P517464

CATALOG NUMBER: HVL12-4-LD4-1LO-50-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.4	1.0	3.3	5.0	6.0
115°	0.2	0.8	2.9	4.8	5.0
117.5°	0.4	0.6	2.3	4.8	5.0
120°	0.4	0.4	1.9	4.6	5.2
122.5°	0.4	0.4	1.4	4.1	5.0
125°	0.2	0.4	1.2	3.1	4.3
127.5°	0.4	0.4	1.0	2.5	3.3
130°	0.4	0.4	0.8	1.9	2.5
132.5°	0.4	0.4	0.6	1.4	1.9
135°	0.4	0.4	0.4	1.0	1.4
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)