

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517484

Luminaire Tested: HVL12-4-LD4-2HI-30-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517484
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-2HI-30-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 3000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8935.0 lumens
Efficiency: N/A
Efficacy: 101.0 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 88.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517484

CATALOG NUMBER: HVL12-4-LD4-2HI-30-UNV-C-EDD

Luminous Intensity Polar Plot

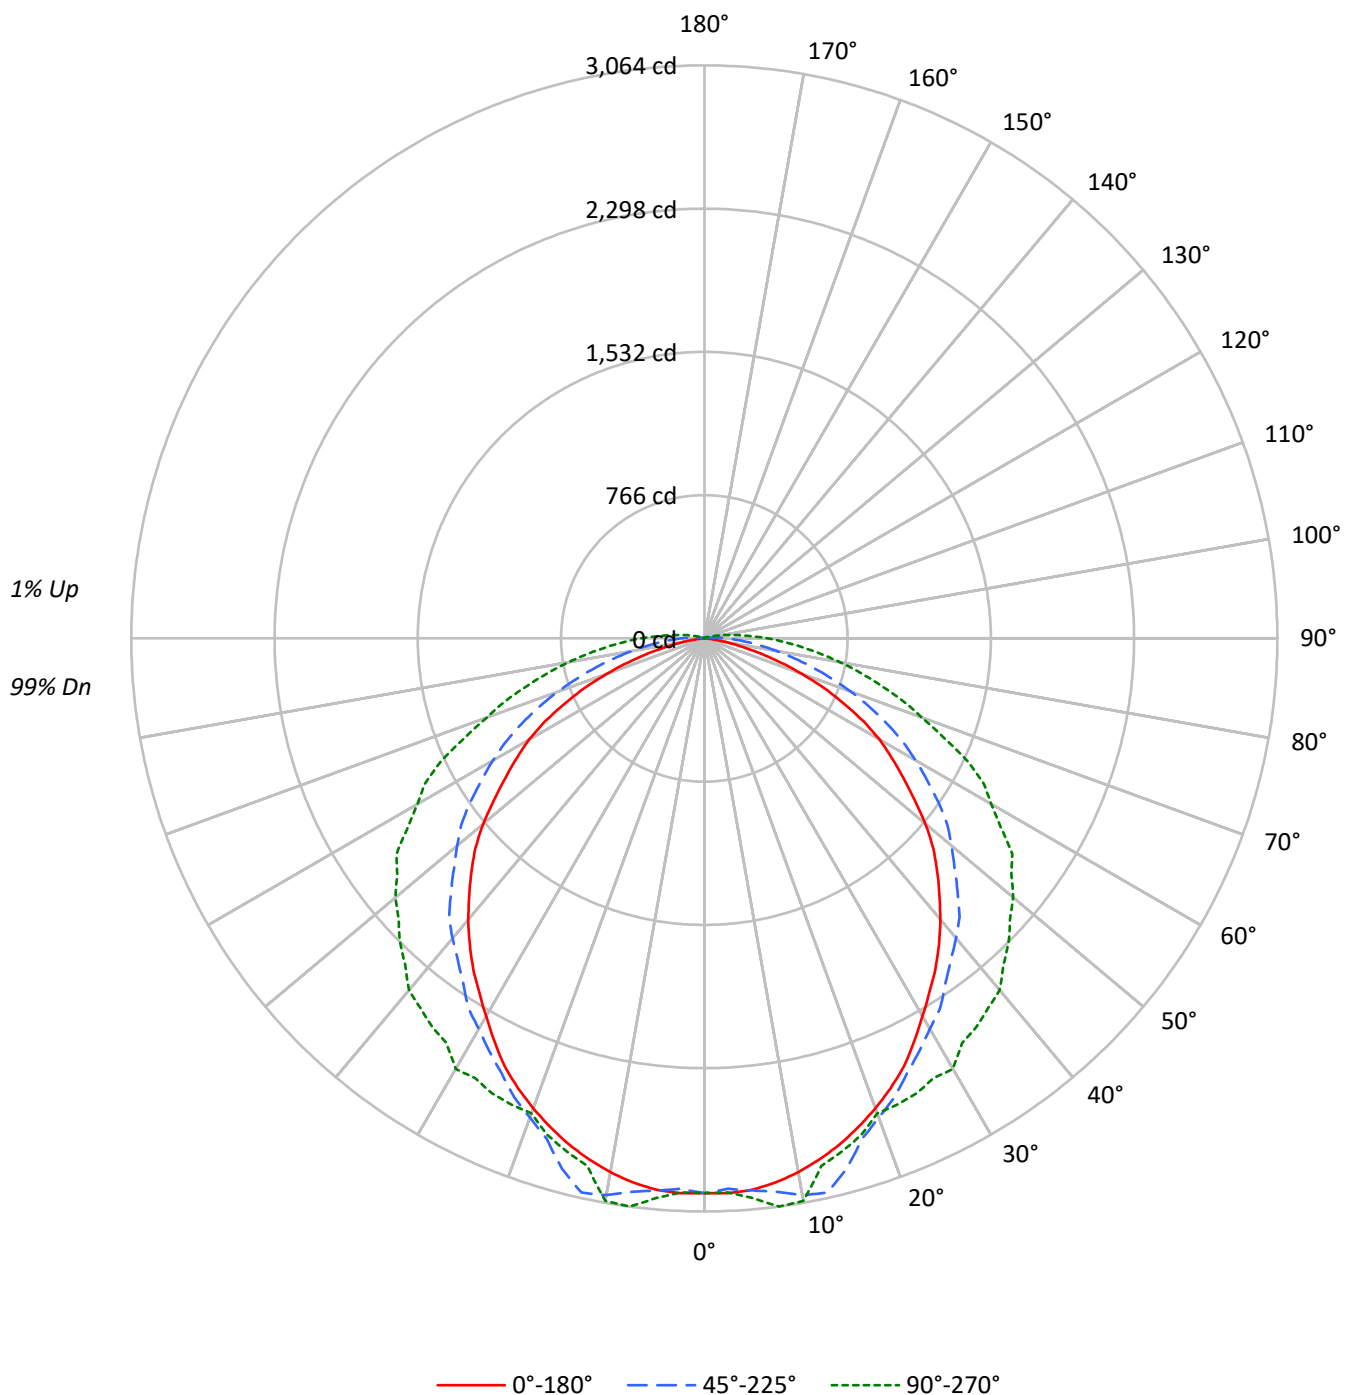

TEST NUMBER: P517484

CATALOG NUMBER: HVL12-4-LD4-2HI-30-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	110	110	110		105	105	105		101
1	108	103	98	94	105	100	96	92	96	92	89		91	89	86		87
2	98	89	82	76	95	87	80	75	83	78	73		80	75	71		76
3	89	78	69	63	86	76	68	62	73	66	61		70	64	59		67
4	81	69	60	53	79	67	59	52	65	57	51		62	56	51		60
5	75	61	52	45	72	60	51	45	58	50	44		56	49	44		54
6	69	55	46	39	67	54	46	39	52	45	39		50	44	38		49
7	64	50	41	35	62	49	41	35	47	40	34		46	39	34		44
8	59	46	37	31	58	45	37	31	43	36	31		42	35	30		41
9	55	42	34	28	54	41	33	28	40	33	28		39	32	27		38
10	52	39	31	25	51	38	30	25	37	30	25		36	29	25		35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	7981	7981	7981
5°	7963	7902	8000
10°	7859	8049	8105
15°	7715	7870	7576
20°	7542	7409	7296
25°	7357	7126	7396
30°	7078	6903	7533
35°	6879	6695	7460
40°	6665	6549	7571
45°	6434	6351	7505
50°	6154	6143	7527
55°	5744	5920	7615
60°	5429	5598	7396
65°	4799	5206	7286
70°	3915	4680	6681
75°	2795	4025	6281
80°	1568	3367	5881
85°	581	2689	5535

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 7615 cd/sqm

TEST NUMBER: P517484

CATALOG NUMBER: HVL12-4-LD4-2HI-30-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	285.1	3.2
10°-20°	811.8	9.1
20°-30°	1207.8	13.5
30°-40°	1451.8	16.2
40°-50°	1528.1	17.1
50°-60°	1417.9	15.9
60°-70°	1121.1	12.5
70°-80°	684.8	7.7
80°-90°	298.4	3.3
90°-100°	92.9	1.0
100°-110°	20.9	0.2
110°-120°	8.4	0.1
120°-130°	4.7	0.1
130°-140°	1.3	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2304.7	25.8
0°-40°	3756.5	42.0
0°-60°	6702.6	75.0
0°-90°	8806.9	98.6
90°-120°	122.1	1.4
90°-150°	128.1	1.4
90°-180°	128.0	1.4
0°-180°	8935.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2966	2966	2966	2966	2966	
5°	2959	2953	2963	2996	3005	280
15°	2800	2908	2936	2839	2841	789
25°	2526	2687	2565	2642	2684	1160
35°	2155	2215	2248	2452	2536	1347
45°	1761	1769	1915	2218	2301	1358
55°	1297	1318	1527	1862	2010	1166
65°	821	847	1076	1424	1553	813
75°	311	411	600	922	980	339
85°	28	97	234	454	521	43
90°	1	29	123	288	339	1
95°	1	7	54	158	193	0
105°	1	4	11	31	44	1
115°	1	2	8	14	14	1
125°	1	1	4	9	13	1
135°	1	1	1	3	4	1
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517484

CATALOG NUMBER: HVL12-4-LD4-2HI-30-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2965.9	2965.9	2965.9	2965.9	2965.9
2.5°	2969.6	2961.7	2945.4	2961.1	2965.3
5°	2958.7	2952.6	2962.9	2996.1	3004.6
7.5°	2933.9	2956.9	2984.1	3044.5	3063.8
10°	2897.1	2940.6	3022.1	3073.5	3053.5
12.5°	2852.3	2926.1	3035.4	2935.1	2888.6
15°	2800.4	2907.9	2936.3	2839.1	2840.9
17.5°	2739.4	2892.8	2805.2	2802.8	2785.3
20°	2673.5	2842.1	2726.1	2721.2	2702.5
22.5°	2602.8	2775.0	2656.0	2646.3	2697.1
25°	2526.1	2687.4	2564.8	2641.5	2684.4
27.5°	2430.0	2572.6	2488.6	2597.4	2651.2
30°	2332.8	2454.2	2410.7	2562.3	2657.8
32.5°	2241.5	2330.3	2346.6	2549.0	2564.8
35°	2155.1	2214.9	2248.2	2452.4	2535.8
37.5°	2060.3	2076.6	2164.8	2411.9	2492.3
40°	1963.6	1953.3	2094.7	2345.4	2456.6
42.5°	1859.7	1856.0	2020.4	2312.2	2367.8
45°	1761.2	1769.0	1914.7	2218.0	2300.7
47.5°	1660.3	1670.6	1814.4	2114.6	2217.4
50°	1543.1	1556.4	1724.9	2022.8	2155.1
52.5°	1416.2	1441.6	1637.9	1935.8	2069.3
55°	1297.2	1318.3	1527.4	1861.5	2009.5
57.5°	1188.4	1201.1	1413.2	1767.8	1879.6
60°	1081.5	1084.5	1305.6	1663.9	1770.9
62.5°	958.8	964.3	1195.1	1541.3	1684.5
65°	821.1	847.1	1076.0	1424.1	1553.4
67.5°	692.4	737.7	954.6	1316.5	1384.2
70°	554.6	631.4	835.6	1190.2	1238.0
72.5°	428.4	518.4	713.5	1048.9	1115.9
75°	310.6	411.4	600.0	922.0	980.0
77.5°	209.0	311.8	493.6	781.8	858.5
80°	125.1	227.8	398.8	651.9	738.3
82.5°	64.0	152.9	309.3	546.8	624.1
85°	27.8	96.7	233.8	453.7	520.8
87.5°	7.9	55.0	172.2	366.7	423.5
90°	0.6	29.0	122.6	287.6	338.9
92.5°	0.6	13.9	86.4	217.5	256.8
95°	0.6	7.3	53.8	157.7	192.7
97.5°	0.6	4.2	32.6	111.8	141.4
100°	0.6	3.6	19.3	74.3	100.9
102.5°	0.6	4.2	13.3	47.1	65.9
105°	0.6	4.2	10.9	30.8	43.5
107.5°	1.2	4.2	9.7	23.0	30.2
110°	0.6	3.6	10.3	17.5	23.6

TEST NUMBER: P517484

CATALOG NUMBER: HVL12-4-LD4-2HI-30-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1.2	3.0	9.7	14.5	17.5
115°	0.6	2.4	8.5	13.9	14.5
117.5°	1.2	1.8	6.6	13.9	14.5
120°	1.2	1.2	5.4	13.3	15.1
122.5°	1.2	1.2	4.2	12.1	14.5
125°	0.6	1.2	3.6	9.1	12.7
127.5°	1.2	1.2	3.0	7.3	9.7
130°	1.2	1.2	2.4	5.4	7.3
132.5°	1.2	1.2	1.8	4.2	5.4
135°	1.2	1.2	1.2	3.0	4.2
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)