

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517500

Luminaire Tested: HVL12-4-LD4-2LO-30-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517500
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-2LO-30-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 3000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5390.0 lumens
Efficiency: N/A
Efficacy: 113.7 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 47.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517500

CATALOG NUMBER: HVL12-4-LD4-2LO-30-UNV-C-EDD

Luminous Intensity Polar Plot

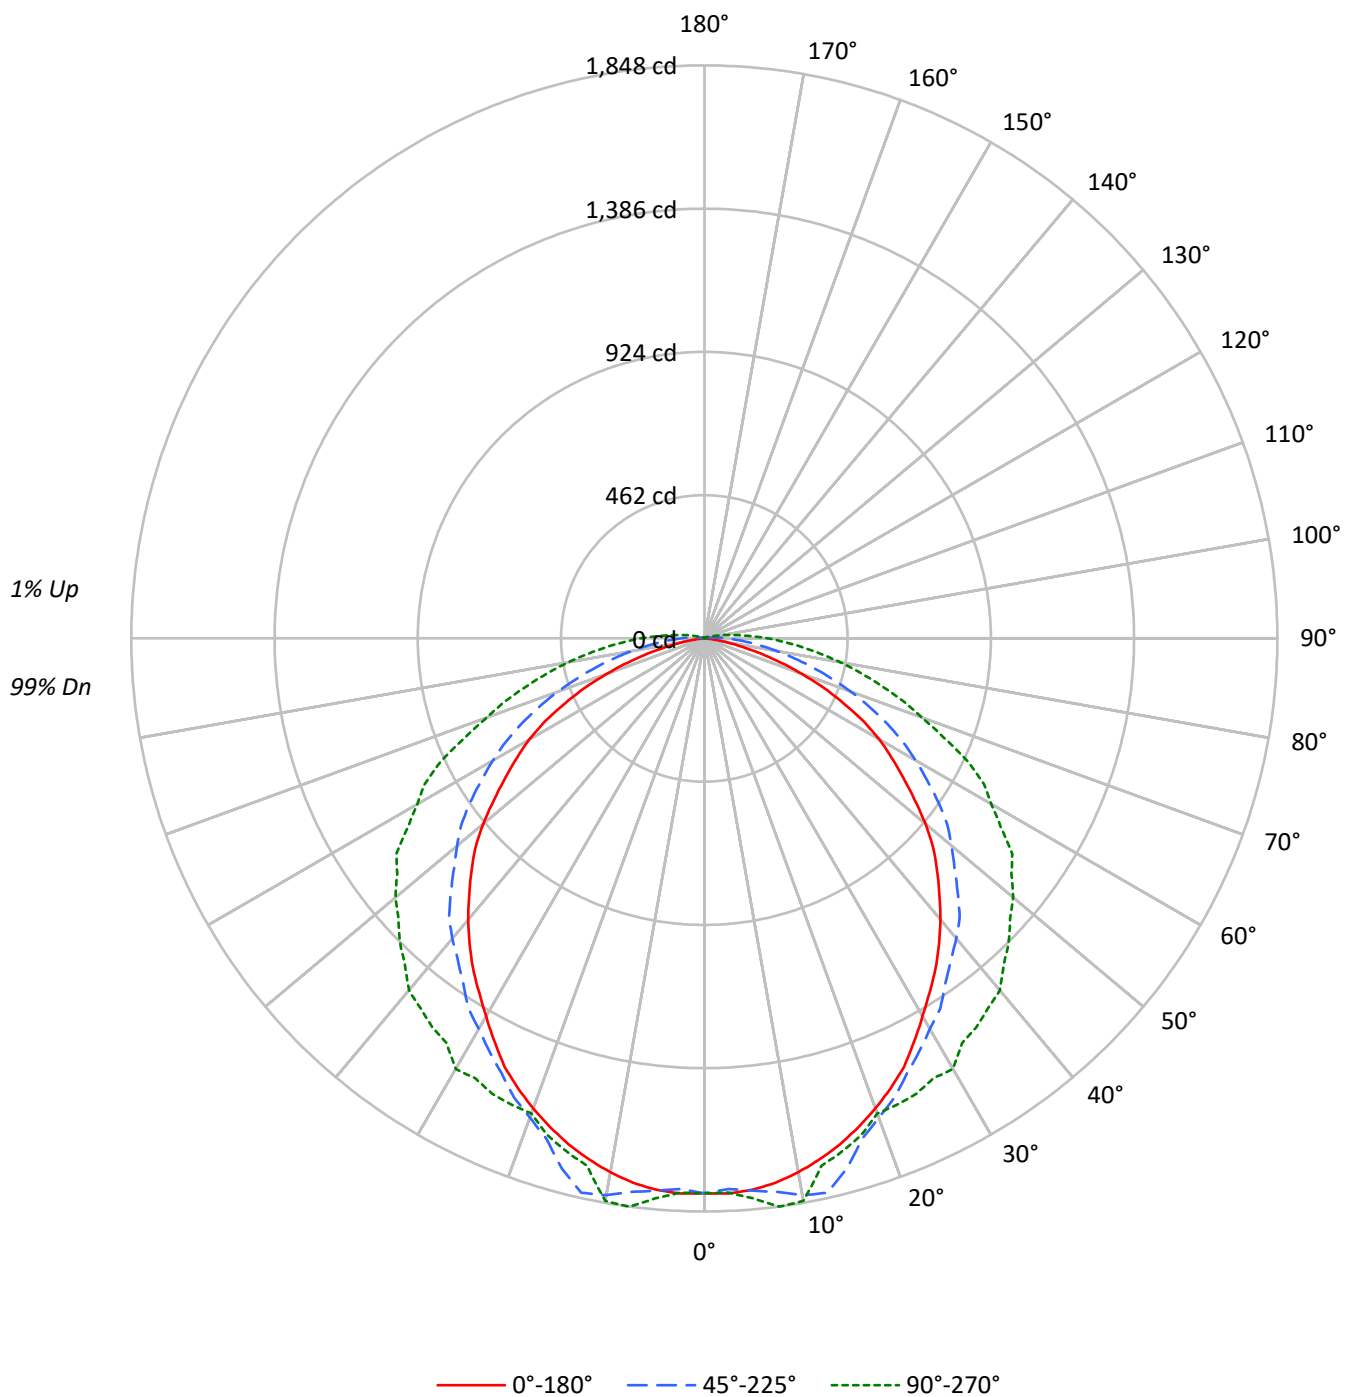

TEST NUMBER: P517500

CATALOG NUMBER: HVL12-4-LD4-2LO-30-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			99
1	108	103	98	94	105	100	96	92	96	92	89	91	89	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	78	73	80	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	51	62	56	51	60	54	50			47
5	75	61	52	45	72	60	51	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	39	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4815	4815	4815
5°	4804	4767	4826
10°	4740	4855	4890
15°	4654	4747	4570
20°	4550	4470	4402
25°	4438	4299	4461
30°	4270	4164	4545
35°	4150	4039	4500
40°	4020	3950	4567
45°	3881	3831	4527
50°	3713	3706	4541
55°	3465	3571	4594
60°	3275	3377	4461
65°	2895	3141	4396
70°	2362	2823	4030
75°	1685	2428	3789
80°	945	2031	3548
85°	351	1623	3339

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 4594 cd/sqm

TEST NUMBER: P517500

CATALOG NUMBER: HVL12-4-LD4-2LO-30-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	172.0	3.2
10°-20°	489.7	9.1
20°-30°	728.6	13.5
30°-40°	875.8	16.2
40°-50°	921.8	17.1
50°-60°	855.4	15.9
60°-70°	676.3	12.5
70°-80°	413.1	7.7
80°-90°	180.0	3.3
90°-100°	56.0	1.0
100°-110°	12.6	0.2
110°-120°	5.1	0.1
120°-130°	2.8	0.1
130°-140°	0.8	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1390.3	25.8
0°-40°	2266.1	42.0
0°-60°	4043.3	75.0
0°-90°	5312.7	98.6
90°-120°	73.7	1.4
90°-150°	77.3	1.4
90°-180°	77.0	1.4
0°-180°	5390.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1789	1789	1789	1789	1789	
5°	1785	1781	1787	1807	1812	169
15°	1689	1754	1771	1713	1714	476
25°	1524	1621	1547	1594	1619	700
35°	1300	1336	1356	1479	1530	813
45°	1062	1067	1155	1338	1388	819
55°	782	795	921	1123	1212	703
65°	495	511	649	859	937	491
75°	187	248	362	556	591	204
85°	17	58	141	274	314	26
90°	0	18	74	174	204	1
95°	0	4	32	95	116	0
105°	0	3	7	19	26	1
115°	0	2	5	8	9	1
125°	0	1	2	6	8	1
135°	1	1	1	2	3	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517500

CATALOG NUMBER: HVL12-4-LD4-2LO-30-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1789.2	1789.2	1789.2	1789.2	1789.2
2.5°	1791.4	1786.6	1776.8	1786.3	1788.8
5°	1784.8	1781.2	1787.4	1807.4	1812.5
7.5°	1769.9	1783.7	1800.1	1836.6	1848.2
10°	1747.6	1773.9	1823.1	1854.1	1842.0
12.5°	1720.7	1765.1	1831.1	1770.6	1742.5
15°	1689.3	1754.2	1771.3	1712.6	1713.7
17.5°	1652.5	1745.1	1692.2	1690.8	1680.2
20°	1612.8	1714.5	1644.5	1641.6	1630.3
22.5°	1570.1	1674.0	1602.2	1596.4	1627.0
25°	1523.9	1621.2	1547.2	1593.5	1619.3
27.5°	1465.9	1551.9	1501.3	1566.9	1599.3
30°	1407.2	1480.5	1454.2	1545.7	1603.3
32.5°	1352.2	1405.8	1415.6	1537.7	1547.2
35°	1300.1	1336.1	1356.2	1479.4	1529.7
37.5°	1242.8	1252.7	1305.9	1455.0	1503.4
40°	1184.5	1178.3	1263.6	1414.9	1481.9
42.5°	1121.8	1119.7	1218.8	1394.8	1428.4
45°	1062.4	1067.2	1155.0	1338.0	1387.9
47.5°	1001.6	1007.8	1094.5	1275.6	1337.6
50°	930.9	938.9	1040.6	1220.2	1300.1
52.5°	854.3	869.6	988.1	1167.8	1248.3
55°	782.5	795.3	921.4	1122.9	1212.2
57.5°	716.9	724.6	852.5	1066.4	1133.9
60°	652.4	654.2	787.6	1003.8	1068.3
62.5°	578.4	581.7	720.9	929.8	1016.1
65°	495.3	511.0	649.1	859.1	937.1
67.5°	417.7	445.0	575.9	794.2	835.0
70°	334.6	380.9	504.1	718.0	746.8
72.5°	258.4	312.7	430.4	632.7	673.2
75°	187.3	248.2	361.9	556.2	591.2
77.5°	126.1	188.1	297.8	471.6	517.9
80°	75.4	137.4	240.6	393.3	445.4
82.5°	38.6	92.2	186.6	329.8	376.5
85°	16.8	58.3	141.1	273.7	314.2
87.5°	4.7	33.2	103.9	221.2	255.5
90°	0.4	17.5	74.0	173.5	204.5
92.5°	0.4	8.4	52.1	131.2	154.9
95°	0.4	4.4	32.4	95.1	116.3
97.5°	0.4	2.6	19.7	67.4	85.3
100°	0.4	2.2	11.7	44.8	60.9
102.5°	0.4	2.6	8.0	28.4	39.7
105°	0.4	2.6	6.6	18.6	26.2
107.5°	0.7	2.6	5.8	13.8	18.2
110°	0.4	2.2	6.2	10.6	14.2

TEST NUMBER: P517500

CATALOG NUMBER: HVL12-4-LD4-2LO-30-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.7	1.8	5.8	8.7	10.6
115°	0.4	1.5	5.1	8.4	8.7
117.5°	0.7	1.1	4.0	8.4	8.7
120°	0.7	0.7	3.3	8.0	9.1
122.5°	0.7	0.7	2.6	7.3	8.7
125°	0.4	0.7	2.2	5.5	7.7
127.5°	0.7	0.7	1.8	4.4	5.8
130°	0.7	0.7	1.5	3.3	4.4
132.5°	0.7	0.7	1.1	2.6	3.3
135°	0.7	0.7	0.7	1.8	2.6
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)