

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517511

Luminaire Tested: HVL12-4-LD4-2LO-50-UNV-C-EDD-90

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517511
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-2LO-50-UNV-C-EDD-90
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 5000K, 90 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5811.0 lumens
Efficiency: N/A
Efficacy: 122.6 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 47.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517511

CATALOG NUMBER: HVL12-4-LD4-2LO-50-UNV-C-EDD-90

Luminous Intensity Polar Plot

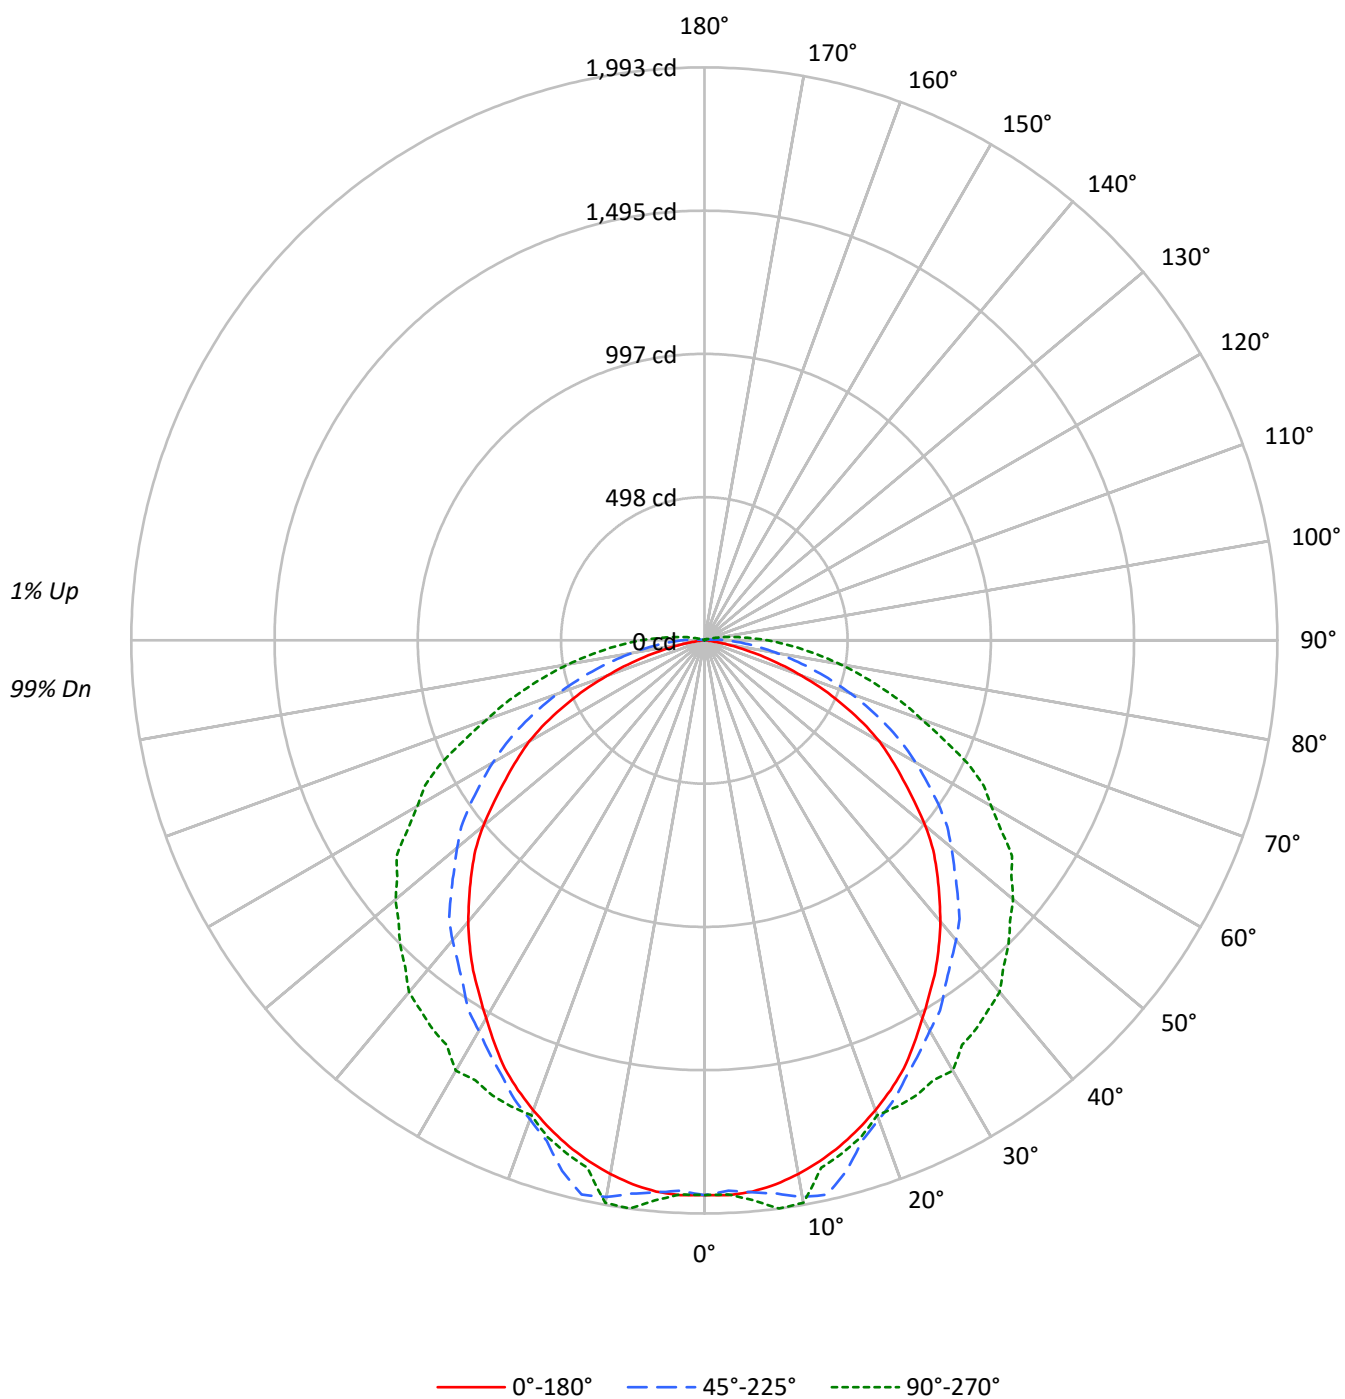

TEST NUMBER: P517511

CATALOG NUMBER: HVL12-4-LD4-2LO-50-UNV-C-EDD-90

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

[illegible]

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5191	5191	5191
5°	5179	5139	5203
10°	5111	5235	5272
15°	5018	5118	4927
20°	4905	4819	4745
25°	4785	4634	4810
30°	4603	4490	4899
35°	4474	4354	4851
40°	4335	4259	4924
45°	4185	4130	4881
50°	4003	3995	4895
55°	3735	3850	4952
60°	3531	3641	4810
65°	3121	3386	4738
70°	2546	3043	4345
75°	1818	2618	4085
80°	1019	2189	3825
85°	379	1750	3599

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 4952 cd/sqm

TEST NUMBER: P517511

CATALOG NUMBER: HVL12-4-LD4-2LO-50-UNV-C-EDD-90

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	185.4	3.2
10°-20°	528.0	9.1
20°-30°	785.5	13.5
30°-40°	944.2	16.2
40°-50°	993.8	17.1
50°-60°	922.2	15.9
60°-70°	729.1	12.5
70°-80°	445.4	7.7
80°-90°	194.1	3.3
90°-100°	60.4	1.0
100°-110°	13.6	0.2
110°-120°	5.5	0.1
120°-130°	3.1	0.1
130°-140°	0.8	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1498.9	25.8
0°-40°	2443.1	42.0
0°-60°	4359.1	75.0
0°-90°	5727.7	98.6
90°-120°	79.4	1.4
90°-150°	83.4	1.4
90°-180°	83.0	1.4
0°-180°	5811.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1929	1929	1929	1929	1929	
5°	1924	1920	1927	1949	1954	182
15°	1821	1891	1910	1846	1848	513
25°	1643	1748	1668	1718	1746	754
35°	1402	1440	1462	1595	1649	876
45°	1145	1150	1245	1442	1496	883
55°	844	857	993	1211	1307	758
65°	534	551	700	926	1010	529
75°	202	268	390	600	637	220
85°	18	63	152	295	339	28
90°	0	19	80	187	220	1
95°	0	5	35	103	125	0
105°	0	3	7	20	28	1
115°	0	2	6	9	9	1
125°	0	1	2	6	8	1
135°	1	1	1	2	3	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517511

CATALOG NUMBER: HVL12-4-LD4-2LO-50-UNV-C-EDD-90

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1928.9	1928.9	1928.9	1928.9	1928.9
2.5°	1931.3	1926.2	1915.6	1925.8	1928.5
5°	1924.2	1920.3	1927.0	1948.6	1954.1
7.5°	1908.1	1923.0	1940.7	1980.0	1992.6
10°	1884.1	1912.4	1965.5	1998.9	1985.9
12.5°	1855.1	1903.0	1974.1	1908.9	1878.6
15°	1821.3	1891.2	1909.7	1846.4	1847.6
17.5°	1781.6	1881.4	1824.4	1822.8	1811.4
20°	1738.8	1848.4	1772.9	1769.8	1757.6
22.5°	1692.8	1804.8	1727.4	1721.1	1754.1
25°	1642.9	1747.8	1668.0	1717.9	1745.8
27.5°	1580.4	1673.1	1618.5	1689.2	1724.2
30°	1517.1	1596.1	1567.8	1666.5	1728.5
32.5°	1457.8	1515.6	1526.2	1657.8	1668.0
35°	1401.6	1440.5	1462.1	1594.9	1649.2
37.5°	1339.9	1350.5	1407.9	1568.6	1620.9
40°	1277.1	1270.4	1362.3	1525.4	1597.7
42.5°	1209.5	1207.1	1314.0	1503.8	1539.9
45°	1145.4	1150.5	1245.2	1442.5	1496.3
47.5°	1079.8	1086.5	1180.0	1375.3	1442.1
50°	1003.6	1012.2	1121.8	1315.6	1401.6
52.5°	921.0	937.6	1065.3	1259.0	1345.8
55°	843.6	857.4	993.3	1210.6	1306.9
57.5°	772.9	781.2	919.1	1149.7	1222.4
60°	703.4	705.3	849.1	1082.2	1151.7
62.5°	623.6	627.1	777.2	1002.4	1095.5
65°	534.0	550.9	699.8	926.2	1010.2
67.5°	450.3	479.8	620.8	856.2	900.2
70°	360.7	410.6	543.4	774.1	805.1
72.5°	278.6	337.1	464.1	682.1	725.8
75°	202.0	267.6	390.2	599.6	637.3
77.5°	136.0	202.8	321.0	508.5	558.4
80°	81.3	148.1	259.3	424.0	480.2
82.5°	41.7	99.4	201.2	355.6	405.9
85°	18.1	62.9	152.1	295.1	338.7
87.5°	5.1	35.8	112.0	238.5	275.5
90°	0.4	18.9	79.8	187.0	220.4
92.5°	0.4	9.0	56.2	141.5	167.0
95°	0.4	4.7	35.0	102.6	125.3
97.5°	0.4	2.8	21.2	72.7	91.9
100°	0.4	2.4	12.6	48.3	65.6
102.5°	0.4	2.8	8.6	30.6	42.8
105°	0.4	2.8	7.1	20.0	28.3
107.5°	0.8	2.8	6.3	14.9	19.6
110°	0.4	2.4	6.7	11.4	15.3

TEST NUMBER: P517511

CATALOG NUMBER: HVL12-4-LD4-2LO-50-UNV-C-EDD-90

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.8	2.0	6.3	9.4	11.4
115°	0.4	1.6	5.5	9.0	9.4
117.5°	0.8	1.2	4.3	9.0	9.4
120°	0.8	0.8	3.5	8.6	9.8
122.5°	0.8	0.8	2.8	7.9	9.4
125°	0.4	0.8	2.4	5.9	8.3
127.5°	0.8	0.8	2.0	4.7	6.3
130°	0.8	0.8	1.6	3.5	4.7
132.5°	0.8	0.8	1.2	2.8	3.5
135°	0.8	0.8	0.8	2.0	2.8
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)