

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517532

Luminaire Tested: HVL12-4-LD4-3HI-30-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517532
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-3HI-30-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 3000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 14090.0 lumens
Efficiency: N/A
Efficacy: 109.0 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 129.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517532

CATALOG NUMBER: HVL12-4-LD4-3HI-30-UNV-C-EDD

Luminous Intensity Polar Plot

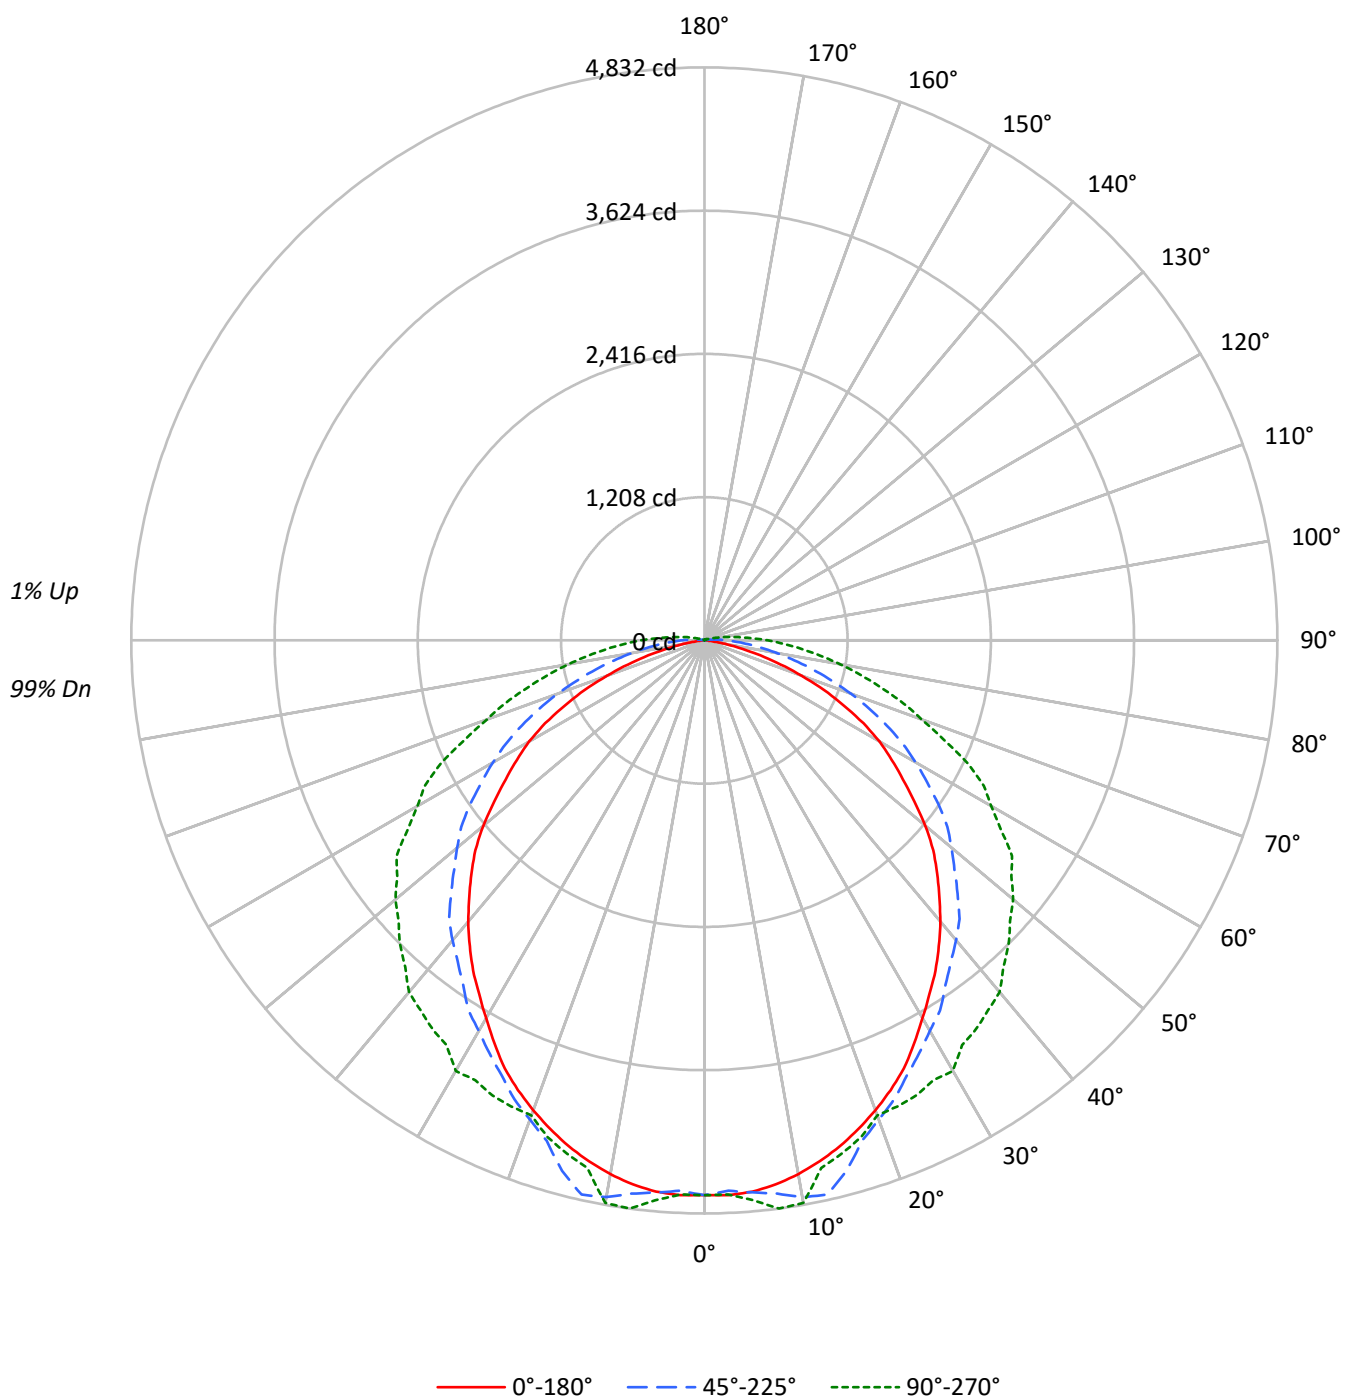

TEST NUMBER: P517532

CATALOG NUMBER: HVL12-4-LD4-3HI-30-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			99
1	108	103	98	94	105	100	96	92	96	92	89	91	89	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	78	73	80	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	51	62	56	51	60	54	50			47
5	75	61	52	45	72	60	51	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	39	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	12586	12586	12586
5°	12557	12460	12615
10°	12392	12692	12782
15°	12167	12410	11947
20°	11893	11684	11506
25°	11602	11237	11662
30°	11162	10886	11880
35°	10848	10557	11763
40°	10510	10327	11938
45°	10146	10015	11834
50°	9705	9687	11869
55°	9058	9336	12008
60°	8560	8828	11662
65°	7568	8210	11490
70°	6174	7380	10535
75°	4406	6347	9905
80°	2472	5308	9275
85°	916	4241	8728

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 12008 cd/sqm

TEST NUMBER: P517532

CATALOG NUMBER: HVL12-4-LD4-3HI-30-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	449.5	3.2
10°-20°	1280.1	9.1
20°-30°	1904.7	13.5
30°-40°	2289.4	16.2
40°-50°	2409.8	17.1
50°-60°	2236.0	15.9
60°-70°	1768.0	12.5
70°-80°	1079.9	7.7
80°-90°	470.5	3.3
90°-100°	146.5	1.0
100°-110°	32.9	0.2
110°-120°	13.2	0.1
120°-130°	7.4	0.1
130°-140°	2.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3634.3	25.8
0°-40°	5923.8	42.0
0°-60°	10569.5	75.0
0°-90°	13887.9	98.6
90°-120°	192.6	1.4
90°-150°	202.1	1.4
90°-180°	202.0	1.4
0°-180°	14090.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4677	4677	4677	4677	4677	
5°	4666	4656	4672	4725	4738	442
15°	4416	4586	4630	4477	4480	1244
25°	3984	4238	4044	4166	4233	1829
35°	3398	3493	3545	3867	3999	2124
45°	2777	2790	3019	3498	3628	2141
55°	2046	2079	2409	2936	3169	1838
65°	1295	1336	1697	2246	2450	1282
75°	490	649	946	1454	1545	534
85°	44	152	369	716	821	68
90°	1	46	193	454	534	2
95°	1	11	85	249	304	1
105°	1	7	17	49	69	1
115°	1	4	13	22	23	2
125°	1	2	6	14	20	2
135°	2	2	2	5	7	1
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517532

CATALOG NUMBER: HVL12-4-LD4-3HI-30-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4677.1	4677.1	4677.1	4677.1	4677.1
2.5°	4682.8	4670.4	4644.7	4669.5	4676.2
5°	4665.7	4656.2	4672.3	4724.8	4738.1
7.5°	4626.6	4662.8	4705.7	4801.0	4831.5
10°	4568.5	4637.1	4765.7	4846.7	4815.3
12.5°	4498.0	4614.2	4786.7	4628.5	4555.2
15°	4416.1	4585.6	4630.4	4477.0	4479.9
17.5°	4319.8	4561.8	4423.7	4419.9	4392.2
20°	4216.0	4481.8	4298.9	4291.2	4261.7
22.5°	4104.5	4376.0	4188.3	4173.1	4253.1
25°	3983.5	4237.9	4044.5	4165.5	4233.1
27.5°	3832.0	4056.9	3924.4	4095.9	4180.7
30°	3678.6	3870.1	3801.5	4040.7	4191.2
32.5°	3534.8	3674.8	3700.5	4019.7	4044.5
35°	3398.5	3492.8	3545.2	3867.3	3998.7
37.5°	3248.9	3274.6	3413.7	3803.4	3930.1
40°	3096.5	3080.3	3303.2	3698.6	3873.9
42.5°	2932.6	2926.9	3186.0	3646.2	3733.9
45°	2777.3	2789.7	3019.3	3497.6	3628.1
47.5°	2618.2	2634.4	2861.1	3334.7	3496.6
50°	2433.4	2454.3	2720.1	3189.9	3398.5
52.5°	2233.3	2273.3	2582.9	3052.7	3263.2
55°	2045.6	2078.9	2408.6	2935.5	3168.9
57.5°	1874.1	1894.1	2228.5	2787.8	2964.0
60°	1705.4	1710.2	2058.9	2623.9	2792.5
62.5°	1512.0	1520.6	1884.6	2430.5	2656.3
65°	1294.8	1335.8	1696.9	2245.7	2449.6
67.5°	1091.9	1163.3	1505.4	2076.1	2182.8
70°	874.6	995.6	1317.7	1876.9	1952.2
72.5°	675.5	817.5	1125.2	1654.0	1759.8
75°	489.7	648.8	946.1	1453.9	1545.4
77.5°	329.7	491.6	778.4	1232.9	1353.9
80°	197.2	359.2	628.8	1028.0	1164.3
82.5°	101.0	241.0	487.8	862.3	984.2
85°	43.8	152.4	368.7	715.5	821.3
87.5°	12.4	86.7	271.5	578.3	667.9
90°	1.0	45.7	193.4	453.5	534.5
92.5°	1.0	21.9	136.2	343.0	404.9
95°	1.0	11.4	84.8	248.7	303.9
97.5°	1.0	6.7	51.4	176.3	222.9
100°	1.0	5.7	30.5	117.2	159.1
102.5°	1.0	6.7	21.0	74.3	103.9
105°	1.0	6.7	17.1	48.6	68.6
107.5°	1.9	6.7	15.2	36.2	47.6
110°	1.0	5.7	16.2	27.6	37.2

TEST NUMBER: P517532

CATALOG NUMBER: HVL12-4-LD4-3HI-30-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1.9	4.8	15.2	22.9	27.6
115°	1.0	3.8	13.3	21.9	22.9
117.5°	1.9	2.9	10.5	21.9	22.9
120°	1.9	1.9	8.6	21.0	23.8
122.5°	1.9	1.9	6.7	19.1	22.9
125°	1.0	1.9	5.7	14.3	20.0
127.5°	1.9	1.9	4.8	11.4	15.2
130°	1.9	1.9	3.8	8.6	11.4
132.5°	1.9	1.9	2.9	6.7	8.6
135°	1.9	1.9	1.9	4.8	6.7
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)