

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517535

Luminaire Tested: HVL12-4-LD4-3HI-35-UNV-C-EDD-90

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517535
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-3HI-35-UNV-C-EDD-90
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 3500K, 90 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 14789.0 lumens
Efficiency: N/A
Efficacy: 114.4 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 129.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517535

CATALOG NUMBER: HVL12-4-LD4-3HI-35-UNV-C-EDD-90

Luminous Intensity Polar Plot

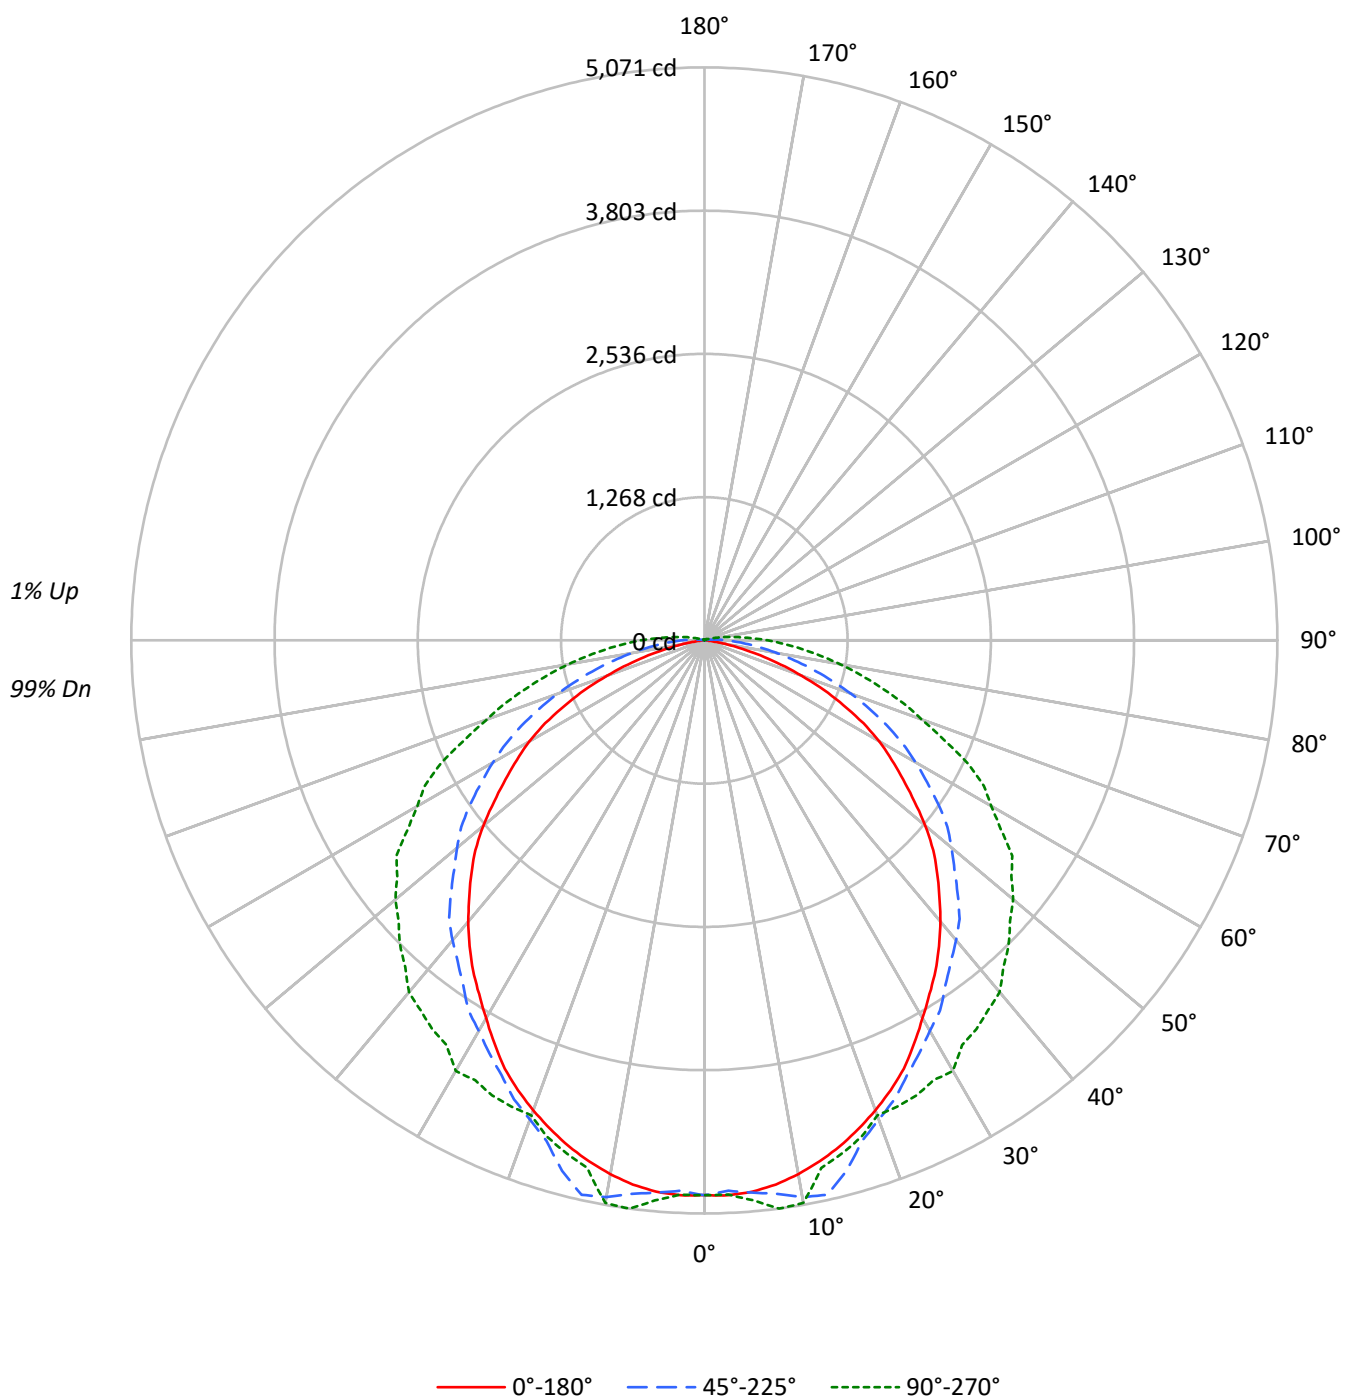

CATALOG NUMBER: HVL12-4-LD4-3HI-35-UNV-C-EDD-90

RF	20					20					20					20					20	
RC	80					70					50					30					0	
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		0			
RCR																						
0	119	119	119	119		116	116	116	116		110	110	110		105	105	105		101	101	101	99
1	108	103	98	94		105	100	96	92		96	92	89		91	89	86		87	85	83	81
2	98	89	82	76		95	87	80	75		83	78	73		80	75	71		76	72	69	67
3	89	78	69	63		86	76	68	62		73	66	61		70	64	59		67	62	58	56
4	81	69	60	53		79	67	59	52		65	57	51		62	56	51		60	54	50	47
5	75	61	52	45		72	60	51	45		58	50	44		56	49	44		54	48	43	41
6	69	55	46	39		67	54	46	39		52	45	39		50	44	38		49	43	38	36
7	64	50	41	35		62	49	41	35		47	40	34		46	39	34		44	38	34	32
8	59	46	37	31		58	45	37	31		43	36	31		42	35	30		41	35	30	28
9	55	42	34	28		54	41	33	28		40	33	28		39	32	27		38	32	27	25
10	52	39	31	25		51	38	30	25		37	30	25		36	29	25		35	29	25	23

	0°	45°	90°
0°	13210	13210	13210
5°	13180	13079	13241
10°	13007	13322	13416
15°	12770	13026	12540
20°	12483	12264	12077
25°	12178	11794	12241
30°	11716	11426	12469
35°	11386	11081	12347
40°	11031	10839	12531
45°	10650	10512	12422
50°	10187	10167	12458
55°	9507	9799	12604
60°	8986	9266	12241
65°	7943	8618	12060
70°	6481	7746	11058
75°	4625	6661	10396
80°	2595	5572	9734
85°	962	4452	9160

Luminance: 12604 cd/sqm

TEST NUMBER: P517535

CATALOG NUMBER: HVL12-4-LD4-3HI-35-UNV-C-EDD-90

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	471.8	3.2
10°-20°	1343.6	9.1
20°-30°	1999.2	13.5
30°-40°	2403.0	16.2
40°-50°	2529.3	17.1
50°-60°	2347.0	15.9
60°-70°	1855.7	12.5
70°-80°	1133.5	7.7
80°-90°	493.8	3.3
90°-100°	153.7	1.0
100°-110°	34.5	0.2
110°-120°	13.9	0.1
120°-130°	7.8	0.1
130°-140°	2.1	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3814.6	25.8
0°-40°	6217.6	42.0
0°-60°	11093.9	75.0
0°-90°	14576.9	98.6
90°-120°	202.2	1.4
90°-150°	212.1	1.4
90°-180°	212.0	1.4
0°-180°	14789.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4909	4909	4909	4909	4909	
5°	4897	4887	4904	4959	4973	464
15°	4635	4813	4860	4699	4702	1306
25°	4181	4448	4245	4372	4443	1920
35°	3567	3666	3721	4059	4197	2229
45°	2915	2928	3169	3671	3808	2247
55°	2147	2182	2528	3081	3326	1929
65°	1359	1402	1781	2357	2571	1346
75°	514	681	993	1526	1622	561
85°	46	160	387	751	862	71
90°	1	48	203	476	561	2
95°	1	12	89	261	319	1
105°	1	7	18	51	72	1
115°	1	4	14	23	24	2
125°	1	2	6	15	21	2
135°	2	2	2	5	7	1
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517535

CATALOG NUMBER: HVL12-4-LD4-3HI-35-UNV-C-EDD-90

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4909.1	4909.1	4909.1	4909.1	4909.1
2.5°	4915.1	4902.1	4875.1	4901.1	4908.1
5°	4897.1	4887.1	4904.1	4959.1	4973.1
7.5°	4856.1	4894.1	4939.1	5039.1	5071.1
10°	4795.1	4867.1	5002.1	5087.1	5054.1
12.5°	4721.1	4843.1	5024.1	4858.1	4781.1
15°	4635.1	4813.1	4860.1	4699.1	4702.1
17.5°	4534.1	4788.1	4643.1	4639.1	4610.1
20°	4425.1	4704.1	4512.1	4504.1	4473.1
22.5°	4308.1	4593.1	4396.1	4380.1	4464.1
25°	4181.1	4448.1	4245.1	4372.1	4443.1
27.5°	4022.1	4258.1	4119.1	4299.1	4388.1
30°	3861.1	4062.1	3990.1	4241.1	4399.1
32.5°	3710.1	3857.1	3884.1	4219.1	4245.1
35°	3567.1	3666.1	3721.1	4059.1	4197.1
37.5°	3410.1	3437.1	3583.1	3992.1	4125.1
40°	3250.1	3233.1	3467.1	3882.1	4066.1
42.5°	3078.1	3072.1	3344.1	3827.1	3919.1
45°	2915.1	2928.1	3169.1	3671.1	3808.1
47.5°	2748.1	2765.1	3003.1	3500.1	3670.1
50°	2554.1	2576.1	2855.1	3348.1	3567.1
52.5°	2344.1	2386.1	2711.1	3204.1	3425.1
55°	2147.1	2182.1	2528.1	3081.1	3326.1
57.5°	1967.1	1988.1	2339.1	2926.1	3111.1
60°	1790.1	1795.1	2161.1	2754.1	2931.1
62.5°	1587.0	1596.0	1978.1	2551.1	2788.1
65°	1359.0	1402.0	1781.1	2357.1	2571.1
67.5°	1146.0	1221.0	1580.0	2179.1	2291.1
70°	918.0	1045.0	1383.0	1970.1	2049.1
72.5°	709.0	858.0	1181.0	1736.1	1847.1
75°	514.0	681.0	993.0	1526.0	1622.0
77.5°	346.0	516.0	817.0	1294.0	1421.0
80°	207.0	377.0	660.0	1079.0	1222.0
82.5°	106.0	253.0	512.0	905.0	1033.0
85°	46.0	160.0	387.0	751.0	862.0
87.5°	13.0	91.0	285.0	607.0	701.0
90°	1.0	48.0	203.0	476.0	561.0
92.5°	1.0	23.0	143.0	360.0	425.0
95°	1.0	12.0	89.0	261.0	319.0
97.5°	1.0	7.0	54.0	185.0	234.0
100°	1.0	6.0	32.0	123.0	167.0
102.5°	1.0	7.0	22.0	78.0	109.0
105°	1.0	7.0	18.0	51.0	72.0
107.5°	2.0	7.0	16.0	38.0	50.0
110°	1.0	6.0	17.0	29.0	39.0

TEST NUMBER: P517535

CATALOG NUMBER: HVL12-4-LD4-3HI-35-UNV-C-EDD-90

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	2.0	5.0	16.0	24.0	29.0
115°	1.0	4.0	14.0	23.0	24.0
117.5°	2.0	3.0	11.0	23.0	24.0
120°	2.0	2.0	9.0	22.0	25.0
122.5°	2.0	2.0	7.0	20.0	24.0
125°	1.0	2.0	6.0	15.0	21.0
127.5°	2.0	2.0	5.0	12.0	16.0
130°	2.0	2.0	4.0	9.0	12.0
132.5°	2.0	2.0	3.0	7.0	9.0
135°	2.0	2.0	2.0	5.0	7.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)