

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517540

Luminaire Tested: HVL12-4-LD4-3HI-40-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517540
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-3HI-40-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 4000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 14937.0 lumens
Efficiency: N/A
Efficacy: 115.5 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 129.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517540

CATALOG NUMBER: HVL12-4-LD4-3HI-40-UNV-C-EDD

Luminous Intensity Polar Plot

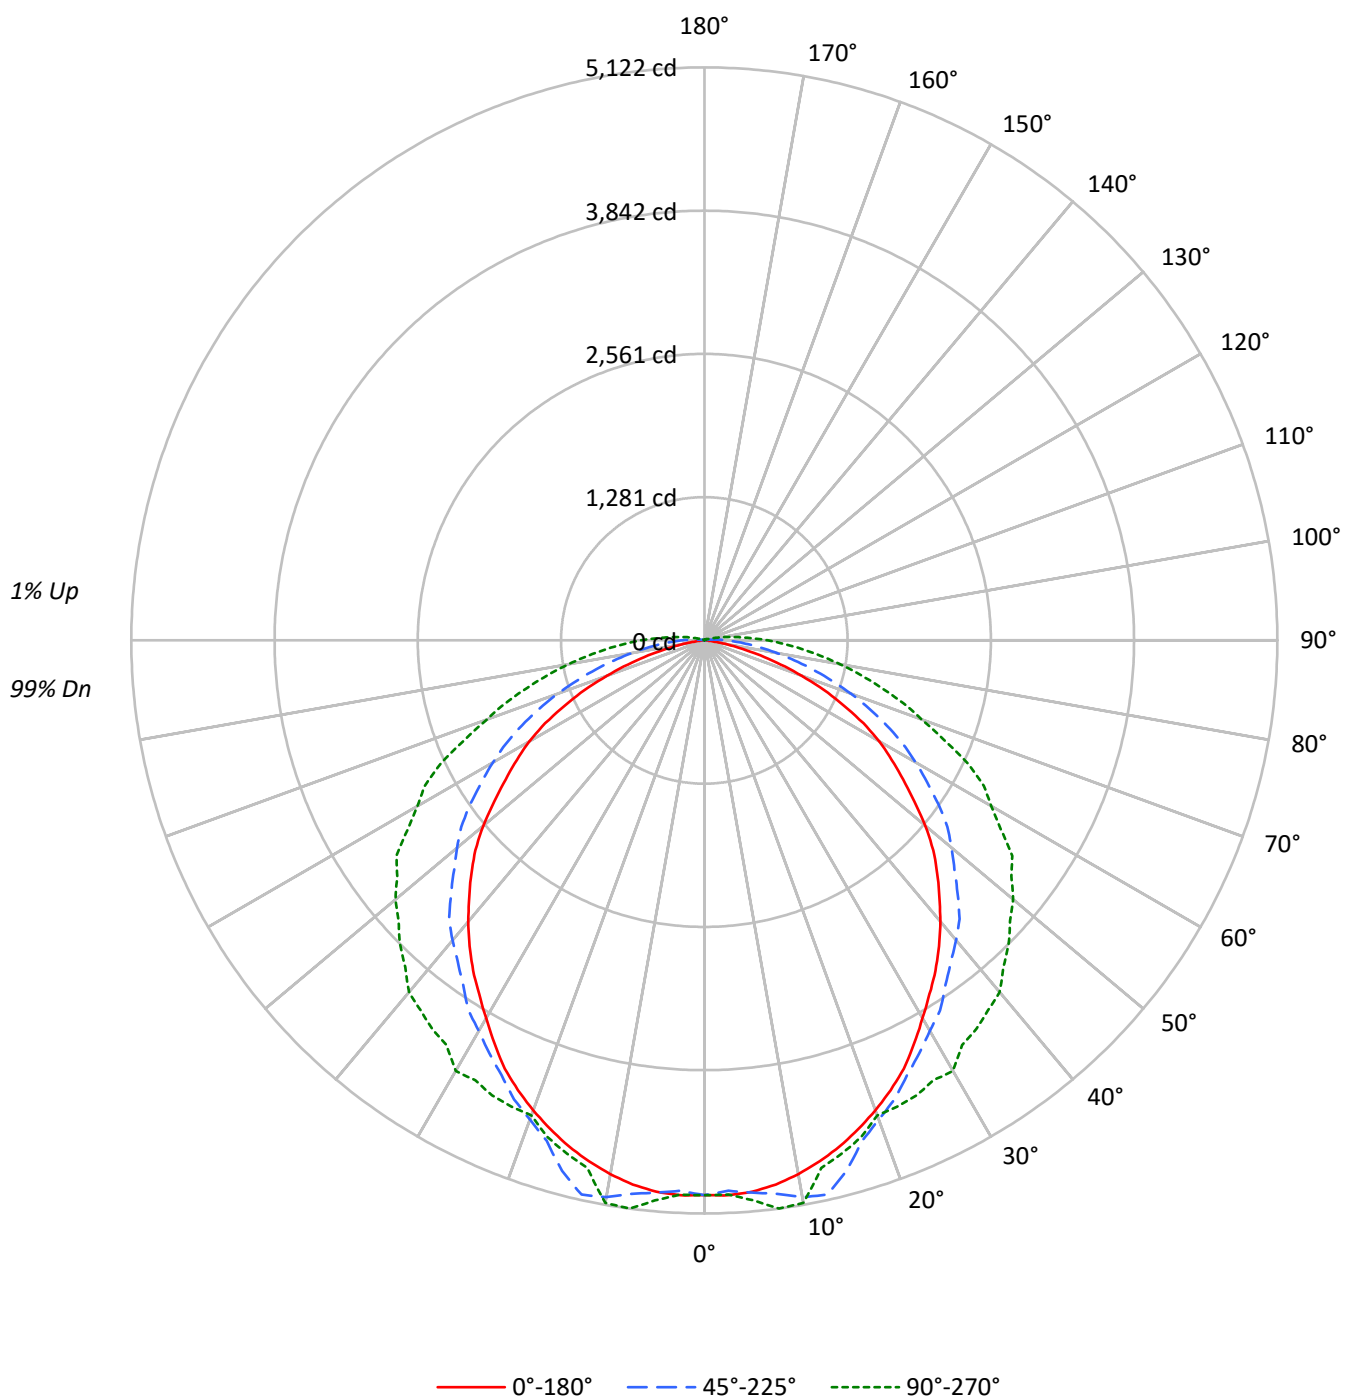

TEST NUMBER: P517540

CATALOG NUMBER: HVL12-4-LD4-3HI-40-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			99
1	108	103	98	94	105	100	96	92	96	92	89	91	89	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	78	73	80	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	51	62	56	51	60	54	50			47
5	75	61	52	45	72	60	51	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	39	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	13343	13343	13343
5°	13312	13210	13373
10°	13137	13456	13550
15°	12898	13156	12665
20°	12608	12386	12198
25°	12300	11912	12363
30°	11833	11541	12594
35°	11500	11192	12470
40°	11142	10948	12656
45°	10757	10617	12546
50°	10288	10269	12583
55°	9602	9897	12730
60°	9075	9359	12363
65°	8023	8704	12180
70°	6546	7824	11168
75°	4672	6728	10501
80°	2621	5628	9832
85°	972	4496	9253

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 12730 cd/sqm

TEST NUMBER: P517540

CATALOG NUMBER: HVL12-4-LD4-3HI-40-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	476.5	3.2
10°-20°	1357.1	9.1
20°-30°	2019.2	13.5
30°-40°	2427.1	16.2
40°-50°	2554.6	17.1
50°-60°	2370.4	15.9
60°-70°	1874.2	12.5
70°-80°	1144.8	7.7
80°-90°	498.8	3.3
90°-100°	155.3	1.0
100°-110°	34.9	0.2
110°-120°	14.0	0.1
120°-130°	7.9	0.1
130°-140°	2.1	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3852.8	25.8
0°-40°	6279.9	42.0
0°-60°	11204.9	75.0
0°-90°	14722.8	98.6
90°-120°	204.2	1.4
90°-150°	214.2	1.4
90°-180°	214.0	1.4
0°-180°	14937.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4958	4958	4958	4958	4958	
5°	4946	4936	4953	5009	5023	469
15°	4682	4861	4909	4746	4749	1319
25°	4223	4493	4288	4416	4488	1939
35°	3603	3703	3758	4100	4239	2252
45°	2944	2957	3201	3708	3846	2270
55°	2168	2204	2553	3112	3359	1948
65°	1373	1416	1799	2381	2597	1359
75°	519	688	1003	1541	1638	567
85°	46	162	391	758	871	72
90°	1	48	205	481	567	2
95°	1	12	90	264	322	1
105°	1	7	18	52	73	1
115°	1	4	14	23	24	2
125°	1	2	6	15	21	2
135°	2	2	2	5	7	1
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517540

CATALOG NUMBER: HVL12-4-LD4-3HI-40-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4958.3	4958.3	4958.3	4958.3	4958.3
2.5°	4964.3	4951.2	4923.9	4950.2	4957.3
5°	4946.2	4936.1	4953.2	5008.8	5022.9
7.5°	4904.7	4943.1	4988.6	5089.6	5121.9
10°	4843.1	4915.8	5052.2	5138.1	5104.7
12.5°	4768.4	4891.6	5074.4	4906.8	4829.0
15°	4681.5	4861.3	4908.8	4746.2	4749.2
17.5°	4579.5	4836.1	4689.6	4685.6	4656.3
20°	4469.4	4751.2	4557.3	4549.2	4517.9
22.5°	4351.2	4639.1	4440.1	4424.0	4508.8
25°	4223.0	4492.6	4287.6	4415.9	4487.6
27.5°	4062.4	4300.7	4160.3	4342.1	4432.0
30°	3899.8	4102.8	4030.0	4283.6	4443.2
32.5°	3747.2	3895.7	3923.0	4261.3	4287.6
35°	3602.8	3702.8	3758.3	4099.7	4239.1
37.5°	3444.2	3471.5	3619.0	4032.1	4166.4
40°	3282.6	3265.4	3501.8	3921.0	4106.8
42.5°	3108.9	3102.8	3377.6	3865.4	3958.3
45°	2944.3	2957.4	3200.8	3707.8	3846.2
47.5°	2775.6	2792.8	3033.1	3535.1	3706.8
50°	2579.6	2601.9	2883.7	3381.6	3602.8
52.5°	2367.5	2409.9	2738.2	3236.2	3459.4
55°	2168.5	2203.9	2553.4	3111.9	3359.4
57.5°	1986.7	2008.0	2362.5	2955.4	3142.2
60°	1808.0	1813.0	2182.7	2781.6	2960.4
62.5°	1602.9	1612.0	1997.9	2576.6	2816.0
65°	1372.6	1416.1	1798.9	2380.7	2596.8
67.5°	1157.5	1233.3	1595.9	2200.9	2314.0
70°	927.2	1055.5	1396.9	1989.8	2069.6
72.5°	716.1	866.6	1192.9	1753.4	1865.5
75°	519.2	687.8	1003.0	1541.3	1638.3
77.5°	349.5	521.2	825.2	1307.0	1435.3
80°	209.1	380.8	666.6	1089.8	1234.3
82.5°	107.1	255.5	517.1	914.1	1043.4
85°	46.5	161.6	390.9	758.5	870.7
87.5°	13.1	91.9	287.9	613.1	708.0
90°	1.0	48.5	205.0	480.8	566.6
92.5°	1.0	23.2	144.4	363.6	429.3
95°	1.0	12.1	89.9	263.6	322.2
97.5°	1.0	7.1	54.5	186.9	236.3
100°	1.0	6.1	32.3	124.2	168.7
102.5°	1.0	7.1	22.2	78.8	110.1
105°	1.0	7.1	18.2	51.5	72.7
107.5°	2.0	7.1	16.2	38.4	50.5
110°	1.0	6.1	17.2	29.3	39.4

TEST NUMBER: P517540

CATALOG NUMBER: HVL12-4-LD4-3HI-40-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	2.0	5.1	16.2	24.2	29.3
115°	1.0	4.0	14.1	23.2	24.2
117.5°	2.0	3.0	11.1	23.2	24.2
120°	2.0	2.0	9.1	22.2	25.3
122.5°	2.0	2.0	7.1	20.2	24.2
125°	1.0	2.0	6.1	15.2	21.2
127.5°	2.0	2.0	5.1	12.1	16.2
130°	2.0	2.0	4.0	9.1	12.1
132.5°	2.0	2.0	3.0	7.1	9.1
135°	2.0	2.0	2.0	5.1	7.1
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)