

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517544

Luminaire Tested: HVL12-4-LD4-3HI-50-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517544
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-3HI-50-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 5000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 15190.0 lumens
Efficiency: N/A
Efficacy: 117.5 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 129.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517544

CATALOG NUMBER: HVL12-4-LD4-3HI-50-UNV-C-EDD

Luminous Intensity Polar Plot

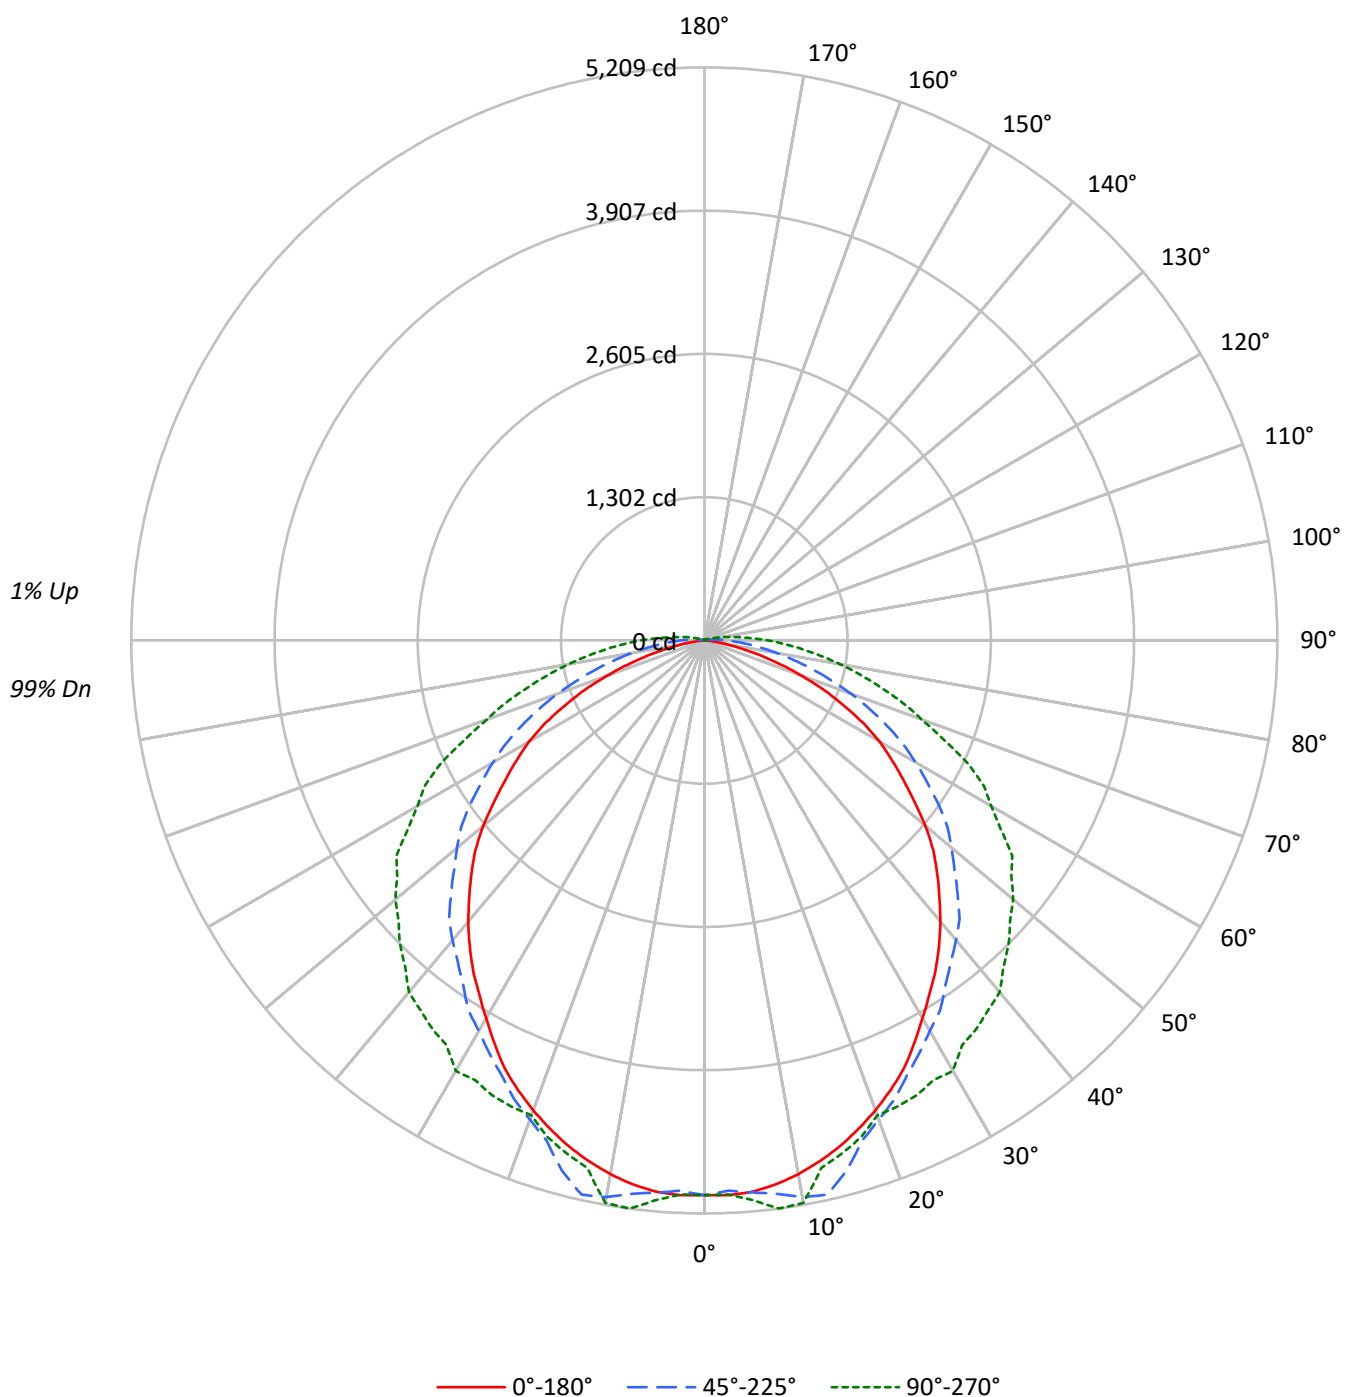

TEST NUMBER: P517544

CATALOG NUMBER: HVL12-4-LD4-3HI-50-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			99
1	108	103	98	94	105	100	96	92	96	92	89	91	89	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	78	73	80	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	51	62	56	51	60	54	50			47
5	75	61	52	45	72	60	51	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	39	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	13569	13569	13569
5°	13538	13433	13600
10°	13360	13683	13780
15°	13117	13379	12880
20°	12821	12596	12404
25°	12508	12114	12573
30°	12033	11736	12807
35°	11695	11381	12681
40°	11330	11133	12871
45°	10939	10796	12758
50°	10463	10443	12796
55°	9765	10064	12946
60°	9229	9517	12573
65°	8159	8851	12387
70°	6656	7956	11357
75°	4751	6842	10678
80°	2665	5723	9999
85°	987	4572	9409

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 12946 cd/sqm

TEST NUMBER: P517544

CATALOG NUMBER: HVL12-4-LD4-3HI-50-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	484.6	3.2
10°-20°	1380.1	9.1
20°-30°	2053.4	13.5
30°-40°	2468.2	16.2
40°-50°	2597.9	17.1
50°-60°	2410.6	15.9
60°-70°	1906.0	12.5
70°-80°	1164.2	7.7
80°-90°	507.2	3.3
90°-100°	157.9	1.0
100°-110°	35.5	0.2
110°-120°	14.3	0.1
120°-130°	8.0	0.1
130°-140°	2.2	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3918.1	25.8
0°-40°	6386.3	42.0
0°-60°	11394.7	75.0
0°-90°	14972.2	98.6
90°-120°	207.7	1.4
90°-150°	217.9	1.4
90°-180°	218.0	1.4
0°-180°	15190.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5042	5042	5042	5042	5042	
5°	5030	5020	5037	5094	5108	477
15°	4761	4944	4992	4827	4830	1341
25°	4294	4569	4360	4491	4564	1972
35°	3664	3766	3822	4169	4311	2290
45°	2994	3008	3255	3771	3911	2308
55°	2205	2241	2597	3165	3416	1981
65°	1396	1440	1829	2421	2641	1382
75°	528	700	1020	1567	1666	576
85°	47	164	398	771	885	73
90°	1	49	208	489	576	2
95°	1	12	91	268	328	1
105°	1	7	18	52	74	1
115°	1	4	14	24	25	2
125°	1	2	6	15	22	2
135°	2	2	2	5	7	1
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517544

CATALOG NUMBER: HVL12-4-LD4-3HI-50-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5042.3	5042.3	5042.3	5042.3	5042.3
2.5°	5048.4	5035.1	5007.3	5034.0	5041.2
5°	5029.9	5019.7	5037.1	5093.6	5108.0
7.5°	4987.8	5026.8	5073.1	5175.8	5208.7
10°	4925.2	4999.1	5137.8	5225.1	5191.2
12.5°	4849.2	4974.5	5160.4	4989.9	4910.8
15°	4760.8	4943.6	4991.9	4826.6	4829.6
17.5°	4657.1	4918.0	4769.0	4764.9	4735.1
20°	4545.1	4831.7	4634.5	4626.3	4594.4
22.5°	4424.9	4717.7	4515.3	4498.9	4585.2
25°	4294.5	4568.7	4360.2	4490.7	4563.6
27.5°	4131.2	4373.6	4230.8	4415.7	4507.1
30°	3965.8	4172.3	4098.3	4356.1	4518.4
32.5°	3810.7	3961.7	3989.4	4333.5	4360.2
35°	3663.8	3765.5	3822.0	4169.2	4310.9
37.5°	3502.6	3530.3	3680.3	4100.4	4237.0
40°	3338.2	3320.8	3561.1	3987.4	4176.4
42.5°	3161.6	3155.4	3434.8	3930.9	4025.4
45°	2994.1	3007.5	3255.0	3770.6	3911.4
47.5°	2822.6	2840.1	3084.5	3595.0	3769.6
50°	2623.3	2645.9	2932.5	3438.9	3663.8
52.5°	2407.6	2450.8	2784.6	3291.0	3518.0
55°	2205.3	2241.2	2596.6	3164.6	3416.3
57.5°	2020.4	2042.0	2402.5	3005.4	3195.4
60°	1838.6	1843.7	2219.7	2828.8	3010.6
62.5°	1630.1	1639.3	2031.7	2620.2	2863.7
65°	1395.9	1440.1	1829.3	2421.0	2640.8
67.5°	1177.1	1254.1	1622.9	2238.1	2353.2
70°	942.9	1073.4	1420.5	2023.5	2104.6
72.5°	728.2	881.3	1213.1	1783.1	1897.1
75°	528.0	699.5	1020.0	1567.4	1666.0
77.5°	355.4	530.0	839.2	1329.1	1459.6
80°	212.6	387.2	677.9	1108.3	1255.2
82.5°	108.9	259.9	525.9	929.6	1061.0
85°	47.2	164.3	397.5	771.4	885.4
87.5°	13.4	93.5	292.7	623.5	720.0
90°	1.0	49.3	208.5	488.9	576.2
92.5°	1.0	23.6	146.9	369.8	436.5
95°	1.0	12.3	91.4	268.1	327.7
97.5°	1.0	7.2	55.5	190.0	240.4
100°	1.0	6.2	32.9	126.3	171.5
102.5°	1.0	7.2	22.6	80.1	112.0
105°	1.0	7.2	18.5	52.4	74.0
107.5°	2.1	7.2	16.4	39.0	51.4
110°	1.0	6.2	17.5	29.8	40.1

TEST NUMBER: P517544

CATALOG NUMBER: HVL12-4-LD4-3HI-50-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	2.1	5.1	16.4	24.7	29.8
115°	1.0	4.1	14.4	23.6	24.7
117.5°	2.1	3.1	11.3	23.6	24.7
120°	2.1	2.1	9.2	22.6	25.7
122.5°	2.1	2.1	7.2	20.5	24.7
125°	1.0	2.1	6.2	15.4	21.6
127.5°	2.1	2.1	5.1	12.3	16.4
130°	2.1	2.1	4.1	9.2	12.3
132.5°	2.1	2.1	3.1	7.2	9.2
135°	2.1	2.1	2.1	5.1	7.2
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)