

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517556

Luminaire Tested: HVL12-4-LD4-3LO-40-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517556
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-3LO-40-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 4000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9011.0 lumens
Efficiency: N/A
Efficacy: 130.2 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 69.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517556

CATALOG NUMBER: HVL12-4-LD4-3LO-40-UNV-C-EDD

Luminous Intensity Polar Plot

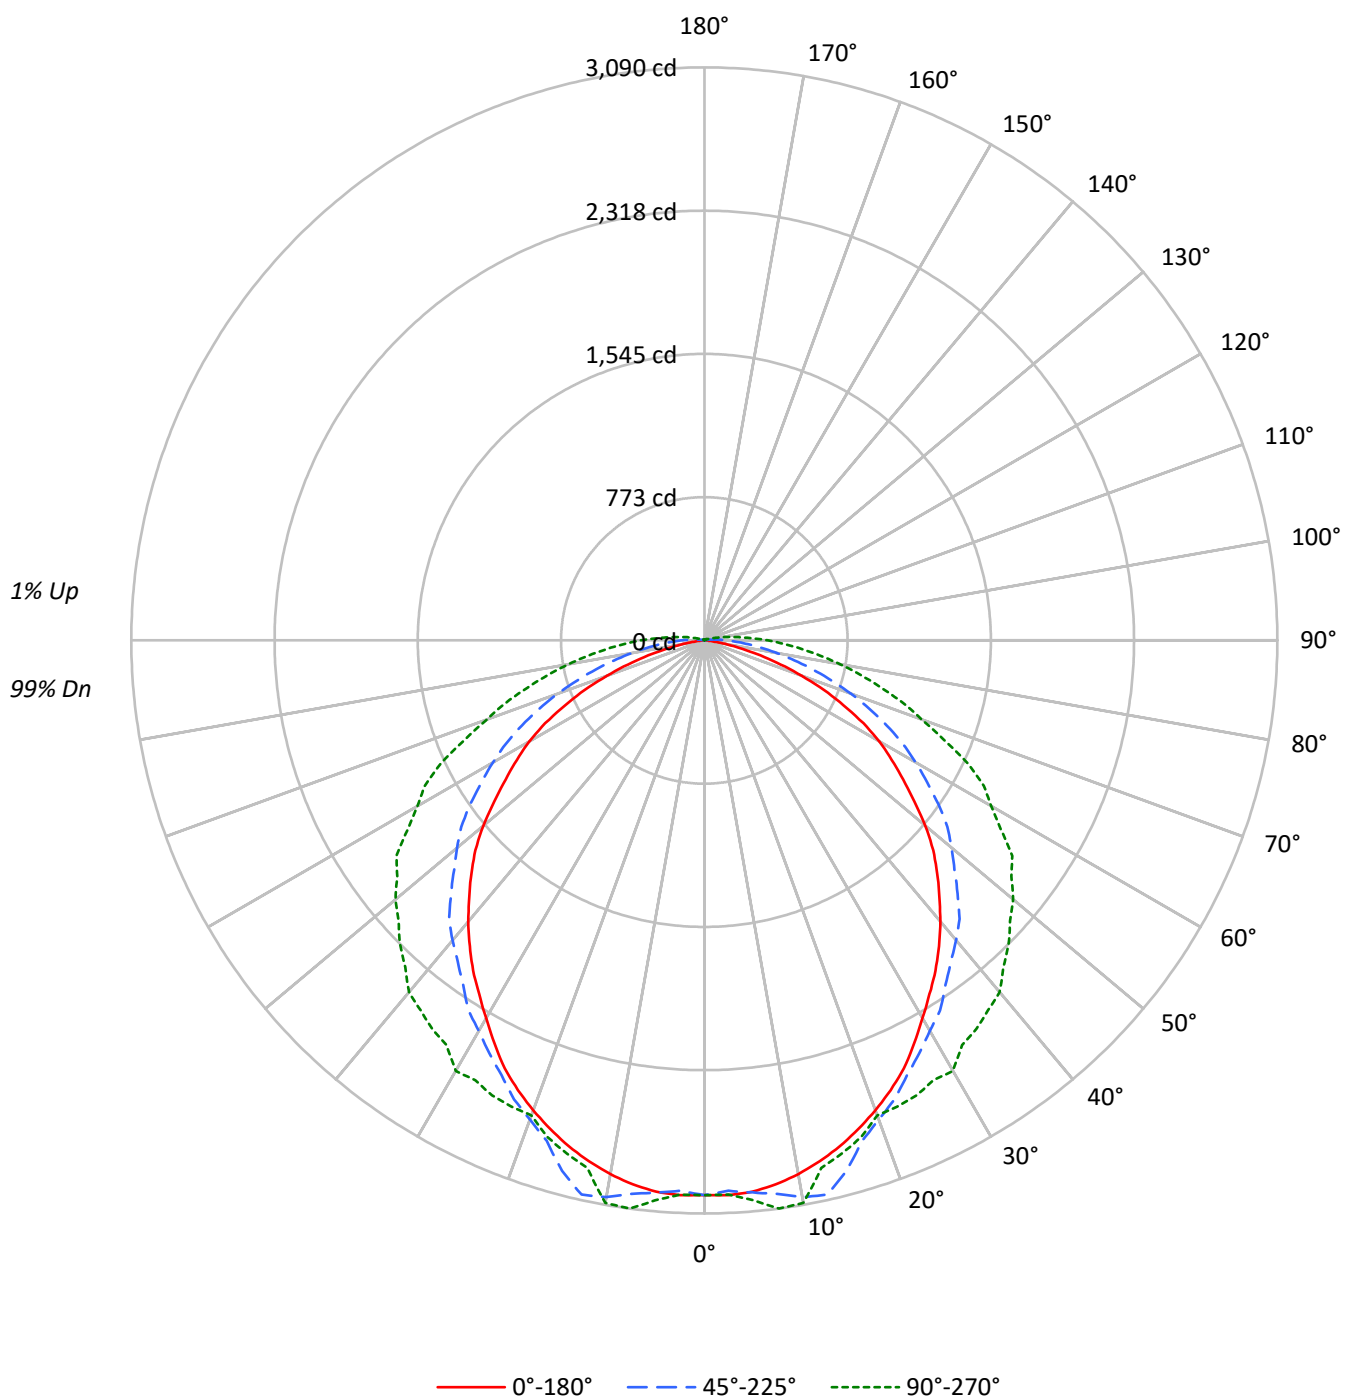

TEST NUMBER: P517556

CATALOG NUMBER: HVL12-4-LD4-3LO-40-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			99
1	108	103	98	94	105	100	96	92	96	92	89	91	89	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	78	73	80	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	51	62	56	51	60	54	50			47
5	75	61	52	45	72	60	51	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	39	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	8049	8049	8049
5°	8031	7969	8068
10°	7925	8117	8174
15°	7781	7937	7640
20°	7606	7472	7358
25°	7420	7186	7458
30°	7138	6962	7598
35°	6938	6752	7523
40°	6721	6604	7635
45°	6489	6405	7569
50°	6207	6195	7591
55°	5793	5971	7680
60°	5475	5646	7458
65°	4840	5251	7348
70°	3949	4720	6737
75°	2818	4059	6335
80°	1581	3395	5931
85°	586	2712	5581

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 7680 cd/sqm

TEST NUMBER: P517556

CATALOG NUMBER: HVL12-4-LD4-3LO-40-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	287.5	3.2
10°-20°	818.7	9.1
20°-30°	1218.1	13.5
30°-40°	1464.2	16.2
40°-50°	1541.1	17.1
50°-60°	1430.0	15.9
60°-70°	1130.7	12.5
70°-80°	690.6	7.7
80°-90°	300.9	3.3
90°-100°	93.7	1.0
100°-110°	21.1	0.2
110°-120°	8.4	0.1
120°-130°	4.7	0.1
130°-140°	1.3	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2324.3	25.8
0°-40°	3788.5	42.0
0°-60°	6759.6	75.0
0°-90°	8881.8	98.6
90°-120°	123.2	1.4
90°-150°	129.2	1.4
90°-180°	129.0	1.4
0°-180°	9011.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2991	2991	2991	2991	2991	
5°	2984	2978	2988	3022	3030	283
15°	2824	2933	2961	2863	2865	796
25°	2548	2710	2587	2664	2707	1170
35°	2174	2234	2267	2473	2557	1358
45°	1776	1784	1931	2237	2320	1369
55°	1308	1330	1540	1877	2027	1175
65°	828	854	1085	1436	1567	820
75°	313	415	605	930	988	342
85°	28	98	236	458	525	43
90°	1	29	124	290	342	1
95°	1	7	54	159	194	0
105°	1	4	11	31	44	1
115°	1	2	8	14	15	1
125°	1	1	4	9	13	1
135°	1	1	1	3	4	1
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517556

CATALOG NUMBER: HVL12-4-LD4-3LO-40-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2991.2	2991.2	2991.2	2991.2	2991.2
2.5°	2994.8	2986.9	2970.4	2986.3	2990.6
5°	2983.9	2977.8	2988.1	3021.6	3030.2
7.5°	2958.9	2982.0	3009.4	3070.4	3089.9
10°	2921.7	2965.6	3047.8	3099.6	3079.5
12.5°	2876.6	2950.9	3061.2	2960.1	2913.2
15°	2824.2	2932.7	2961.3	2863.2	2865.0
17.5°	2762.7	2917.4	2829.1	2826.6	2809.0
20°	2696.3	2866.3	2749.3	2744.4	2725.5
22.5°	2625.0	2798.6	2678.6	2668.8	2720.0
25°	2547.6	2710.3	2586.6	2664.0	2707.2
27.5°	2450.7	2594.5	2509.8	2619.5	2673.7
30°	2352.6	2475.1	2431.2	2584.1	2680.4
32.5°	2260.6	2350.2	2366.6	2570.7	2586.6
35°	2173.5	2233.8	2267.3	2473.2	2557.3
37.5°	2077.8	2094.2	2183.2	2432.4	2513.5
40°	1980.3	1969.9	2112.5	2365.4	2477.5
42.5°	1875.5	1871.8	2037.6	2331.9	2387.9
45°	1776.2	1784.1	1930.9	2236.8	2320.3
47.5°	1674.4	1684.8	1829.8	2132.6	2236.2
50°	1556.2	1569.6	1739.6	2040.0	2173.5
52.5°	1428.3	1453.8	1651.9	1952.3	2086.9
55°	1308.2	1329.5	1540.4	1877.3	2026.6
57.5°	1198.5	1211.3	1425.2	1782.9	1895.6
60°	1090.7	1093.7	1316.7	1678.1	1785.9
62.5°	967.0	972.5	1205.2	1554.4	1698.8
65°	828.1	854.3	1085.2	1436.2	1566.6
67.5°	698.3	744.0	962.7	1327.7	1396.0
70°	559.4	636.7	842.7	1200.4	1248.5
72.5°	432.0	522.8	719.6	1057.8	1125.4
75°	313.2	414.9	605.1	929.8	988.3
77.5°	210.8	314.4	497.8	788.5	865.8
80°	126.1	229.7	402.2	657.5	744.6
82.5°	64.6	154.2	312.0	551.4	629.4
85°	28.0	97.5	235.8	457.6	525.2
87.5°	7.9	55.4	173.7	369.9	427.1
90°	0.6	29.2	123.7	290.0	341.8
92.5°	0.6	14.0	87.1	219.4	259.0
95°	0.6	7.3	54.2	159.0	194.4
97.5°	0.6	4.3	32.9	112.7	142.6
100°	0.6	3.7	19.5	74.9	101.8
102.5°	0.6	4.3	13.4	47.5	66.4
105°	0.6	4.3	11.0	31.1	43.9
107.5°	1.2	4.3	9.7	23.2	30.5
110°	0.6	3.7	10.4	17.7	23.8

TEST NUMBER: P517556

CATALOG NUMBER: HVL12-4-LD4-3LO-40-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1.2	3.0	9.7	14.6	17.7
115°	0.6	2.4	8.5	14.0	14.6
117.5°	1.2	1.8	6.7	14.0	14.6
120°	1.2	1.2	5.5	13.4	15.2
122.5°	1.2	1.2	4.3	12.2	14.6
125°	0.6	1.2	3.7	9.1	12.8
127.5°	1.2	1.2	3.0	7.3	9.7
130°	1.2	1.2	2.4	5.5	7.3
132.5°	1.2	1.2	1.8	4.3	5.5
135°	1.2	1.2	1.2	3.0	4.3
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)