

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517560

Luminaire Tested: HVL12-4-LD4-3LO-50-UNV-C-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517560
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-4-LD4-3LO-50-UNV-C-EDD
Description: 4 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 5000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9163.0 lumens
Efficiency: N/A
Efficacy: 132.4 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.32 / 1.37
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 4' x H: 0.17')
CIE Type: Direct


Input Watts (W): 69.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517560

CATALOG NUMBER: HVL12-4-LD4-3LO-50-UNV-C-EDD

Luminous Intensity Polar Plot

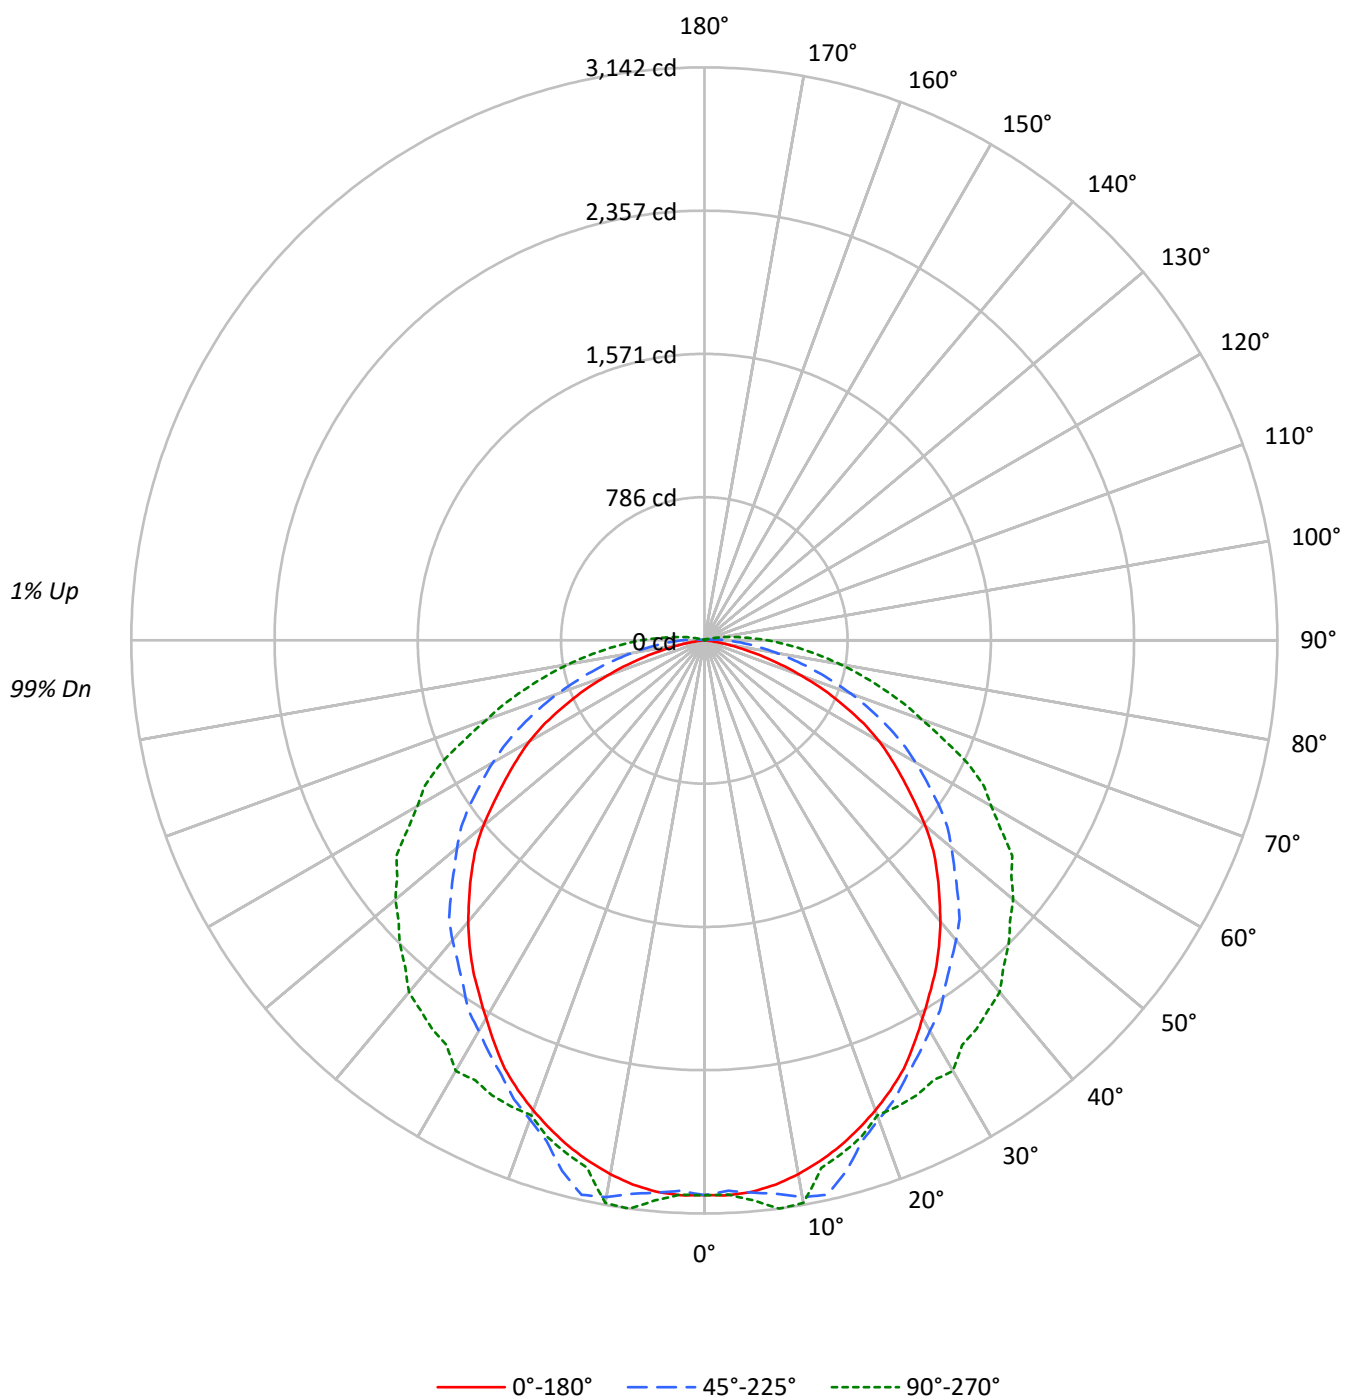

TEST NUMBER: P517560

CATALOG NUMBER: HVL12-4-LD4-3LO-50-UNV-C-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	110	110	110		105	105	105		101
1	108	103	98	94	105	100	96	92	96	92	89		91	89	86		87
2	98	89	82	76	95	87	80	75	83	78	73		80	75	71		76
3	89	78	69	63	86	76	68	62	73	66	61		70	64	59		67
4	81	69	60	53	79	67	59	52	65	57	51		62	56	51		60
5	75	61	52	45	72	60	51	45	58	50	44		56	49	44		54
6	69	55	46	39	67	54	46	39	52	45	39		50	44	38		49
7	64	50	41	35	62	49	41	35	47	40	34		46	39	34		44
8	59	46	37	31	58	45	37	31	43	36	31		42	35	30		41
9	55	42	34	28	54	41	33	28	40	33	28		39	32	27		38
10	52	39	31	25	51	38	30	25	37	30	25		36	29	25		35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	8185	8185	8185
5°	8166	8103	8204
10°	8059	8254	8312
15°	7912	8071	7769
20°	7734	7598	7483
25°	7545	7307	7584
30°	7259	7080	7726
35°	7054	6865	7650
40°	6835	6716	7764
45°	6598	6513	7696
50°	6312	6300	7719
55°	5891	6071	7809
60°	5567	5741	7584
65°	4922	5339	7472
70°	4015	4799	6851
75°	2866	4128	6442
80°	1608	3452	6032
85°	596	2758	5676

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 55°

Luminance: 7809 cd/sqm

TEST NUMBER: P517560

CATALOG NUMBER: HVL12-4-LD4-3LO-50-UNV-C-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	292.3	3.2
10°-20°	832.5	9.1
20°-30°	1238.7	13.5
30°-40°	1488.9	16.2
40°-50°	1567.1	17.1
50°-60°	1454.1	15.9
60°-70°	1149.7	12.5
70°-80°	702.3	7.7
80°-90°	306.0	3.3
90°-100°	95.3	1.0
100°-110°	21.4	0.2
110°-120°	8.6	0.1
120°-130°	4.8	0.1
130°-140°	1.3	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2363.5	25.8
0°-40°	3852.4	42.0
0°-60°	6873.6	75.0
0°-90°	9031.6	98.6
90°-120°	125.2	1.4
90°-150°	131.4	1.4
90°-180°	131.0	1.4
0°-180°	9163.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3042	3042	3042	3042	3042	
5°	3034	3028	3038	3073	3081	288
15°	2872	2982	3011	2912	2913	809
25°	2590	2756	2630	2709	2753	1189
35°	2210	2272	2306	2515	2600	1381
45°	1806	1814	1964	2275	2359	1392
55°	1330	1352	1566	1909	2061	1195
65°	842	869	1104	1460	1593	834
75°	318	422	615	946	1005	348
85°	28	99	240	465	534	44
90°	1	30	126	295	348	1
95°	1	7	55	162	198	0
105°	1	4	11	32	45	1
115°	1	2	9	14	15	1
125°	1	1	4	9	13	1
135°	1	1	1	3	4	1
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517560

CATALOG NUMBER: HVL12-4-LD4-3LO-50-UNV-C-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3041.6	3041.6	3041.6	3041.6	3041.6
2.5°	3045.3	3037.3	3020.6	3036.7	3041.0
5°	3034.2	3028.0	3038.5	3072.6	3081.3
7.5°	3008.8	3032.3	3060.2	3122.2	3142.0
10°	2971.0	3015.6	3099.2	3151.9	3131.5
12.5°	2925.1	3000.7	3112.9	3010.0	2962.3
15°	2871.8	2982.1	3011.3	2911.5	2913.4
17.5°	2809.3	2966.6	2876.8	2874.3	2856.4
20°	2741.7	2914.6	2795.6	2790.7	2771.5
22.5°	2669.2	2845.8	2723.8	2713.8	2765.9
25°	2590.5	2756.0	2630.2	2708.9	2752.9
27.5°	2492.0	2638.3	2552.1	2663.7	2718.8
30°	2392.3	2516.8	2472.2	2627.7	2725.6
32.5°	2298.7	2389.8	2406.5	2614.1	2630.2
35°	2210.1	2271.5	2305.5	2515.0	2600.5
37.5°	2112.8	2129.6	2220.0	2473.4	2555.9
40°	2013.7	2003.2	2148.2	2405.3	2519.3
42.5°	1907.1	1903.4	2071.9	2371.2	2428.2
45°	1806.1	1814.2	1963.5	2274.6	2359.4
47.5°	1702.7	1713.2	1860.7	2168.6	2273.9
50°	1582.5	1596.1	1769.0	2074.4	2210.1
52.5°	1452.3	1478.4	1679.7	1985.2	2122.1
55°	1330.3	1352.0	1566.3	1909.0	2060.8
57.5°	1218.8	1231.8	1449.2	1813.0	1927.6
60°	1109.1	1112.2	1339.0	1706.4	1816.0
62.5°	983.3	988.9	1225.6	1580.6	1727.4
65°	842.0	868.7	1103.5	1460.4	1593.0
67.5°	710.1	756.5	979.0	1350.1	1419.5
70°	568.8	647.5	856.9	1220.6	1269.6
72.5°	439.3	531.6	731.7	1075.6	1144.4
75°	318.5	421.9	615.3	945.5	1005.0
77.5°	214.4	319.7	506.2	801.8	880.5
80°	128.3	233.6	408.9	668.5	757.2
82.5°	65.7	156.8	317.2	560.7	640.0
85°	28.5	99.1	239.8	465.3	534.1
87.5°	8.1	56.4	176.6	376.1	434.3
90°	0.6	29.7	125.8	294.9	347.6
92.5°	0.6	14.3	88.6	223.1	263.3
95°	0.6	7.4	55.1	161.7	197.7
97.5°	0.6	4.3	33.5	114.6	145.0
100°	0.6	3.7	19.8	76.2	103.5
102.5°	0.6	4.3	13.6	48.3	67.5
105°	0.6	4.3	11.2	31.6	44.6
107.5°	1.2	4.3	9.9	23.5	31.0
110°	0.6	3.7	10.5	18.0	24.2

TEST NUMBER: P517560

CATALOG NUMBER: HVL12-4-LD4-3LO-50-UNV-C-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1.2	3.1	9.9	14.9	18.0
115°	0.6	2.5	8.7	14.3	14.9
117.5°	1.2	1.9	6.8	14.3	14.9
120°	1.2	1.2	5.6	13.6	15.5
122.5°	1.2	1.2	4.3	12.4	14.9
125°	0.6	1.2	3.7	9.3	13.0
127.5°	1.2	1.2	3.1	7.4	9.9
130°	1.2	1.2	2.5	5.6	7.4
132.5°	1.2	1.2	1.9	4.3	5.6
135°	1.2	1.2	1.2	3.1	4.3
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)