

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517678

Luminaire Tested: HVL12-8-LD4-3HI-30-UNV-O-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517678
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-8-LD4-3HI-30-UNV-O-EDD
Description: 8 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 3000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 22114.0 lumens
Efficiency: N/A
Efficacy: 85.5 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.27 / 1.38
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 8' x H: 0.17')
CIE Type: Direct


Input Watts (W): 258.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517678

CATALOG NUMBER: HVL12-8-LD4-3HI-30-UNV-O-EDD

Luminous Intensity Polar Plot

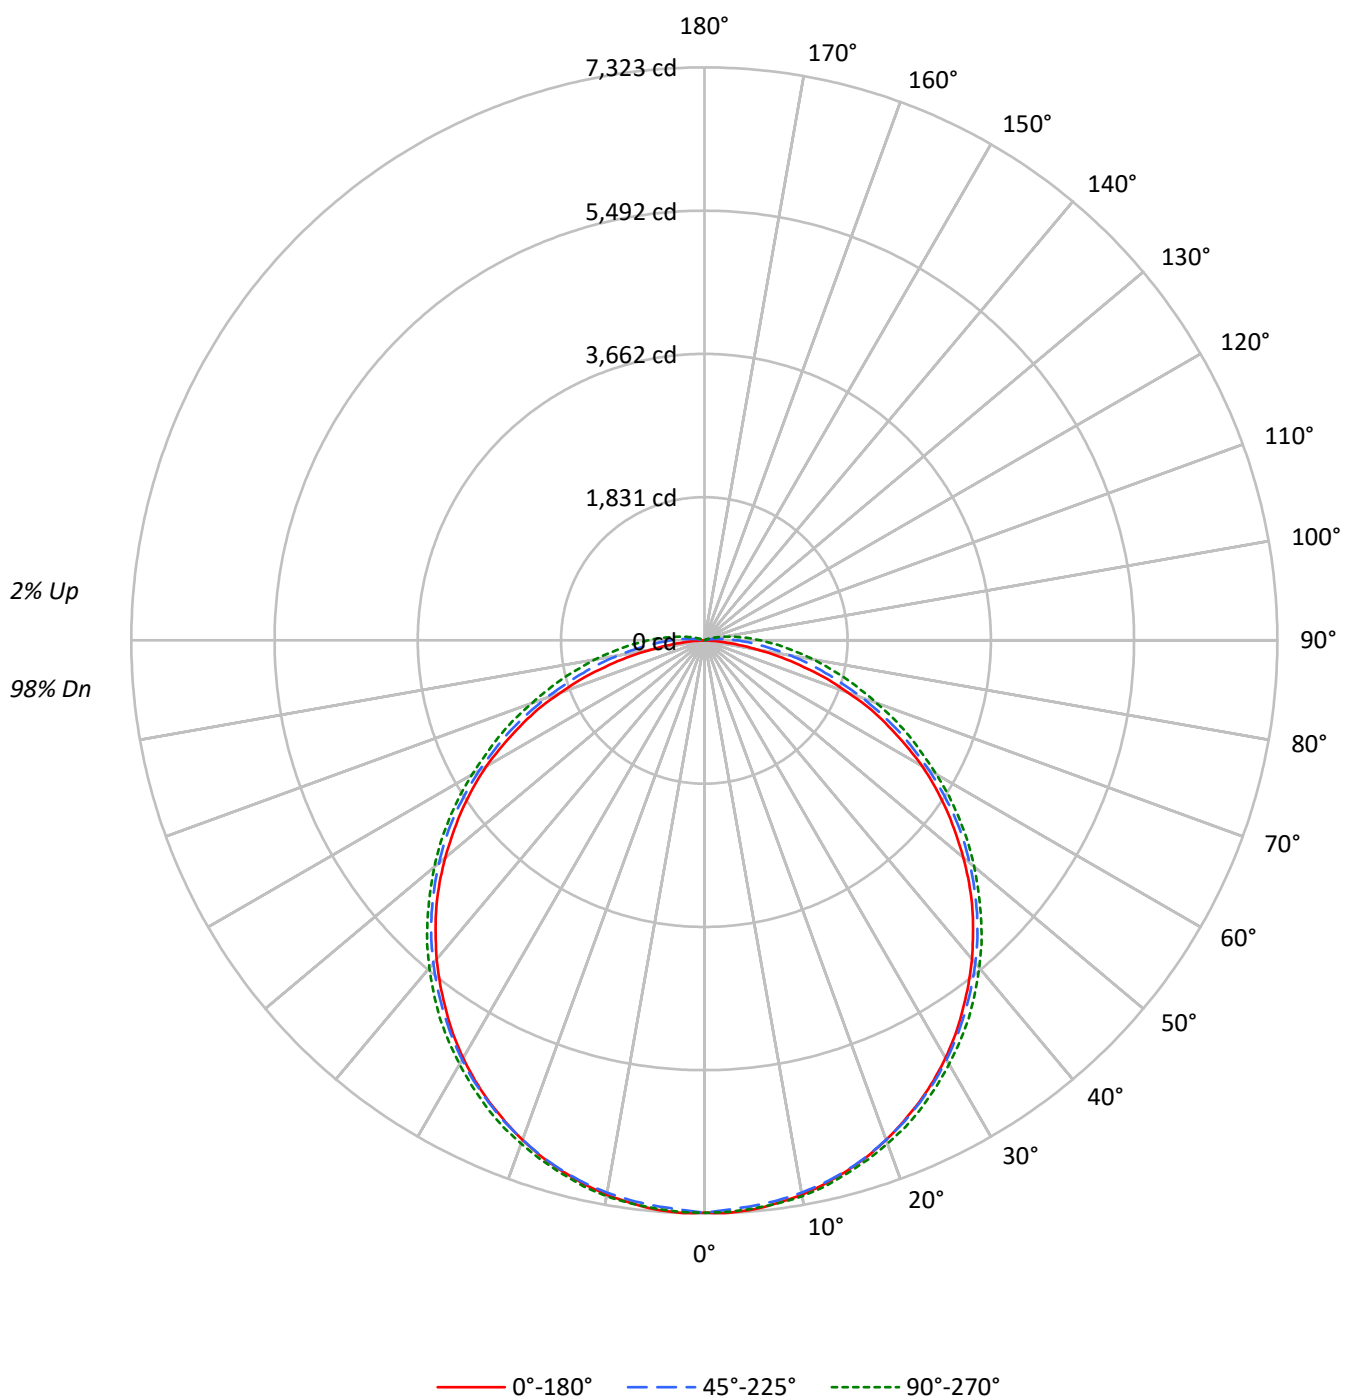

TEST NUMBER: P517678

CATALOG NUMBER: HVL12-8-LD4-3HI-30-UNV-O-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			98
1	108	102	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	77	73	79	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	52	62	56	51	60	54	50			47
5	75	61	52	45	72	60	52	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	40	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	9841	9841	9841
5°	9840	9682	9700
10°	9792	9569	9572
15°	9725	9435	9403
20°	9654	9277	9238
25°	9565	9112	9068
30°	9460	8933	8865
35°	9323	8731	8666
40°	9182	8516	8422
45°	9031	8279	8155
50°	8829	7997	7865
55°	8613	7685	7540
60°	8356	7259	7150
65°	7918	6778	6773
70°	7275	6200	6327
75°	6346	5564	5957
80°	4923	4972	5679
85°	2838	4433	5524

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 9031 cd/sqm

TEST NUMBER: P517678

CATALOG NUMBER: HVL12-8-LD4-3HI-30-UNV-O-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	692.1	3.1
10°-20°	1985.3	9.0
20°-30°	3012.4	13.6
30°-40°	3642.5	16.5
40°-50°	3800.7	17.2
50°-60°	3474.9	15.7
60°-70°	2708.9	12.2
70°-80°	1694.5	7.7
80°-90°	769.7	3.5
90°-100°	257.9	1.2
100°-110°	64.8	0.3
110°-120°	10.2	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5689.9	25.7
0°-40°	9332.4	42.2
0°-60°	16608.0	75.1
0°-90°	21781.1	98.5
90°-120°	332.9	1.5
90°-150°	332.9	1.5
90°-180°	333.0	1.5
0°-180°	22114.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	7314	7314	7314	7314	7314	
5°	7298	7285	7252	7286	7286	693
15°	7021	7033	7014	7054	7052	1982
25°	6505	6510	6517	6573	6583	2998
35°	5759	5785	5809	5867	5892	3604
45°	4845	4888	4928	4976	5000	3733
55°	3781	3826	3897	3954	3979	3378
65°	2598	2643	2735	2843	2888	2571
75°	1316	1397	1600	1791	1859	1402
85°	228	421	722	955	1040	288
90°	2	157	426	640	717	9
95°	2	41	221	400	462	1
105°	3	5	36	107	143	4
115°	5	5	7	19	28	3
125°	0	0	0	0	0	0
135°	0	0	0	0	0	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517678

CATALOG NUMBER: HVL12-8-LD4-3HI-30-UNV-O-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	7314.0	7314.0	7314.0	7314.0	7314.0
2.5°	7322.6	7312.3	7279.5	7312.3	7310.5
5°	7298.5	7284.7	7251.9	7286.4	7286.4
7.5°	7250.2	7245.0	7215.7	7255.4	7255.4
10°	7193.3	7191.6	7167.4	7210.5	7212.2
12.5°	7114.0	7120.9	7098.5	7139.8	7145.0
15°	7020.9	7032.9	7014.0	7053.6	7051.9
17.5°	6919.1	6926.0	6912.2	6957.1	6955.3
20°	6793.3	6801.9	6791.5	6838.1	6843.3
22.5°	6653.6	6665.7	6664.0	6712.2	6726.0
25°	6505.3	6510.5	6517.4	6572.6	6582.9
27.5°	6341.5	6350.2	6362.2	6412.2	6422.6
30°	6162.2	6176.0	6189.8	6241.5	6255.3
32.5°	5972.6	5986.4	6003.6	6070.8	6077.7
35°	5758.8	5784.6	5808.8	5867.4	5891.5
37.5°	5545.0	5577.7	5600.1	5662.2	5681.2
40°	5319.1	5351.9	5388.1	5453.6	5465.7
42.5°	5082.9	5120.8	5163.9	5222.5	5243.2
45°	4844.9	4888.1	4927.7	4976.0	5000.1
47.5°	4588.0	4631.1	4679.4	4734.6	4750.1
50°	4322.5	4372.5	4424.2	4476.0	4503.6
52.5°	4050.1	4110.4	4169.1	4224.2	4250.1
55°	3781.1	3826.0	3896.6	3953.5	3979.4
57.5°	3501.8	3539.7	3603.5	3696.6	3710.4
60°	3217.3	3251.8	3317.3	3393.2	3424.2
62.5°	2903.5	2950.1	3019.0	3115.6	3143.2
65°	2598.3	2643.2	2734.6	2843.2	2888.0
67.5°	2303.5	2319.0	2436.3	2550.1	2622.5
70°	1955.2	2013.8	2150.1	2289.7	2344.9
72.5°	1655.2	1713.8	1863.8	2027.6	2096.6
75°	1315.6	1396.6	1600.0	1791.4	1858.7
77.5°	1017.3	1106.9	1358.7	1551.8	1629.4
80°	710.4	850.0	1124.2	1341.4	1425.9
82.5°	446.6	619.0	912.1	1139.7	1213.8
85°	227.6	420.7	722.4	955.2	1039.7
87.5°	60.3	272.4	562.1	784.5	870.7
90°	1.7	156.9	425.9	639.7	717.3
92.5°	1.7	87.9	317.2	508.6	587.9
95°	1.7	41.4	220.7	400.0	462.1
97.5°	1.7	17.2	151.7	301.7	363.8
100°	1.7	8.6	96.6	219.0	272.4
102.5°	3.4	5.2	60.3	156.9	200.0
105°	3.4	5.2	36.2	106.9	143.1
107.5°	3.4	5.2	20.7	72.4	98.3
110°	5.2	5.2	12.1	44.8	65.5

TEST NUMBER: P517678

CATALOG NUMBER: HVL12-8-LD4-3HI-30-UNV-O-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	5.2	5.2	6.9	29.3	43.1
115°	5.2	5.2	6.9	19.0	27.6
117.5°	0.0	0.0	0.0	0.0	0.0
120°	0.0	0.0	0.0	0.0	0.0
122.5°	0.0	0.0	0.0	0.0	0.0
125°	0.0	0.0	0.0	0.0	0.0
127.5°	0.0	0.0	0.0	0.0	0.0
130°	0.0	0.0	0.0	0.0	0.0
132.5°	0.0	0.0	0.0	0.0	0.0
135°	0.0	0.0	0.0	0.0	0.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)