

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517682

Luminaire Tested: HVL12-8-LD4-3HI-35-UNV-O-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517682
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-8-LD4-3HI-35-UNV-O-EDD
Description: 8 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 3500K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 22410.0 lumens
Efficiency: N/A
Efficacy: 86.7 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.27 / 1.38
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 8' x H: 0.17')
CIE Type: Direct


Input Watts (W): 258.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517682

CATALOG NUMBER: HVL12-8-LD4-3HI-35-UNV-O-EDD

Luminous Intensity Polar Plot

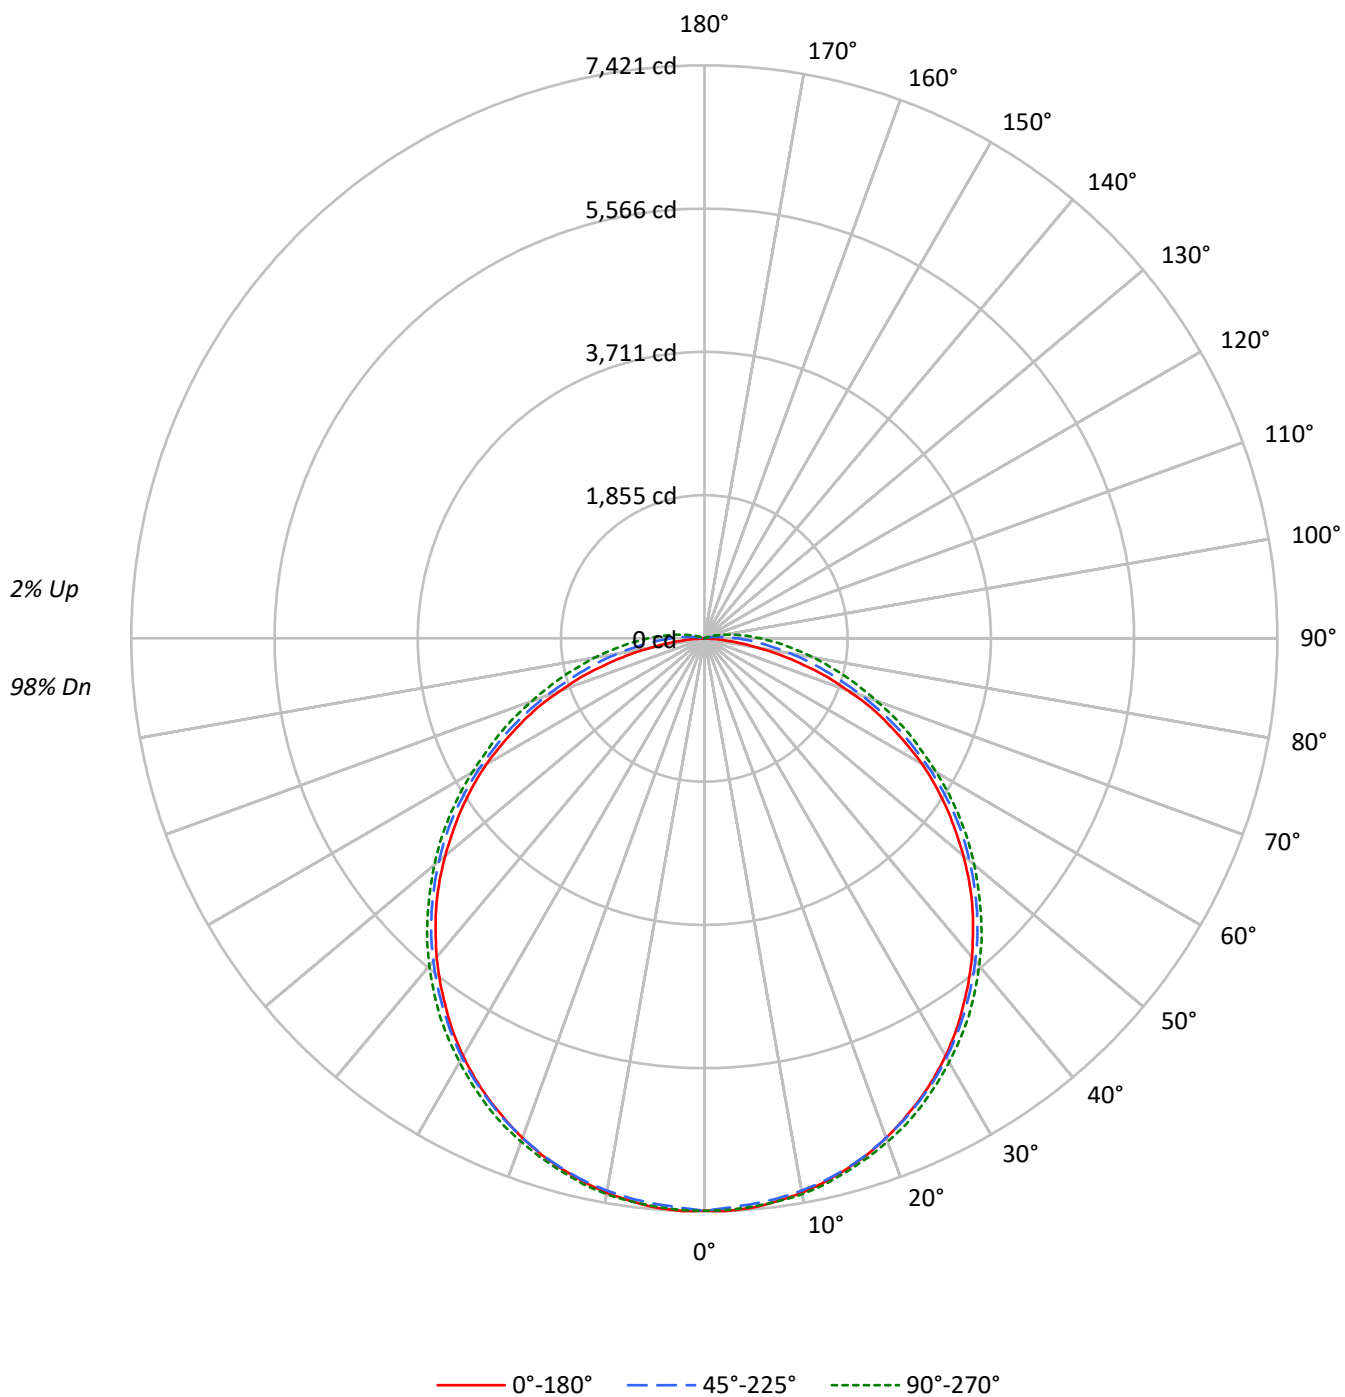

TEST NUMBER: P517682

CATALOG NUMBER: HVL12-8-LD4-3HI-35-UNV-O-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			98
1	108	102	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	77	73	79	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	52	62	56	51	60	54	50			47
5	75	61	52	45	72	60	52	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	40	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	9973	9973	9973
5°	9971	9812	9830
10°	9923	9697	9700
15°	9856	9561	9529
20°	9783	9401	9362
25°	9693	9234	9189
30°	9587	9052	8984
35°	9448	8847	8782
40°	9305	8630	8535
45°	9152	8390	8264
50°	8947	8104	7970
55°	8729	7788	7641
60°	8468	7357	7246
65°	8024	6869	6864
70°	7373	6282	6412
75°	6431	5639	6036
80°	4989	5038	5755
85°	2875	4493	5598

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 9152 cd/sqm

TEST NUMBER: P517682

CATALOG NUMBER: HVL12-8-LD4-3HI-35-UNV-O-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	701.4	3.1
10°-20°	2011.9	9.0
20°-30°	3052.7	13.6
30°-40°	3691.3	16.5
40°-50°	3851.6	17.2
50°-60°	3521.5	15.7
60°-70°	2745.2	12.2
70°-80°	1717.2	7.7
80°-90°	780.0	3.5
90°-100°	261.4	1.2
100°-110°	65.6	0.3
110°-120°	10.3	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5766.0	25.7
0°-40°	9457.3	42.2
0°-60°	16830.3	75.1
0°-90°	22072.7	98.5
90°-120°	337.3	1.5
90°-150°	337.3	1.5
90°-180°	337.0	1.5
0°-180°	22410.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	7412	7412	7412	7412	7412	
5°	7396	7382	7349	7384	7384	702
15°	7115	7127	7108	7148	7146	2008
25°	6592	6598	6605	6661	6671	3038
35°	5836	5862	5886	5946	5970	3653
45°	4910	4954	4994	5043	5067	3783
55°	3832	3877	3949	4006	4033	3423
65°	2633	2678	2771	2881	2927	2605
75°	1333	1415	1622	1815	1884	1421
85°	231	426	732	968	1054	292
90°	2	159	432	648	727	9
95°	2	42	224	405	468	1
105°	4	5	37	108	145	4
115°	5	5	7	19	28	3
125°	0	0	0	0	0	0
135°	0	0	0	0	0	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517682

CATALOG NUMBER: HVL12-8-LD4-3HI-35-UNV-O-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	7411.9	7411.9	7411.9	7411.9	7411.9
2.5°	7420.6	7410.1	7376.9	7410.1	7408.4
5°	7396.1	7382.2	7349.0	7383.9	7383.9
7.5°	7347.2	7342.0	7312.3	7352.5	7352.5
10°	7289.6	7287.8	7263.4	7307.0	7308.8
12.5°	7209.2	7216.2	7193.5	7235.4	7240.6
15°	7114.8	7127.1	7107.9	7148.0	7146.3
17.5°	7011.8	7018.7	7004.8	7050.2	7048.4
20°	6884.2	6892.9	6882.5	6929.6	6934.9
22.5°	6742.7	6754.9	6753.2	6802.1	6816.1
25°	6592.4	6597.7	6604.6	6660.6	6671.0
27.5°	6426.4	6435.2	6447.4	6498.1	6508.5
30°	6244.7	6258.7	6272.7	6325.1	6339.1
32.5°	6052.5	6066.5	6084.0	6152.1	6159.1
35°	5835.8	5862.1	5886.5	5945.9	5970.4
37.5°	5619.2	5652.4	5675.1	5738.0	5757.2
40°	5390.3	5423.5	5460.2	5526.6	5538.8
42.5°	5150.9	5189.4	5233.0	5292.4	5313.4
45°	4909.8	4953.5	4993.7	5042.6	5067.1
47.5°	4649.5	4693.1	4742.1	4798.0	4813.7
50°	4380.4	4431.0	4483.5	4535.9	4563.8
52.5°	4104.3	4165.5	4224.9	4280.8	4307.0
55°	3831.7	3877.2	3948.8	4006.5	4032.7
57.5°	3548.7	3587.1	3651.8	3746.1	3760.1
60°	3260.4	3295.3	3361.7	3438.6	3470.1
62.5°	2942.4	2989.6	3059.5	3157.3	3185.3
65°	2633.1	2678.5	2771.2	2881.2	2926.7
67.5°	2334.3	2350.1	2468.9	2584.2	2657.6
70°	1981.4	2040.8	2178.8	2320.4	2376.3
72.5°	1677.4	1736.8	1888.8	2054.8	2124.7
75°	1333.2	1415.3	1621.5	1815.4	1883.5
77.5°	1030.9	1121.7	1376.8	1572.5	1651.2
80°	719.9	861.4	1139.2	1359.4	1445.0
82.5°	452.5	627.3	924.3	1154.9	1230.1
85°	230.6	426.3	732.1	968.0	1053.6
87.5°	61.2	276.1	569.6	795.0	882.4
90°	1.7	159.0	431.6	648.2	726.9
92.5°	1.7	89.1	321.5	515.4	595.8
95°	1.7	41.9	223.6	405.4	468.3
97.5°	1.7	17.5	153.8	305.8	368.7
100°	1.7	8.7	97.8	221.9	276.1
102.5°	3.5	5.2	61.2	159.0	202.7
105°	3.5	5.2	36.7	108.3	145.0
107.5°	3.5	5.2	21.0	73.4	99.6
110°	5.2	5.2	12.2	45.4	66.4

TEST NUMBER: P517682

CATALOG NUMBER: HVL12-8-LD4-3HI-35-UNV-O-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	5.2	5.2	7.0	29.7	43.7
115°	5.2	5.2	7.0	19.2	28.0
117.5°	0.0	0.0	0.0	0.0	0.0
120°	0.0	0.0	0.0	0.0	0.0
122.5°	0.0	0.0	0.0	0.0	0.0
125°	0.0	0.0	0.0	0.0	0.0
127.5°	0.0	0.0	0.0	0.0	0.0
130°	0.0	0.0	0.0	0.0	0.0
132.5°	0.0	0.0	0.0	0.0	0.0
135°	0.0	0.0	0.0	0.0	0.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)