

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517686

Luminaire Tested: HVL12-8-LD4-3HI-40-UNV-O-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517686
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-8-LD4-3HI-40-UNV-O-EDD
Description: 8 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 4000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 22728.0 lumens
Efficiency: N/A
Efficacy: 87.9 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.27 / 1.38
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 8' x H: 0.17')
CIE Type: Direct


Input Watts (W): 258.6
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517686

CATALOG NUMBER: HVL12-8-LD4-3HI-40-UNV-O-EDD

Luminous Intensity Polar Plot

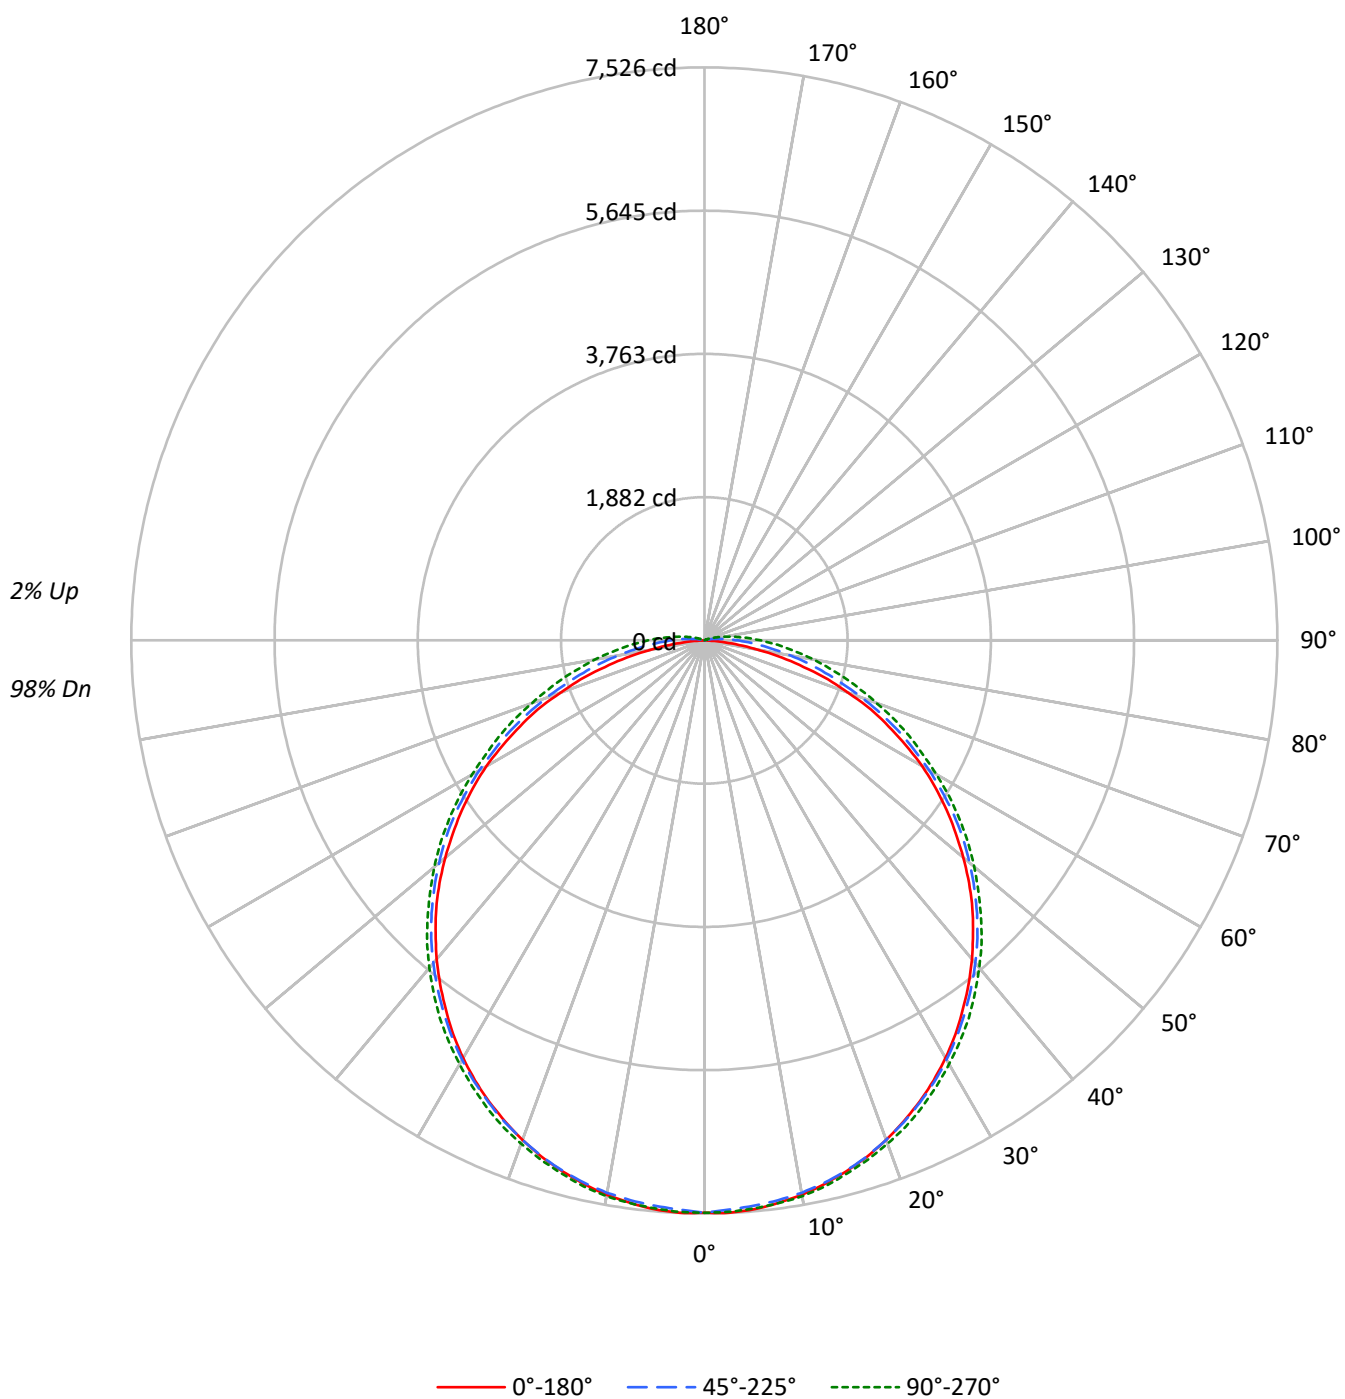

TEST NUMBER: P517686

CATALOG NUMBER: HVL12-8-LD4-3HI-40-UNV-O-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			98
1	108	102	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	77	73	79	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	52	62	56	51	60	54	50			47
5	75	61	52	45	72	60	52	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	40	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	10114	10114	10114
5°	10113	9951	9969
10°	10064	9834	9838
15°	9995	9697	9664
20°	9922	9534	9494
25°	9830	9365	9320
30°	9723	9181	9111
35°	9582	8973	8906
40°	9437	8753	8656
45°	9282	8508	8381
50°	9074	8219	8083
55°	8853	7899	7749
60°	8588	7461	7349
65°	8138	6967	6961
70°	7477	6372	6503
75°	6522	5719	6122
80°	5059	5110	5837
85°	2916	4556	5677

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 9282 cd/sqm

TEST NUMBER: P517686

CATALOG NUMBER: HVL12-8-LD4-3HI-40-UNV-O-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	711.3	3.1
10°-20°	2040.5	9.0
20°-30°	3096.0	13.6
30°-40°	3743.6	16.5
40°-50°	3906.2	17.2
50°-60°	3571.4	15.7
60°-70°	2784.1	12.2
70°-80°	1741.6	7.7
80°-90°	791.0	3.5
90°-100°	265.1	1.2
100°-110°	66.6	0.3
110°-120°	10.5	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5847.8	25.7
0°-40°	9591.5	42.2
0°-60°	17069.1	75.1
0°-90°	22385.9	98.5
90°-120°	342.2	1.5
90°-150°	342.2	1.5
90°-180°	342.0	1.5
0°-180°	22728.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	7517	7517	7517	7517	7517	
5°	7501	7487	7453	7489	7489	712
15°	7216	7228	7209	7250	7248	2037
25°	6686	6691	6698	6755	6766	3081
35°	5919	5945	5970	6030	6055	3705
45°	4980	5024	5064	5114	5139	3837
55°	3886	3932	4005	4063	4090	3472
65°	2670	2717	2810	2922	2968	2642
75°	1352	1435	1644	1841	1910	1441
85°	234	432	742	982	1068	296
90°	2	161	438	657	737	9
95°	2	42	227	411	475	1
105°	4	5	37	110	147	4
115°	5	5	7	20	28	3
125°	0	0	0	0	0	0
135°	0	0	0	0	0	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517686

CATALOG NUMBER: HVL12-8-LD4-3HI-40-UNV-O-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	7517.0	7517.0	7517.0	7517.0	7517.0
2.5°	7525.9	7515.3	7481.6	7515.3	7513.5
5°	7501.1	7486.9	7453.3	7488.7	7488.7
7.5°	7451.5	7446.2	7416.0	7456.8	7456.8
10°	7393.0	7391.2	7366.4	7410.7	7412.5
12.5°	7311.5	7318.6	7295.5	7338.1	7343.4
15°	7215.8	7228.2	7208.7	7249.5	7247.7
17.5°	7111.2	7118.3	7104.2	7150.2	7148.5
20°	6981.9	6990.7	6980.1	7028.0	7033.3
22.5°	6838.4	6850.8	6849.0	6898.6	6912.8
25°	6686.0	6691.3	6698.4	6755.1	6765.7
27.5°	6517.6	6526.5	6538.9	6590.3	6600.9
30°	6333.3	6347.5	6361.7	6414.8	6429.0
32.5°	6138.4	6152.6	6170.3	6239.4	6246.5
35°	5918.7	5945.2	5970.0	6030.3	6055.1
37.5°	5698.9	5732.6	5755.6	5819.4	5838.9
40°	5466.8	5500.5	5537.7	5605.0	5617.4
42.5°	5224.0	5263.0	5307.3	5367.5	5388.8
45°	4979.5	5023.8	5064.5	5114.1	5139.0
47.5°	4715.4	4759.7	4809.4	4866.1	4882.0
50°	4442.5	4493.9	4547.1	4600.3	4628.6
52.5°	4162.6	4224.6	4284.8	4341.5	4368.1
55°	3886.1	3932.2	4004.8	4063.3	4089.9
57.5°	3599.0	3638.0	3703.6	3799.3	3813.5
60°	3306.7	3342.1	3409.4	3487.4	3519.3
62.5°	2984.1	3032.0	3102.9	3202.1	3230.5
65°	2670.5	2716.6	2810.5	2922.1	2968.2
67.5°	2367.5	2383.4	2503.9	2620.9	2695.3
70°	2009.5	2069.8	2209.8	2353.3	2410.0
72.5°	1701.2	1761.4	1915.6	2083.9	2154.8
75°	1352.1	1435.4	1644.5	1841.2	1910.3
77.5°	1045.5	1137.7	1396.4	1594.8	1674.6
80°	730.1	873.6	1155.4	1378.7	1465.5
82.5°	459.0	636.2	937.4	1171.3	1247.5
85°	233.9	432.4	742.5	981.7	1068.5
87.5°	62.0	280.0	577.7	806.3	894.9
90°	1.8	161.3	437.7	657.4	737.2
92.5°	1.8	90.4	326.1	522.8	604.3
95°	1.8	42.5	226.8	411.1	474.9
97.5°	1.8	17.7	155.9	310.1	373.9
100°	1.8	8.9	99.2	225.1	280.0
102.5°	3.5	5.3	62.0	161.3	205.6
105°	3.5	5.3	37.2	109.9	147.1
107.5°	3.5	5.3	21.3	74.4	101.0
110°	5.3	5.3	12.4	46.1	67.3

TEST NUMBER: P517686

CATALOG NUMBER: HVL12-8-LD4-3HI-40-UNV-O-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	5.3	5.3	7.1	30.1	44.3
115°	5.3	5.3	7.1	19.5	28.4
117.5°	0.0	0.0	0.0	0.0	0.0
120°	0.0	0.0	0.0	0.0	0.0
122.5°	0.0	0.0	0.0	0.0	0.0
125°	0.0	0.0	0.0	0.0	0.0
127.5°	0.0	0.0	0.0	0.0	0.0
130°	0.0	0.0	0.0	0.0	0.0
132.5°	0.0	0.0	0.0	0.0	0.0
135°	0.0	0.0	0.0	0.0	0.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)