

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517702

Luminaire Tested: HVL12-8-LD4-3LO-40-UNV-O-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517702
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-8-LD4-3LO-40-UNV-O-EDD
Description: 8 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 4000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 13711.0 lumens
Efficiency: N/A
Efficacy: 99.1 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.27 / 1.38
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 8' x H: 0.17')
CIE Type: Direct


Input Watts (W): 138.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517702

CATALOG NUMBER: HVL12-8-LD4-3LO-40-UNV-O-EDD

Luminous Intensity Polar Plot

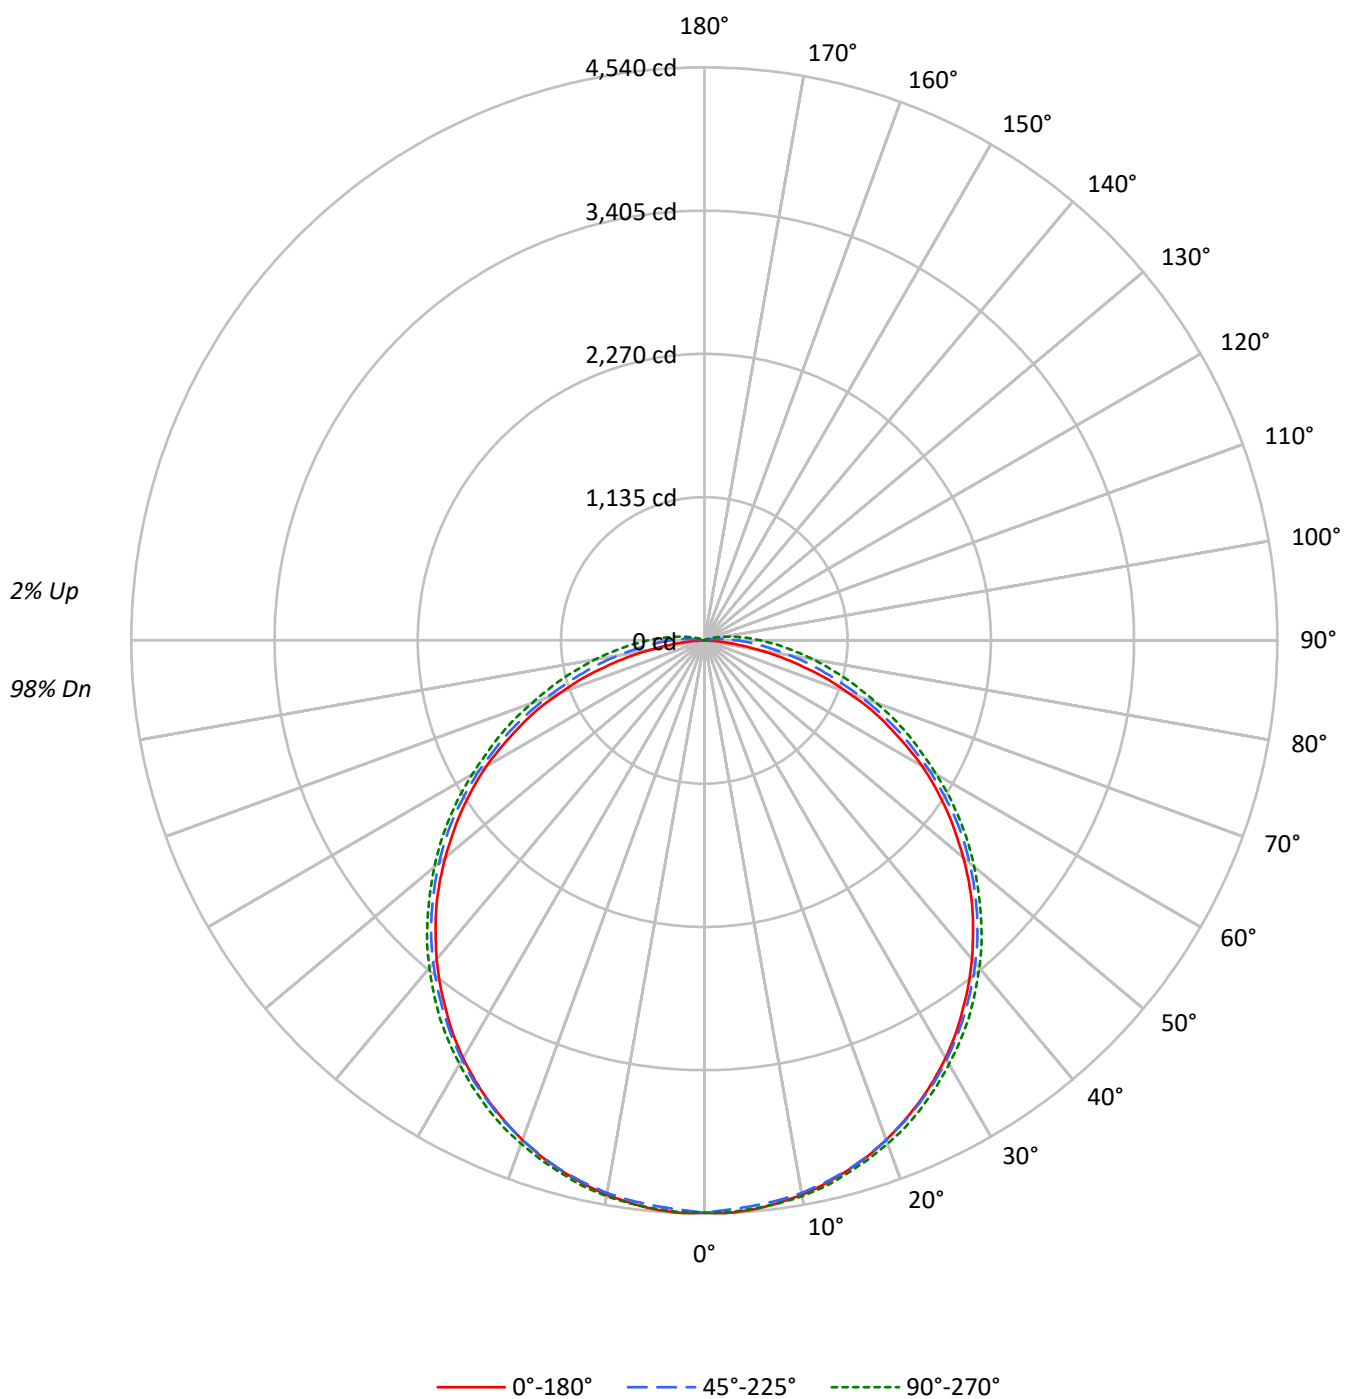

TEST NUMBER: P517702

CATALOG NUMBER: HVL12-8-LD4-3LO-40-UNV-O-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			98
1	108	102	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	77	73	79	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	52	62	56	51	60	54	50			47
5	75	61	52	45	72	60	52	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	40	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6102	6102	6102
5°	6101	6003	6014
10°	6071	5933	5935
15°	6030	5850	5830
20°	5985	5752	5728
25°	5930	5650	5622
30°	5865	5539	5497
35°	5780	5413	5373
40°	5693	5280	5222
45°	5599	5133	5056
50°	5474	4958	4876
55°	5341	4765	4675
60°	5181	4501	4433
65°	4910	4203	4199
70°	4511	3844	3923
75°	3935	3450	3693
80°	3052	3082	3521
85°	1759	2749	3425

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5599 cd/sqm

TEST NUMBER: P517702

CATALOG NUMBER: HVL12-8-LD4-3LO-40-UNV-O-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	429.1	3.1
10°-20°	1230.9	9.0
20°-30°	1867.7	13.6
30°-40°	2258.4	16.5
40°-50°	2356.5	17.2
50°-60°	2154.5	15.7
60°-70°	1679.6	12.2
70°-80°	1050.6	7.7
80°-90°	477.2	3.5
90°-100°	159.9	1.2
100°-110°	40.1	0.3
110°-120°	6.3	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3527.8	25.7
0°-40°	5786.2	42.2
0°-60°	10297.2	75.1
0°-90°	13504.6	98.5
90°-120°	206.4	1.5
90°-150°	206.4	1.5
90°-180°	206.0	1.5
0°-180°	13711.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4535	4535	4535	4535	4535	
5°	4525	4517	4496	4518	4518	430
15°	4353	4360	4349	4373	4372	1229
25°	4033	4037	4041	4075	4082	1859
35°	3570	3587	3602	3638	3653	2235
45°	3004	3031	3055	3085	3100	2315
55°	2344	2372	2416	2451	2467	2094
65°	1611	1639	1696	1763	1791	1594
75°	816	866	992	1111	1152	870
85°	141	261	448	592	645	179
90°	1	97	264	397	445	6
95°	1	26	137	248	286	1
105°	2	3	22	66	89	2
115°	3	3	4	12	17	2
125°	0	0	0	0	0	0
135°	0	0	0	0	0	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517702

CATALOG NUMBER: HVL12-8-LD4-3LO-40-UNV-O-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4534.8	4534.8	4534.8	4534.8	4534.8
2.5°	4540.1	4533.7	4513.4	4533.7	4532.6
5°	4525.1	4516.6	4496.3	4517.7	4517.7
7.5°	4495.2	4492.0	4473.8	4498.4	4498.4
10°	4459.9	4458.9	4443.9	4470.6	4471.7
12.5°	4410.8	4415.0	4401.1	4426.8	4430.0
15°	4353.0	4360.5	4348.8	4373.3	4372.3
17.5°	4290.0	4294.2	4285.7	4313.5	4312.4
20°	4211.9	4217.3	4210.9	4239.7	4242.9
22.5°	4125.3	4132.8	4131.8	4161.7	4170.2
25°	4033.4	4036.6	4040.9	4075.1	4081.5
27.5°	3931.8	3937.2	3944.7	3975.7	3982.1
30°	3820.7	3829.2	3837.8	3869.8	3878.4
32.5°	3703.1	3711.6	3722.3	3764.0	3768.3
35°	3570.5	3586.6	3601.5	3637.9	3652.8
37.5°	3438.0	3458.3	3472.2	3510.7	3522.4
40°	3297.9	3318.2	3340.7	3381.3	3388.8
42.5°	3151.5	3175.0	3201.7	3238.1	3250.9
45°	3003.9	3030.7	3055.3	3085.2	3100.1
47.5°	2844.7	2871.4	2901.3	2935.5	2945.1
50°	2680.0	2711.0	2743.1	2775.2	2792.3
52.5°	2511.1	2548.5	2584.9	2619.1	2635.1
55°	2344.4	2372.1	2416.0	2451.3	2467.3
57.5°	2171.2	2194.7	2234.2	2292.0	2300.5
60°	1994.8	2016.2	2056.8	2103.8	2123.1
62.5°	1800.2	1829.1	1871.8	1931.7	1948.8
65°	1611.0	1638.8	1695.5	1762.8	1790.6
67.5°	1428.2	1437.8	1510.5	1581.1	1626.0
70°	1212.3	1248.6	1333.1	1419.7	1453.9
72.5°	1026.3	1062.6	1155.6	1257.2	1299.9
75°	815.7	865.9	992.0	1110.7	1152.4
77.5°	630.7	686.3	842.4	962.1	1010.2
80°	440.4	527.0	697.0	831.7	884.1
82.5°	276.9	383.8	565.5	706.6	752.6
85°	141.1	260.8	447.9	592.2	644.6
87.5°	37.4	168.9	348.5	486.4	539.9
90°	1.1	97.3	264.0	396.6	444.7
92.5°	1.1	54.5	196.7	315.4	364.5
95°	1.1	25.7	136.8	248.0	286.5
97.5°	1.1	10.7	94.1	187.1	225.6
100°	1.1	5.3	59.9	135.8	168.9
102.5°	2.1	3.2	37.4	97.3	124.0
105°	2.1	3.2	22.4	66.3	88.7
107.5°	2.1	3.2	12.8	44.9	60.9
110°	3.2	3.2	7.5	27.8	40.6

TEST NUMBER: P517702

CATALOG NUMBER: HVL12-8-LD4-3LO-40-UNV-O-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	3.2	3.2	4.3	18.2	26.7
115°	3.2	3.2	4.3	11.8	17.1
117.5°	0.0	0.0	0.0	0.0	0.0
120°	0.0	0.0	0.0	0.0	0.0
122.5°	0.0	0.0	0.0	0.0	0.0
125°	0.0	0.0	0.0	0.0	0.0
127.5°	0.0	0.0	0.0	0.0	0.0
130°	0.0	0.0	0.0	0.0	0.0
132.5°	0.0	0.0	0.0	0.0	0.0
135°	0.0	0.0	0.0	0.0	0.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)