

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517706

Luminaire Tested: HVL12-8-LD4-3LO-50-UNV-O-EDD

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517706
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL12-8-LD4-3LO-50-UNV-O-EDD
Description: 8 FOOT, 12 INCH WIDE, HVL LED LUMINAIRE, WITH 5000K, 80 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 14437.0 lumens
Efficiency: N/A
Efficacy: 104.3 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.27 / 1.38
Luminous Opening: Rectangular w/ Sides (W: 1' x L: 8' x H: 0.17')
CIE Type: Direct


Input Watts (W): 138.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517706

CATALOG NUMBER: HVL12-8-LD4-3LO-50-UNV-O-EDD

Luminous Intensity Polar Plot

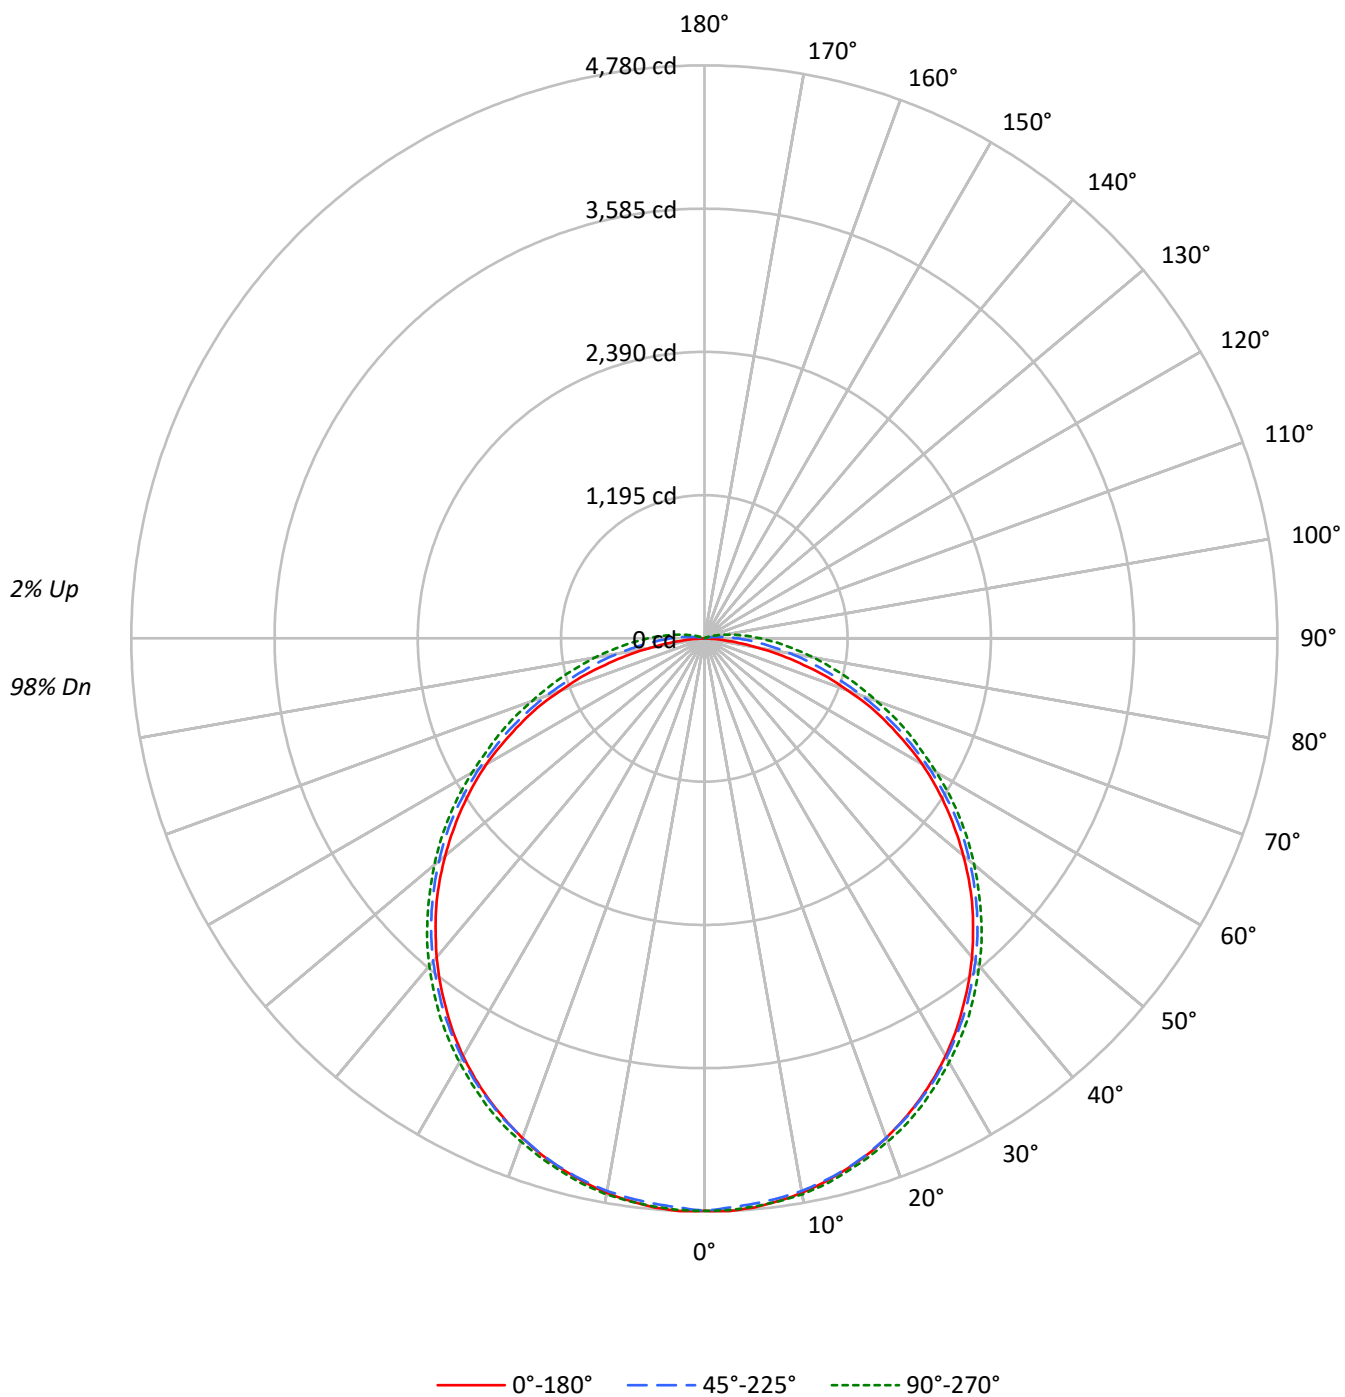

TEST NUMBER: P517706

CATALOG NUMBER: HVL12-8-LD4-3LO-50-UNV-O-EDD

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101			98
1	108	102	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83			81
2	98	89	82	76	95	87	80	75	83	77	73	79	75	71	76	72	69			67
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58			56
4	81	69	60	53	79	67	59	52	65	57	52	62	56	51	60	54	50			47
5	75	61	52	45	72	60	52	45	58	50	44	56	49	44	54	48	43			41
6	69	55	46	40	67	54	46	39	52	45	39	50	44	38	49	43	38			36
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34			32
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30			28
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27			25
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25			23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	6425	6425	6425
5°	6424	6321	6332
10°	6393	6247	6249
15°	6349	6159	6139
20°	6302	6056	6031
25°	6244	5949	5920
30°	6176	5832	5788
35°	6086	5700	5657
40°	5994	5560	5498
45°	5896	5405	5324
50°	5764	5221	5134
55°	5623	5017	4922
60°	5455	4739	4668
65°	5170	4425	4422
70°	4750	4047	4130
75°	4142	3633	3889
80°	3214	3246	3708
85°	1853	2894	3606

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5896 cd/sqm

TEST NUMBER: P517706

CATALOG NUMBER: HVL12-8-LD4-3LO-50-UNV-O-EDD

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	451.9	3.1
10°-20°	1296.1	9.0
20°-30°	1966.6	13.6
30°-40°	2378.0	16.5
40°-50°	2481.2	17.2
50°-60°	2268.6	15.7
60°-70°	1768.5	12.2
70°-80°	1106.3	7.7
80°-90°	502.5	3.5
90°-100°	168.4	1.2
100°-110°	42.3	0.3
110°-120°	6.7	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3714.6	25.7
0°-40°	6092.6	42.2
0°-60°	10842.4	75.1
0°-90°	14219.6	98.5
90°-120°	217.4	1.5
90°-150°	217.4	1.5
90°-180°	217.0	1.5
0°-180°	14437.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4775	4775	4775	4775	4775	
5°	4765	4756	4734	4757	4757	452
15°	4584	4591	4579	4605	4604	1294
25°	4247	4250	4255	4291	4298	1957
35°	3760	3776	3792	3830	3846	2353
45°	3163	3191	3217	3248	3264	2437
55°	2468	2498	2544	2581	2598	2205
65°	1696	1726	1785	1856	1885	1678
75°	859	912	1045	1170	1213	916
85°	149	275	472	624	679	188
90°	1	102	278	418	468	6
95°	1	27	144	261	302	1
105°	2	3	24	70	93	2
115°	3	3	4	12	18	2
125°	0	0	0	0	0	0
135°	0	0	0	0	0	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517706

CATALOG NUMBER: HVL12-8-LD4-3LO-50-UNV-O-EDD

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4774.9	4774.9	4774.9	4774.9	4774.9
2.5°	4780.5	4773.8	4752.4	4773.8	4772.6
5°	4764.8	4755.8	4734.4	4756.9	4756.9
7.5°	4733.2	4729.9	4710.7	4736.6	4736.6
10°	4696.1	4695.0	4679.2	4707.4	4708.5
12.5°	4644.3	4648.8	4634.2	4661.2	4664.6
15°	4583.5	4591.4	4579.0	4604.9	4603.8
17.5°	4517.1	4521.6	4512.6	4541.9	4540.8
20°	4434.9	4440.6	4433.8	4464.2	4467.6
22.5°	4343.8	4351.7	4350.5	4382.0	4391.1
25°	4247.0	4250.3	4254.9	4290.9	4297.6
27.5°	4140.0	4145.7	4153.5	4186.2	4192.9
30°	4023.0	4032.0	4041.0	4074.8	4083.8
32.5°	3899.2	3908.2	3919.4	3963.3	3967.8
35°	3759.6	3776.5	3792.2	3830.5	3846.2
37.5°	3620.0	3641.4	3656.0	3696.5	3708.9
40°	3472.5	3493.9	3517.6	3560.3	3568.2
42.5°	3318.3	3343.1	3371.2	3409.5	3423.0
45°	3163.0	3191.1	3217.0	3248.5	3264.3
47.5°	2995.3	3023.4	3054.9	3091.0	3101.1
50°	2821.9	2854.6	2888.3	2922.1	2940.1
52.5°	2644.1	2683.5	2721.8	2757.8	2774.7
55°	2468.5	2497.8	2543.9	2581.1	2597.9
57.5°	2286.1	2310.9	2352.5	2413.3	2422.3
60°	2100.4	2122.9	2165.7	2215.2	2235.5
62.5°	1895.5	1925.9	1971.0	2034.0	2052.0
65°	1696.3	1725.6	1785.2	1856.2	1885.4
67.5°	1503.8	1514.0	1590.5	1664.8	1712.1
70°	1276.5	1314.7	1403.7	1494.8	1530.8
72.5°	1080.6	1118.9	1216.8	1323.7	1368.8
75°	858.8	911.8	1044.6	1169.5	1213.4
77.5°	664.1	722.6	887.0	1013.1	1063.7
80°	463.8	554.9	733.9	875.7	930.9
82.5°	291.5	404.1	595.5	744.0	792.4
85°	148.6	274.7	471.6	623.6	678.7
87.5°	39.4	177.8	367.0	512.2	568.4
90°	1.1	102.4	278.0	417.6	468.3
92.5°	1.1	57.4	207.1	332.1	383.8
95°	1.1	27.0	144.1	261.1	301.7
97.5°	1.1	11.3	99.1	197.0	237.5
100°	1.1	5.6	63.0	143.0	177.8
102.5°	2.3	3.4	39.4	102.4	130.6
105°	2.3	3.4	23.6	69.8	93.4
107.5°	2.3	3.4	13.5	47.3	64.2
110°	3.4	3.4	7.9	29.3	42.8

TEST NUMBER: P517706

CATALOG NUMBER: HVL12-8-LD4-3LO-50-UNV-O-EDD

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	3.4	3.4	4.5	19.1	28.1
115°	3.4	3.4	4.5	12.4	18.0
117.5°	0.0	0.0	0.0	0.0	0.0
120°	0.0	0.0	0.0	0.0	0.0
122.5°	0.0	0.0	0.0	0.0	0.0
125°	0.0	0.0	0.0	0.0	0.0
127.5°	0.0	0.0	0.0	0.0	0.0
130°	0.0	0.0	0.0	0.0	0.0
132.5°	0.0	0.0	0.0	0.0	0.0
135°	0.0	0.0	0.0	0.0	0.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)