

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517745

Luminaire Tested: HVL8-1-LD4-1LO-35-UNV-O-EDD-90

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517745
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL8-1-LD4-1LO-35-UNV-O-EDD-90
Description: 1 FOOT, 8 INCH WIDE, HVL LED LUMINAIRE, WITH 3500K, 90 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 646.0 lumens
Efficiency: N/A
Efficacy: 111.4 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.27 / 1.38
Luminous Opening: Rectangular w/ Sides (W: 0.67' x L: 1' x H: 0.17')
CIE Type: Direct


Input Watts (W): 5.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517745

CATALOG NUMBER: HVL8-1-LD4-1LO-35-UNV-O-EDD-90

Luminous Intensity Polar Plot

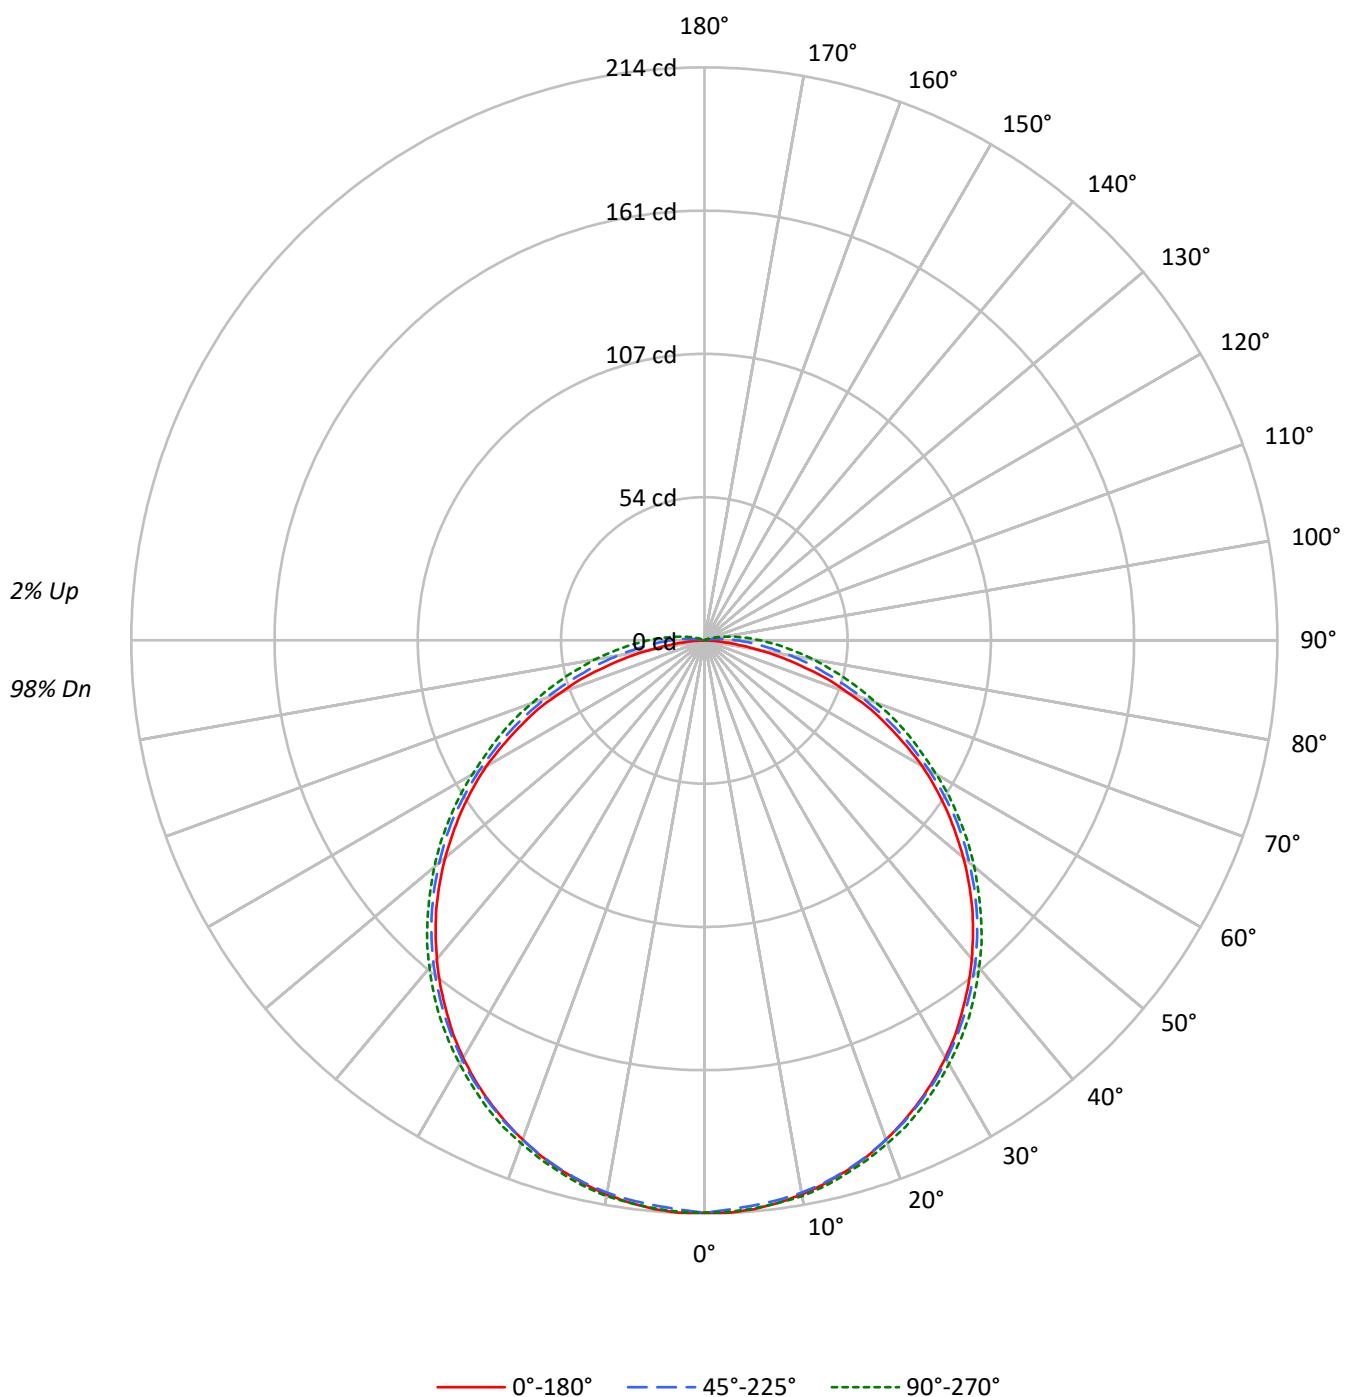

TEST NUMBER: P517745

CATALOG NUMBER: HVL8-1-LD4-1LO-35-UNV-O-EDD-90

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	110	110	110		105	105	105		98
1	108	102	98	94	105	100	96	92	95	92	89		91	88	86		81
2	98	89	82	76	95	87	80	75	83	77	73		79	75	71		67
3	89	78	69	63	86	76	68	62	73	66	61		70	64	59		56
4	81	69	60	53	79	67	59	52	65	57	52		62	56	51		47
5	75	61	52	45	72	60	52	45	58	50	44		56	49	44		41
6	69	55	46	40	67	54	46	39	52	45	39		50	44	38		36
7	64	50	41	35	62	49	41	35	47	40	34		46	39	34		32
8	59	46	37	31	58	45	37	31	43	36	31		42	35	30		28
9	55	42	34	28	54	41	33	28	40	33	28		39	32	27		25
10	52	39	31	25	51	38	30	25	37	30	25		36	29	25		23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3450	3450	3450
5°	3406	3346	3377
10°	3346	3264	3309
15°	3282	3174	3227
20°	3214	3079	3148
25°	3141	2982	3068
30°	3061	2881	2976
35°	2969	2773	2887
40°	2873	2660	2782
45°	2769	2538	2669
50°	2647	2402	2547
55°	2512	2255	2410
60°	2355	2072	2253
65°	2136	1870	2099
70°	1849	1638	1917
75°	1477	1387	1752
80°	994	1142	1603
85°	421	895	1460

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2769 cd/sqm

TEST NUMBER: P517745

CATALOG NUMBER: HVL8-1-LD4-1LO-35-UNV-O-EDD-90

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	20.2	3.1
10°-20°	58.0	9.0
20°-30°	88.0	13.6
30°-40°	106.4	16.5
40°-50°	111.0	17.2
50°-60°	101.5	15.7
60°-70°	79.1	12.2
70°-80°	49.5	7.7
80°-90°	22.5	3.5
90°-100°	7.5	1.2
100°-110°	1.9	0.3
110°-120°	0.3	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	166.2	25.7
0°-40°	272.6	42.2
0°-60°	485.2	75.1
0°-90°	636.3	98.5
90°-120°	9.8	1.5
90°-150°	9.8	1.5
90°-180°	10.0	1.5
0°-180°	646.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	214	214	214	214	214	
5°	213	213	212	213	213	20
15°	205	205	205	206	206	58
25°	190	190	190	192	192	88
35°	168	169	170	171	172	105
45°	142	143	144	145	146	109
55°	110	112	114	116	116	99
65°	76	77	80	83	84	75
75°	38	41	47	52	54	41
85°	7	12	21	28	30	8
90°	0	5	12	19	21	0
95°	0	1	6	12	14	0
105°	0	0	1	3	4	0
115°	0	0	0	1	1	0
125°	0	0	0	0	0	0
135°	0	0	0	0	0	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517745

CATALOG NUMBER: HVL8-1-LD4-1LO-35-UNV-O-EDD-90

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	213.7	213.7	213.7	213.7	213.7
2.5°	213.9	213.6	212.7	213.6	213.6
5°	213.2	212.8	211.8	212.9	212.9
7.5°	211.8	211.6	210.8	211.9	211.9
10°	210.1	210.1	209.4	210.6	210.7
12.5°	207.8	208.0	207.4	208.6	208.7
15°	205.1	205.4	204.9	206.1	206.0
17.5°	202.1	202.3	201.9	203.2	203.2
20°	198.4	198.7	198.4	199.8	199.9
22.5°	194.4	194.7	194.7	196.1	196.5
25°	190.0	190.2	190.4	192.0	192.3
27.5°	185.3	185.5	185.9	187.3	187.6
30°	180.0	180.4	180.8	182.3	182.7
32.5°	174.5	174.9	175.4	177.3	177.5
35°	168.2	169.0	169.7	171.4	172.1
37.5°	162.0	162.9	163.6	165.4	166.0
40°	155.4	156.3	157.4	159.3	159.7
42.5°	148.5	149.6	150.8	152.6	153.2
45°	141.5	142.8	143.9	145.4	146.1
47.5°	134.0	135.3	136.7	138.3	138.8
50°	126.3	127.7	129.2	130.8	131.6
52.5°	118.3	120.1	121.8	123.4	124.2
55°	110.5	111.8	113.8	115.5	116.2
57.5°	102.3	103.4	105.3	108.0	108.4
60°	94.0	95.0	96.9	99.1	100.0
62.5°	84.8	86.2	88.2	91.0	91.8
65°	75.9	77.2	79.9	83.1	84.4
67.5°	67.3	67.7	71.2	74.5	76.6
70°	57.1	58.8	62.8	66.9	68.5
72.5°	48.4	50.1	54.4	59.2	61.2
75°	38.4	40.8	46.7	52.3	54.3
77.5°	29.7	32.3	39.7	45.3	47.6
80°	20.8	24.8	32.8	39.2	41.7
82.5°	13.0	18.1	26.6	33.3	35.5
85°	6.6	12.3	21.1	27.9	30.4
87.5°	1.8	8.0	16.4	22.9	25.4
90°	0.1	4.6	12.4	18.7	21.0
92.5°	0.1	2.6	9.3	14.9	17.2
95°	0.1	1.2	6.4	11.7	13.5
97.5°	0.1	0.5	4.4	8.8	10.6
100°	0.1	0.3	2.8	6.4	8.0
102.5°	0.1	0.2	1.8	4.6	5.8
105°	0.1	0.2	1.1	3.1	4.2
107.5°	0.1	0.2	0.6	2.1	2.9
110°	0.2	0.2	0.4	1.3	1.9

TEST NUMBER: P517745

CATALOG NUMBER: HVL8-1-LD4-1LO-35-UNV-O-EDD-90

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.2	0.2	0.2	0.9	1.3
115°	0.2	0.2	0.2	0.6	0.8
117.5°	0.0	0.0	0.0	0.0	0.0
120°	0.0	0.0	0.0	0.0	0.0
122.5°	0.0	0.0	0.0	0.0	0.0
125°	0.0	0.0	0.0	0.0	0.0
127.5°	0.0	0.0	0.0	0.0	0.0
130°	0.0	0.0	0.0	0.0	0.0
132.5°	0.0	0.0	0.0	0.0	0.0
135°	0.0	0.0	0.0	0.0	0.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)