

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P517945

Luminaire Tested: HVL8-2-LD4-2LO-50-UNV-O-EDD-90

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P517945
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL8-2-LD4-2LO-50-UNV-O-EDD-90
Description: 2 FOOT, 8 INCH WIDE, HVL LED LUMINAIRE, WITH 5000K, 90 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2192.0 lumens
Efficiency: N/A
Efficacy: 94.9 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.27 / 1.38
Luminous Opening: Rectangular w/ Sides (W: 0.67' x L: 2' x H: 0.17')
CIE Type: Direct


Input Watts (W): 23.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P517945

CATALOG NUMBER: HVL8-2-LD4-2LO-50-UNV-O-EDD-90

Luminous Intensity Polar Plot

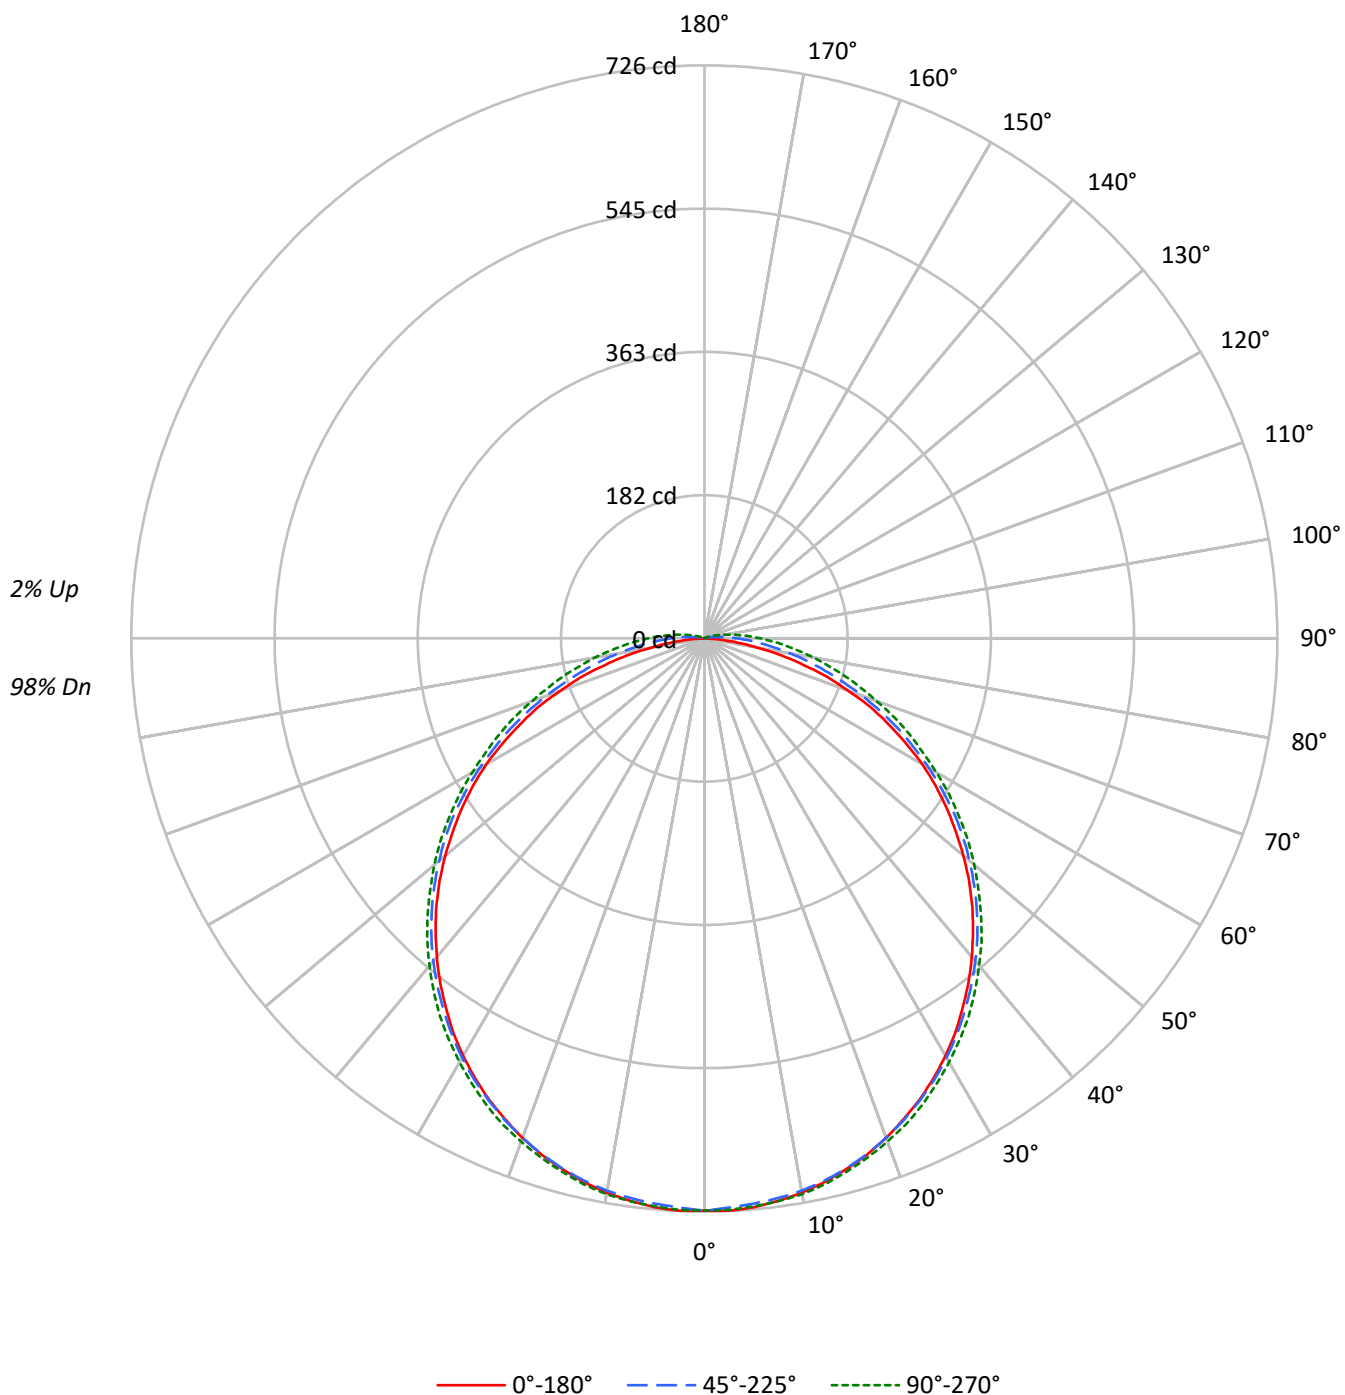

TEST NUMBER: P517945

CATALOG NUMBER: HVL8-2-LD4-2LO-50-UNV-O-EDD-90

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	110	110	110		105	105	105		101
1	108	102	98	94	105	100	96	92	95	92	89		91	88	86		87
2	98	89	82	76	95	87	80	75	83	77	73		79	75	71		76
3	89	78	69	63	86	76	68	62	73	66	61		70	64	59		67
4	81	69	60	53	79	67	59	52	65	57	52		62	56	51		60
5	75	61	52	45	72	60	52	45	58	50	44		56	49	44		54
6	69	55	46	40	67	54	46	39	52	45	39		50	44	38		49
7	64	50	41	35	62	49	41	35	47	40	34		46	39	34		44
8	59	46	37	31	58	45	37	31	43	36	31		42	35	30		41
9	55	42	34	28	54	41	33	28	40	33	28		39	32	27		38
10	52	39	31	25	51	38	30	25	37	30	25		36	29	25		35

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5853	5853	5853
5°	5820	5707	5727
10°	5760	5592	5613
15°	5689	5465	5475
20°	5615	5326	5341
25°	5529	5184	5205
30°	5432	5035	5050
35°	5315	4871	4898
40°	5193	4699	4720
45°	5061	4512	4526
50°	4895	4299	4319
55°	4714	4067	4090
60°	4499	3770	3824
65°	4175	3440	3560
70°	3722	3053	3252
75°	3102	2632	2972
80°	2222	2216	2717
85°	1072	1795	2475

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5061 cd/sqm

TEST NUMBER: P517945

CATALOG NUMBER: HVL8-2-LD4-2LO-50-UNV-O-EDD-90

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	68.6	3.1
10°-20°	196.8	9.0
20°-30°	298.6	13.6
30°-40°	361.1	16.5
40°-50°	376.7	17.2
50°-60°	344.4	15.7
60°-70°	268.5	12.2
70°-80°	168.0	7.7
80°-90°	76.3	3.5
90°-100°	25.6	1.2
100°-110°	6.4	0.3
110°-120°	1.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	564.0	25.7
0°-40°	925.0	42.2
0°-60°	1646.2	75.1
0°-90°	2159.0	98.5
90°-120°	33.0	1.5
90°-150°	33.0	1.5
90°-180°	33.0	1.5
0°-180°	2192.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	725	725	725	725	725	
5°	723	722	719	722	722	69
15°	696	697	695	699	699	196
25°	645	645	646	652	652	297
35°	571	573	576	582	584	357
45°	480	484	488	493	496	370
55°	375	379	386	392	394	335
65°	258	262	271	282	286	255
75°	130	138	159	178	184	139
85°	23	42	72	95	103	29
90°	0	16	42	63	71	1
95°	0	4	22	40	46	0
105°	0	0	4	11	14	0
115°	0	0	1	2	3	0
125°	0	0	0	0	0	0
135°	0	0	0	0	0	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P517945

CATALOG NUMBER: HVL8-2-LD4-2LO-50-UNV-O-EDD-90

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	725.0	725.0	725.0	725.0	725.0
2.5°	725.8	724.8	721.6	724.8	724.6
5°	723.4	722.1	718.8	722.2	722.2
7.5°	718.7	718.1	715.2	719.2	719.2
10°	713.0	712.8	710.5	714.7	714.9
12.5°	705.2	705.8	703.6	707.7	708.2
15°	695.9	697.1	695.2	699.2	699.0
17.5°	685.8	686.5	685.2	689.6	689.4
20°	673.4	674.2	673.2	677.8	678.3
22.5°	659.5	660.7	660.5	665.3	666.7
25°	644.8	645.3	646.0	651.5	652.5
27.5°	628.6	629.4	630.6	635.6	636.6
30°	610.8	612.2	613.6	618.7	620.0
32.5°	592.0	593.4	595.1	601.8	602.4
35°	570.8	573.4	575.8	581.6	584.0
37.5°	549.6	552.9	555.1	561.3	563.1
40°	527.2	530.5	534.1	540.6	541.8
42.5°	503.8	507.6	511.9	517.7	519.7
45°	480.2	484.5	488.4	493.2	495.6
47.5°	454.8	459.1	463.8	469.3	470.8
50°	428.5	433.4	438.5	443.7	446.4
52.5°	401.5	407.4	413.2	418.7	421.3
55°	374.8	379.2	386.2	391.9	394.4
57.5°	347.1	350.9	357.2	366.4	367.8
60°	318.9	322.3	328.8	336.3	339.4
62.5°	287.8	292.4	299.3	308.8	311.6
65°	257.6	262.0	271.1	281.8	286.3
67.5°	228.3	229.9	241.5	252.8	259.9
70°	193.8	199.6	213.1	227.0	232.4
72.5°	164.1	169.9	184.7	201.0	207.8
75°	130.4	138.4	158.6	177.6	184.2
77.5°	100.8	109.7	134.7	153.8	161.5
80°	70.4	84.3	111.4	133.0	141.3
82.5°	44.3	61.4	90.4	113.0	120.3
85°	22.6	41.7	71.6	94.7	103.1
87.5°	6.0	27.0	55.7	77.8	86.3
90°	0.2	15.6	42.2	63.4	71.1
92.5°	0.2	8.7	31.4	50.4	58.3
95°	0.2	4.1	21.9	39.7	45.8
97.5°	0.2	1.7	15.0	29.9	36.1
100°	0.2	0.9	9.6	21.7	27.0
102.5°	0.3	0.5	6.0	15.6	19.8
105°	0.3	0.5	3.6	10.6	14.2
107.5°	0.3	0.5	2.1	7.2	9.7
110°	0.5	0.5	1.2	4.4	6.5

TEST NUMBER: P517945

CATALOG NUMBER: HVL8-2-LD4-2LO-50-UNV-O-EDD-90

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	0.5	0.5	0.7	2.9	4.3
115°	0.5	0.5	0.7	1.9	2.7
117.5°	0.0	0.0	0.0	0.0	0.0
120°	0.0	0.0	0.0	0.0	0.0
122.5°	0.0	0.0	0.0	0.0	0.0
125°	0.0	0.0	0.0	0.0	0.0
127.5°	0.0	0.0	0.0	0.0	0.0
130°	0.0	0.0	0.0	0.0	0.0
132.5°	0.0	0.0	0.0	0.0	0.0
135°	0.0	0.0	0.0	0.0	0.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)