

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: FAIL-SAFE

Report Number: P518233

Luminaire Tested: HVL8-8-LD4-2LO-50-UNV-O-EDD-90

Issue Date: 4/27/2021

Tested By:

Approved By:



NVLAP Lab Code: 200050-0

Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-2019
Report Number: P518233
Test Lab: INNOVATION CENTER
Issue Date: 4/27/2021
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: FAIL-SAFE
Catalog Number: HVL8-8-LD4-2LO-50-UNV-O-EDD-90
Description: 8 FOOT, 8 INCH WIDE, HVL LED LUMINAIRE, WITH 5000K, 90 CRI LEDS
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8769.0 lumens
Efficiency: N/A
Efficacy: 95.1 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.27 / 1.38
Luminous Opening: Rectangular w/ Sides (W: 0.67' x L: 8' x H: 0.17')
CIE Type: Direct


Input Watts (W): 92.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	P3	10/30/2015	4/30/2016
Power Meter	IN0214	1/12/2016	1/12/2017
AC Power Source	IN0062	1/12/2016	1/12/2017
DC Power Supply	--	--	--
Room Thermometer	IN0145	1/13/2016	1/13/2017

TEST NUMBER: P518233

CATALOG NUMBER: HVL8-8-LD4-2LO-50-UNV-O-EDD-90

Luminous Intensity Polar Plot

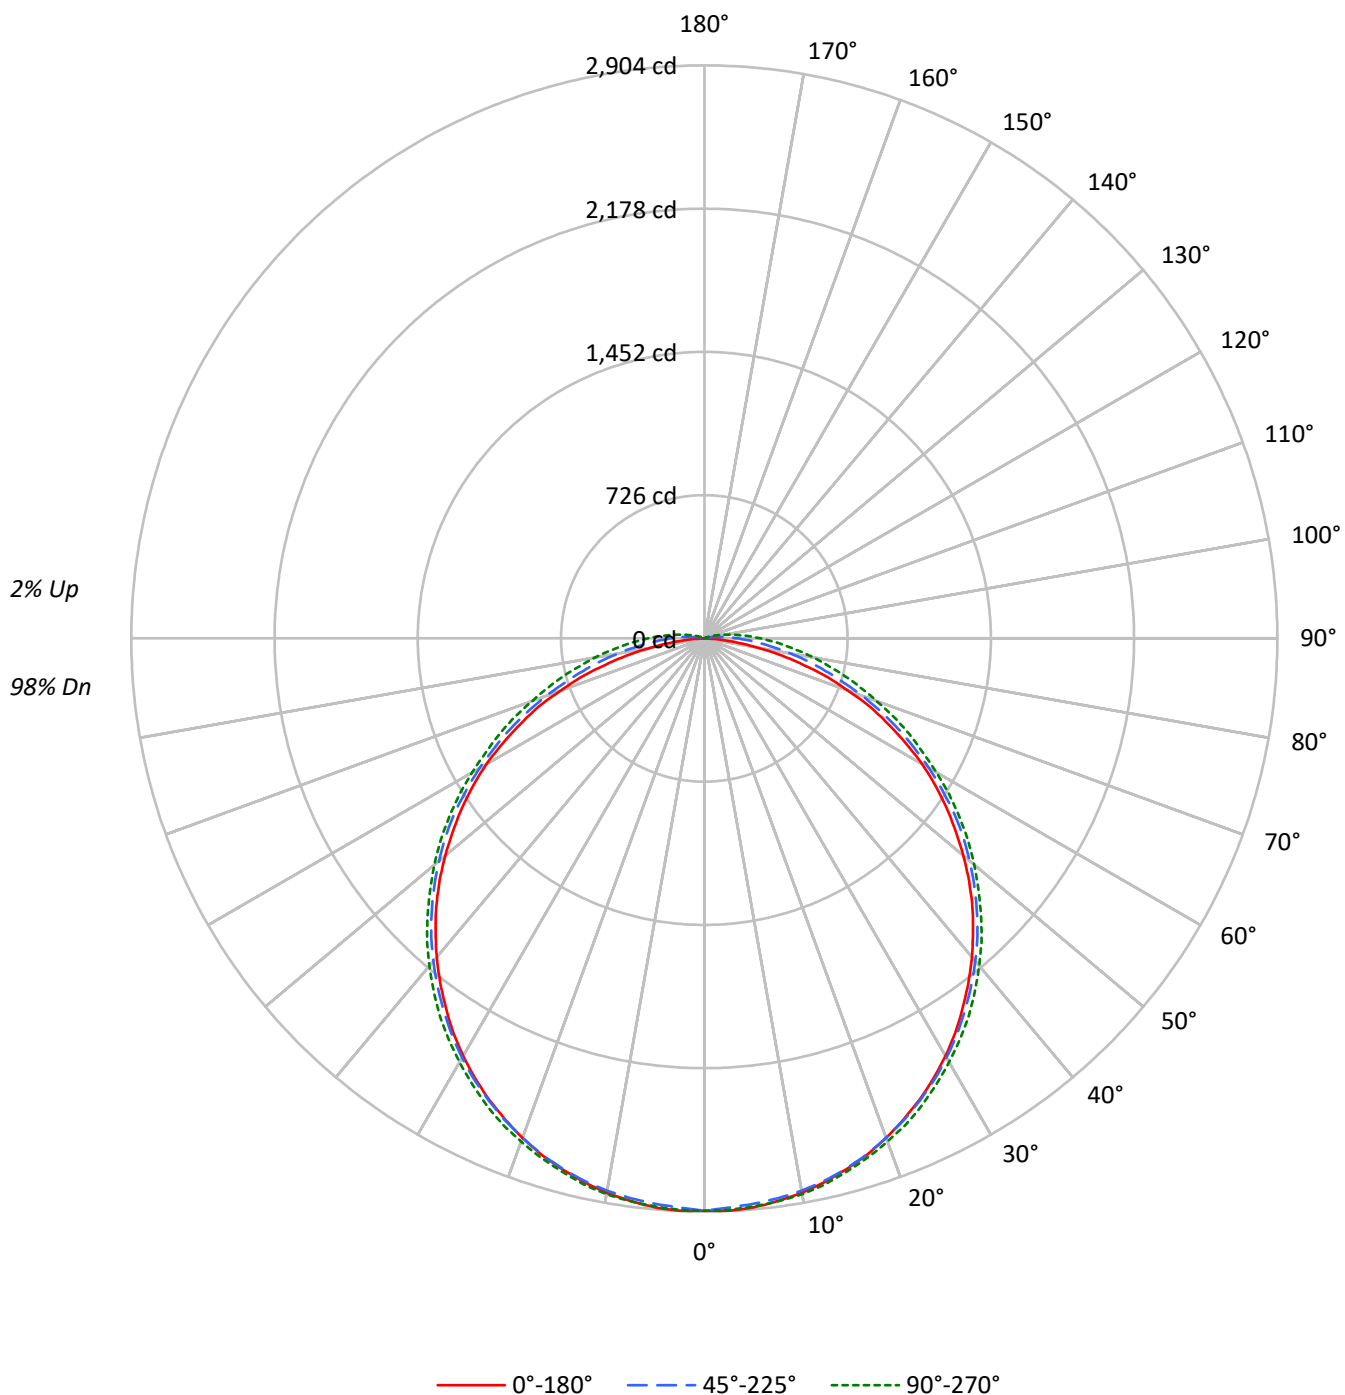

TEST NUMBER: P518233

CATALOG NUMBER: HVL8-8-LD4-2LO-50-UNV-O-EDD-90

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	119	119	119	119	116	116	116	116	110	110	110	105	105	105	101	101	101
1	108	102	98	94	105	100	96	92	95	92	89	91	88	86	87	85	83
2	98	89	82	76	95	87	80	75	83	77	73	79	75	71	76	72	69
3	89	78	69	63	86	76	68	62	73	66	61	70	64	59	67	62	58
4	81	69	60	53	79	67	59	52	65	57	52	62	56	51	60	54	50
5	75	61	52	45	72	60	52	45	58	50	44	56	49	44	54	48	43
6	69	55	46	40	67	54	46	39	52	45	39	50	44	38	49	43	38
7	64	50	41	35	62	49	41	35	47	40	34	46	39	34	44	38	34
8	59	46	37	31	58	45	37	31	43	36	31	42	35	30	41	35	30
9	55	42	34	28	54	41	33	28	40	33	28	39	32	27	38	32	27
10	52	39	31	25	51	38	30	25	37	30	25	36	29	25	35	29	25

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5853	5853	5853
5°	5853	5730	5728
10°	5824	5634	5613
15°	5785	5528	5476
20°	5742	5407	5342
25°	5689	5283	5206
30°	5627	5151	5051
35°	5545	5004	4898
40°	5461	4850	4720
45°	5372	4681	4527
50°	5251	4485	4320
55°	5123	4269	4091
60°	4970	3987	3824
65°	4710	3670	3560
70°	4327	3296	3252
75°	3775	2885	2973
80°	2928	2483	2718
85°	1687	2080	2475

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 5372 cd/sqm

TEST NUMBER: P518233

CATALOG NUMBER: HVL8-8-LD4-2LO-50-UNV-O-EDD-90

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	274.5	3.1
10°-20°	787.3	9.0
20°-30°	1194.5	13.6
30°-40°	1444.4	16.5
40°-50°	1507.1	17.2
50°-60°	1377.9	15.7
60°-70°	1074.2	12.2
70°-80°	672.0	7.7
80°-90°	305.2	3.5
90°-100°	102.3	1.2
100°-110°	25.7	0.3
110°-120°	4.1	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2256.2	25.7
0°-40°	3700.6	42.2
0°-60°	6585.7	75.1
0°-90°	8637.0	98.5
90°-120°	132.0	1.5
90°-150°	132.0	1.5
90°-180°	132.0	1.5
0°-180°	8769.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2900	2900	2900	2900	2900	
5°	2894	2889	2876	2889	2889	275
15°	2784	2789	2781	2797	2796	786
25°	2580	2582	2584	2606	2610	1189
35°	2284	2294	2303	2327	2336	1429
45°	1921	1938	1954	1973	1983	1480
55°	1499	1517	1545	1568	1578	1340
65°	1030	1048	1084	1127	1145	1019
75°	522	554	634	710	737	556
85°	90	167	286	379	412	114
90°	1	62	169	254	284	4
95°	1	16	88	159	183	1
105°	1	2	14	42	57	1
115°	2	2	3	8	11	1
125°	0	0	0	0	0	0
135°	0	0	0	0	0	0
145°	0	0	0	0	0	0
155°	0	0	0	0	0	0
165°	0	0	0	0	0	0
175°	0	0	0	0	0	0
180°	0	0	0	0	0	0

TEST NUMBER: P518233

CATALOG NUMBER: HVL8-8-LD4-2LO-50-UNV-O-EDD-90

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2900.3	2900.3	2900.3	2900.3	2900.3
2.5°	2903.7	2899.6	2886.6	2899.6	2898.9
5°	2894.1	2888.6	2875.6	2889.3	2889.3
7.5°	2875.0	2872.9	2861.3	2877.0	2877.0
10°	2852.4	2851.7	2842.1	2859.2	2859.9
12.5°	2820.9	2823.7	2814.8	2831.2	2833.3
15°	2784.0	2788.8	2781.3	2797.0	2796.3
17.5°	2743.7	2746.4	2741.0	2758.7	2758.0
20°	2693.8	2697.2	2693.1	2711.6	2713.6
22.5°	2638.4	2643.2	2642.5	2661.6	2667.1
25°	2579.6	2581.7	2584.4	2606.3	2610.4
27.5°	2514.6	2518.1	2522.9	2542.7	2546.8
30°	2443.5	2449.0	2454.5	2475.0	2480.5
32.5°	2368.3	2373.8	2380.6	2407.3	2410.0
35°	2283.6	2293.8	2303.4	2326.6	2336.2
37.5°	2198.8	2211.8	2220.7	2245.3	2252.8
40°	2109.2	2122.2	2136.6	2162.5	2167.3
42.5°	2015.5	2030.6	2047.7	2070.9	2079.1
45°	1921.2	1938.3	1954.0	1973.2	1982.7
47.5°	1819.3	1836.4	1855.6	1877.4	1883.6
50°	1714.0	1733.9	1754.4	1774.9	1785.8
52.5°	1606.0	1629.9	1653.2	1675.1	1685.3
55°	1499.4	1517.1	1545.2	1567.7	1578.0
57.5°	1388.6	1403.6	1428.9	1465.9	1471.3
60°	1275.8	1289.5	1315.4	1345.5	1357.8
62.5°	1151.4	1169.8	1197.2	1235.4	1246.4
65°	1030.3	1048.1	1084.3	1127.4	1145.2
67.5°	913.4	919.6	966.1	1011.2	1039.9
70°	775.3	798.6	852.6	908.0	929.8
72.5°	656.4	679.6	739.1	804.0	831.4
75°	521.7	553.8	634.5	710.4	737.0
77.5°	403.4	438.9	538.8	615.3	646.1
80°	281.7	337.1	445.8	531.9	565.4
82.5°	177.1	245.4	361.7	451.9	481.3
85°	90.2	166.8	286.5	378.8	412.3
87.5°	23.9	108.0	222.9	311.1	345.3
90°	0.7	62.2	168.9	253.7	284.4
92.5°	0.7	34.9	125.8	201.7	233.1
95°	0.7	16.4	87.5	158.6	183.2
97.5°	0.7	6.8	60.2	119.6	144.3
100°	0.7	3.4	38.3	86.8	108.0
102.5°	1.4	2.1	23.9	62.2	79.3
105°	1.4	2.1	14.4	42.4	56.7
107.5°	1.4	2.1	8.2	28.7	39.0
110°	2.1	2.1	4.8	17.8	26.0

TEST NUMBER: P518233

CATALOG NUMBER: HVL8-8-LD4-2LO-50-UNV-O-EDD-90

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	2.1	2.1	2.7	11.6	17.1
115°	2.1	2.1	2.7	7.5	10.9
117.5°	0.0	0.0	0.0	0.0	0.0
120°	0.0	0.0	0.0	0.0	0.0
122.5°	0.0	0.0	0.0	0.0	0.0
125°	0.0	0.0	0.0	0.0	0.0
127.5°	0.0	0.0	0.0	0.0	0.0
130°	0.0	0.0	0.0	0.0	0.0
132.5°	0.0	0.0	0.0	0.0	0.0
135°	0.0	0.0	0.0	0.0	0.0
137.5°	0.0	0.0	0.0	0.0	0.0
140°	0.0	0.0	0.0	0.0	0.0
142.5°	0.0	0.0	0.0	0.0	0.0
145°	0.0	0.0	0.0	0.0	0.0
147.5°	0.0	0.0	0.0	0.0	0.0
150°	0.0	0.0	0.0	0.0	0.0
152.5°	0.0	0.0	0.0	0.0	0.0
155°	0.0	0.0	0.0	0.0	0.0
157.5°	0.0	0.0	0.0	0.0	0.0
160°	0.0	0.0	0.0	0.0	0.0
162.5°	0.0	0.0	0.0	0.0	0.0
165°	0.0	0.0	0.0	0.0	0.0
167.5°	0.0	0.0	0.0	0.0	0.0
170°	0.0	0.0	0.0	0.0	0.0
172.5°	0.0	0.0	0.0	0.0	0.0
175°	0.0	0.0	0.0	0.0	0.0
177.5°	0.0	0.0	0.0	0.0	0.0
180°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)