

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P572879

Luminaire Tested: **FLD4C-25-D010 FEU4C-X-90-50 F4X-N-X-H-BL89BV**

Issue Date: 3/1/2023



**Test Information**

Test Method: LM-79-08  
Report Number: P572879  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207666)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/1/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: FLD4C-25-D010 FEU4C-X-90-50 F4X-N-X-H-BL89BV  
Description: 4 INCH FAIL-SAFE LED DOWNLIGHT WITH 5000K, 90 CRI LEDS, 4LBNH TRIM  
AND BOTTOM LENS, 0.125" CLEAR ACRYLIC  
  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1577.0 lumens  
Efficiency: N/A  
Efficacy: 50.1 lumens/watt  
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.85  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 31.5  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P572879

CATALOG NUMBER: FLD4C-25-D010 FEU4C-X-90-50 F4X-N-X-H-BL89BV

### Luminous Intensity Polar Plot

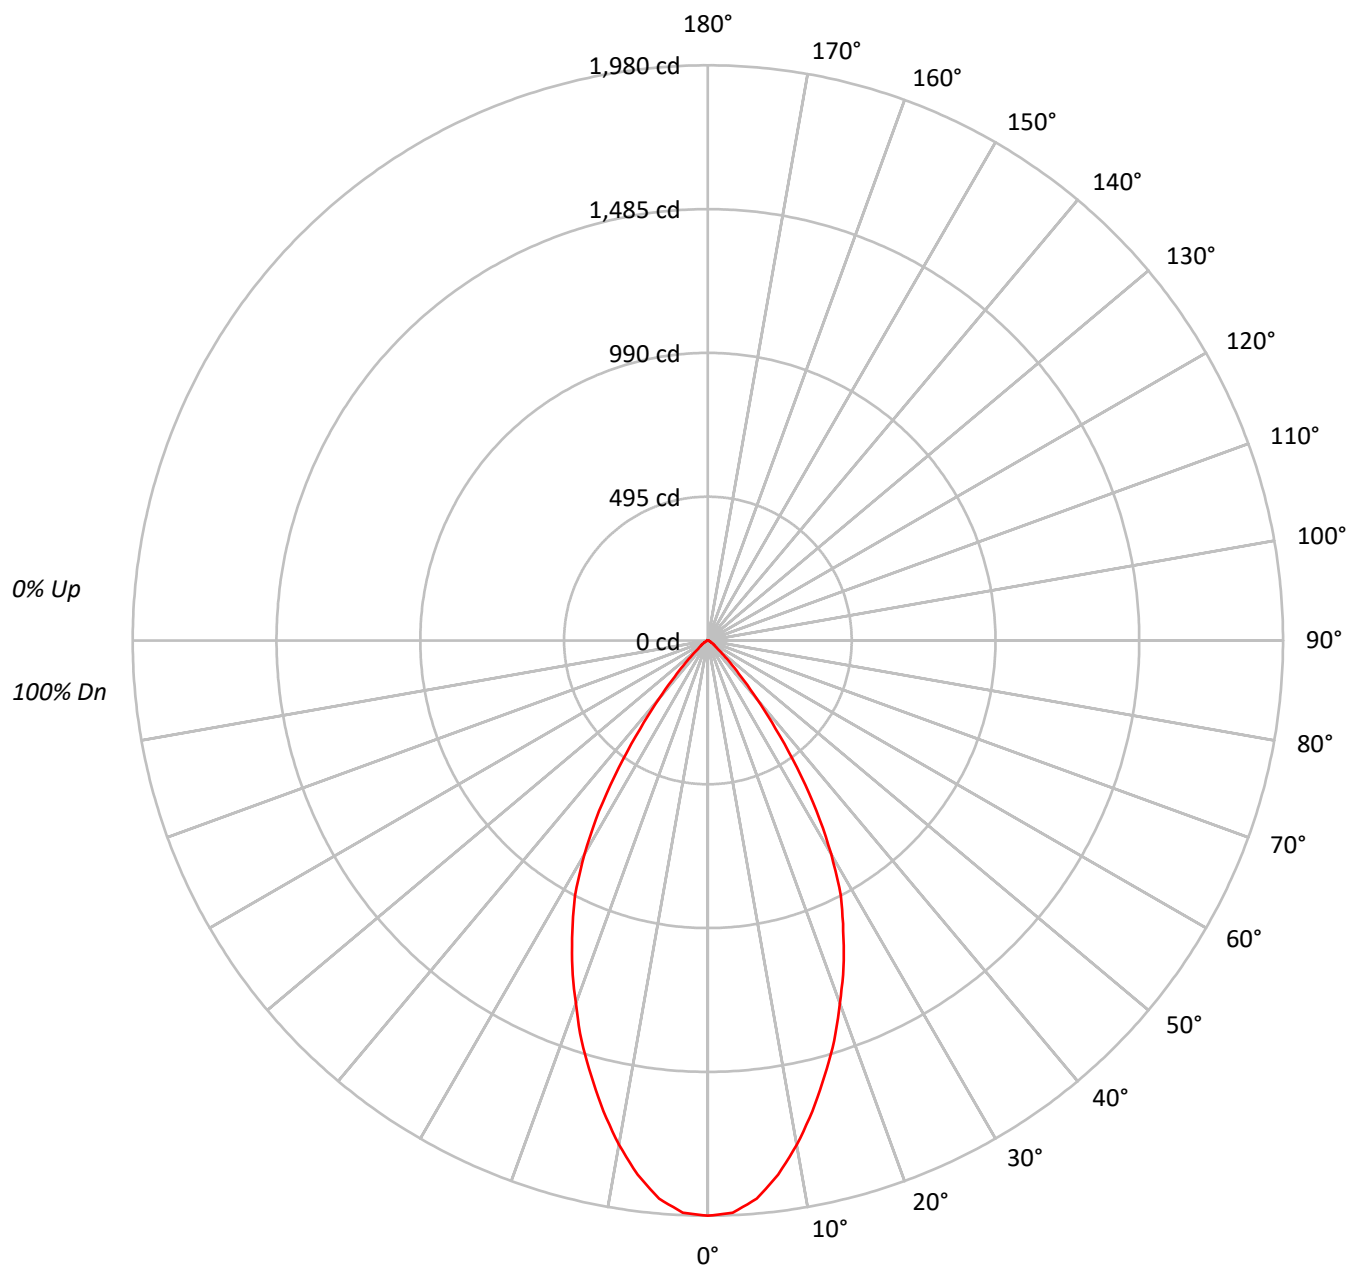

TEST NUMBER: P572879

CATALOG NUMBER: FLD4C-25-D010 FEU4C-X-90-50 F4X-N-X-H-BL89BV

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |  |  |  |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|---|--|--|--|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |    |    |   |  |  |  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |    |    | 0 |  |  |  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0 |  |  |  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |   |  |  |  |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |   |  |  |  |
| 1   | 113 | 111 | 108 | 106 | 111 | 109 | 106 | 104 | 105 | 103 | 101 | 101 | 99  | 98  | 97  | 96  | 95  | 93  |    |    |   |  |  |  |
| 2   | 108 | 103 | 99  | 96  | 106 | 101 | 98  | 94  | 98  | 95  | 92  | 95  | 93  | 90  | 92  | 90  | 89  | 87  |    |    |   |  |  |  |
| 3   | 102 | 96  | 91  | 87  | 100 | 95  | 90  | 86  | 92  | 88  | 85  | 90  | 86  | 84  | 87  | 85  | 82  | 81  |    |    |   |  |  |  |
| 4   | 97  | 90  | 84  | 80  | 95  | 89  | 83  | 79  | 86  | 82  | 78  | 84  | 81  | 78  | 83  | 79  | 77  | 75  |    |    |   |  |  |  |
| 5   | 92  | 84  | 78  | 74  | 91  | 83  | 78  | 73  | 81  | 76  | 73  | 80  | 75  | 72  | 78  | 74  | 72  | 70  |    |    |   |  |  |  |
| 6   | 88  | 79  | 73  | 69  | 86  | 78  | 72  | 68  | 77  | 72  | 68  | 75  | 71  | 67  | 74  | 70  | 67  | 65  |    |    |   |  |  |  |
| 7   | 83  | 74  | 68  | 64  | 82  | 73  | 68  | 64  | 72  | 67  | 63  | 71  | 66  | 63  | 70  | 66  | 63  | 61  |    |    |   |  |  |  |
| 8   | 79  | 70  | 64  | 60  | 78  | 69  | 64  | 60  | 68  | 63  | 59  | 67  | 63  | 59  | 66  | 62  | 59  | 58  |    |    |   |  |  |  |
| 9   | 76  | 66  | 60  | 56  | 74  | 65  | 60  | 56  | 65  | 59  | 56  | 64  | 59  | 56  | 63  | 59  | 55  | 54  |    |    |   |  |  |  |
| 10  | 72  | 62  | 57  | 53  | 71  | 62  | 56  | 53  | 61  | 56  | 53  | 60  | 56  | 52  | 60  | 55  | 52  | 51  |    |    |   |  |  |  |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°     |
|-----|--------|
| 0°  | 243250 |
| 5°  | 237840 |
| 10° | 219907 |
| 15° | 197318 |
| 20° | 173698 |
| 25° | 149489 |
| 30° | 120382 |
| 35° | 80132  |
| 40° | 41681  |
| 45° | 18868  |
| 50° | 8180   |
| 55° | 5505   |
| 60° | 3514   |
| 65° | 2500   |
| 70° | 2047   |
| 75° | 1377   |
| 80° | 0      |
| 85° | 0      |



TEST NUMBER: P572879

CATALOG NUMBER: FLD4C-25-D010 FEU4C-X-90-50 F4X-N-X-H-BL89BV

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 178.6  | 11.3      |
| 10°-20°   | 433.3  | 27.5      |
| 20°-30°   | 503.1  | 31.9      |
| 30°-40°   | 333.2  | 21.1      |
| 40°-50°   | 93.4   | 5.9       |
| 50°-60°   | 23.5   | 1.5       |
| 60°-70°   | 8.8    | 0.6       |
| 70°-80°   | 3.0    | 0.2       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 1115.1 | 70.7      |
| 0°-40°    | 1448.2 | 91.8      |
| 0°-60°    | 1565.2 | 99.2      |
| 0°-90°    | 1577.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1577.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 1980 |      |
| 5°  | 1929 | 179  |
| 15° | 1551 | 433  |
| 25° | 1103 | 503  |
| 35° | 534  | 333  |
| 45° | 109  | 93   |
| 55° | 26   | 23   |
| 65° | 9    | 9    |
| 75° | 3    | 3    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P572879

CATALOG NUMBER: FLD4C-25-D010 FEU4C-X-90-50 F4X-N-X-H-BL89BV

**CANDELA DISTRIBUTION (FULL):**

|       | 0°     |
|-------|--------|
| 0°    | 1980.0 |
| 2.5°  | 1971.4 |
| 5°    | 1928.6 |
| 7.5°  | 1854.2 |
| 10°   | 1762.8 |
| 12.5° | 1659.9 |
| 15°   | 1551.4 |
| 17.5° | 1445.7 |
| 20°   | 1328.6 |
| 22.5° | 1220.0 |
| 25°   | 1102.8 |
| 27.5° | 991.4  |
| 30°   | 848.6  |
| 32.5° | 697.1  |
| 35°   | 534.3  |
| 37.5° | 382.9  |
| 40°   | 259.9  |
| 42.5° | 168.5  |
| 45°   | 108.6  |
| 47.5° | 65.8   |
| 50°   | 42.8   |
| 52.5° | 31.4   |
| 55°   | 25.7   |
| 57.5° | 20.1   |
| 60°   | 14.3   |
| 62.5° | 11.5   |
| 65°   | 8.6    |
| 67.5° | 5.7    |
| 70°   | 5.7    |
| 72.5° | 2.9    |
| 75°   | 2.9    |
| 77.5° | 2.9    |
| 80°   | 0.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180°







(END OF REPORT)