

Scaled data based on original data using  
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State  
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P572975

Luminaire Tested: **FLD4C-30-D010 FEU4C-X-90-35 F4X-M-X-H-BL89BV**

Issue Date: 3/1/2023



**Test Information**

Test Method: LM-79-08  
Report Number: P572975  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)  
Test Lab: INNOVATION CENTER-P3  
Issue Date: 3/1/2023  
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)  
Product Line: FAIL-SAFE  
Catalog Number: FLD4C-30-D010 FEU4C-X-90-35 F4X-M-X-H-BL89BV  
Description: 4 INCH FAIL-SAFE LED DOWNLIGHT WITH 3500K, 90 CRI LEDS, 4LBMH TRIM  
AND BOTTOM LENS, 0.125" CLEAR ACRYLIC  
  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2179.0 lumens  
Efficiency: N/A  
Efficacy: 69.0 lumens/watt  
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93  
Luminous Opening: Circular (Dia: 0.33' x H: 0')  
CIE Type: Direct

Input Watts (W): 31.6  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 25 FT

TEST NUMBER: P572975

CATALOG NUMBER: FLD4C-30-D010 FEU4C-X-90-35 F4X-M-X-H-BL89BV

### Luminous Intensity Polar Plot

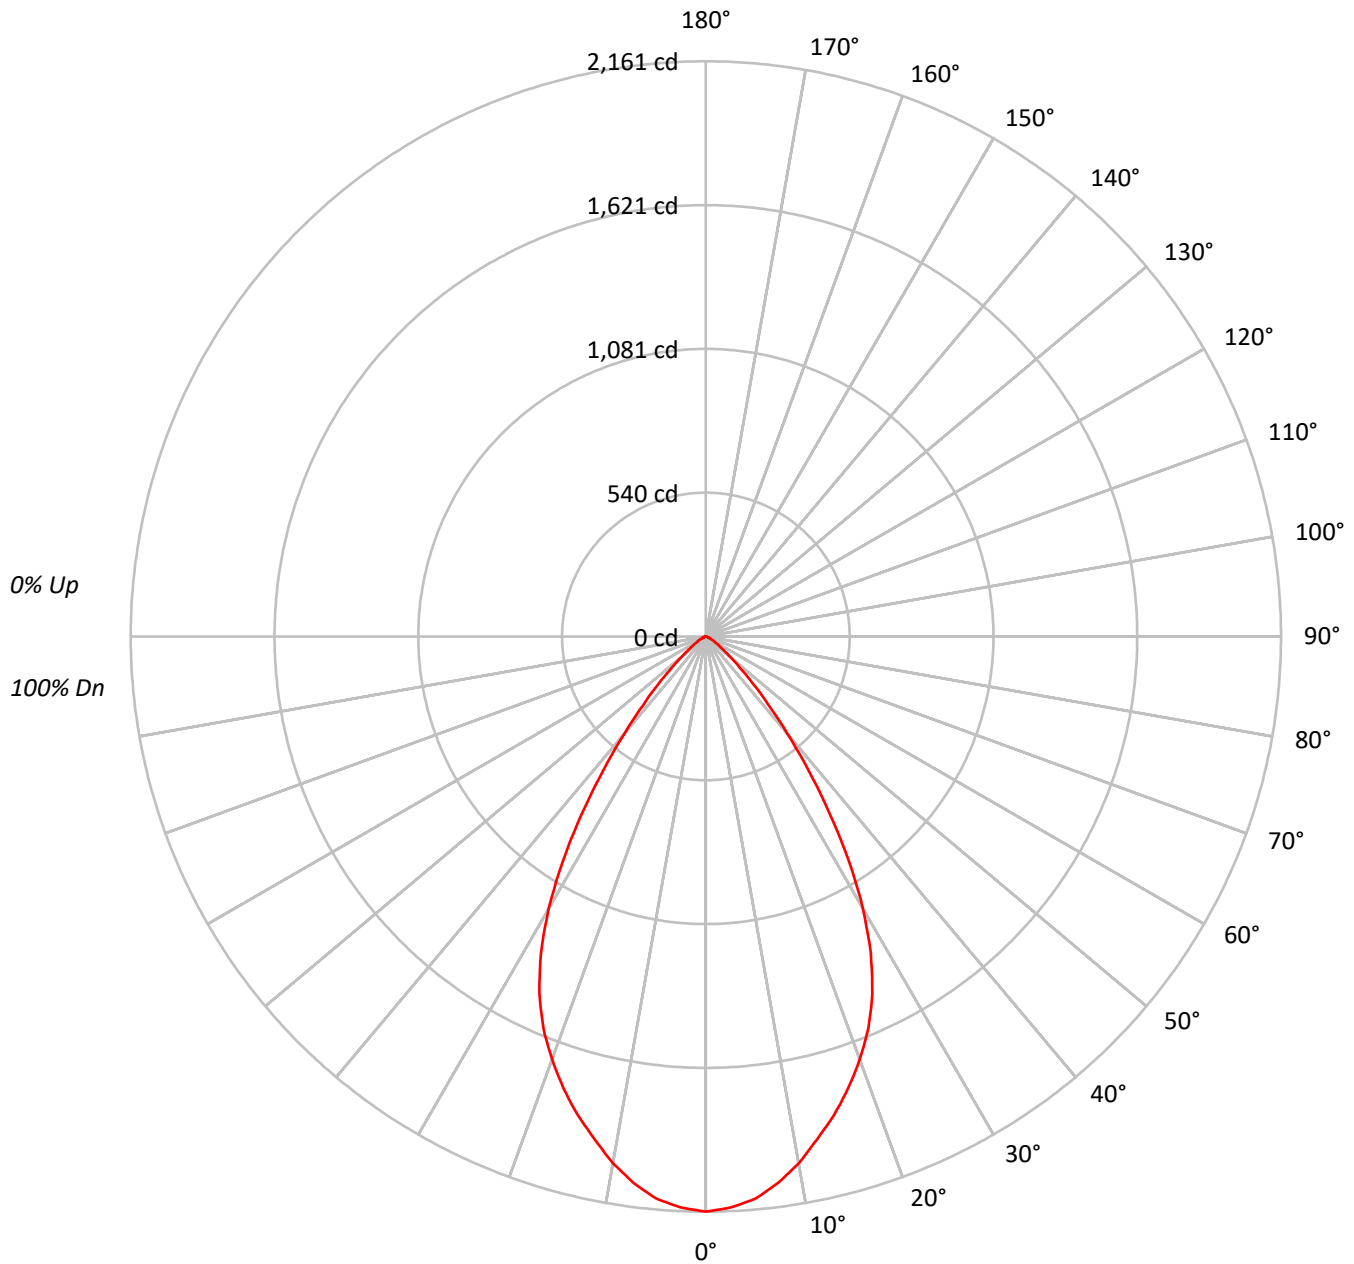



TEST NUMBER: P572975

CATALOG NUMBER: FLD4C-30-D010 FEU4C-X-90-35 F4X-M-X-H-BL89BV

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 |
| 1   | 113 | 110 | 108 | 105 | 111 | 108 | 106 | 104 | 104 | 102 | 100 |  | 100 | 99  | 97  |  | 97  |
| 2   | 107 | 102 | 98  | 94  | 105 | 100 | 96  | 93  | 97  | 94  | 91  |  | 94  | 91  | 89  |  | 91  |
| 3   | 101 | 94  | 89  | 85  | 99  | 93  | 88  | 84  | 90  | 86  | 83  |  | 88  | 84  | 82  |  | 86  |
| 4   | 96  | 88  | 82  | 77  | 94  | 86  | 81  | 77  | 84  | 80  | 76  |  | 82  | 78  | 75  |  | 80  |
| 5   | 90  | 82  | 75  | 71  | 89  | 81  | 75  | 70  | 79  | 74  | 70  |  | 77  | 73  | 69  |  | 75  |
| 6   | 86  | 76  | 70  | 65  | 84  | 75  | 69  | 65  | 74  | 68  | 64  |  | 72  | 68  | 64  |  | 71  |
| 7   | 81  | 71  | 65  | 60  | 80  | 70  | 64  | 60  | 69  | 64  | 60  |  | 68  | 63  | 59  |  | 67  |
| 8   | 77  | 67  | 60  | 56  | 75  | 66  | 60  | 56  | 65  | 59  | 56  |  | 64  | 59  | 55  |  | 63  |
| 9   | 73  | 63  | 56  | 52  | 72  | 62  | 56  | 52  | 61  | 56  | 52  |  | 60  | 55  | 52  |  | 59  |
| 10  | 69  | 59  | 53  | 49  | 68  | 59  | 53  | 49  | 58  | 52  | 49  |  | 57  | 52  | 48  |  | 56  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 265437 |
| 5°  | 261580 |
| 10° | 250658 |
| 15° | 236746 |
| 20° | 220986 |
| 25° | 200606 |
| 30° | 167493 |
| 35° | 121331 |
| 40° | 75953  |
| 45° | 43418  |
| 50° | 22629  |
| 55° | 12680  |
| 60° | 8084   |
| 65° | 4767   |
| 70° | 3556   |
| 75° | 1566   |
| 80° | 2335   |
| 85° | 0      |



TEST NUMBER: P572975

CATALOG NUMBER: FLD4C-30-D010 FEU4C-X-90-35 F4X-M-X-H-BL89BV

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 198.8  | 9.1       |
| 10°-20°   | 521.6  | 23.9      |
| 20°-30°   | 670.3  | 30.8      |
| 30°-40°   | 504.3  | 23.1      |
| 40°-50°   | 202.6  | 9.3       |
| 50°-60°   | 57.6   | 2.6       |
| 60°-70°   | 18.2   | 0.8       |
| 70°-80°   | 5.2    | 0.2       |
| 80°-90°   | 0.4    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 1390.7 | 63.8      |
| 0°-40°    | 1895.0 | 87.0      |
| 0°-60°    | 2155.1 | 98.9      |
| 0°-90°    | 2179.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 2179.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 2161 |      |
| 5°  | 2121 | 199  |
| 15° | 1861 | 522  |
| 25° | 1480 | 670  |
| 35° | 809  | 504  |
| 45° | 250  | 203  |
| 55° | 59   | 58   |
| 65° | 16   | 18   |
| 75° | 3    | 5    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P572975

CATALOG NUMBER: FLD4C-30-D010 FEU4C-X-90-35 F4X-M-X-H-BL89BV

**CANDELA DISTRIBUTION (FULL):**

|       | 0°     |
|-------|--------|
| 0°    | 2160.6 |
| 2.5°  | 2147.5 |
| 5°    | 2121.1 |
| 7.5°  | 2071.8 |
| 10°   | 2009.3 |
| 12.5° | 1933.8 |
| 15°   | 1861.4 |
| 17.5° | 1779.1 |
| 20°   | 1690.3 |
| 22.5° | 1595.0 |
| 25°   | 1479.9 |
| 27.5° | 1341.7 |
| 30°   | 1180.7 |
| 32.5° | 999.7  |
| 35°   | 809.0  |
| 37.5° | 631.4  |
| 40°   | 473.6  |
| 42.5° | 348.6  |
| 45°   | 249.9  |
| 47.5° | 171.1  |
| 50°   | 118.4  |
| 52.5° | 82.2   |
| 55°   | 59.2   |
| 57.5° | 42.8   |
| 60°   | 32.9   |
| 62.5° | 23.0   |
| 65°   | 16.4   |
| 67.5° | 13.2   |
| 70°   | 9.9    |
| 72.5° | 6.6    |
| 75°   | 3.3    |
| 77.5° | 3.3    |
| 80°   | 3.3    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |



Report Generated By 670246072 / DESKTOP-MV3F9LC





— 0°-180°







(END OF REPORT)