

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C35D010 FEU4C359030 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
Report Number: P#
Test Lab: INNOVATION CENTER
Issue Date: 12/13/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLDSQ4C35D010 FEU4C359030 F4LC-CSSQ-MW
Description: 4 INCH 3500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3000K, 90CRI LEDS
AND F4LC-CSSQ TRIM WITH MW FINISH
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3402.0 lumens
Efficiency: N/A
Efficacy: 84.2 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C35D010 FEU4C359030 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

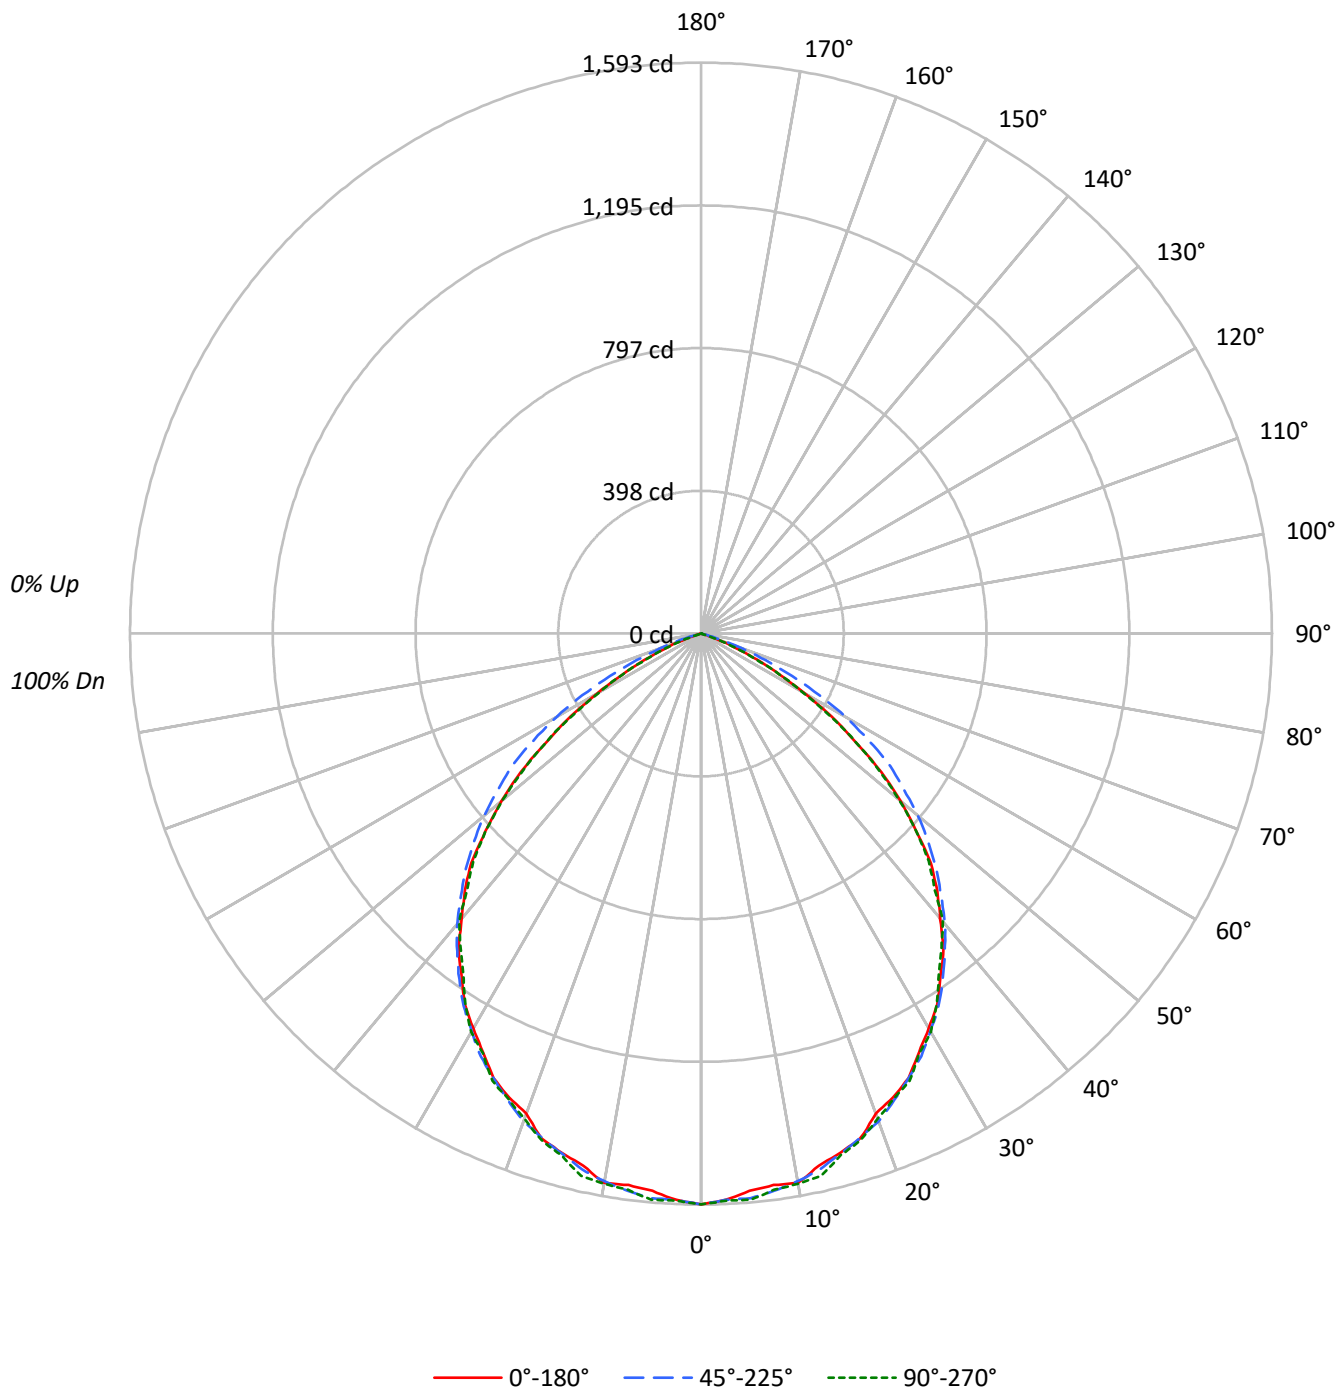

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C35D010 FEU4C359030 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	153668	153668	153668
5°	151185	153151	153597
10°	152492	152051	152708
15°	149819	150039	150498
20°	146341	148662	147964
25°	145706	145706	146664
30°	141643	142646	142902
35°	137227	138558	136155
40°	130781	133338	132205
45°	123779	126563	122537
50°	109010	118512	108334
55°	88284	108454	88670
60°	64609	89928	63297
65°	39247	64042	38219
70°	15319	34474	14698
75°	1678	9283	1678
80°	1278	1278	1278
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C35D010 FEU4C359030 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	150.3	4.4
10°-20°	425.4	12.5
20°-30°	631.2	18.6
30°-40°	731.3	21.5
40°-50°	701.2	20.6
50°-60°	515.6	15.2
60°-70°	222.7	6.5
70°-80°	24.0	0.7
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1206.9	35.5
0°-40°	1938.2	57.0
0°-60°	3155.0	92.7
0°-90°	3402.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3402.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1593	1593	1593	1593	1593	
5°	1561	1577	1581	1584	1586	149
15°	1500	1509	1502	1504	1507	423
25°	1369	1366	1369	1371	1378	627
35°	1165	1172	1176	1174	1156	728
45°	907	909	928	914	898	690
55°	525	579	645	577	527	472
65°	172	215	280	213	167	177
75°	4	7	25	4	4	14
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C35D010 FEU4C359030 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6
2.5°	1581.2	1599.3	1601.6	1590.3	1585.8	1579.0	1594.8	1583.5	1588.1	1583.5	1581.2
5°	1560.9	1581.2	1583.5	1583.5	1579.0	1576.7	1583.5	1581.2	1579.0	1574.5	1581.2
7.5°	1551.9	1563.1	1574.5	1560.9	1567.7	1565.4	1581.2	1574.5	1572.2	1572.2	1567.7
10°	1556.4	1554.1	1563.1	1549.6	1554.1	1549.6	1563.1	1563.1	1558.6	1554.1	1551.9
12.5°	1520.1	1538.2	1538.2	1536.0	1531.5	1524.7	1538.2	1547.4	1533.7	1533.7	1531.5
15°	1499.8	1504.3	1506.6	1506.6	1504.3	1508.9	1515.6	1506.6	1508.9	1497.5	1502.0
17.5°	1477.2	1468.2	1474.9	1470.4	1472.7	1477.2	1486.3	1486.3	1472.7	1470.4	1474.9
20°	1425.2	1452.3	1454.6	1441.0	1443.2	1443.2	1459.1	1445.6	1454.6	1443.2	1447.8
22.5°	1400.2	1418.3	1420.6	1402.5	1413.8	1400.2	1416.1	1395.7	1418.3	1402.5	1409.3
25°	1368.6	1366.4	1373.1	1364.1	1366.4	1366.4	1377.6	1368.6	1375.4	1366.4	1368.6
27.5°	1316.6	1334.7	1332.4	1323.4	1327.9	1325.7	1348.3	1323.4	1336.9	1325.7	1330.2
30°	1271.3	1287.2	1282.6	1273.6	1273.6	1266.8	1291.7	1284.9	1282.6	1282.6	1280.3
32.5°	1226.1	1228.4	1223.9	1226.1	1228.4	1219.3	1239.6	1230.6	1228.4	1230.6	1232.9
35°	1165.0	1165.0	1169.5	1162.8	1171.8	1171.8	1189.9	1178.5	1176.3	1169.5	1176.3
37.5°	1110.7	1104.0	1106.2	1106.2	1110.7	1115.2	1124.3	1119.7	1119.7	1113.0	1117.5
40°	1038.3	1033.8	1040.6	1040.6	1047.4	1047.4	1056.4	1051.9	1058.6	1058.6	1058.6
42.5°	975.0	975.0	970.5	977.2	979.5	977.2	993.1	990.8	993.1	988.6	990.8
45°	907.1	907.1	902.6	900.4	911.6	909.4	927.5	920.7	929.7	925.2	927.5
47.5°	814.3	825.7	818.9	825.7	839.3	841.6	852.8	848.3	857.3	850.6	859.7
50°	726.2	726.2	732.9	742.0	755.5	757.8	771.4	780.5	785.0	787.2	789.5
52.5°	633.4	631.1	638.0	649.2	660.6	669.6	683.2	696.7	705.8	719.4	712.5
55°	524.8	529.3	536.2	549.7	567.8	579.1	590.4	608.5	624.4	631.1	644.7
57.5°	432.0	427.5	432.0	450.1	470.5	479.6	495.4	513.5	536.2	549.7	554.2
60°	334.8	337.1	341.6	357.5	373.2	386.8	393.6	423.0	443.4	457.0	466.0
62.5°	246.6	251.1	255.7	269.2	285.0	296.4	307.6	332.5	350.6	364.2	373.2
65°	171.9	174.2	181.0	187.7	203.6	214.9	223.9	244.3	262.4	273.8	280.5
67.5°	106.3	108.5	113.1	122.2	133.5	142.5	151.6	165.1	181.0	192.3	194.6
70°	54.3	56.6	58.8	65.6	74.7	79.2	85.9	97.3	108.5	117.6	122.2
72.5°	18.1	18.1	20.4	24.9	29.4	34.0	36.2	47.5	56.6	61.1	63.3
75°	4.5	4.5	4.5	4.5	4.5	6.8	6.8	13.6	18.1	22.6	24.9
77.5°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	4.5	4.5
80°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C35D010 FEU4C359030 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6	1592.6
2.5°	1592.6	1588.1	1585.8	1588.1	1588.1	1585.8	1592.6	1601.6	1612.9	1583.5
5°	1590.3	1585.8	1590.3	1576.7	1583.5	1579.0	1588.1	1585.8	1594.8	1585.8
7.5°	1583.5	1574.5	1576.7	1570.0	1579.0	1567.7	1574.5	1588.1	1579.0	1565.4
10°	1560.9	1556.4	1572.2	1549.6	1545.0	1554.1	1572.2	1558.6	1554.1	1558.6
12.5°	1538.2	1538.2	1545.0	1527.0	1529.2	1533.7	1542.7	1533.7	1538.2	1549.6
15°	1513.4	1508.9	1520.1	1506.6	1504.3	1499.8	1508.9	1508.9	1513.4	1506.6
17.5°	1483.9	1477.2	1477.2	1472.7	1470.4	1481.7	1486.3	1488.5	1490.8	1481.7
20°	1447.8	1445.6	1452.3	1445.6	1447.8	1450.1	1450.1	1445.6	1465.9	1441.0
22.5°	1409.3	1416.1	1407.1	1402.5	1407.1	1411.6	1411.6	1413.8	1409.3	1404.8
25°	1370.9	1375.4	1377.6	1364.1	1370.9	1364.1	1379.9	1382.1	1373.1	1377.6
27.5°	1336.9	1330.2	1327.9	1318.8	1323.4	1321.1	1323.4	1323.4	1336.9	1318.8
30°	1284.9	1278.1	1280.3	1273.6	1275.8	1273.6	1275.8	1275.8	1284.9	1282.6
32.5°	1235.1	1228.4	1230.6	1223.9	1223.9	1226.1	1221.5	1221.5	1228.4	1223.9
35°	1187.6	1171.8	1174.0	1171.8	1174.0	1165.0	1165.0	1162.8	1167.3	1155.9
37.5°	1119.7	1113.0	1110.7	1108.5	1110.7	1106.2	1110.7	1104.0	1110.7	1101.7
40°	1058.6	1054.1	1056.4	1042.9	1042.9	1045.1	1040.6	1038.3	1040.6	1049.6
42.5°	997.6	988.6	984.1	979.5	981.8	975.0	972.7	968.2	972.7	963.7
45°	925.2	925.2	923.0	911.6	913.9	913.9	904.9	895.8	898.0	898.0
47.5°	859.7	855.1	852.8	841.6	839.3	837.0	827.9	821.2	821.2	814.3
50°	787.2	782.7	775.9	764.6	760.1	746.5	739.8	730.7	721.7	721.7
52.5°	719.4	703.5	694.4	676.4	669.6	662.8	644.7	638.0	631.1	624.4
55°	638.0	624.4	606.3	585.9	576.9	565.5	547.4	533.8	524.8	527.1
57.5°	558.8	536.2	518.1	490.9	479.6	472.7	454.7	436.6	427.5	427.5
60°	461.5	443.4	420.8	395.9	386.8	375.6	352.9	341.6	334.8	328.0
62.5°	368.7	355.2	334.8	303.1	296.4	285.0	269.2	255.7	248.8	248.8
65°	276.0	262.4	244.3	221.7	212.7	203.6	190.0	176.5	169.6	167.4
67.5°	194.6	178.7	162.9	144.8	138.0	133.5	119.9	110.8	106.3	104.0
70°	117.6	108.5	97.3	83.7	76.9	72.4	63.3	56.6	54.3	52.1
72.5°	61.1	54.3	45.2	36.2	31.7	27.1	22.6	18.1	15.9	15.9
75°	22.6	18.1	11.4	6.8	4.5	4.5	4.5	4.5	4.5	4.5
77.5°	4.5	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
80°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)