

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C35D010 FEU4C359035 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
Report Number: P#
Test Lab: INNOVATION CENTER
Issue Date: 12/13/2022
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: FLDSQ4C35D010 FEU4C359035 F4LC-CSSQ-MW
Description: 4 INCH 3500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 3500K, 90CRI LEDS
AND F4LC-CSSQ TRIM WITH MW FINISH
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3450.0 lumens
Efficiency: N/A
Efficacy: 85.4 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C35D010 FEU4C359035 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

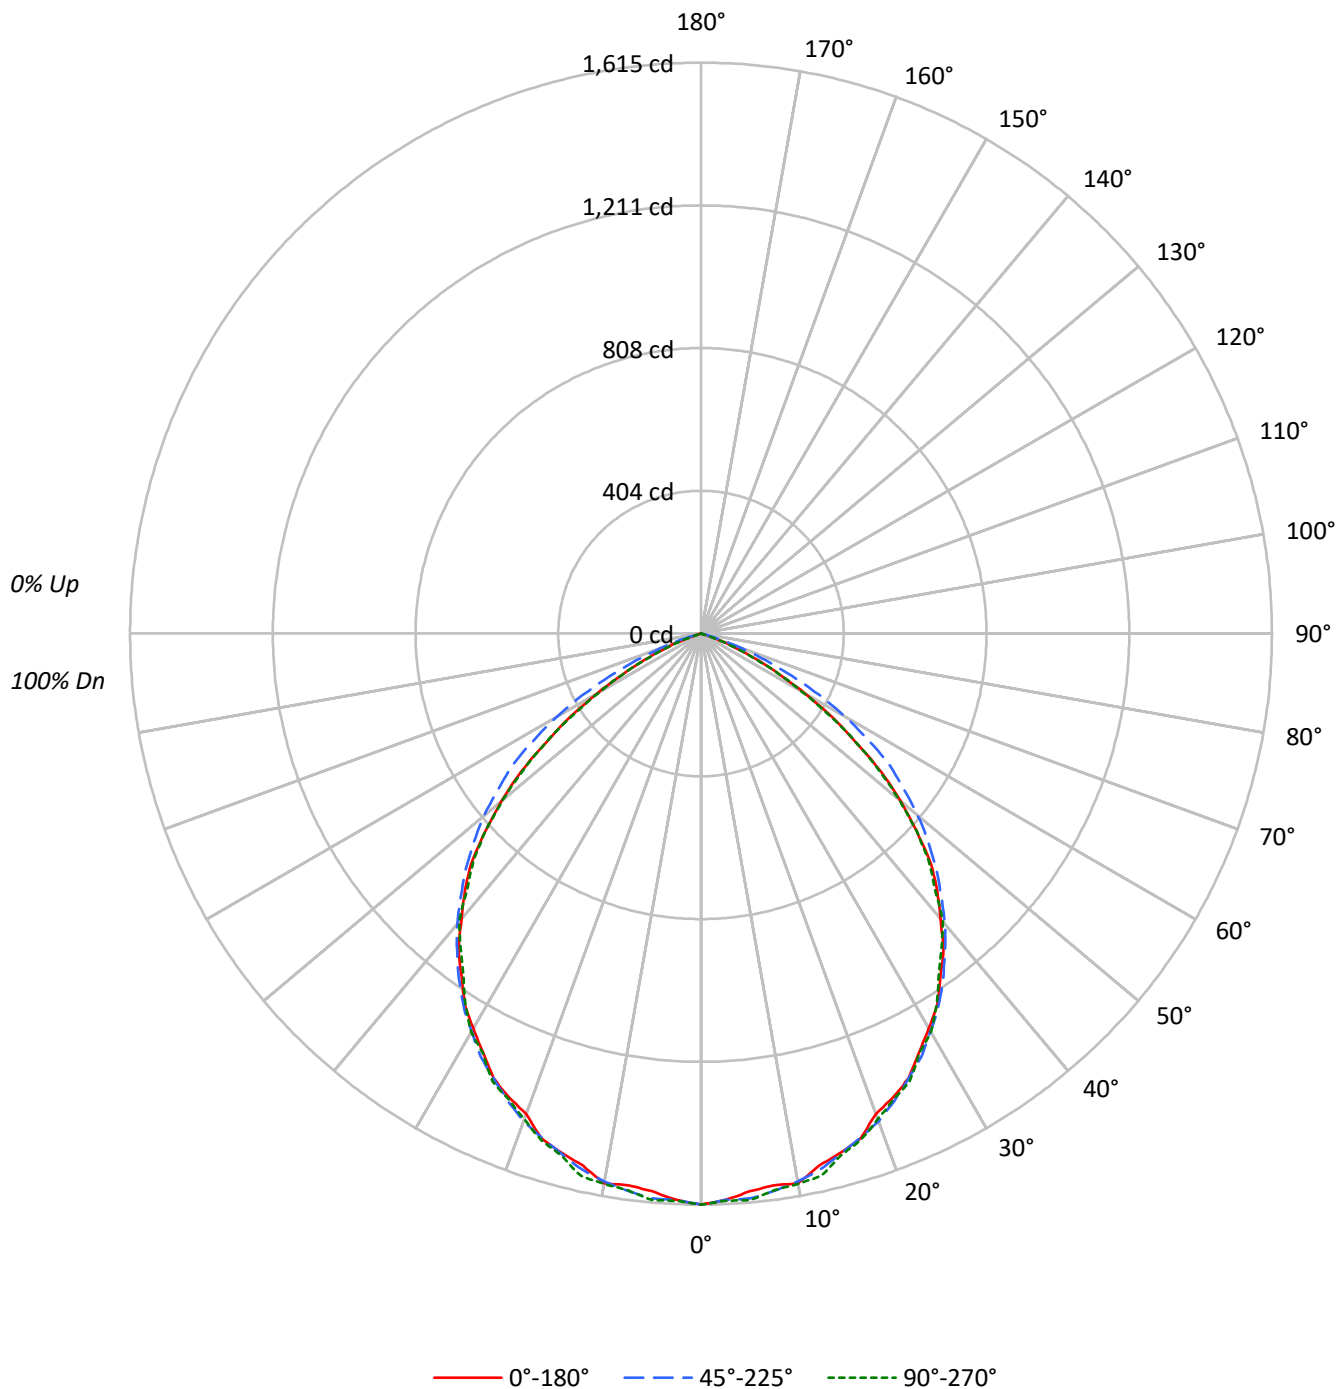

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C35D010 FEU4C359035 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	155839	155839	155839
5°	153316	155311	155756
10°	154648	154197	154863
15°	151937	152156	152616
20°	148405	150757	150059
25°	147761	147761	148740
30°	143637	144662	144919
35°	139159	140513	138075
40°	132633	135228	134069
45°	125526	128350	124270
50°	110541	120178	109851
55°	89528	109984	89915
60°	65516	91201	64204
65°	39818	64932	38767
70°	15516	34954	14896
75°	1715	9432	1715
80°	1278	1278	1278
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C35D010 FEU4C359035 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	152.4	4.4
10°-20°	431.4	12.5
20°-30°	640.1	18.6
30°-40°	741.7	21.5
40°-50°	711.1	20.6
50°-60°	522.8	15.2
60°-70°	225.8	6.5
70°-80°	24.4	0.7
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1223.9	35.5
0°-40°	1965.6	57.0
0°-60°	3199.5	92.7
0°-90°	3450.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3450.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1615	1615	1615	1615	1615	
5°	1583	1599	1604	1606	1608	151
15°	1521	1530	1523	1526	1528	429
25°	1388	1386	1388	1390	1397	635
35°	1181	1188	1193	1191	1172	739
45°	920	922	941	927	911	699
55°	532	587	654	585	534	479
65°	174	218	284	216	170	179
75°	5	7	25	5	5	14
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C35D010 FEU4C359035 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1
2.5°	1603.5	1621.9	1624.2	1612.7	1608.1	1601.3	1617.3	1605.9	1610.5	1605.9	1603.5
5°	1582.9	1603.5	1605.9	1605.9	1601.3	1599.0	1605.9	1603.5	1601.3	1596.7	1603.5
7.5°	1573.8	1585.2	1596.7	1582.9	1589.8	1587.5	1603.5	1596.7	1594.4	1594.4	1589.8
10°	1578.4	1576.0	1585.2	1571.4	1576.0	1571.4	1585.2	1585.2	1580.6	1576.0	1573.8
12.5°	1541.6	1559.9	1559.9	1557.7	1553.1	1546.2	1559.9	1569.2	1555.3	1555.3	1553.1
15°	1521.0	1525.6	1527.8	1527.8	1525.6	1530.2	1537.0	1527.8	1530.2	1518.6	1523.2
17.5°	1498.1	1488.9	1495.7	1491.1	1493.5	1498.1	1507.2	1507.2	1493.5	1491.1	1495.7
20°	1445.3	1472.8	1475.1	1461.4	1463.6	1463.6	1479.7	1465.9	1475.1	1463.6	1468.2
22.5°	1420.0	1438.3	1440.7	1422.3	1433.8	1420.0	1436.1	1415.4	1438.3	1422.3	1429.2
25°	1387.9	1385.6	1392.5	1383.3	1385.6	1385.6	1397.1	1387.9	1394.8	1385.6	1387.9
27.5°	1335.2	1353.5	1351.2	1342.0	1346.6	1344.4	1367.3	1342.0	1355.8	1344.4	1348.9
30°	1289.2	1305.3	1300.7	1291.6	1291.6	1284.6	1309.9	1303.0	1300.7	1300.7	1298.4
32.5°	1243.4	1245.7	1241.1	1243.4	1245.7	1236.5	1257.1	1248.0	1245.7	1248.0	1250.3
35°	1181.4	1181.4	1186.0	1179.2	1188.3	1188.3	1206.7	1195.2	1192.9	1186.0	1192.9
37.5°	1126.4	1119.5	1121.8	1121.8	1126.4	1131.0	1140.1	1135.5	1135.5	1128.7	1133.3
40°	1053.0	1048.4	1055.2	1055.2	1062.2	1062.2	1071.3	1066.7	1073.6	1073.6	1073.6
42.5°	988.8	988.8	984.2	991.0	993.4	991.0	1007.1	1004.8	1007.1	1002.5	1004.8
45°	919.9	919.9	915.3	913.1	924.5	922.2	940.6	933.7	942.8	938.2	940.6
47.5°	825.8	837.3	830.4	837.3	851.1	853.4	864.9	860.3	869.4	862.6	871.8
50°	736.4	736.4	743.3	752.4	766.2	768.5	782.3	791.5	796.1	798.3	800.6
52.5°	642.4	640.0	647.0	658.4	669.9	679.1	692.8	706.6	715.8	729.5	722.6
55°	532.2	536.8	543.7	557.5	575.8	587.2	598.8	617.1	633.2	640.0	653.8
57.5°	438.1	433.6	438.1	456.5	477.2	486.3	502.4	520.8	543.7	557.5	562.1
60°	339.5	341.8	346.4	362.5	378.5	392.3	399.2	429.0	449.6	463.4	472.6
62.5°	250.1	254.7	259.3	273.0	289.0	300.5	312.0	337.2	355.6	369.3	378.5
65°	174.4	176.6	183.5	190.4	206.5	217.9	227.1	247.8	266.1	277.6	284.4
67.5°	107.8	110.1	114.7	123.9	135.3	144.5	153.7	167.4	183.5	195.0	197.3
70°	55.0	57.4	59.6	66.5	75.7	80.3	87.1	98.7	110.1	119.2	123.9
72.5°	18.3	18.3	20.7	25.3	29.9	34.4	36.7	48.2	57.4	62.0	64.2
75°	4.6	4.6	4.6	4.6	4.6	6.9	6.9	13.8	18.3	22.9	25.3
77.5°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	4.6	4.6
80°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C35D010 FEU4C359035 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1	1615.1
2.5°	1615.1	1610.5	1608.1	1610.5	1610.5	1608.1	1615.1	1624.2	1635.6	1605.9
5°	1612.7	1608.1	1612.7	1599.0	1605.9	1601.3	1610.5	1608.1	1617.3	1608.1
7.5°	1605.9	1596.7	1599.0	1592.1	1601.3	1589.8	1596.7	1610.5	1601.3	1587.5
10°	1582.9	1578.4	1594.4	1571.4	1566.8	1576.0	1594.4	1580.6	1576.0	1580.6
12.5°	1559.9	1559.9	1566.8	1548.5	1550.8	1555.3	1564.5	1555.3	1559.9	1571.4
15°	1534.7	1530.2	1541.6	1527.8	1525.6	1521.0	1530.2	1530.2	1534.7	1527.8
17.5°	1504.9	1498.1	1498.1	1493.5	1491.1	1502.6	1507.2	1509.5	1511.8	1502.6
20°	1468.2	1465.9	1472.8	1465.9	1468.2	1470.5	1470.5	1465.9	1486.5	1461.4
22.5°	1429.2	1436.1	1426.9	1422.3	1426.9	1431.5	1431.5	1433.8	1429.2	1424.6
25°	1390.2	1394.8	1397.1	1383.3	1390.2	1383.3	1399.4	1401.6	1392.5	1397.1
27.5°	1355.8	1348.9	1346.6	1337.4	1342.0	1339.8	1342.0	1342.0	1355.8	1337.4
30°	1303.0	1296.2	1298.4	1291.6	1293.8	1291.6	1293.8	1293.8	1303.0	1300.7
32.5°	1252.5	1245.7	1248.0	1241.1	1241.1	1243.4	1238.8	1238.8	1245.7	1241.1
35°	1204.3	1188.3	1190.6	1188.3	1190.6	1181.4	1181.4	1179.2	1183.7	1172.2
37.5°	1135.5	1128.7	1126.4	1124.1	1126.4	1121.8	1126.4	1119.5	1126.4	1117.2
40°	1073.6	1069.0	1071.3	1057.6	1057.6	1059.8	1055.2	1053.0	1055.2	1064.4
42.5°	1011.7	1002.5	998.0	993.4	995.6	988.8	986.4	981.9	986.4	977.3
45°	938.2	938.2	936.0	924.5	926.8	926.8	917.6	908.5	910.7	910.7
47.5°	871.8	867.2	864.9	853.4	851.1	848.8	839.6	832.8	832.8	825.8
50°	798.3	793.7	786.9	775.4	770.8	757.0	750.2	741.0	731.8	731.8
52.5°	729.5	713.4	704.2	685.9	679.1	672.1	653.8	647.0	640.0	633.2
55°	647.0	633.2	614.9	594.2	585.0	573.5	555.1	541.4	532.2	534.5
57.5°	566.6	543.7	525.4	497.9	486.3	479.4	461.1	442.7	433.6	433.6
60°	468.0	449.6	426.7	401.4	392.3	380.9	357.8	346.4	339.5	332.7
62.5°	373.9	360.2	339.5	307.4	300.5	289.0	273.0	259.3	252.3	252.3
65°	279.9	266.1	247.8	224.8	215.7	206.5	192.7	179.0	172.0	169.8
67.5°	197.3	181.2	165.2	146.9	139.9	135.3	121.6	112.4	107.8	105.5
70°	119.2	110.1	98.7	84.9	78.0	73.4	64.2	57.4	55.0	52.8
72.5°	62.0	55.0	45.9	36.7	32.1	27.5	22.9	18.3	16.1	16.1
75°	22.9	18.3	11.5	6.9	4.6	4.6	4.6	4.6	4.6	4.6
77.5°	4.6	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
80°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)