

LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P#

Luminaire Tested: **FLDSQ4C35D010 FEU4C359040 F4LC-CSSQ-MW**

Issue Date: 12/13/2022

Tested By:

Approved By:



Cooper Lighting Solutions laboratories have been accredited by National Voluntary Laboratory Accreditation Program (NVLAP) that it adheres to the requirements of ISO/IEC 17025:2005 and appropriate IESNA test methods. This report must not be used to claim product certification, approval or endorsement by NVLAP, NIST or any agency of the Federal Government. Results contained in this report are valid for luminaire sample tested, as supplied by requestor. Information related to the luminaire tested has been supplied by requestor and can affect the validity of the test results. Report shall not be reproduced except in full without approval of Cooper Lighting Solutions Lighting Laboratory. Test performed at address noted above.

Test Information

Test Method: LM-79-08
 Report Number: P#
 Test Lab: INNOVATION CENTER
 Issue Date: 12/13/2022
 Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
 Product Line: FAIL-SAFE
 Catalog Number: FLDSQ4C35D010 FEU4C359040 F4LC-CSSQ-MW
 Description: 4 INCH 3500 LUMEN FAIL-SAFE LED DOWNLIGHT WITH, 4000K, 90CRI LEDS
 AND F4LC-CSSQ TRIM WITH MW FINISH
 Light Source: -
 Ballast/Driver: -

Summary


Lumens per Lamp: N/A
 Luminaire Lumens: 3455.0 lumens
 Efficiency: N/A
 Efficacy: 85.5 lumens/watt
 Spacing Criteria (0/90/45): 1.19 / 1.2 / 1.29
 Luminous Opening: Rectangular (W 0.33' x L: 0.33' x H: 0')
 CIE Type: Direct

Input Watts (W): 40.4
 Input Voltage (V):
 Input Current (Ain): NR
 Voltage Rise (V): NR
 Power Factor: NR
 Total Harmonic Distortion (THDi): NR
 Frequency (hertz): 60
 Stabilization Time: NR
 Operation Time: NR
 Ambient Temperature (°C): NR
 Test Distance: 25 FT

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	GONIO 1 IN0055	4/22/2021	10/22/2021
Power Meter	XITRON 2801 IN0197	12/1/2020	12/1/2021
AC Power Source	CHROMA 61505 IN0196	12/1/2020	12/1/2021
DC Power Supply	AGILENT E3634A IN0198	11/30/2020	11/30/2021
Room Thermometer	ONSET IN0143	12/1/2020	12/1/2021

TEST NUMBER: P#
CATALOG NUMBER: FLDSQ4C35D010 FEU4C359040 F4LC-CSSQ-MW

Luminous Intensity Polar Plot

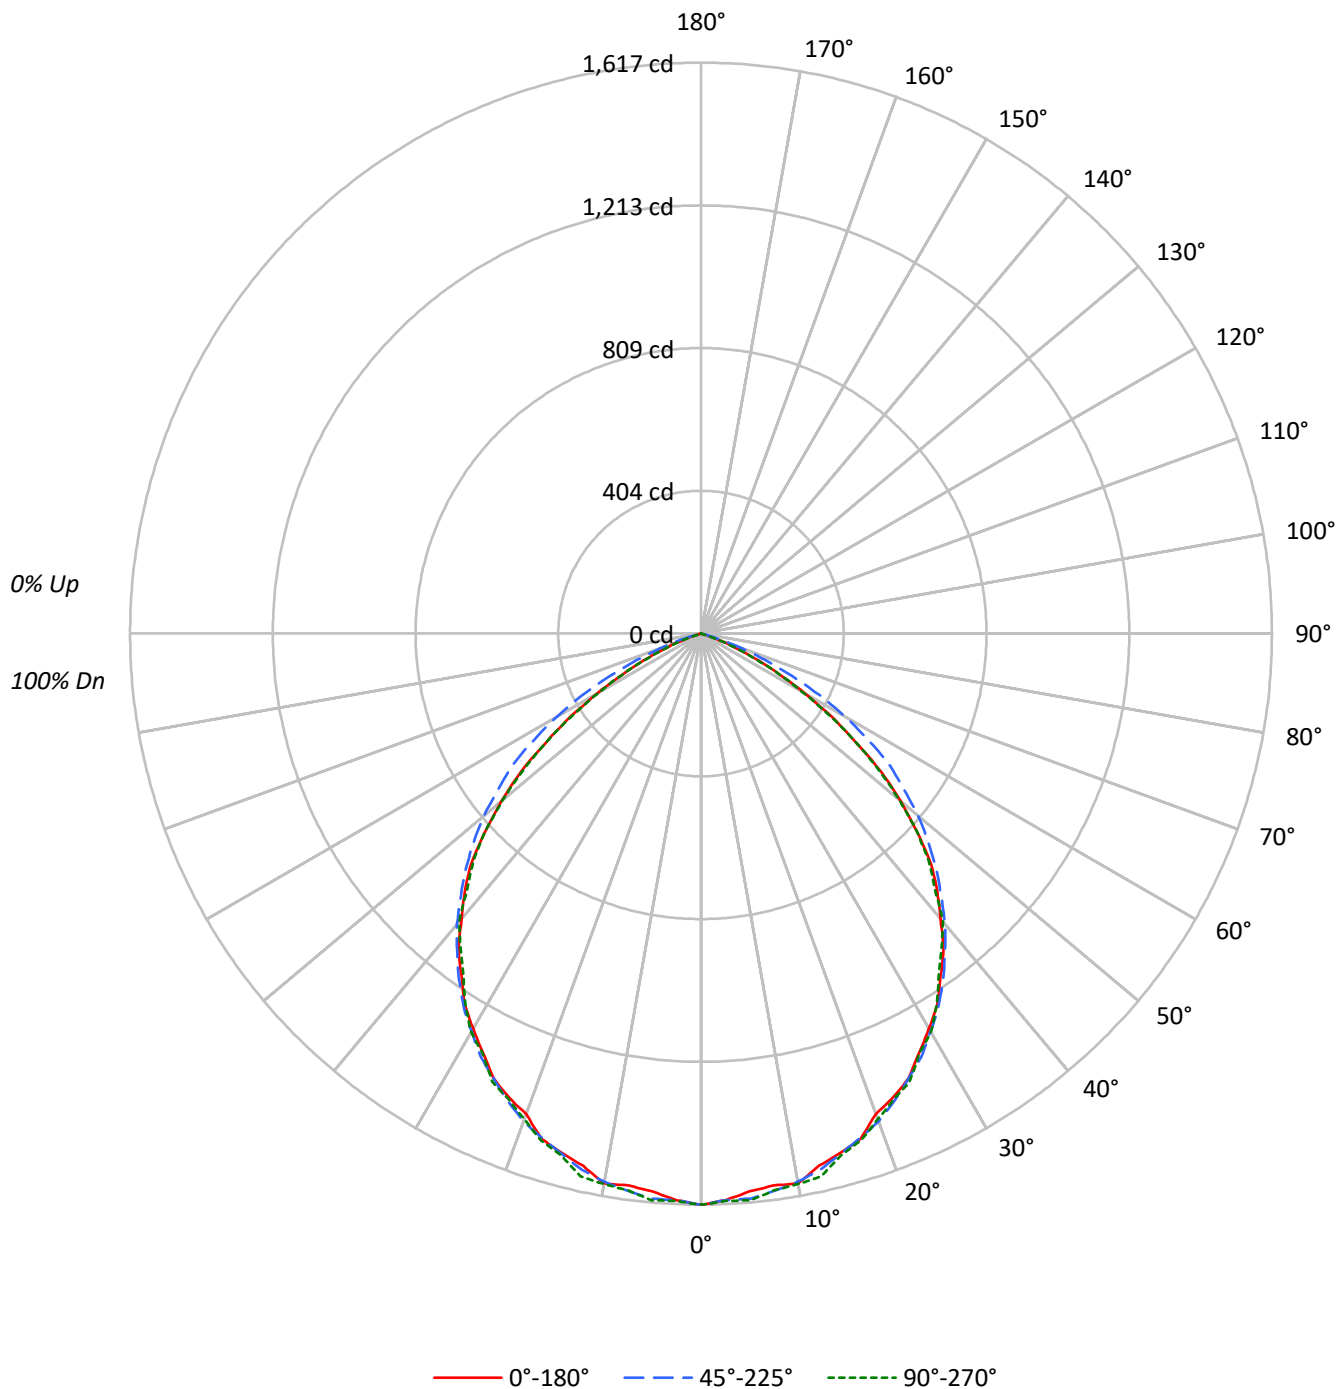

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C35D010 FEU4C359040 F4LC-CSSQ-MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	111	108	104	101	109	105	102	100	101	99	96		97	95	94		89
2	103	96	91	86	100	94	89	85	91	87	83		88	84	81		77
3	95	86	79	74	93	85	78	73	82	76	72		79	74	71		67
4	88	77	70	64	86	76	69	63	74	67	63		71	66	62		59
5	81	70	62	56	79	69	61	56	67	60	55		65	59	54		52
6	75	63	55	49	73	62	55	49	61	54	49		59	53	48		46
7	70	58	50	44	68	57	49	44	55	49	44		54	48	43		41
8	65	53	45	40	64	52	45	39	51	44	39		50	44	39		37
9	61	49	41	36	60	48	41	36	47	40	36		46	40	35		33
10	57	45	38	33	56	44	37	33	44	37	32		43	37	32		31

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	156061	156061	156061
5°	153538	155543	155989
10°	154863	154422	155088
15°	152156	152376	152836
20°	148621	150972	150274
25°	147974	147974	148953
30°	143849	144874	145130
35°	139359	140713	138275
40°	132822	135417	134270
45°	125703	128528	124448
50°	110706	120358	110016
55°	89663	110136	90050
60°	65612	91336	64281
65°	39863	65046	38813
70°	15545	35010	14924
75°	1715	9432	1715
80°	1278	1278	1278
85°	0	0	0

TEST NUMBER: P#
 CATALOG NUMBER: FLDSQ4C35D010 FEU4C359040 F4LC-CSSQ-MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	152.7	4.4
10°-20°	432.0	12.5
20°-30°	641.0	18.6
30°-40°	742.7	21.5
40°-50°	712.1	20.6
50°-60°	523.6	15.2
60°-70°	226.1	6.5
70°-80°	24.4	0.7
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1225.7	35.5
0°-40°	1968.4	57.0
0°-60°	3204.1	92.7
0°-90°	3455.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3455.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1617	1617	1617	1617	1617	
5°	1585	1601	1606	1608	1610	151
15°	1523	1532	1525	1528	1530	429
25°	1390	1388	1390	1392	1399	636
35°	1183	1190	1195	1192	1174	740
45°	921	924	942	928	912	700
55°	533	588	655	586	535	480
65°	175	218	285	216	170	180
75°	5	7	25	5	5	14
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C35D010 FEU4C359040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (FULL):

	0°	5°	10°	15°	20°	22.5°	25°	30°	35°	40°	45°
0°	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4
2.5°	1605.9	1624.2	1626.6	1615.1	1610.5	1603.6	1619.6	1608.2	1612.8	1608.2	1605.9
5°	1585.2	1605.9	1608.2	1608.2	1603.6	1601.3	1608.2	1605.9	1603.6	1599.0	1605.9
7.5°	1576.1	1587.5	1599.0	1585.2	1592.1	1589.8	1605.9	1599.0	1596.7	1596.7	1592.1
10°	1580.6	1578.3	1587.5	1573.7	1578.3	1573.7	1587.5	1587.5	1582.9	1578.3	1576.1
12.5°	1543.8	1562.2	1562.2	1559.9	1555.3	1548.4	1562.2	1571.5	1557.6	1557.6	1555.3
15°	1523.2	1527.8	1530.0	1530.0	1527.8	1532.4	1539.2	1530.0	1532.4	1520.8	1525.4
17.5°	1500.2	1491.0	1497.9	1493.3	1495.6	1500.2	1509.4	1509.4	1495.6	1493.3	1497.9
20°	1447.4	1474.9	1477.3	1463.5	1465.7	1465.7	1481.9	1468.1	1477.3	1465.7	1470.3
22.5°	1422.1	1440.4	1442.8	1424.4	1435.8	1422.1	1438.2	1417.5	1440.4	1424.4	1431.2
25°	1389.9	1387.6	1394.5	1385.3	1387.6	1387.6	1399.1	1389.9	1396.8	1387.6	1389.9
27.5°	1337.1	1355.5	1353.2	1344.0	1348.6	1346.3	1369.3	1344.0	1357.7	1346.3	1350.9
30°	1291.1	1307.2	1302.6	1293.4	1293.4	1286.5	1311.8	1304.9	1302.6	1302.6	1300.3
32.5°	1245.2	1247.5	1242.9	1245.2	1247.5	1238.3	1259.0	1249.8	1247.5	1249.8	1252.1
35°	1183.1	1183.1	1187.7	1180.9	1190.1	1190.1	1208.4	1196.9	1194.6	1187.7	1194.6
37.5°	1128.0	1121.2	1123.4	1123.4	1128.0	1132.6	1141.8	1137.2	1137.2	1130.3	1134.9
40°	1054.5	1049.9	1056.8	1056.8	1063.7	1063.7	1072.9	1068.3	1075.1	1075.1	1075.1
42.5°	990.2	990.2	985.6	992.5	994.8	992.5	1008.6	1006.2	1008.6	1004.0	1006.2
45°	921.2	921.2	916.6	914.4	925.8	923.6	941.9	935.0	944.2	939.6	941.9
47.5°	827.0	838.6	831.6	838.6	852.3	854.7	866.1	861.5	870.7	863.9	873.0
50°	737.5	737.5	744.3	753.5	767.3	769.7	783.4	792.6	797.2	799.5	801.8
52.5°	643.3	641.0	647.9	659.3	670.9	680.0	693.8	707.6	716.8	730.6	723.6
55°	533.0	537.6	544.5	558.3	576.7	588.1	599.6	618.0	634.1	641.0	654.7
57.5°	438.8	434.2	438.8	457.1	477.9	487.0	503.2	521.5	544.5	558.3	562.9
60°	340.0	342.3	346.9	363.0	379.1	392.8	399.8	429.6	450.3	464.1	473.3
62.5°	250.5	255.1	259.6	273.4	289.5	301.0	312.4	337.7	356.1	369.9	379.1
65°	174.6	176.9	183.8	190.7	206.8	218.2	227.4	248.1	266.5	278.0	284.9
67.5°	108.0	110.2	114.8	124.1	135.5	144.7	153.9	167.7	183.8	195.3	197.6
70°	55.1	57.5	59.7	66.6	75.8	80.4	87.3	98.8	110.2	119.4	124.1
72.5°	18.4	18.4	20.7	25.3	29.9	34.5	36.7	48.3	57.5	62.1	64.3
75°	4.6	4.6	4.6	4.6	4.6	6.9	6.9	13.8	18.4	23.0	25.3
77.5°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	4.6	4.6
80°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

TEST NUMBER: P#

CATALOG NUMBER: FLDSQ4C35D010 FEU4C359040 F4LC-CSSQ-MW

CANDELA DISTRIBUTION (continued):

	50°	55°	60°	65°	67.5°	70°	75°	80°	85°	90°
0°	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4	1617.4
2.5°	1617.4	1612.8	1610.5	1612.8	1612.8	1610.5	1617.4	1626.6	1638.0	1608.2
5°	1615.1	1610.5	1615.1	1601.3	1608.2	1603.6	1612.8	1610.5	1619.6	1610.5
7.5°	1608.2	1599.0	1601.3	1594.4	1603.6	1592.1	1599.0	1612.8	1603.6	1589.8
10°	1585.2	1580.6	1596.7	1573.7	1569.1	1578.3	1596.7	1582.9	1578.3	1582.9
12.5°	1562.2	1562.2	1569.1	1550.7	1553.0	1557.6	1566.8	1557.6	1562.2	1573.7
15°	1537.0	1532.4	1543.8	1530.0	1527.8	1523.2	1532.4	1532.4	1537.0	1530.0
17.5°	1507.1	1500.2	1500.2	1495.6	1493.3	1504.8	1509.4	1511.7	1514.0	1504.8
20°	1470.3	1468.1	1474.9	1468.1	1470.3	1472.7	1472.7	1468.1	1488.7	1463.5
22.5°	1431.2	1438.2	1429.0	1424.4	1429.0	1433.6	1433.6	1435.8	1431.2	1426.6
25°	1392.2	1396.8	1399.1	1385.3	1392.2	1385.3	1401.4	1403.7	1394.5	1399.1
27.5°	1357.7	1350.9	1348.6	1339.4	1344.0	1341.7	1344.0	1344.0	1357.7	1339.4
30°	1304.9	1298.0	1300.3	1293.4	1295.7	1293.4	1295.7	1295.7	1304.9	1302.6
32.5°	1254.4	1247.5	1249.8	1242.9	1242.9	1245.2	1240.6	1240.6	1247.5	1242.9
35°	1206.1	1190.1	1192.3	1190.1	1192.3	1183.1	1183.1	1180.9	1185.5	1173.9
37.5°	1137.2	1130.3	1128.0	1125.8	1128.0	1123.4	1128.0	1121.2	1128.0	1118.8
40°	1075.1	1070.5	1072.9	1059.1	1059.1	1061.4	1056.8	1054.5	1056.8	1066.0
42.5°	1013.2	1004.0	999.4	994.8	997.1	990.2	987.9	983.3	987.9	978.7
45°	939.6	939.6	937.3	925.8	928.2	928.2	919.0	909.8	912.0	912.0
47.5°	873.0	868.5	866.1	854.7	852.3	850.1	840.8	834.0	834.0	827.0
50°	799.5	794.9	788.0	776.5	771.9	758.1	751.3	742.1	732.9	732.9
52.5°	730.6	714.4	705.3	686.9	680.0	673.1	654.7	647.9	641.0	634.1
55°	647.9	634.1	615.7	595.0	585.8	574.3	555.9	542.2	533.0	535.3
57.5°	567.5	544.5	526.1	498.6	487.0	480.1	461.7	443.4	434.2	434.2
60°	468.7	450.3	427.3	402.0	392.8	381.4	358.3	346.9	340.0	333.1
62.5°	374.5	360.7	340.0	307.8	301.0	289.5	273.4	259.6	252.7	252.7
65°	280.3	266.5	248.1	225.2	216.0	206.8	193.0	179.2	172.3	170.0
67.5°	197.6	181.5	165.4	147.1	140.1	135.5	121.8	112.6	108.0	105.6
70°	119.4	110.2	98.8	85.0	78.1	73.5	64.3	57.5	55.1	52.9
72.5°	62.1	55.1	45.9	36.7	32.2	27.6	23.0	18.4	16.1	16.1
75°	23.0	18.4	11.5	6.9	4.6	4.6	4.6	4.6	4.6	4.6
77.5°	4.6	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
80°	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)