

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727288

Luminaire Tested: **MRI-DRV-FLD4C-05-L930 F4LC-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727288
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-05-L930 F4LC-M-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3000K, 90 CRI
LEDS, 4LBMLI TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 614.0 lumens
Efficiency: N/A
Efficacy: 85.3 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727288

CATALOG NUMBER: MRI-DRV-FLD4C-05-L930 F4LC-M-X-LI

Luminous Intensity Polar Plot

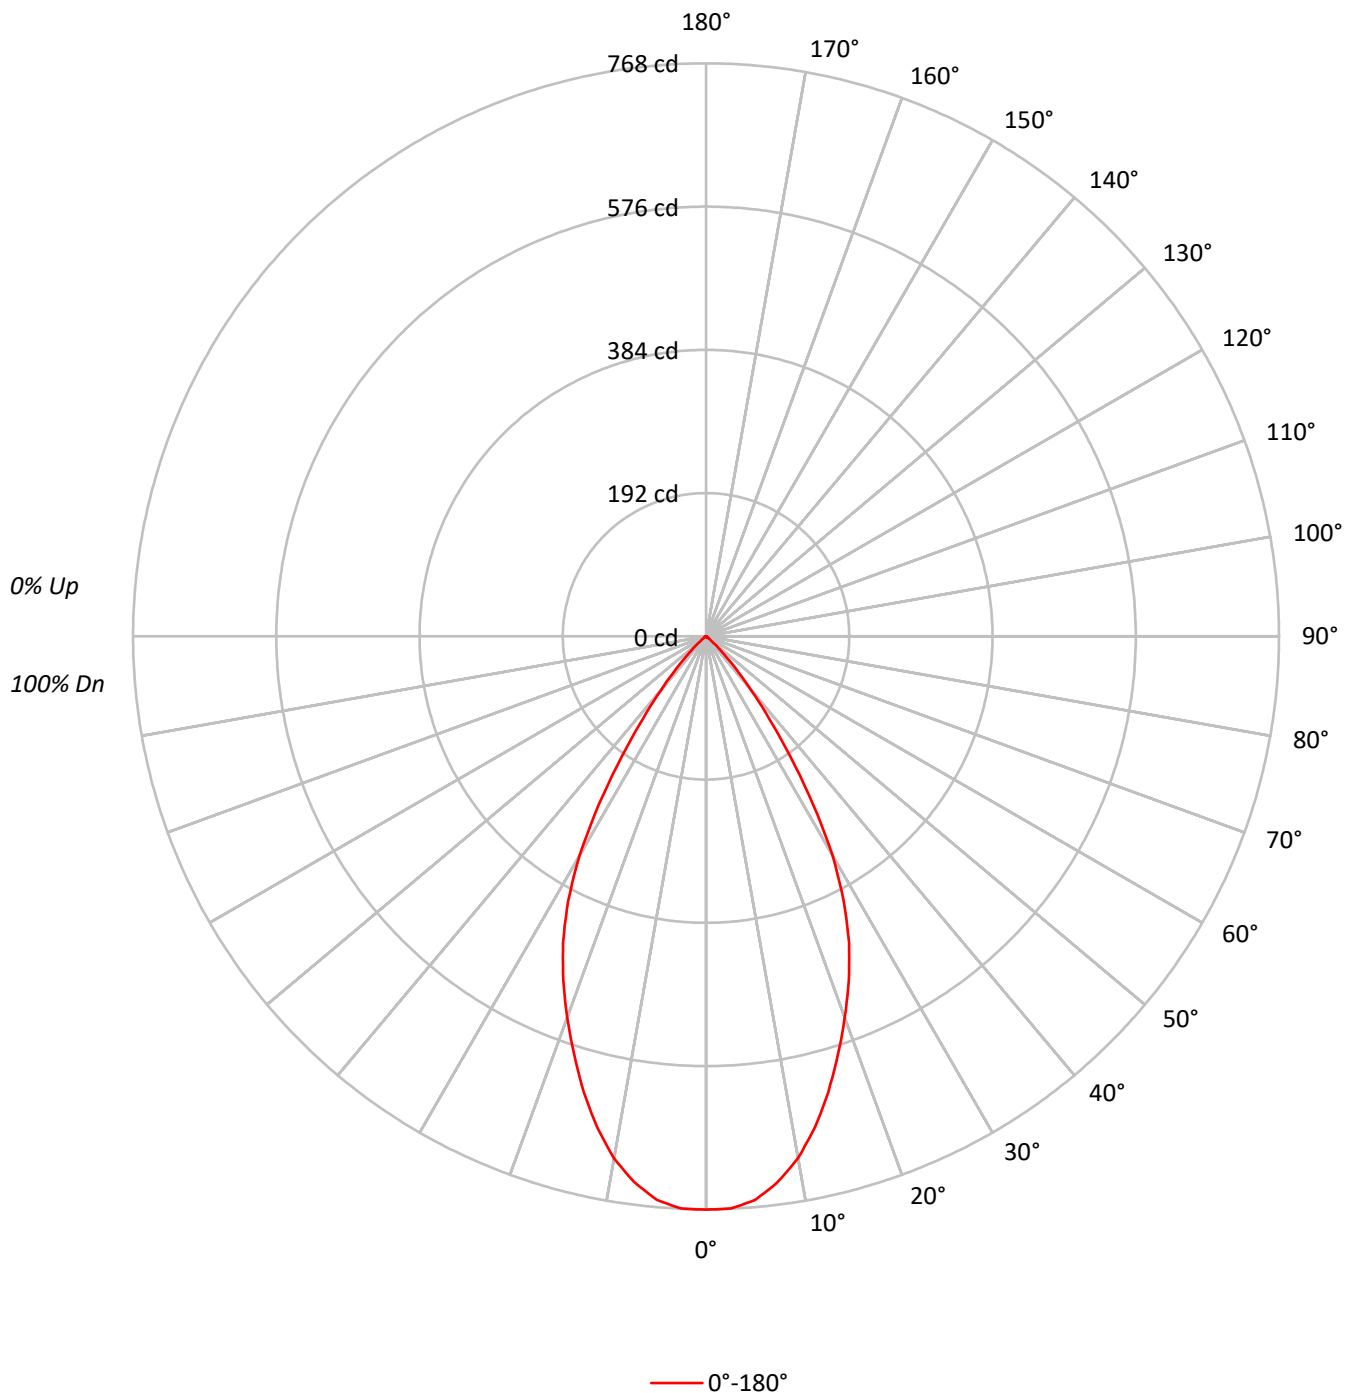



TEST NUMBER: P727288

CATALOG NUMBER: MRI-DRV-FLD4C-05-L930 F4LC-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94		
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88		
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82		
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76		
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71		
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67		
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63		
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59		
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55		
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	94401
5°	93503
10°	88597
15°	80446
20°	71082
25°	61447
30°	48033
35°	29455
40°	15123
45°	6011
50°	1949
55°	664
60°	565
65°	465
70°	287
75°	380
80°	0
85°	0

TEST NUMBER: P727288

CATALOG NUMBER: MRI-DRV-FLD4C-05-L930 F4LC-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	70.8	11.5
10°-20°	176.2	28.7
20°-30°	204.9	33.4
30°-40°	125.4	20.4
40°-50°	31.1	5.1
50°-60°	3.6	0.6
60°-70°	1.4	0.2
70°-80°	0.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	451.9	73.6
0°-40°	577.3	94.0
0°-60°	612.1	99.7
0°-90°	614.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	614.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	768	
5°	758	71
15°	632	176
25°	453	205
35°	196	125
45°	35	31
55°	3	4
65°	2	1
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P727288

CATALOG NUMBER: MRI-DRV-FLD4C-05-L930 F4LC-M-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	768.4
2.5°	767.6
5°	758.2
7.5°	737.7
10°	710.2
12.5°	674.1
15°	632.5
17.5°	587.7
20°	543.7
22.5°	499.7
25°	453.3
27.5°	399.9
30°	338.6
32.5°	267.1
35°	196.4
37.5°	138.3
40°	94.3
42.5°	58.9
45°	34.6
47.5°	19.6
50°	10.2
52.5°	4.7
55°	3.1
57.5°	2.3
60°	2.3
62.5°	1.6
65°	1.6
67.5°	0.8
70°	0.8
72.5°	0.8
75°	0.8
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)