

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727324

Luminaire Tested: **MRI-DRV-FLD4C-05-L935 F4LC-M-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727324
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205108)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-05-L935 F4LC-M-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 4LBMLI TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 622.0 lumens
Efficiency: N/A
Efficacy: 86.4 lumens/watt
Spacing Criteria (0/90/45): 0.85 / 0.85 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727324

CATALOG NUMBER: MRI-DRV-FLD4C-05-L935 F4LC-M-X-LI

Luminous Intensity Polar Plot

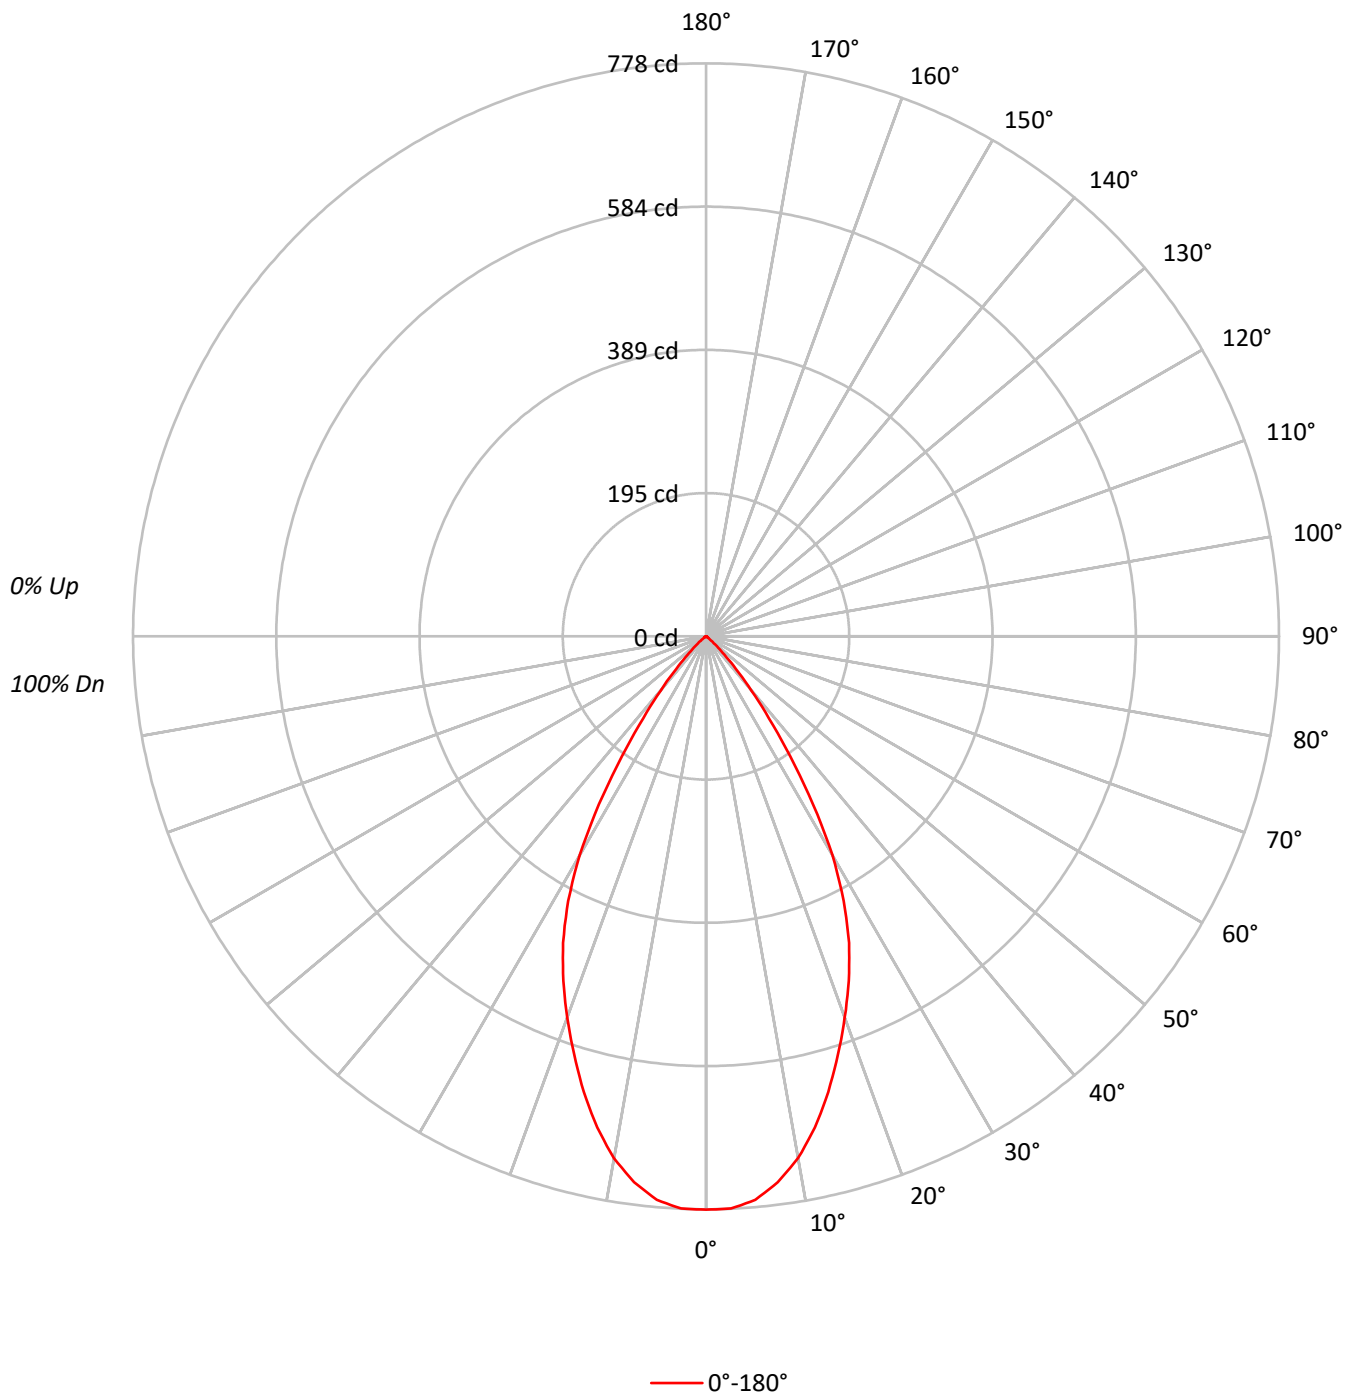



TEST NUMBER: P727324

CATALOG NUMBER: MRI-DRV-FLD4C-05-L935 F4LC-M-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	109	106	111	109	107	105	105	103	101	101	100	98	98	97	96	94		
2	108	103	100	96	106	102	98	95	99	96	93	96	93	91	93	91	89	88		
3	103	97	92	88	101	95	91	87	93	89	86	90	87	85	88	85	83	82		
4	98	91	85	81	96	89	84	81	87	83	80	85	82	79	83	80	78	76		
5	93	85	79	75	91	84	79	75	82	78	74	81	77	73	79	76	73	71		
6	89	80	74	70	87	79	74	70	78	73	69	76	72	69	75	71	68	67		
7	84	75	69	65	83	75	69	65	73	68	65	72	68	64	71	67	64	63		
8	80	71	65	61	79	70	65	61	69	64	61	68	64	60	67	63	60	59		
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55		
10	73	64	58	54	72	63	58	54	62	57	54	62	57	54	61	57	54	52		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	95629
5°	94724
10°	89757
15°	81489
20°	72010
25°	62260
30°	48658
35°	29845
40°	15316
45°	6081
50°	1969
55°	685
60°	590
65°	465
70°	287
75°	380
80°	0
85°	0



TEST NUMBER: P727324

CATALOG NUMBER: MRI-DRV-FLD4C-05-L935 F4LC-M-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	71.7	11.5
10°-20°	178.5	28.7
20°-30°	207.5	33.4
30°-40°	127.1	20.4
40°-50°	31.6	5.1
50°-60°	3.7	0.6
60°-70°	1.4	0.2
70°-80°	0.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	457.8	73.6
0°-40°	584.9	94.0
0°-60°	620.1	99.7
0°-90°	622.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	622.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	778	
5°	768	72
15°	641	179
25°	459	208
35°	199	127
45°	35	32
55°	3	4
65°	2	1
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P727324

CATALOG NUMBER: MRI-DRV-FLD4C-05-L935 F4LC-M-X-LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	778.4
2.5°	777.6
5°	768.1
7.5°	747.4
10°	719.5
12.5°	682.9
15°	640.7
17.5°	595.3
20°	550.8
22.5°	506.2
25°	459.3
27.5°	405.1
30°	343.0
32.5°	270.6
35°	199.0
37.5°	140.1
40°	95.5
42.5°	59.7
45°	35.0
47.5°	19.9
50°	10.3
52.5°	4.8
55°	3.2
57.5°	2.4
60°	2.4
62.5°	1.6
65°	1.6
67.5°	0.8
70°	0.8
72.5°	0.8
75°	0.8
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)