

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727348

Luminaire Tested: **MRI-DRV-FLD4C-05-L935 F4LC-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727348
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208077)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-05-L935 F4LC-W-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 4LBWLI TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 657.0 lumens
Efficiency: N/A
Efficacy: 91.3 lumens/watt
Spacing Criteria (0/90/45): 1.29 / 1.29 / 1.18
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727348

CATALOG NUMBER: MRI-DRV-FLD4C-05-L935 F4LC-W-X-LI

Luminous Intensity Polar Plot

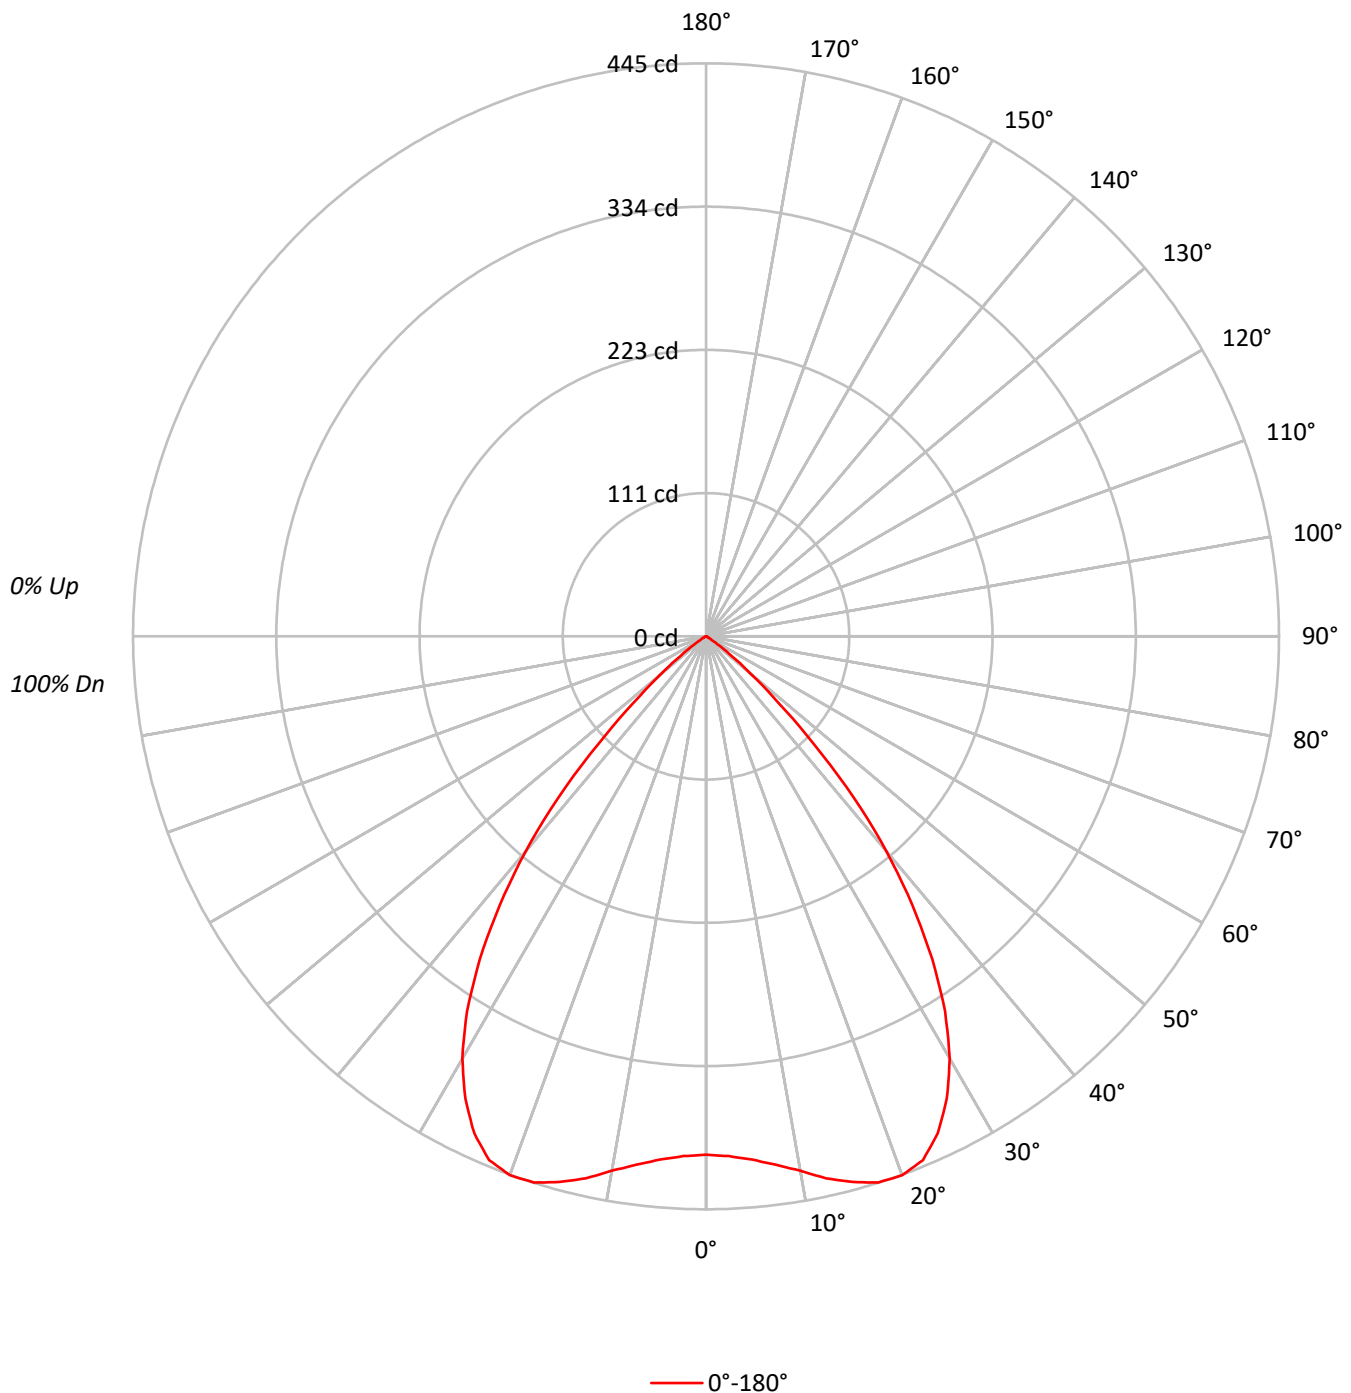



TEST NUMBER: P727348

CATALOG NUMBER: MRI-DRV-FLD4C-05-L935 F4LC-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	105	110	108	105	103	104	102	100		100	98	97		96
2	106	101	97	93	104	99	95	92	96	93	90		93	90	88		90
3	100	93	87	83	98	92	86	82	89	85	81		86	83	80		84
4	94	86	79	75	92	84	79	74	82	77	73		80	76	72		78
5	88	79	72	68	87	78	72	67	76	71	67		74	70	66		73
6	83	73	66	62	82	72	66	61	71	65	61		69	64	60		68
7	78	68	61	56	77	67	61	56	66	60	56		64	59	55		63
8	74	63	56	52	72	62	56	51	61	55	51		60	55	51		59
9	69	59	52	48	68	58	52	47	57	51	47		56	51	47		55
10	66	55	48	44	65	54	48	44	53	48	44		53	47	44		52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	49449
5°	50291
10°	52569
15°	55797
20°	58231
25°	57732
30°	53694
35°	45923
40°	34994
45°	20519
50°	8773
55°	2592
60°	737
65°	436
70°	287
75°	380
80°	0
85°	0



TEST NUMBER: P727348

CATALOG NUMBER: MRI-DRV-FLD4C-05-L935 F4LC-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	39.4	6.0
10°-20°	124.2	18.9
20°-30°	193.8	29.5
30°-40°	188.6	28.7
40°-50°	94.2	14.3
50°-60°	14.6	2.2
60°-70°	1.8	0.3
70°-80°	0.5	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	357.4	54.4
0°-40°	546.0	83.1
0°-60°	654.7	99.7
0°-90°	657.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	657.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	402	
5°	408	39
15°	439	124
25°	426	194
35°	306	189
45°	118	94
55°	12	15
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P727348

CATALOG NUMBER: MRI-DRV-FLD4C-05-L935 F4LC-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	402.5
2.5°	404.0
5°	407.8
7.5°	413.8
10°	421.4
12.5°	431.1
15°	438.7
17.5°	444.7
20°	445.4
22.5°	440.2
25°	425.9
27.5°	404.8
30°	378.5
32.5°	345.4
35°	306.2
37.5°	263.3
40°	218.2
42.5°	170.1
45°	118.1
47.5°	76.0
50°	45.9
52.5°	24.8
55°	12.1
57.5°	5.3
60°	3.0
62.5°	2.3
65°	1.5
67.5°	1.5
70°	0.8
72.5°	0.8
75°	0.8
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)