

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727366

Luminaire Tested: **MRI-DRV-FLD4C-05-L940 F4LC-N-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727366
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207666)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-05-L940 F4LC-N-X-H
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 4000K, 90 CRI
LEDS, 4LBNH TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 415.1 lumens
Efficiency: N/A
Efficacy: 57.6 lumens/watt
Spacing Criteria (0/90/45): 0.81 / 0.81 / 0.85
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727366

CATALOG NUMBER: MRI-DRV-FLD4C-05-L940 F4LC-N-X-H

Luminous Intensity Polar Plot

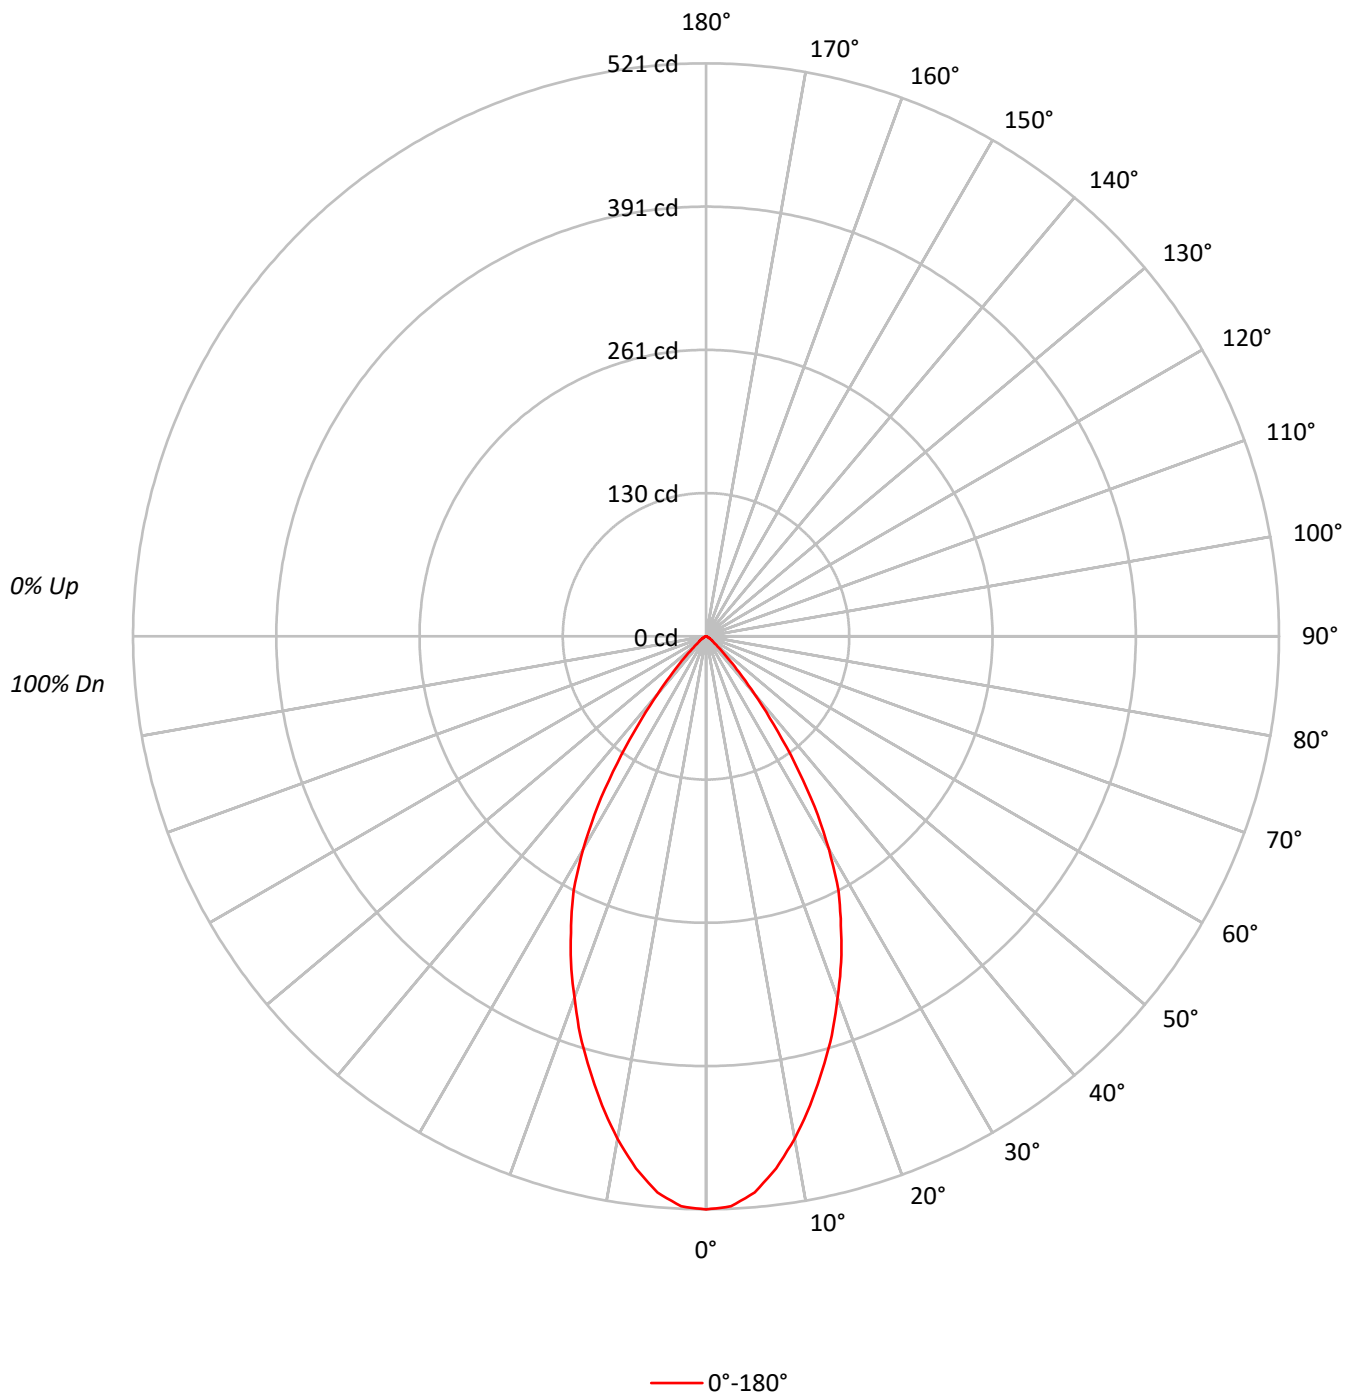



TEST NUMBER: P727366

CATALOG NUMBER: MRI-DRV-FLD4C-05-L940 F4LC-N-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	93		
2	108	103	99	96	106	101	98	94	98	95	92	95	93	90	92	90	89	87		
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81		
4	97	90	84	80	95	89	83	79	86	82	78	84	81	78	83	79	77	75		
5	92	84	78	74	91	83	78	73	81	76	73	80	75	72	78	74	72	70		
6	88	79	73	69	86	78	72	68	76	72	68	75	71	67	74	70	67	65		
7	83	74	68	64	82	73	68	64	72	67	63	71	66	63	70	66	63	61		
8	79	70	64	60	78	69	64	60	68	63	59	67	63	59	66	62	59	58		
9	76	66	60	56	74	65	60	56	65	59	56	64	59	56	63	59	55	54		
10	72	62	57	53	71	62	56	53	61	56	53	60	56	52	60	55	52	51		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	64019
5°	62586
10°	57871
15°	51931
20°	45706
25°	39338
30°	31677
35°	21087
40°	10970
45°	4969
50°	2160
55°	1456
60°	934
65°	669
70°	539
75°	380
80°	0
85°	0



TEST NUMBER: P727366

CATALOG NUMBER: MRI-DRV-FLD4C-05-L940 F4LC-N-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	47.0	11.3
10°-20°	114.0	27.5
20°-30°	132.4	31.9
30°-40°	87.7	21.1
40°-50°	24.6	5.9
50°-60°	6.2	1.5
60°-70°	2.3	0.6
70°-80°	0.8	0.2
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	293.4	70.7
0°-40°	381.1	91.8
0°-60°	411.9	99.2
0°-90°	415.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	415.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	521	
5°	508	47
15°	408	114
25°	290	132
35°	141	88
45°	29	25
55°	7	6
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P727366

CATALOG NUMBER: MRI-DRV-FLD4C-05-L940 F4LC-N-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	521.1
2.5°	518.8
5°	507.5
7.5°	487.9
10°	463.9
12.5°	436.8
15°	408.3
17.5°	380.4
20°	349.6
22.5°	321.0
25°	290.2
27.5°	260.9
30°	223.3
32.5°	183.5
35°	140.6
37.5°	100.8
40°	68.4
42.5°	44.3
45°	28.6
47.5°	17.3
50°	11.3
52.5°	8.3
55°	6.8
57.5°	5.3
60°	3.8
62.5°	3.0
65°	2.3
67.5°	1.5
70°	1.5
72.5°	0.8
75°	0.8
77.5°	0.8
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)