

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727372

Luminaire Tested: **MRI-DRV-FLD4C-05-L940 F4LC-N-X-LI**

Issue Date: 08/03/2023

Test Information

Test Method: LM-79-08
Report Number: P727372
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P208279)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-05-L940 F4LC-N-X-LI
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 4000K, 90 CRI
LEDS, 4LBNLI TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 489.0 lumens
Efficiency: N/A
Efficacy: 67.9 lumens/watt
Spacing Criteria (0/90/45): 0.48 / 0.48 / 0.54
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727372

CATALOG NUMBER: MRI-DRV-FLD4C-05-L940 F4LC-N-X-LI

Luminous Intensity Polar Plot

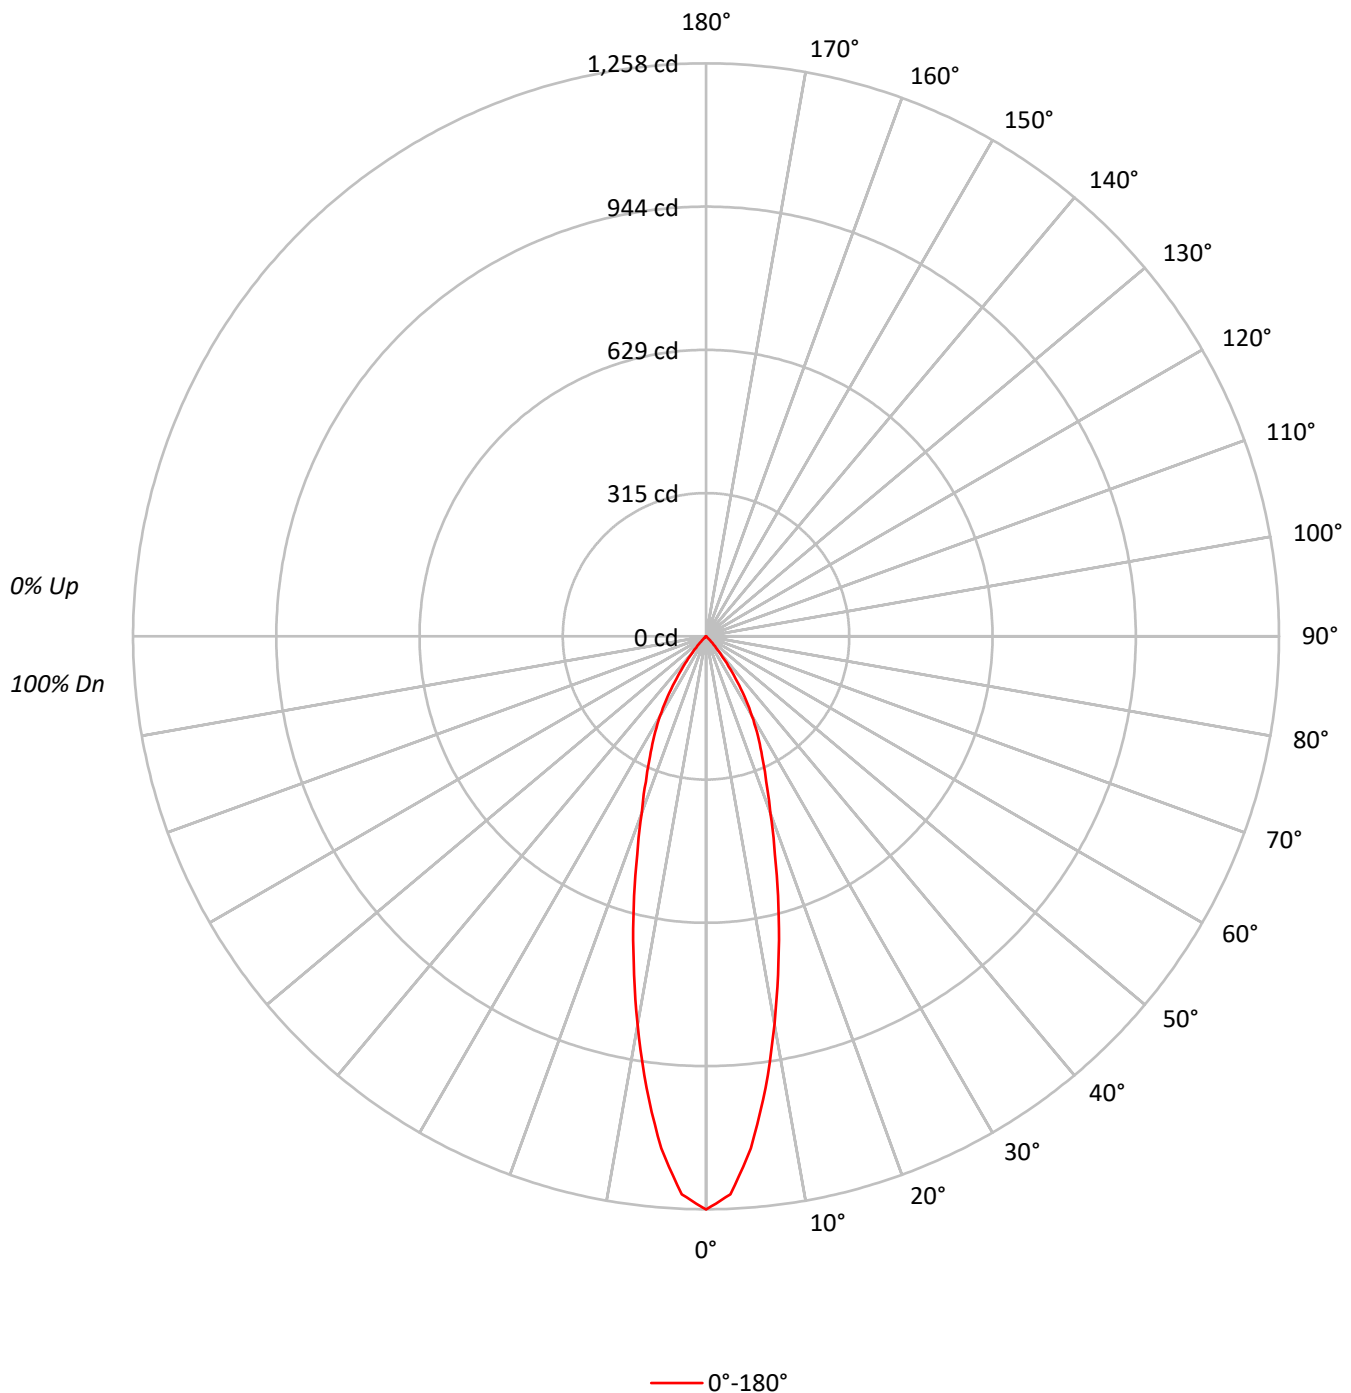



TEST NUMBER: P727372

CATALOG NUMBER: MRI-DRV-FLD4C-05-L940 F4LC-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	99	99
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95	94	93
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	92	90	89	88
3	105	99	95	92	103	98	94	91	95	92	89	93	90	88	91	89	87	85	84	83
4	101	94	89	86	99	93	88	85	91	87	84	89	86	83	87	84	82	81	80	79
5	96	89	84	80	95	88	84	80	87	82	79	85	81	79	83	80	78	77	76	75
6	92	85	80	76	91	84	79	76	83	78	75	81	78	75	80	77	74	73	72	71
7	89	81	76	72	88	80	75	72	79	75	71	78	74	71	77	73	71	69	68	67
8	85	77	72	68	84	77	72	68	76	71	68	75	71	68	74	70	67	66	65	64
9	82	74	69	65	81	73	68	65	72	68	65	72	68	65	71	67	64	63	62	61
10	79	71	66	62	78	70	65	62	69	65	62	69	65	62	68	64	62	61	60	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	154599
5°	139120
10°	107845
15°	78068
20°	54047
25°	39405
30°	28627
35°	16947
40°	7121
45°	2224
50°	287
55°	171
60°	197
65°	233
70°	0
75°	0
80°	0
85°	0

TEST NUMBER: P727372

CATALOG NUMBER: MRI-DRV-FLD4C-05-L940 F4LC-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	99.2	20.3
10°-20°	169.8	34.7
20°-30°	134.9	27.6
30°-40°	71.4	14.6
40°-50°	12.3	2.5
50°-60°	0.9	0.2
60°-70°	0.5	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	403.9	82.6
0°-40°	475.3	97.2
0°-60°	488.6	99.9
0°-90°	489.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	489.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1258	
5°	1128	99
15°	614	170
25°	291	135
35°	113	71
45°	13	12
55°	1	1
65°	1	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P727372

CATALOG NUMBER: MRI-DRV-FLD4C-05-L940 F4LC-N-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	1258.4
2.5°	1226.0
5°	1128.1
7.5°	1000.1
10°	864.5
12.5°	733.5
15°	613.8
17.5°	502.3
20°	413.4
22.5°	345.7
25°	290.7
27.5°	246.3
30°	201.8
32.5°	156.6
35°	113.0
37.5°	74.6
40°	44.4
42.5°	25.6
45°	12.8
47.5°	4.5
50°	1.5
52.5°	1.5
55°	0.8
57.5°	0.8
60°	0.8
62.5°	0.8
65°	0.8
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)