

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P727390

Luminaire Tested: **MRI-DRV-FLD4C-05-L950 F4LC-M-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P727390
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P207151)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD4C-05-L950 F4LC-M-X-H
Description: 4 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 5000K, 90 CRI
LEDS, 4LBMH TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 510.0 lumens
Efficiency: N/A
Efficacy: 70.8 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.93
Luminous Opening: Circular (Dia: 0.33' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P727390

CATALOG NUMBER: MRI-DRV-FLD4C-05-L950 F4LC-M-X-H

Luminous Intensity Polar Plot

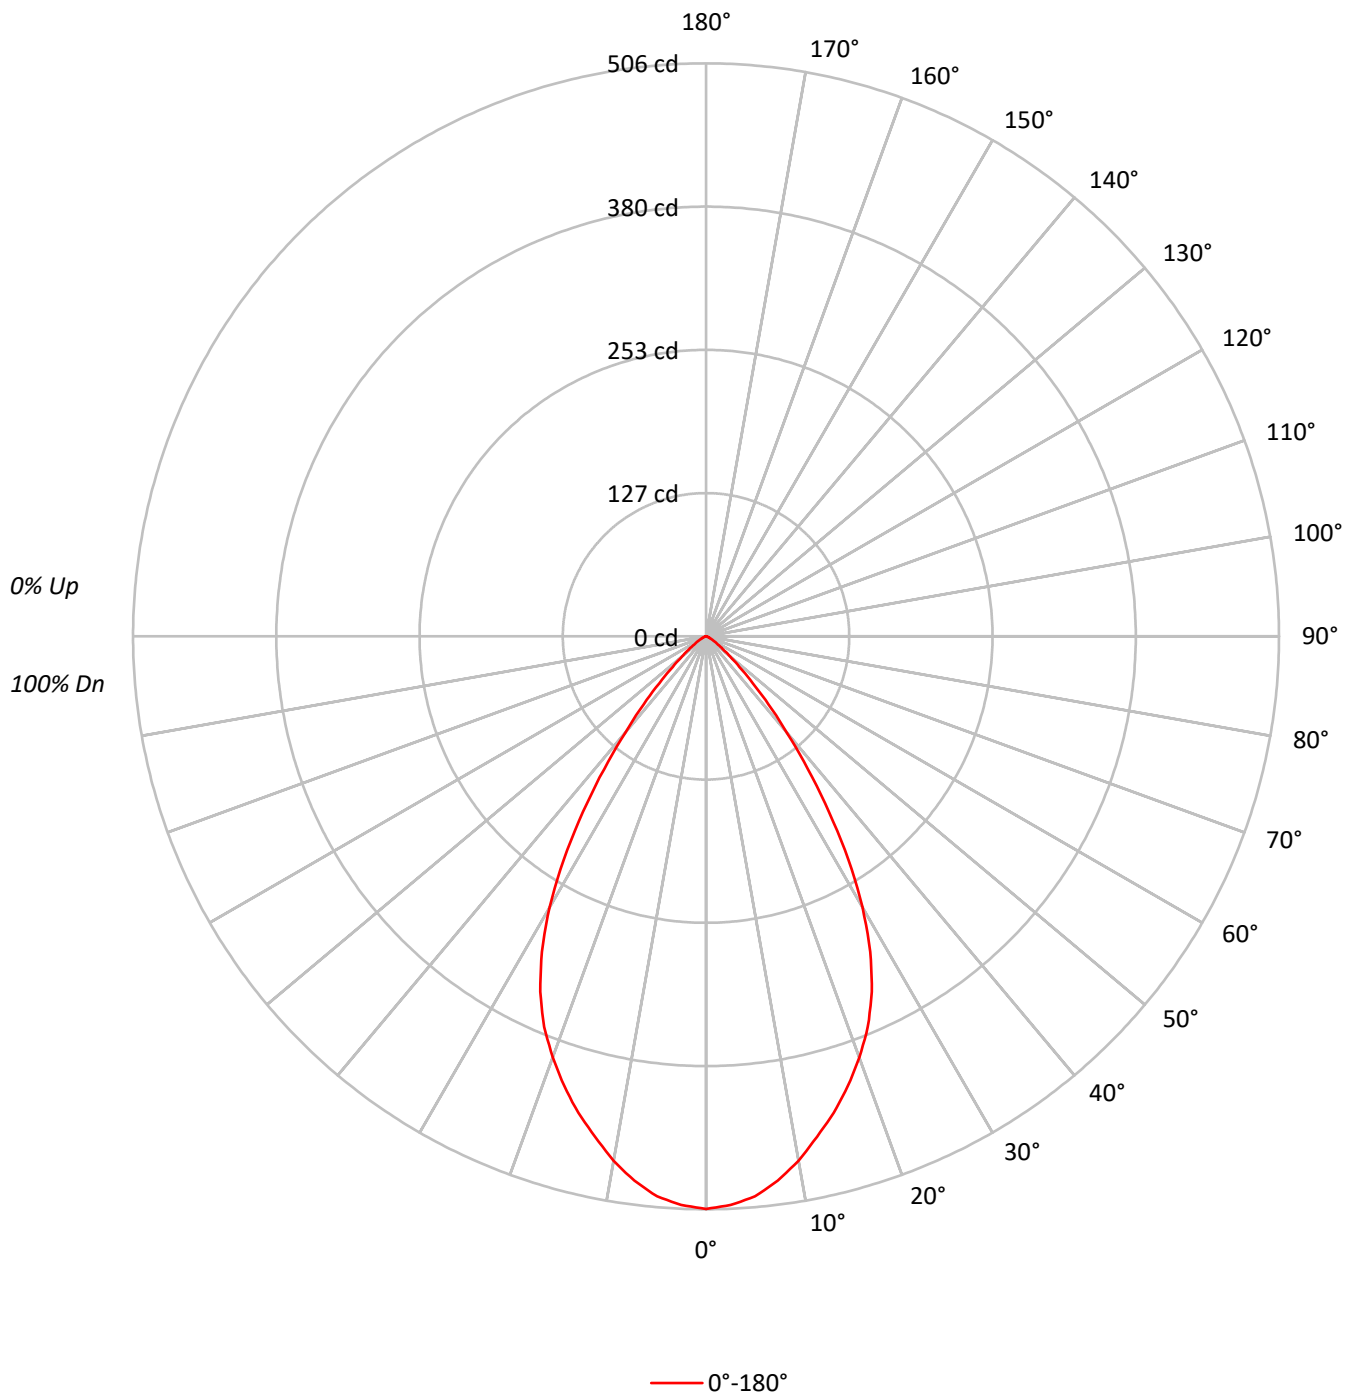



TEST NUMBER: P727390

CATALOG NUMBER: MRI-DRV-FLD4C-05-L950 F4LC-M-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	108	105	111	108	106	104	104	102	100		100	99	97		97
2	107	102	98	94	105	100	96	93	97	94	91		94	91	89		91
3	101	94	89	85	99	93	88	84	90	86	83		88	84	82		86
4	96	88	82	77	94	86	81	77	84	80	76		82	78	75		80
5	90	82	75	71	89	81	75	70	79	74	70		77	73	69		75
6	86	76	70	65	84	75	69	65	74	68	64		72	68	64		71
7	81	71	65	60	80	70	64	60	69	64	60		68	63	59		67
8	77	67	60	56	75	66	60	56	65	59	56		64	59	55		63
9	73	63	56	52	72	62	56	52	61	56	52		60	55	52		59
10	69	59	53	49	68	59	53	49	58	52	49		57	52	48		56

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	62127
5°	61230
10°	58669
15°	55415
20°	51720
25°	46956
30°	39196
35°	28406
40°	17769
45°	10164
50°	5294
55°	2977
60°	1892
65°	1134
70°	826
75°	380
80°	566
85°	0



TEST NUMBER: P727390

CATALOG NUMBER: MRI-DRV-FLD4C-05-L950 F4LC-M-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	46.5	9.1
10°-20°	122.1	23.9
20°-30°	156.9	30.8
30°-40°	118.0	23.1
40°-50°	47.4	9.3
50°-60°	13.5	2.6
60°-70°	4.3	0.8
70°-80°	1.2	0.2
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	325.5	63.8
0°-40°	443.5	87.0
0°-60°	504.4	98.9
0°-90°	510.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	510.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	506	
5°	496	47
15°	436	122
25°	346	157
35°	189	118
45°	58	47
55°	14	13
65°	4	4
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P727390

CATALOG NUMBER: MRI-DRV-FLD4C-05-L950 F4LC-M-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	505.7
2.5°	502.6
5°	496.5
7.5°	484.9
10°	470.3
12.5°	452.6
15°	435.7
17.5°	416.4
20°	395.6
22.5°	373.3
25°	346.4
27.5°	314.0
30°	276.3
32.5°	234.0
35°	189.4
37.5°	147.8
40°	110.8
42.5°	81.6
45°	58.5
47.5°	40.0
50°	27.7
52.5°	19.3
55°	13.9
57.5°	10.0
60°	7.7
62.5°	5.4
65°	3.9
67.5°	3.1
70°	2.3
72.5°	1.5
75°	0.8
77.5°	0.8
80°	0.8
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)