

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204313

Luminaire Tested: **MRI-DRV-FLD6C-25-L935 F6LC-N-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P204313
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205310)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-25-L935 F6LC-N-X-LI
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 6LBNLI TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2062.0 lumens
Efficiency: N/A
Efficacy: 65.5 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.58
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 31.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P204313

CATALOG NUMBER: MRI-DRV-FLD6C-25-L935 F6LC-N-X-LI

Luminous Intensity Polar Plot

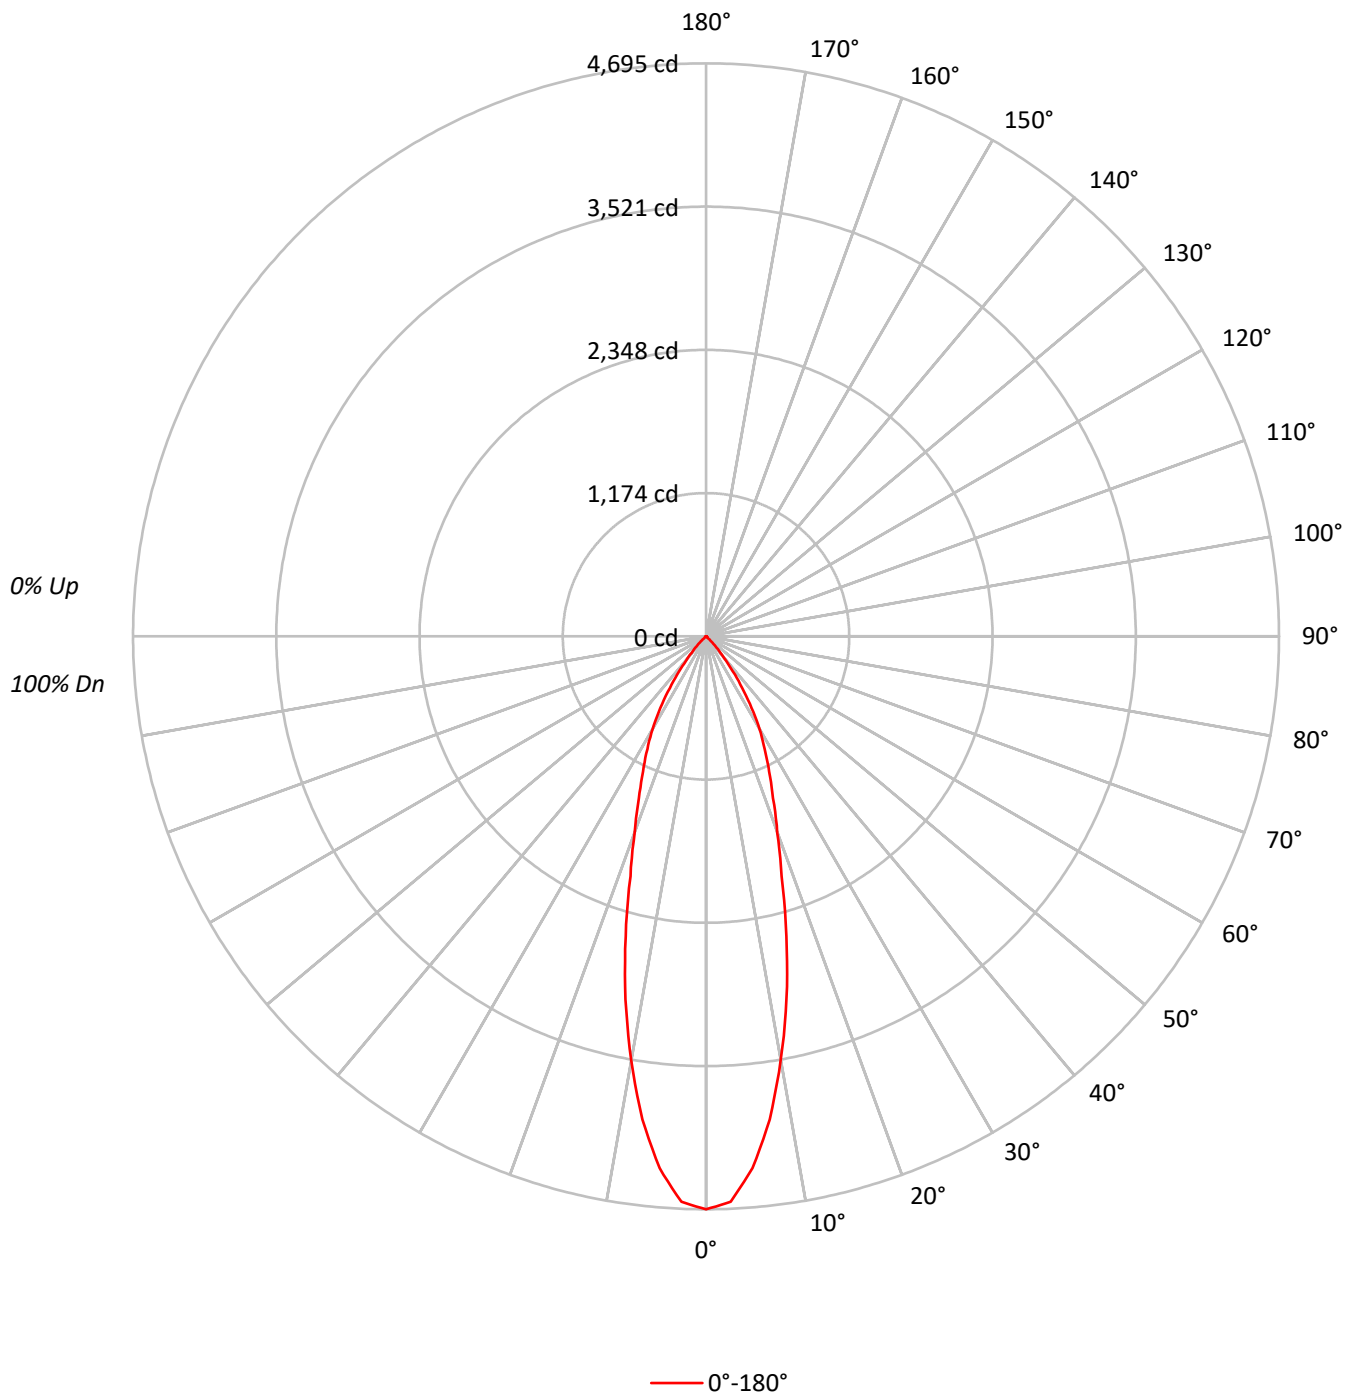



TEST NUMBER: P204313

CATALOG NUMBER: MRI-DRV-FLD6C-25-L935 F6LC-N-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	102	102	100
1	114	112	109	107	112	109	107	106	105	104	102	102	101	99	98	97	96	96	96	95
2	109	105	101	98	107	103	100	97	100	97	95	97	95	93	94	93	91	91	91	89
3	105	99	94	91	103	97	93	90	95	91	89	93	90	87	90	88	86	86	86	85
4	100	93	88	85	98	92	88	84	90	86	83	88	85	82	86	84	81	81	81	80
5	96	88	83	79	94	87	83	79	86	82	78	84	81	78	83	80	77	77	77	76
6	92	84	79	75	90	83	78	75	82	77	74	80	76	74	79	76	73	73	73	72
7	88	80	74	71	87	79	74	71	78	73	70	77	73	70	76	72	69	69	69	68
8	84	76	71	67	83	75	70	67	74	70	67	73	69	66	73	69	66	66	66	65
9	81	73	67	64	80	72	67	64	71	67	63	70	66	63	70	66	63	63	63	62
10	78	69	64	61	77	69	64	61	68	64	61	67	63	60	67	63	60	60	60	59

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	257364
5°	240677
10°	196295
15°	144445
20°	99560
25°	73916
30°	55521
35°	34619
40°	16803
45°	5768
50°	759
55°	573
60°	329
65°	389
70°	481
75°	0
80°	0
85°	0

TEST NUMBER: P204313

CATALOG NUMBER: MRI-DRV-FLD6C-25-L935 F6LC-N-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	390.3	18.9
10°-20°	700.6	34.0
20°-30°	566.5	27.5
30°-40°	326.3	15.8
40°-50°	69.0	3.3
50°-60°	6.0	0.3
60°-70°	3.0	0.1
70°-80°	0.4	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1657.4	80.4
0°-40°	1983.7	96.2
0°-60°	2058.7	99.8
0°-90°	2062.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2062.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4695	
5°	4374	390
15°	2545	701
25°	1222	566
35°	517	326
45°	74	69
55°	6	6
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P204313

CATALOG NUMBER: MRI-DRV-FLD6C-25-L935 F6LC-N-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	4694.7
2.5°	4638.3
5°	4373.6
7.5°	3993.0
10°	3526.3
12.5°	3047.6
15°	2545.1
17.5°	2060.5
20°	1706.6
22.5°	1436.1
25°	1222.0
27.5°	1040.7
30°	877.1
32.5°	695.8
35°	517.3
37.5°	359.7
40°	234.8
42.5°	142.7
45°	74.4
47.5°	29.7
50°	8.9
52.5°	8.9
55°	6.0
57.5°	6.0
60°	3.0
62.5°	3.0
65°	3.0
67.5°	3.0
70°	3.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)