

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204803

Luminaire Tested: **MRI-DRV-FLD6C-35-L927 F6LC-W-X-H**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P204803
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P202739)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-35-L927 F6LC-W-X-H
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 2700K, 90 CRI
LEDS, 6LBWH TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3016.0 lumens
Efficiency: N/A
Efficacy: 74.7 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.16
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P204803

CATALOG NUMBER: MRI-DRV-FLD6C-35-L927 F6LC-W-X-H

Luminous Intensity Polar Plot

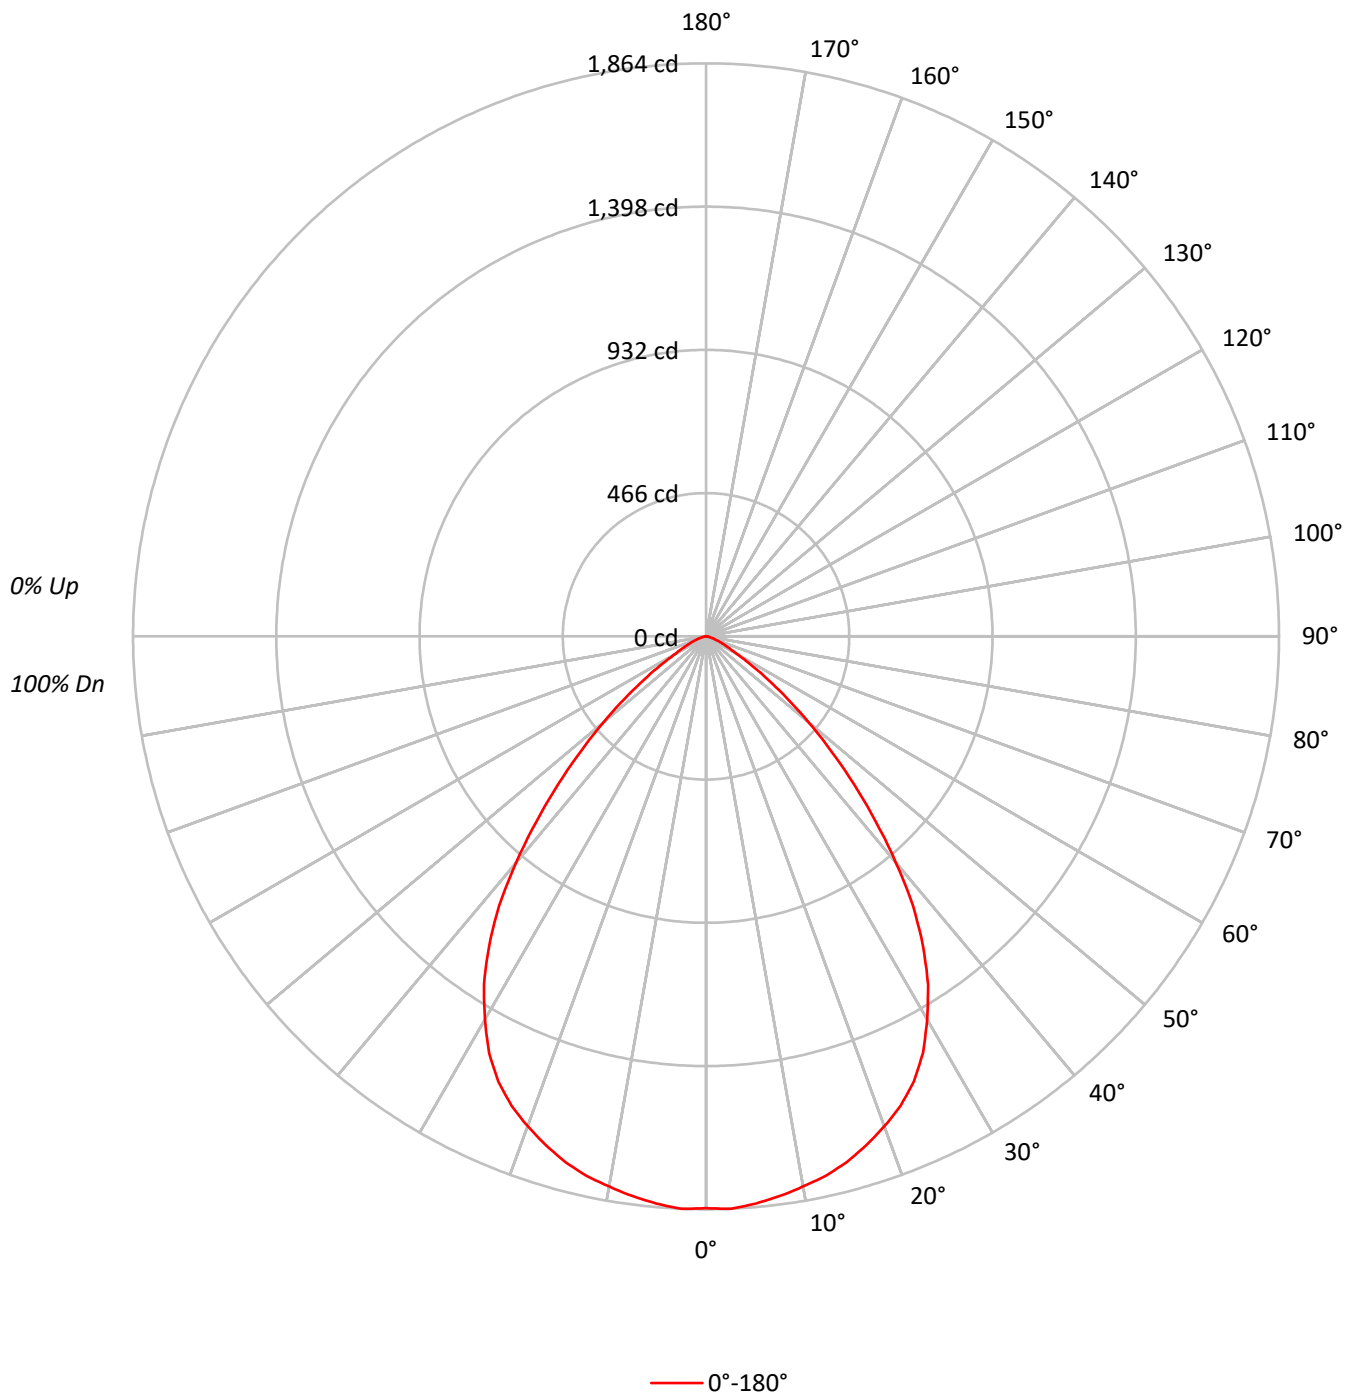



TEST NUMBER: P204803

CATALOG NUMBER: MRI-DRV-FLD6C-35-L927 F6LC-W-X-H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		0
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		100
1	112	109	106	103	110	107	104	101	103	100	98		99	97	95		91
2	105	99	94	90	103	97	93	89	94	90	87		91	88	85		81
3	98	90	84	79	96	89	83	78	86	81	77		83	79	76		73
4	92	82	75	70	90	81	75	70	79	73	69		77	72	68		65
5	86	75	68	63	84	74	68	63	72	66	62		71	65	61		59
6	80	69	62	57	78	68	61	56	67	61	56		65	60	56		53
7	75	64	56	51	73	63	56	51	62	55	51		60	55	51		49
8	70	59	52	47	69	58	51	47	57	51	46		56	50	46		44
9	66	55	48	43	65	54	47	43	53	47	43		52	47	42		41
10	62	51	44	40	61	50	44	39	50	43	39		49	43	39		38

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	101976
5°	101937
10°	101156
15°	100477
20°	98948
25°	96683
30°	91033
35°	82389
40°	68793
45°	52711
50°	37338
55°	23540
60°	13277
65°	8613
70°	5626
75°	4130
80°	2494
85°	2453



TEST NUMBER: P204803

CATALOG NUMBER: MRI-DRV-FLD6C-35-L927 F6LC-W-X-H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	175.7	5.8
10°-20°	498.5	16.5
20°-30°	731.0	24.2
30°-40°	760.7	25.2
40°-50°	526.3	17.5
50°-60°	229.2	7.6
60°-70°	70.3	2.3
70°-80°	21.1	0.7
80°-90°	3.2	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1405.2	46.6
0°-40°	2165.9	71.8
0°-60°	2921.4	96.9
0°-90°	3016.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3016.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1860	
5°	1852	176
15°	1770	499
25°	1598	731
35°	1231	761
45°	680	526
55°	246	229
65°	66	70
75°	20	21
85°	4	3
90°	0	



TEST NUMBER: P204803

CATALOG NUMBER: MRI-DRV-FLD6C-35-L927 F6LC-W-X-H

CANDELA DISTRIBUTION (FULL):

0°	
0°	1860.2
2.5°	1864.1
5°	1852.4
7.5°	1836.8
10°	1817.2
12.5°	1797.6
15°	1770.4
17.5°	1735.1
20°	1696.1
22.5°	1653.1
25°	1598.4
27.5°	1528.1
30°	1438.1
32.5°	1344.3
35°	1231.1
37.5°	1106.0
40°	961.3
42.5°	816.8
45°	679.9
47.5°	551.0
50°	437.8
52.5°	332.2
55°	246.3
57.5°	175.9
60°	121.1
62.5°	89.9
65°	66.4
67.5°	50.9
70°	35.1
72.5°	27.4
75°	19.5
77.5°	11.7
80°	7.9
82.5°	3.9
85°	3.9
87.5°	0.0
90°	0.0

(END OF REPORT)