

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

(formerly Eaton)

Brand: FAIL-SAFE

Report Number: P204933

Luminaire Tested: **MRI-DRV-FLD6C-35-L935 F6LC-W-X-LI**

Issue Date: 08/03/2023



Test Information

Test Method: LM-79-08
Report Number: P204933
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P205209)
Test Lab: INNOVATION CENTER-P3
Issue Date: 08/03/2023
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: FAIL-SAFE
Catalog Number: MRI-DRV-FLD6C-35-L935 F6LC-W-X-LI
Description: 6 INCH FAIL-SAFE MRI REMOTE DRIVER LED DOWNLIGHT WITH 3500K, 90 CRI
LEDS, 6LBWLI TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3632.0 lumens
Efficiency: N/A
Efficacy: 89.9 lumens/watt
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.18
Luminous Opening: Circular (Dia: 0.5' x H: 0')
CIE Type: Direct

Input Watts (W): 40.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT

TEST NUMBER: P204933

CATALOG NUMBER: MRI-DRV-FLD6C-35-L935 F6LC-W-X-LI

Luminous Intensity Polar Plot

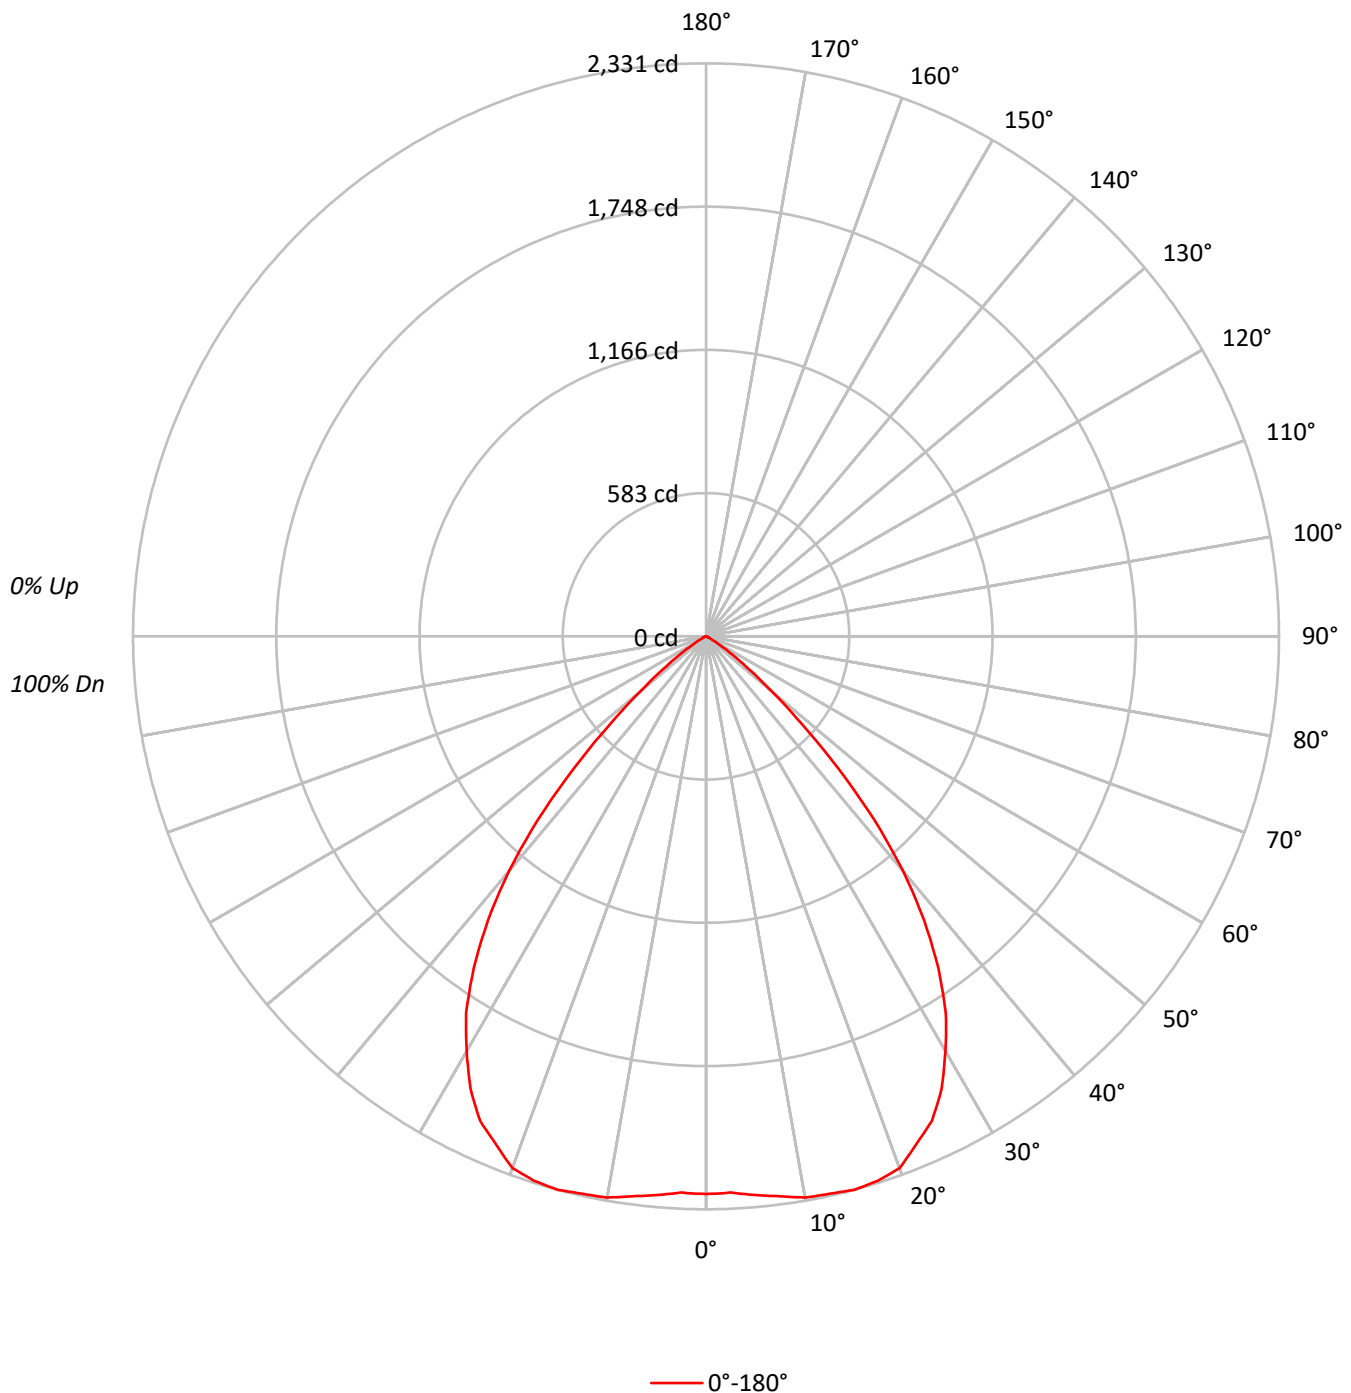



TEST NUMBER: P204933

CATALOG NUMBER: MRI-DRV-FLD6C-35-L935 F6LC-W-X-LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	113	110	107	104	110	107	105	103	103	101	99		100	98	97		96
2	106	101	96	92	104	99	95	91	95	92	89		92	90	87		90
3	100	92	87	82	97	91	86	81	88	84	80		86	82	79		83
4	93	85	78	73	92	84	78	73	81	76	72		79	75	71		77
5	88	78	71	66	86	77	71	66	75	70	65		73	69	65		72
6	82	72	65	60	81	71	65	60	70	64	59		68	63	59		67
7	77	67	60	55	76	66	59	55	65	59	54		63	58	54		62
8	73	62	55	50	71	61	55	50	60	54	50		59	54	50		58
9	69	57	51	46	67	57	50	46	56	50	46		55	50	46		54
10	65	54	47	43	64	53	47	42	52	46	42		51	46	42		51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	124387
5°	125539
10°	129050
15°	132282
20°	134289
25°	131512
30°	123297
35°	110236
40°	89289
45°	59068
50°	29858
55°	12597
60°	4057
65°	1596
70°	1330
75°	868
80°	0
85°	0



TEST NUMBER: P204933

CATALOG NUMBER: MRI-DRV-FLD6C-35-L935 F6LC-W-X-LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	218.9	6.0
10°-20°	657.9	18.1
20°-30°	991.8	27.3
30°-40°	1015.1	27.9
40°-50°	591.4	16.3
50°-60°	135.9	3.7
60°-70°	16.7	0.5
70°-80°	4.3	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1868.6	51.4
0°-40°	2883.7	79.4
0°-60°	3611.0	99.4
0°-90°	3632.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3632.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2269	
5°	2281	219
15°	2331	658
25°	2174	992
35°	1647	1015
45°	762	591
55°	132	136
65°	12	17
75°	4	4
85°	0	0
90°	0	



TEST NUMBER: P204933

CATALOG NUMBER: MRI-DRV-FLD6C-35-L935 F6LC-W-X-LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	2269.0
2.5°	2264.9
5°	2281.3
7.5°	2297.7
10°	2318.3
12.5°	2322.5
15°	2330.8
17.5°	2322.5
20°	2301.9
22.5°	2236.0
25°	2174.2
27.5°	2075.5
30°	1947.8
32.5°	1816.0
35°	1647.2
37.5°	1457.7
40°	1247.7
42.5°	1013.0
45°	761.9
47.5°	531.2
50°	350.1
52.5°	222.4
55°	131.8
57.5°	70.0
60°	37.0
62.5°	20.6
65°	12.3
67.5°	12.3
70°	8.3
72.5°	4.1
75°	4.1
77.5°	4.1
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)